

F.W. KENT PARK CAMPGROUND SITE AND UTILITY IMPROVEMENTS

JOHNSON COUNTY CONSERVATION BOARD
2048 HIGHWAY 6 NW OXFORD, IOWA 52322



SHEET INDEX

GENERAL		SITE	
A1.00	COVER SHEET	T1.00	OVERALL LANDSCAPE PLAN
SITE		T1.01	LANDSCAPE PLAN AND NOTES
A1.01	GENERAL NOTES	U1.01	DETAILS
B1.01	TYPICAL SECTIONS	U1.02	DETAILS
C1.01	OVERALL SITE PLAN - BASE BID	U1.03	DETAILS
C1.02	OVERALL SITE PLAN - BID ALT. A	U1.04	DETAILS
C1.03	OVERALL SITE PLAN - BID ALT. B	U1.05	DETAILS
D1.01	MAINLINE PLAN & PROFILE	U1.06	DETAILS
D1.02	MAINLINE PLAN & PROFILE	BUILDING	
D1.03	MAINLINE PLAN & PROFILE	V1.01	STRUCTURAL GENERAL NOTES
D1.04	MAINLINE PLAN & PROFILE	V1.02	SPECIAL INSPECTIONS
D1.05	MAINLINE PLAN & PROFILE	V1.03	SHOWER HOUSE STRUCTURAL PLANS
D1.06	MAINLINE PLAN & PROFILE	V1.04	SHOWER HOUSE STRUCTURAL SECTIONS
EC1.01	STORM WATER POLLUTION PREVENTION PLAN	V1.05	SHOWER HOUSE STRUCTURAL DETAILS
EC1.02	STORMWATER POLLUTION PREVENTION PLAN	V1.06	SHOWER HOUSE PRECAST DETAILS
F1.01	GRADING	V1.07	WOOD SHED PLANS
G1.01	SURVEY INFORMATION	W1.01	ARCHITECTURAL GENERAL INFORMATION
J1.01	PHASING PLAN	W1.02	SHOWER HOUSE PLANS
K1.01	INTERSECTION & PAVEMENT DETAILS	W1.03	SHOWER HOUSE ENLARGED PLAN AND ELEVATIONS
K1.02	INTERSECTION & PAVEMENT DETAILS	W1.04	SHOWER HOUSE PRECAST ELEVATIONS
K1.03	INTERSECTION & PAVEMENT DETAILS	W1.05	SHOWER HOUSE BUILDING SECTIONS
K1.04	INTERSECTION & PAVEMENT DETAILS	W1.06	SHOWER HOUSE BUILDING SECTIONS
K1.05	INTERSECTION & PAVEMENT DETAILS	W1.07	SHOWER HOUSE WALL SECTIONS
M1.01	SITE UTILITIES - WATER	W1.08	ROOFING DETAILS
M1.02	SITE ELECTRICAL PLAN	W1.09	SHOWER HOUSE DETAILS
M1.03	SITE ELECTRICAL DETAILS	W1.10	ROOM FINISH AND DOOR SCHEDULE
M1.04	SITE UTILITIES - STORM SEWER	W1.11	WOOD SHED PLANS AND ELEVATIONS
M1.05	SITE UTILITIES - DRAIN LINE	W1.12	WOOD SHED DETAILS
MS1.01	SEPTIC SYSTEM LEGEND, GENERAL NOTES, AND SPECS	X1.01	SHOWER HOUSE MECHANICAL PLAN
MS1.02	SEPTIC SYSTEM INDEX	X1.02	SHOWER HOUSE MECHANICAL DETAILS
MS1.03	SEPTIC SYSTEM 1, STA 10+00 TO STA 16+00	X1.03	SHOWER HOUSE MECHANICAL SCHEDULES
MS1.04	SEPTIC SYSTEM 1, STA 16+00 TO 21+25	Y1.01	SHOWER HOUSE SANITARY WASTE AND VENT PLANS
MS1.05	SEPTIC SYSTEM 1, STA 21+25 TO 27+00	Y1.02	SHOWER HOUSE DOMESTIC WATER PLUMBING PLANS
MS1.06	SEPTIC SYSTEM 2, STA 30+00 TO 35+00	Y1.03	SHOWER HOUSE PLUMBING DETAILS AND SCHEDULES
MS1.07	SEPTIC SYSTEM 2, STA 35+00 TO 37+37 AND DETAILS	Z1.01	ELECTRICAL POWER PLANS
MS1.08	SEPTIC SYSTEM FIELD DETAILS	Z1.02	ELECTRICAL LIGHTING PLANS
MS1.09	SEPTIC SYSTEM - OVERALL SITE ELECTRICAL	Z1.03	ELECTRICAL PANEL SCHEDULES, MATERIAL LIST, & DETAILS
MS1.10	SEPTIC SYSTEM 1, PUMP STATION ELECTRICAL	Z1.04	SHOWER HOUSE ELECTRICAL PV PLAN
R1.01	REMOVALS	Z1.05	SEPTIC ELECTRICAL PV PLAN
R1.02	OVERALL ELECTRICAL SITE DEMOLITION PLAN	Z1.06	SEPTIC ELECTRICAL PV DETAILS
R1.03	ENLARGED ELECTRICAL SITE DEMOLITION PLAN		
S1.01	SIDEWALK PLAN		
S1.02	SIDEWALK PLAN		

THE IOWA DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FOR HIGHWAY AND BRIDGE CONSTRUCTION, SERIES 2015, PLUS GENERAL SUPPLEMENTAL SPECIFICATIONS; AND APPLICABLE SUPPLEMENTAL SPECIFICATIONS, DEVELOPMENTAL SPECIFICATIONS, AND SPECIAL PROVISIONS, SHALL APPLY TO THE CONSTRUCTION OF THIS PROJECT.

CERTIFICATIONS

CIVIL ENGINEER

	I HEREBY CERTIFY THAT THIS ENGINEERING DOCUMENT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF IOWA.
	Signature _____ Date 08/01/2022
	Printed or typed name Barrett Hubbard
	License Number 23274
	My license renewal date is 12/31/2023
PAGES, SHEETS OR DIVISIONS COVERED BY THIS SEAL: ALL "A" SHEETS ALL "EC" SHEETS M1.01, M1.04 ALL "B" SHEETS ALL "F" SHEETS M1.05, R1.01 ALL "C" SHEETS ALL "G" SHEETS ALL "S" SHEETS ALL "D" SHEETS ALL "K" SHEETS ALL "U" SHEETS	

CIVIL ENGINEER

	I HEREBY CERTIFY THAT THIS ENGINEERING DOCUMENT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF IOWA.
	Signature _____ Date 08/01/2022
	Printed or typed name James A. Carroll
	License Number 11328
	My license renewal date is 12/31/2023
PAGES, SHEETS OR DIVISIONS COVERED BY THIS SEAL: ALL "MS" SHEETS EXCEPT MS1.09	

ELECTRICAL ENGINEER

	I HEREBY CERTIFY THAT THIS ENGINEERING DOCUMENT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF IOWA.
	Signature _____ Date 08/01/2022
	Printed or typed name Matthew K. Gordon
	License Number 19216
	My license renewal date is 12/31/2022
PAGES, SHEETS OR DIVISIONS COVERED BY THIS SEAL: M1.02, M1.03, MS1.09, R1.02, R1.03, Z1.01, Z1.02, Z1.03	

ELECTRICAL ENGINEER

	I HEREBY CERTIFY THAT THIS ENGINEERING DOCUMENT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF IOWA.
	Signature _____ Date 08/01/2022
	Printed or typed name Lon Bromolson
	License Number P25784
	My license renewal date is 12/31/2023
PAGES, SHEETS OR DIVISIONS COVERED BY THIS SEAL: Z1.04, Z1.05, Z1.06	

LANDSCAPE ARCHITECT

	I HEREBY CERTIFY THAT THE PORTION OF THIS TECHNICAL SUBMISSION DESCRIBED BELOW WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND RESPONSIBLE CHARGE. I AM A DULY LICENSED LANDSCAPE ARCHITECT UNDER THE LAWS OF THE STATE OF IOWA.
	Signature _____ Date 08/01/2022
	Printed or typed name Emily Naylor
	License Number 23274
	My license renewal date is 12/31/2023
PAGES, SHEETS OR DIVISIONS COVERED BY THIS SEAL: ALL "T" SHEETS	

STRUCTURAL ENGINEER

	I HEREBY CERTIFY THAT THIS ENGINEERING DOCUMENT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF IOWA.
	Signature _____ Date 08/01/2022
	Printed or typed name Benjamin E. Lyon
	License Number 21138
	My license renewal date is 12/31/2023
PAGES, SHEETS OR DIVISIONS COVERED BY THIS SEAL: ALL "V" SHEETS	

ARCHITECT

	I HEREBY CERTIFY THAT THE PORTION OF THIS TECHNICAL SUBMISSION DESCRIBED BELOW WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND RESPONSIBLE CHARGE. I AM A DULY REGISTERED ARCHITECT UNDER THE LAWS OF THE STATE OF IOWA.
	Signature _____ Date 08/01/2022
	Printed or typed name Richard C. Cleaveland
	Registration Expires _____ Date Issued _____
	PAGES, SHEETS OR DIVISIONS COVERED BY THIS SEAL: ALL "W" SHEETS

MECHANICAL ENGINEER

	I HEREBY CERTIFY THAT THIS ENGINEERING DOCUMENT WAS PREPARED BY ME OR UNDER MY DIRECT SUPERVISION AND THAT I AM A DULY LICENSED PROFESSIONAL ENGINEER UNDER THE LAWS OF THE STATE OF IOWA.
	Signature _____ Date 08/01/2022
	Printed or typed name Travis L. Sprenger
	License Number 24039
	My license renewal date is 12/31/2022
PAGES, SHEETS OR DIVISIONS COVERED BY THIS SEAL: ALL "X" SHEETS ALL "Y" SHEETS	

GENERAL NOTES

1. UTILITY NOTE:

A. THE LOCATIONS OF UTILITY MAINS, STRUCTURES AND SERVICE CONNECTIONS PLOTTED ON THIS DRAWING ARE APPROXIMATE ONLY AND WERE OBTAINED FROM RECORDS MADE AVAILABLE TO SHIVE-HATTERY, INC. THERE MAY BE OTHER EXISTING UTILITY MAINS, STRUCTURES AND SERVICE CONNECTIONS NOT KNOWN TO SHIVE-HATTERY, INC. AND NOT SHOWN ON THIS DRAWING. THE VERIFICATION OF EXISTENCE OF, AND THE DETERMINATION OF THE EXACT LOCATION OF, UTILITY MAINS, STRUCTURES AND SERVICE CONNECTIONS SHALL BE THE RESPONSIBILITY OF THE CONSTRUCTION CONTRACTOR(S).
2. NOTIFY UTILITY COMPANIES WHOSE FACILITIES ARE SHOWN ON THE PLANS OR KNOWN TO BE WITHIN CONSTRUCTION LIMITS OF THE SCHEDULE PRIOR TO EACH STAGE OF CONSTRUCTION.
3. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL UNCOVER EXISTING UTILITIES AT CRITICAL LOCATIONS TO VERIFY EXACT HORIZONTAL AND VERTICAL LOCATION.
4. IOWA CODE 480, UNDERGROUND FACILITIES INFORMATION, REQUIRES VERBAL NOTICE TO IOWA ONE-CALL 1-800-292-8989, NOT LESS THAN 48 HOURS BEFORE EXCAVATING, EXCLUDING WEEKENDS AND HOLIDAYS.
5. NOTIFY THE APPROPRIATE GOVERNING AUTHORITY 48 - 72 HOURS PRIOR TO BEGINNING CONSTRUCTION WITHIN PUBLIC RIGHT-OF-WAY. JOHNSON COUNTY CONSERVATION SHALL BE THE PUBLIC AGENCY RESPONSIBLE FOR INSPECTION DURING CONSTRUCTION OF THE PUBLIC PORTIONS OF THE PROJECT.
6. THE MEANS OF THE WORK AND THE SAFETY OF THE CONTRACTOR'S EMPLOYEES ARE SOLELY THE RESPONSIBILITY OF THE CONTRACTOR.
7. NO WORK SHALL BE PERFORMED BEYOND THE PROJECT LIMITS WITHOUT PRIOR AUTHORIZATION FROM THE OWNER'S REPRESENTATIVE.
8. A PRE-CONSTRUCTION MEETING SHALL BE HELD FOLLOWING ISSUANCE OF THE NOTICE TO PROCEED BUT PRIOR TO COMMENCING WORK.
9. ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH IOWA DOT STANDARD SPECIFICATIONS FOR HIGHWAY AND BRIDGE CONSTRUCTION, UNLESS OTHERWISE NOTED ON THE DRAWINGS.
10. PROVIDE TRAFFIC AND PEDESTRIAN CONTROL MEASURES (SIGNS, BARRICADES, FLAGGERS, ETC.) IN COMPLIANCE WITH PART VI OF THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) LATEST EDITION.
11. PROTECT EXISTING UTILITIES DURING CONSTRUCTION.
12. MAINTAIN POSITIVE DRAINAGE ON THE SITE THROUGHOUT THE PROJECT DURATION.
13. ADJUST ALL VALVES, MANHOLES, CASTINGS, GAS VENTS, ETC., TO MATCH THE NEW SURFACE. ADJUSTMENT SHALL BE COORDINATED WITH THE UTILITY COMPANIES AND THE COST FOR ALL ADJUSTMENTS SHALL BE INCIDENTAL TO THE CONSTRUCTION. AT NO ADDITIONAL COST TO THE OWNER, REPAIR ANY DAMAGE TO SAID STRUCTURES AND APPURTENANCES THAT OCCUR DURING CONSTRUCTION.
14. CONTRACTOR SHALL REFER TO BUILDING PLANS FOR BUILDING DIMENSIONS, STOOP SIZES AND LOCATIONS, AND BUILDING UTILITY ENTRANCE LOCATIONS AND ELEVATIONS.
15. SITE CLEAN-UP SHALL BE PERFORMED ON A DAILY BASIS. SIDEWALKS, PARKING LOTS, ROADWAYS, ETC. SHALL BE KEPT CLEAN AT ALL TIMES.
16. ALL OPEN EXCAVATIONS SHALL BE PROTECTED.
17. REPLACE ANY PROPERTY MONUMENTS REMOVED OR DESTROYED BY CONSTRUCTION. MONUMENTS SHALL BE SET BY A LAND SURVEYOR REGISTERED TO PRACTICE IN THE STATE OF IOWA.
18. CONSTRUCTION ACTIVITIES ARE TO BE LIMITED TO THE EXISTING RIGHT-OF-WAY AND TEMPORARY CONSTRUCTION EASEMENTS. IF ADDITIONAL AREAS ARE NEEDED FOR STAGING, STORAGE, ETC., IT IS THE CONTRACTOR'S RESPONSIBILITY TO OBTAIN WRITTEN PERMISSION FROM THE PROPERTY OWNER(S). COPIES OF THE AGREEMENTS SHALL BE SUBMITTED TO THE OWNER'S REPRESENTATIVE PRIOR TO THE USE OF PROPERTY.
19. CONTROL DUST SPREADING FROM ALL WORK AND STAGING AREAS.
20. ANY WORK REQUIRED TO COMPLETE THE SCOPE OF THIS PROJECT BUT NOT SET FORTH AS A SPECIFIC BID ITEM, SHALL BE CONSIDERED INCIDENTAL TO THE PROJECT. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED FOR THE COMPLETION OF THIS WORK.
21. REPAIR OR REPLACE EXISTING FACILITIES (CURBS, PAVEMENT, UTILITIES, ETC.) TO REMAIN, AT NO ADDITIONAL EXPENSE TO THE OWNER.
22. IT IS INTENDED THAT ALL COSTS OF MATERIALS, EQUIPMENT, TOOLS, LABOR AND INCIDENTALS BE PAID FOR UNDER THE ITEMS LISTED ON THE BIDDER'S PROPOSAL. BEFORE SUBMITTING A BID ON THIS PROJECT, THE CONTRACTOR SHALL EXAMINE ALL DRAWINGS, SPECIFICATIONS, SPECIAL PROVISIONS AND THE JOB SITE. IF ANY DISCREPANCIES OR DELETIONS OCCUR IN THE CONTRACT DOCUMENTS, THE CONTRACTOR SHALL REPORT SAME TO SHIVE-HATTERY, INC. IN WRITING AND OBTAIN WRITTEN CLARIFICATION AND/OR INSTRUCTIONS ON HOW TO PROCEED.
23. WORK WHICH DOES NOT CONFORM TO THE REQUIREMENTS OF THE CONTRACT WILL BE CONSIDERED UNACCEPTABLE. UNACCEPTABLE WORK, WHETHER THE RESULT OF POOR WORKMANSHIP, USE OF DEFECTIVE MATERIALS, DAMAGE THROUGH CARELESSNESS OR ANY OTHER CAUSE, FOUND TO EXIST PRIOR TO THE FINAL ACCEPTANCE OF THE WORK, SHALL BE REMOVED AND REPLACED IN AN ACCEPTABLE MANNER, AS REQUIRED BY SHIVE-HATTERY, INC. AT THE CONTRACTOR'S EXPENSE. WORK DONE CONTRARY TO THE INSTRUCTIONS OF SHIVE-HATTERY, INC., WORK DONE BEYOND THE LINES SHOWN ON THE PLANS OR ANY EXTRA WORK DONE WITHOUT AUTHORITY WILL NOT BE PAID FOR.
24. THE CONTRACTOR SHALL PROTECT ALL TREES SHOWN TO BE SAVED ON THE PLANS. CONTRACTOR SHALL ERECT FENCING AROUND TREE AT THE DRIP LINE, UNDER NO CIRCUMSTANCES SHALL THE CONTRACTOR PARK OR TRAVEL WITH ANY VEHICLE UNDER THE TREE DRIP LINE.

LEGEND	
EXISTING GENERAL SITE	
PLAN MARK	DESCRIPTION
	EXISTING STRUCTURE
	BOLLARD
	SHRUB
	DECIDUOUS TREE
	CONIFEROUS TREE
	SINGLE POLE SIGN
	DOUBLE POLE SIGN
	TREE LINE
	MINOR CONTOUR
	MAJOR CONTOUR


LEGEND	
RIGHT-OF-WAY	
PLAN MARK	DESCRIPTION
	PROPOSED RIGHT-OF-WAY
	EXISTING RIGHT-OF-WAY
	EXISTING PROPERTY LINE
	EXISTING EASEMENT
	TEMPORARY EASMENT
	PROPOSED EASEMENT

LEGEND	
GENERAL SITE GRADING / EROSION CONTROL	
PLAN MARK	DESCRIPTION
	SLOPE ARROW
	FLOW ARROW
	SILT FENCE
	INLET PROTECTION
	COMPOST SOCK
	GRADING LIMITS


LEGEND		
UTILITY LINES		
EXISTING LINE TYPE	DESCRIPTION	PROPOSED LINE TYPE
	ELECTRIC - OVERHEAD	
	ELECTRIC - UNDERGROUND	
	GAS MAIN	
	WATER MAIN	
	SANITARY SEWER	
	STORM SEWER	
	TELEPHONE - UNDERGROUND	
	FIBER OPTICS	
	HIGH VOLTAGE ELECTRICAL	
	LOW VOLTAGE ELECTRICAL	

LEGEND	
SURVEY	
PLAN MARK	DESCRIPTION
	BENCH MARK
	BOUND
	IRON ROD - FOUND
	IRON ROD - SET
	MONUMENT FOUND
	MONUMENT SET
	X CUT FOUND
	X CUT SET
	RIGHT OF WAY MARKER
	DRILL HOLE
	STATION MARKER
	SOIL BORING
	PROPERTY CORNER
	SURVEY POINT ELEVATION


LEGEND	
UTILITIES	
PLAN MARK	DESCRIPTION
	WATER IRRIGATION VALVE
	UTILITY POLE W/TRANSFORMER
	SIREN POLE
	WATER SHUTOFF VALVE
	GUY ANCHOR
	FIRE HYDRANT
	FLARED END SECTION
	VALVE
	STOP BOX
	CABLE TV PEDESTAL
	CLEANOUT
	JUNCTION BOX
	MANHOLE
	STORM MANHOLE
	ELECTRICAL MANHOLE
	SANITARY MANHOLE
	TELEPHONE MANHOLE
	TELEPHONE PEDESTAL
	VAULT BOX
	HANDHOLE
	SIGNAL BOX
	GAS METER
	ELECTRIC METER
	WATER METER
	CURB INLET
	INTAKE - CIRCLE
	INTAKE - RECTANGLE
	INTAKE - SQUARE

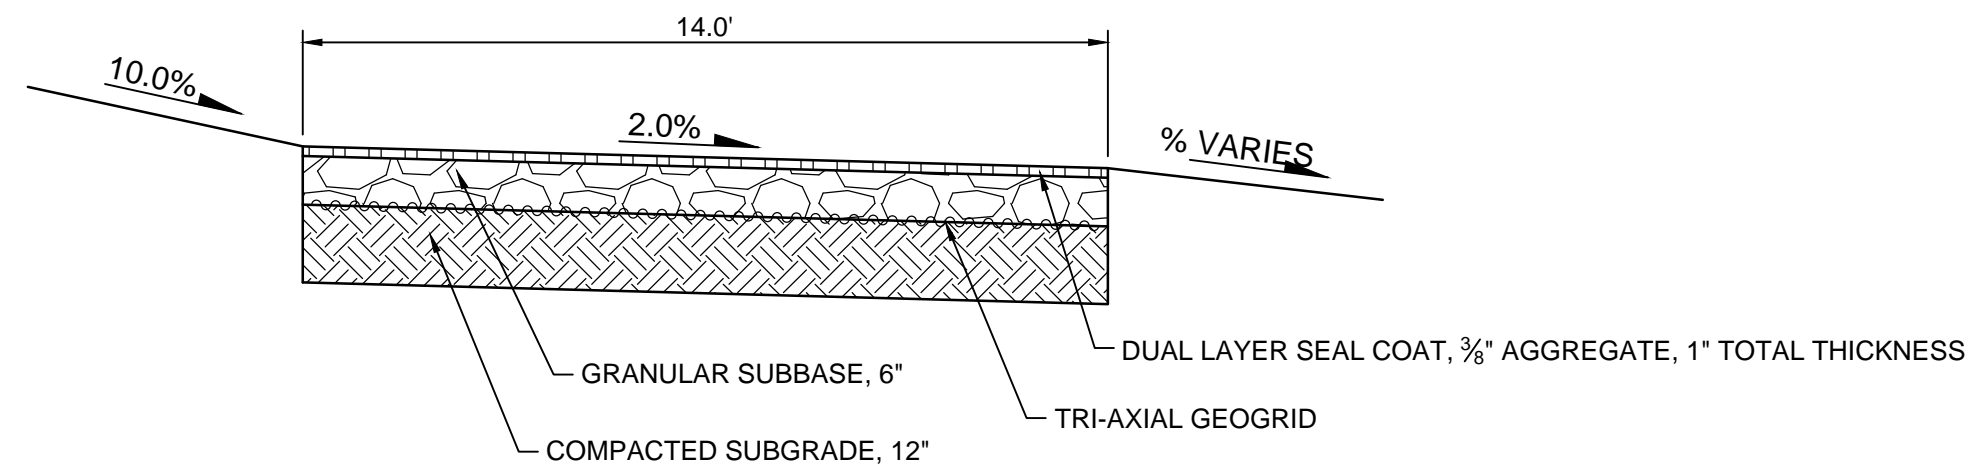


1 TYPICAL ROADWAY SECTION - LOOP ALIGNMENT
NO SCALE

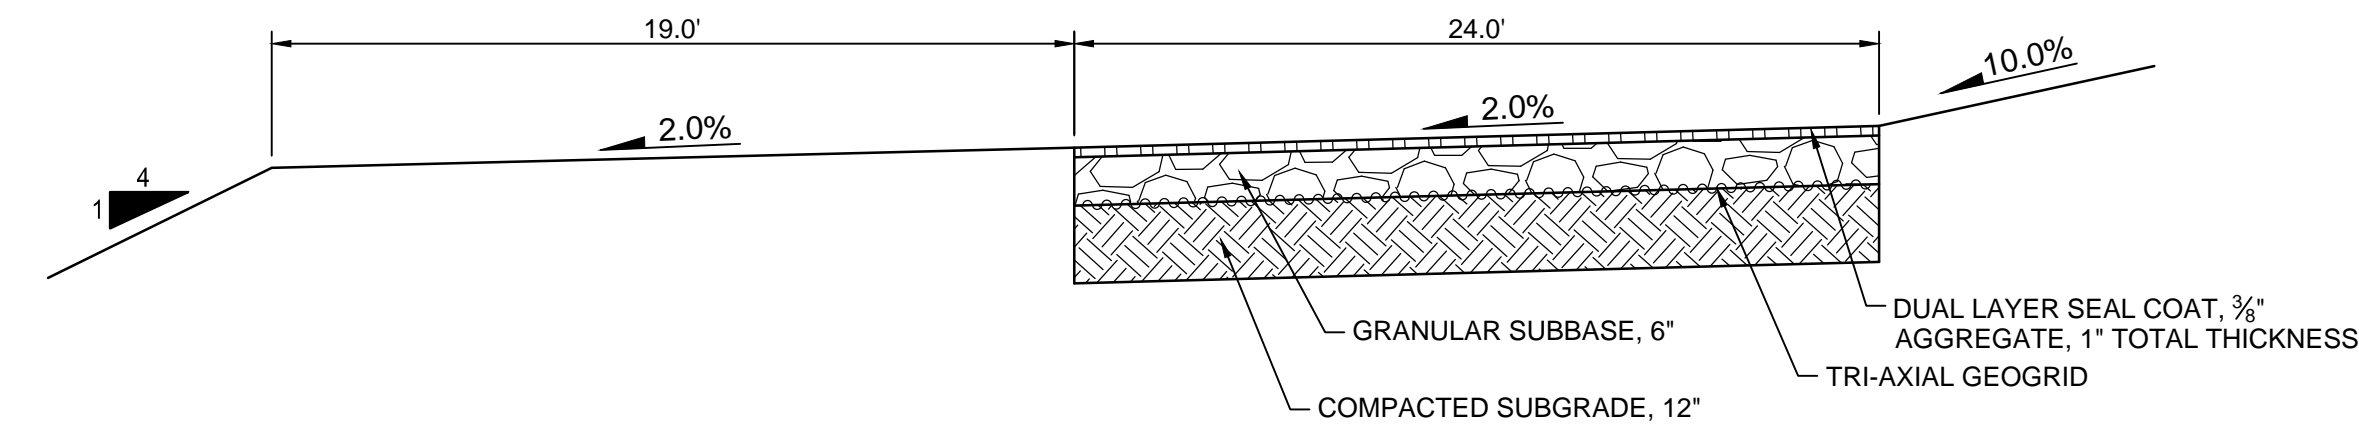


2 TYPICAL ROADWAY SECTION - MAIN ENTRANCE ALIGNMENT
NO SCALE

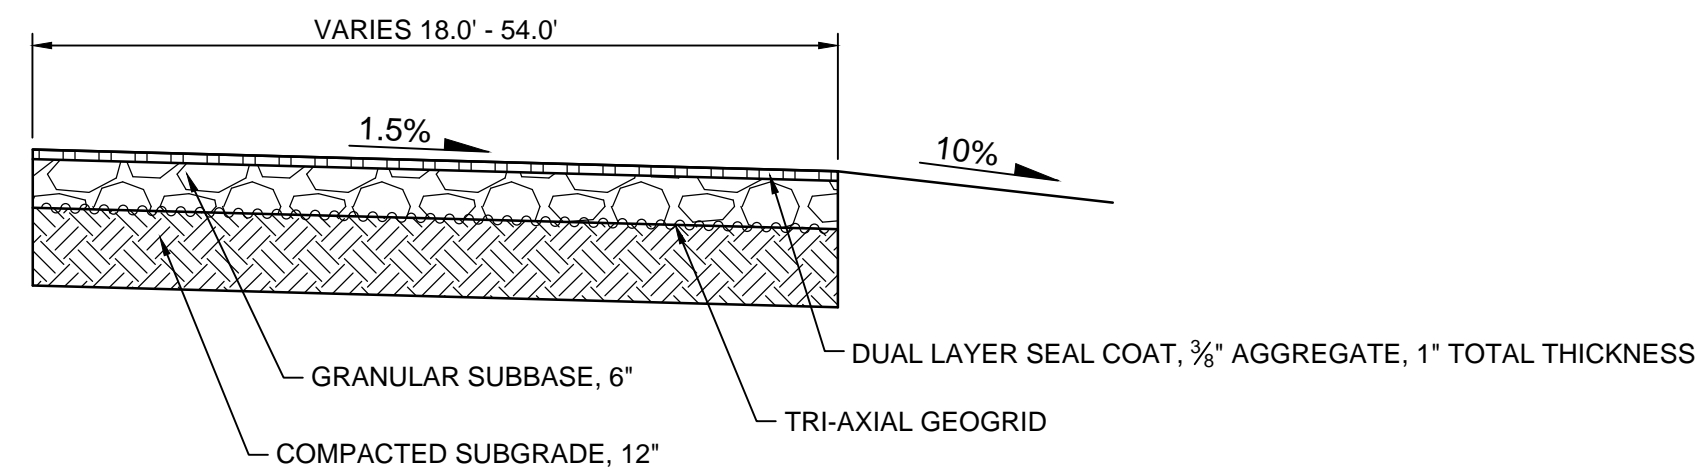


3 TYPICAL ROADWAY SECTION - PARKING ALIGNMENT
NO SCALE

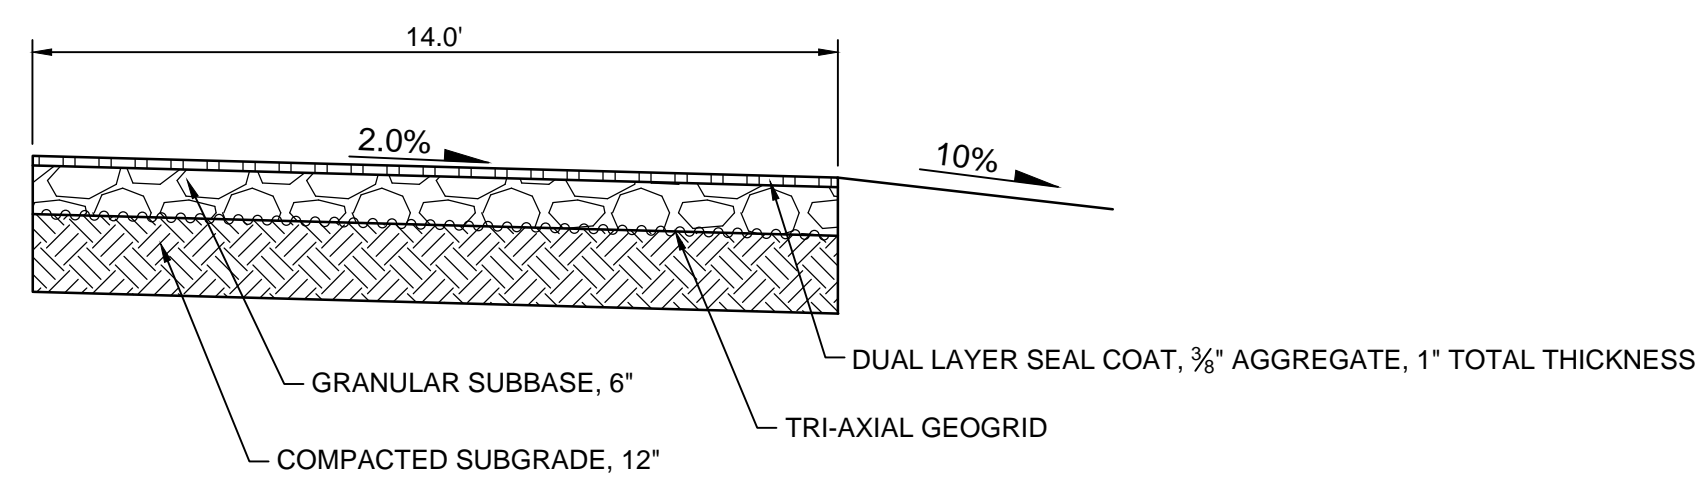


4 TYPICAL ROADWAY SECTION - CAMPING ENTRANCE ALIGNMENT
NO SCALE

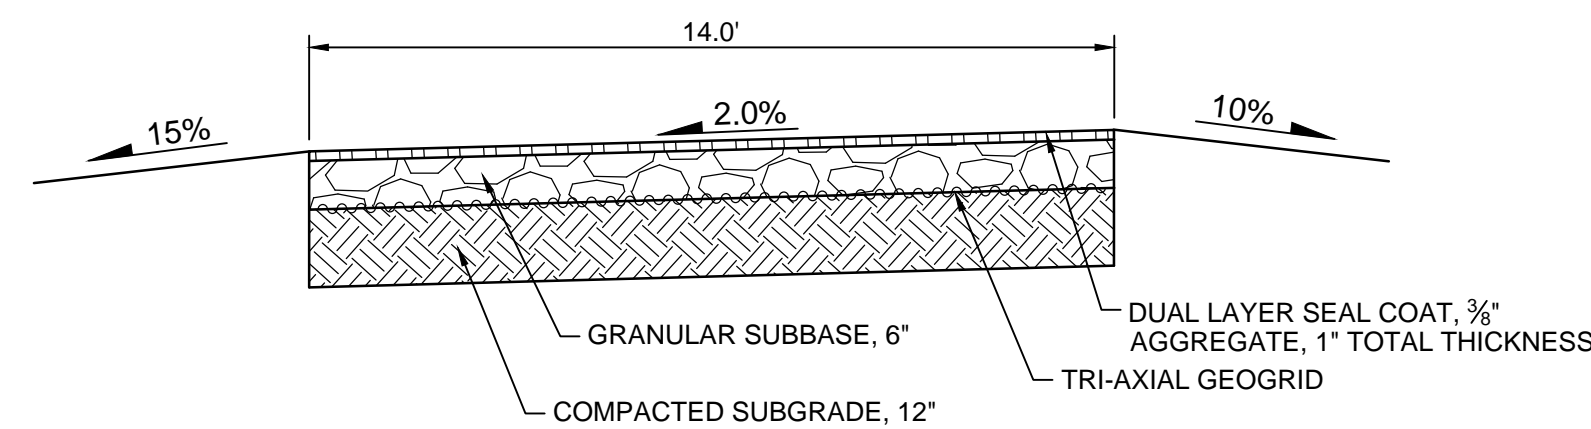



5 TYPICAL ROADWAY SECTION - CAMP CIRCULATORY ALIGNMENT
NO SCALE

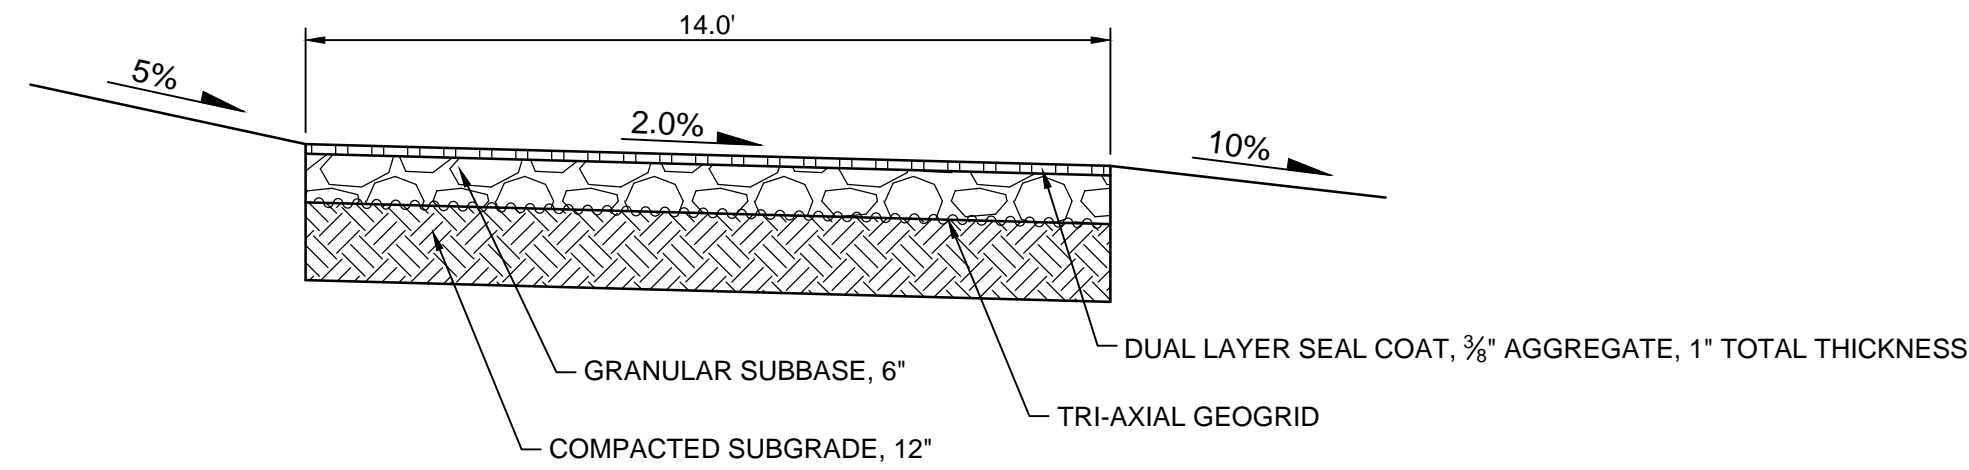



6 TYPICAL ROADWAY SECTION - CAMPING EXIT ALIGNMENT
NO SCALE

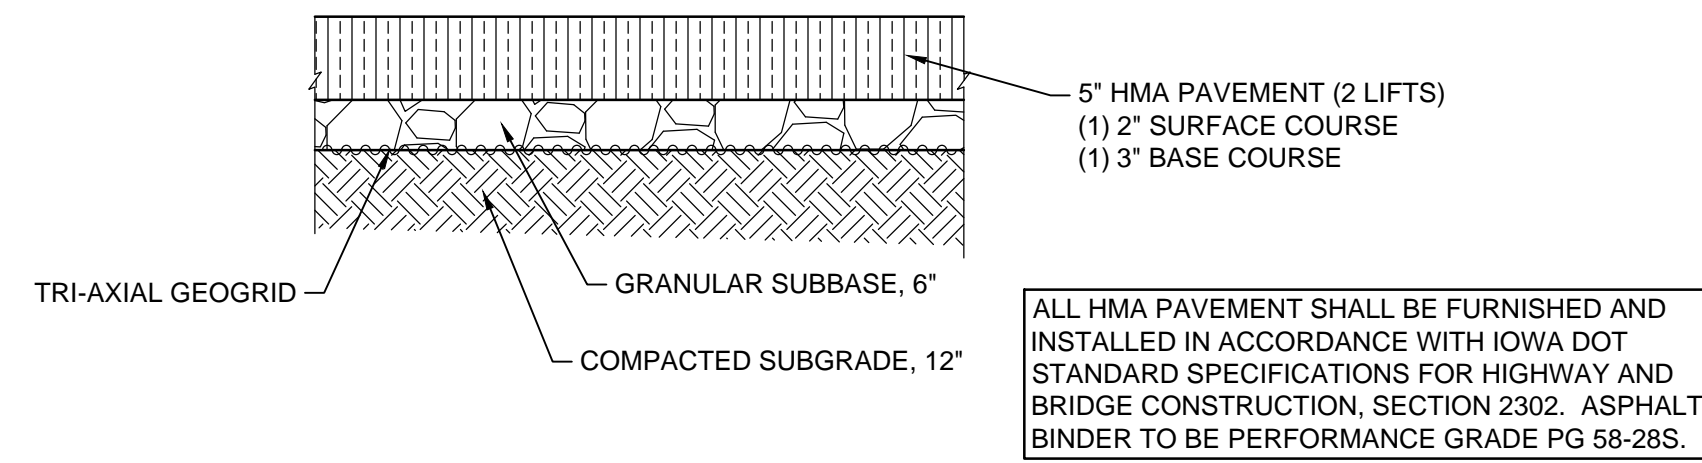



7 ASPHALT ALTERNATE SECTION
NO SCALE

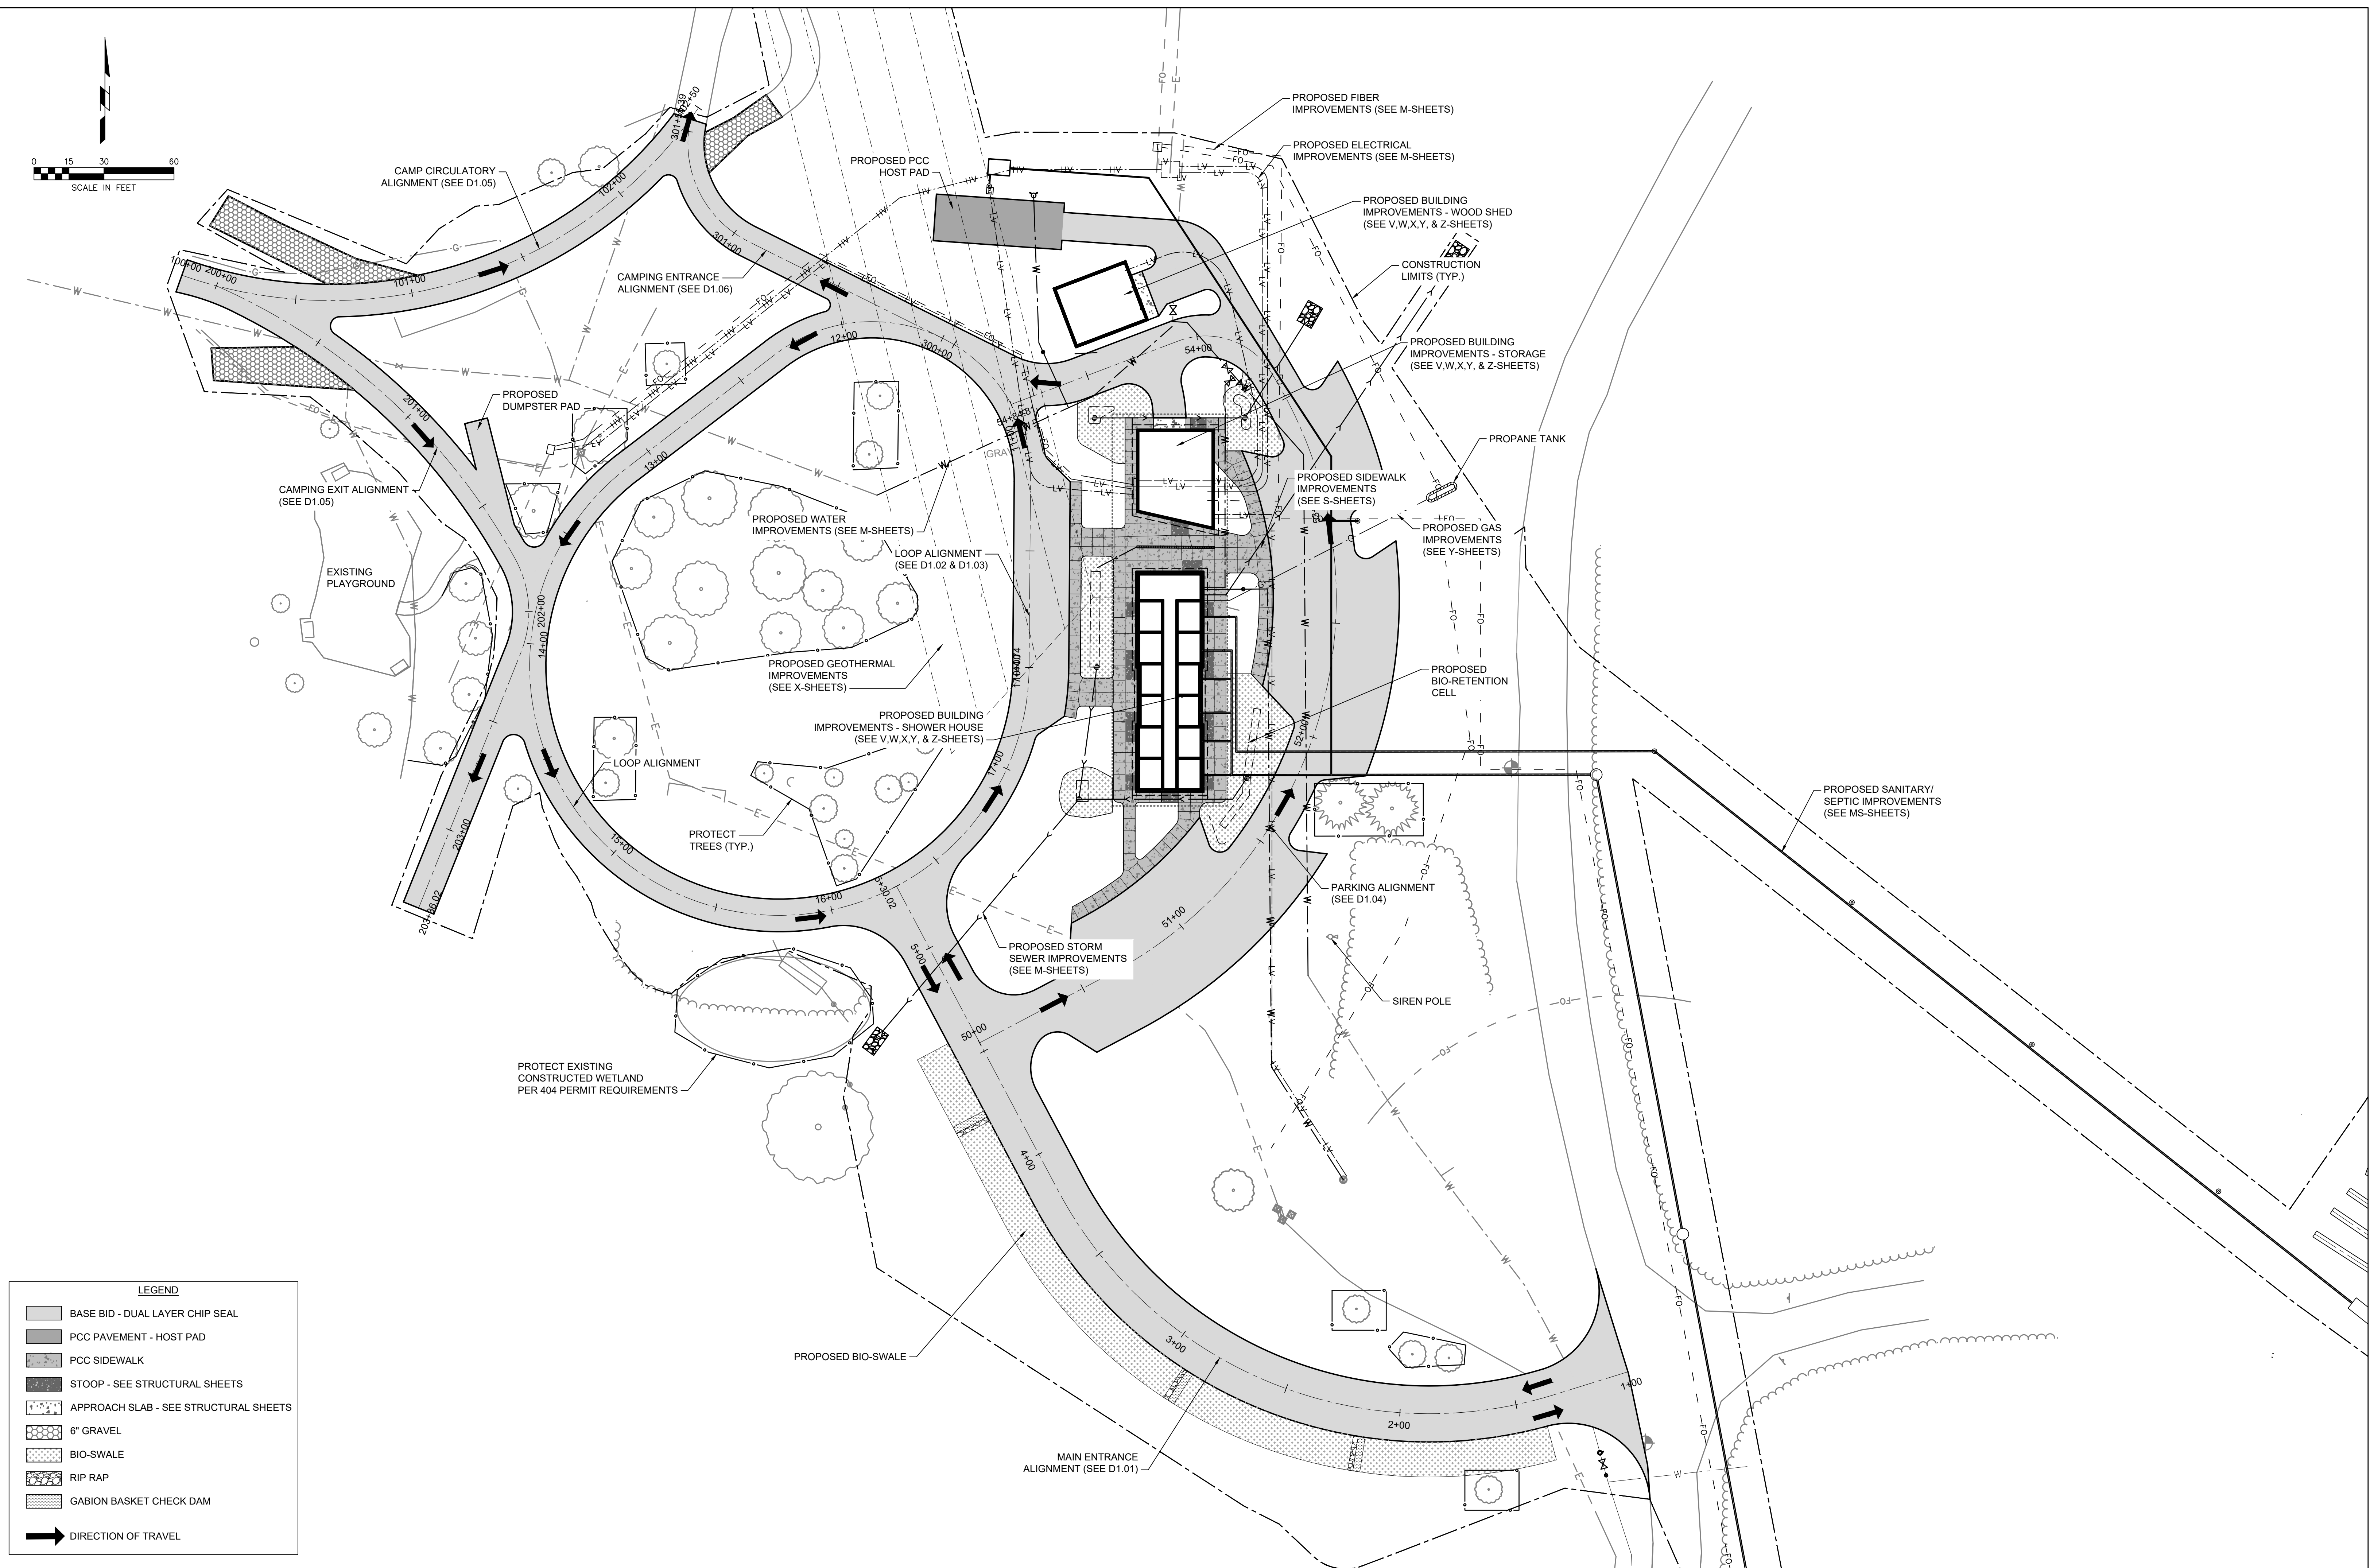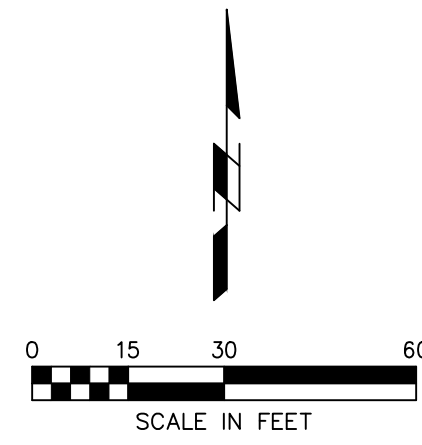

LEGEND	
	BASE BID - DUAL LAYER CHIP SEAL
	PCC PAVEMENT - HOST PAD
	PCC SIDEWALK
	STOOP - SEE STRUCTURAL SHEETS
	APPROACH SLAB - SEE STRUCTURAL SHEETS
	6" GRAVEL
	BIO-SWALE
	RIP RAP
	GABION BASKET CHECK DAM
	DIRECTION OF TRAVEL

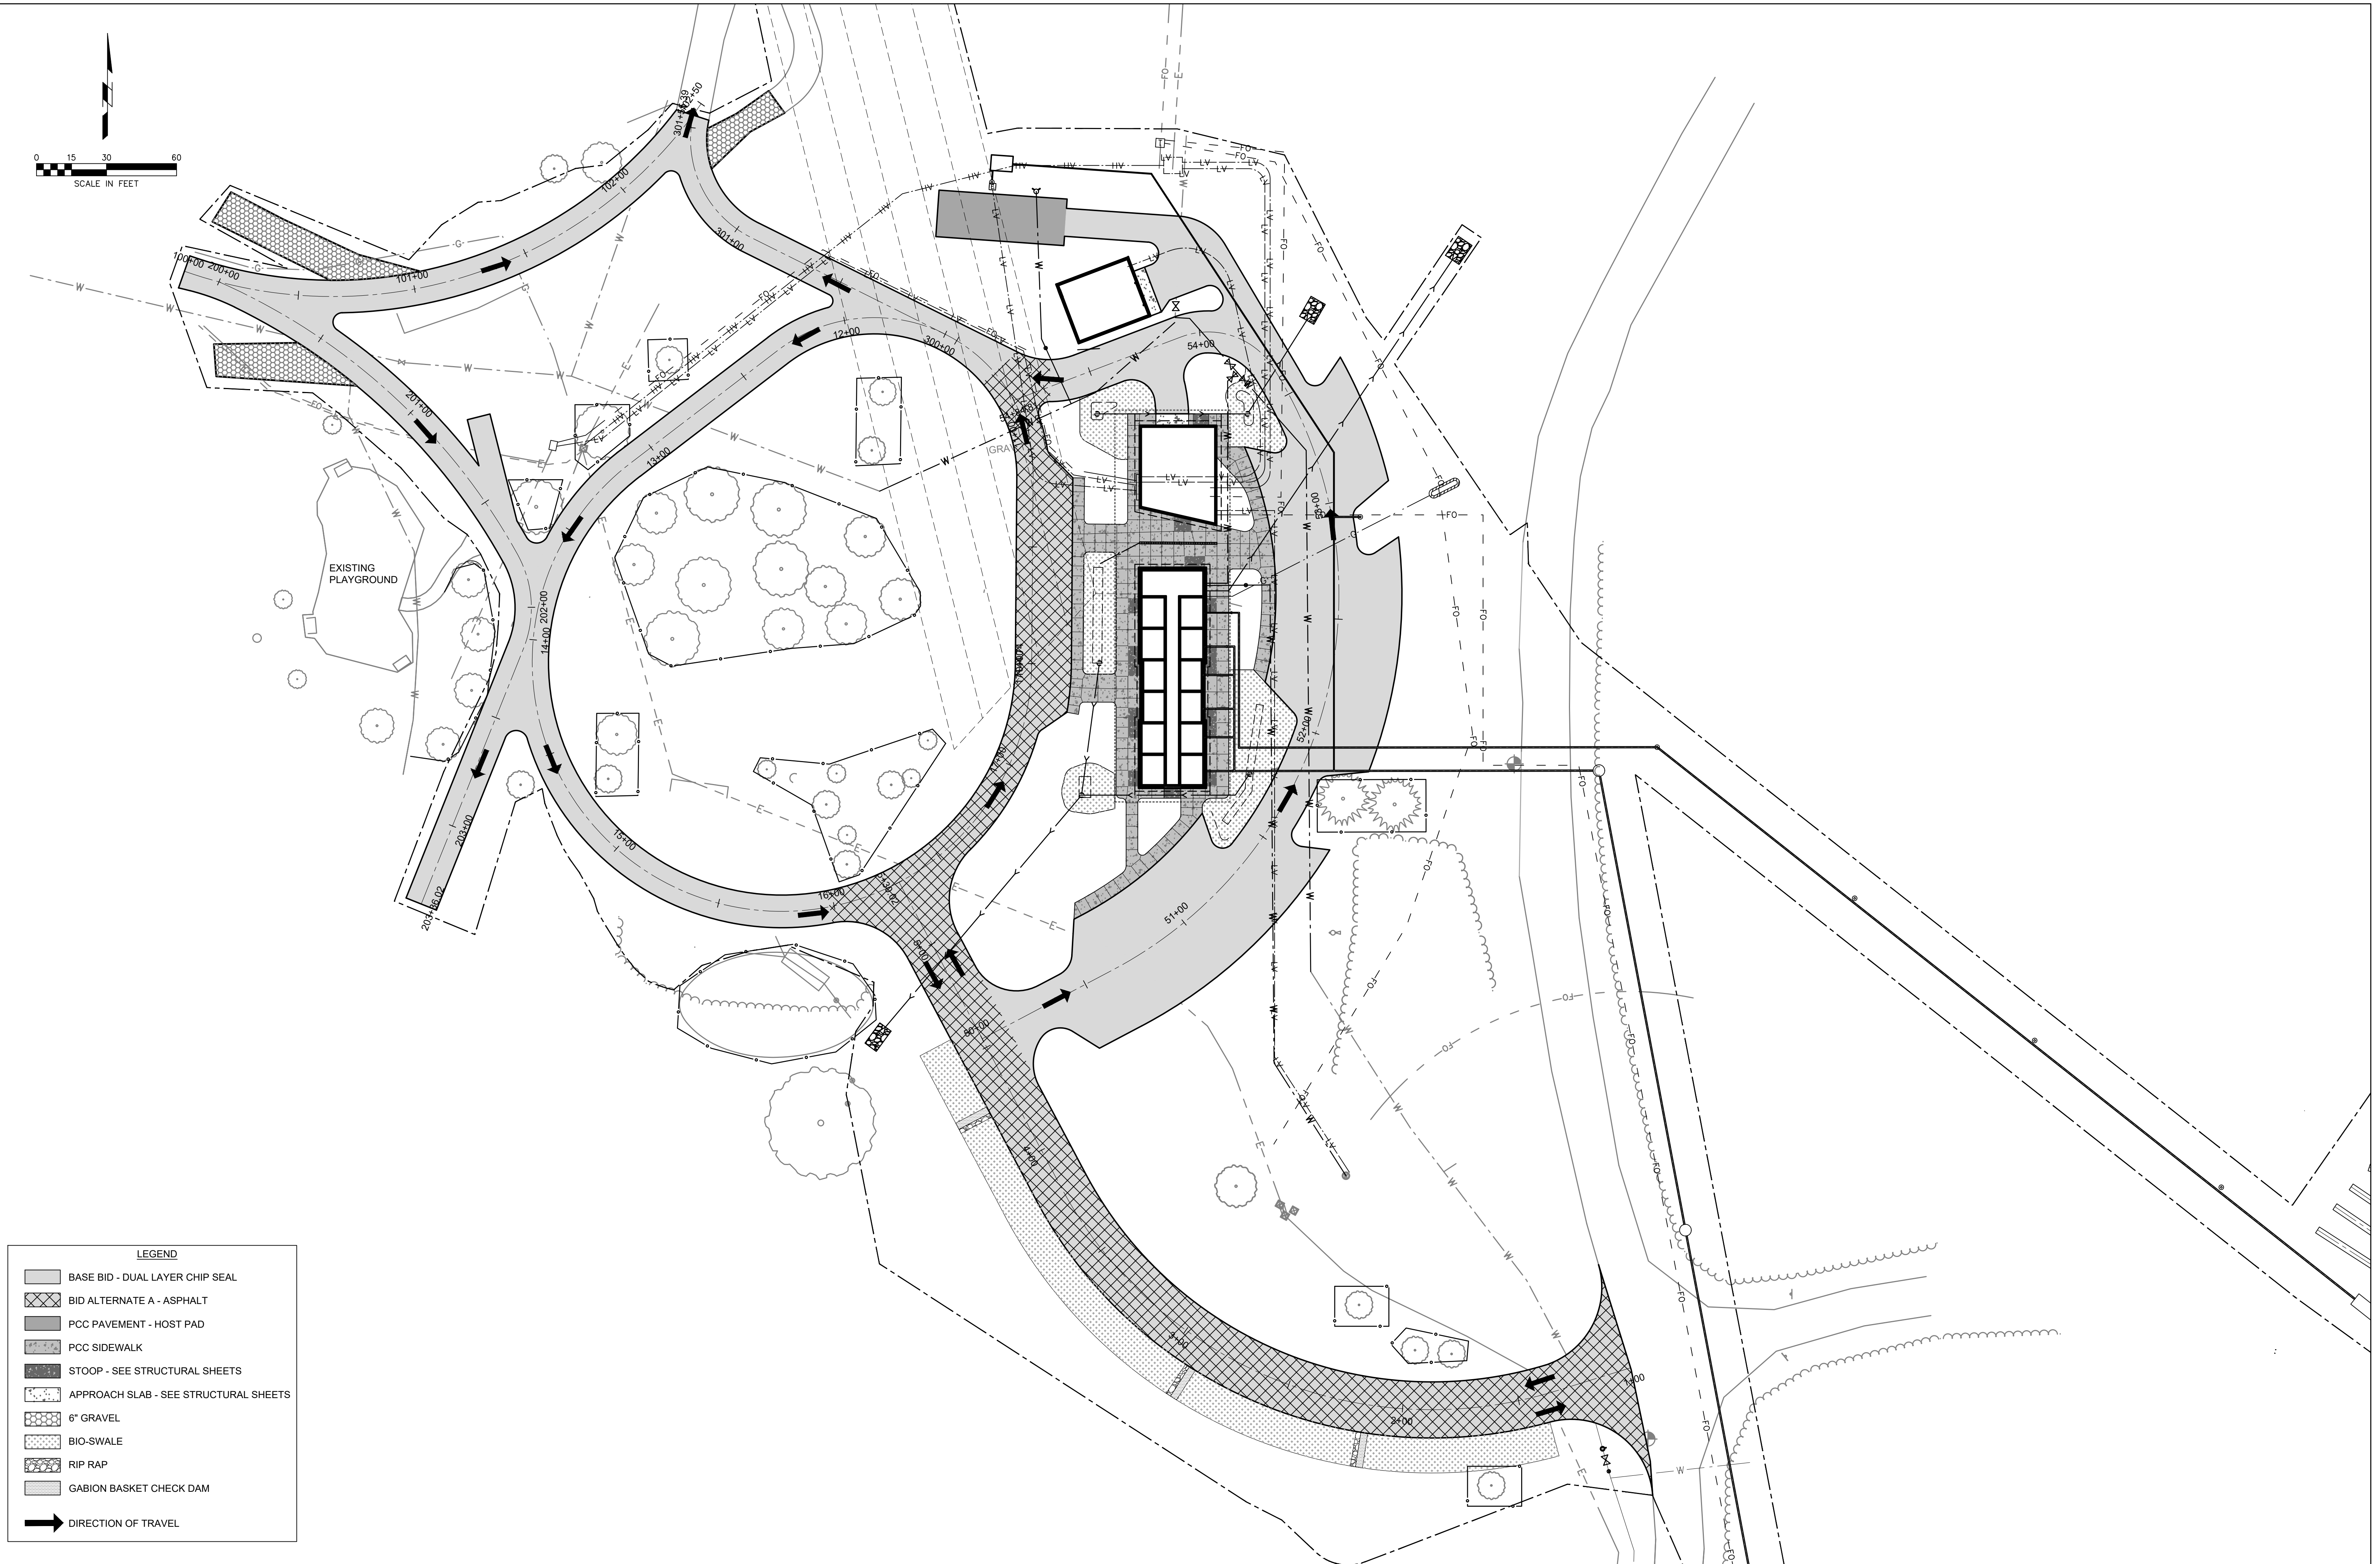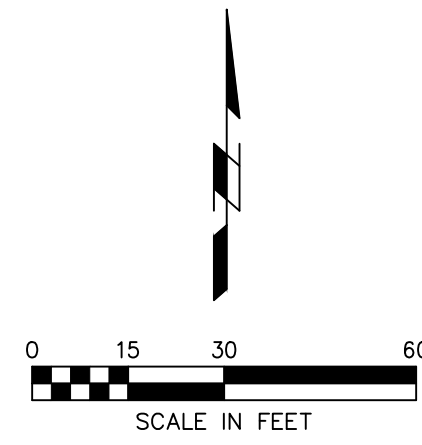


LEGEND	
	BASE BID - DUAL LAYER CHIP SEAL
	BID ALTERNATE A - ASPHALT
	PCC PAVEMENT - HOST PAD
	PCC SIDEWALK
	STOOP - SEE STRUCTURAL SHEETS
	APPROACH SLAB - SEE STRUCTURAL SHEETS
	6" GRAVEL
	BIO-SWALE
	RIP RAP
	GABION BASKET CHECK DAM
	DIRECTION OF TRAVEL

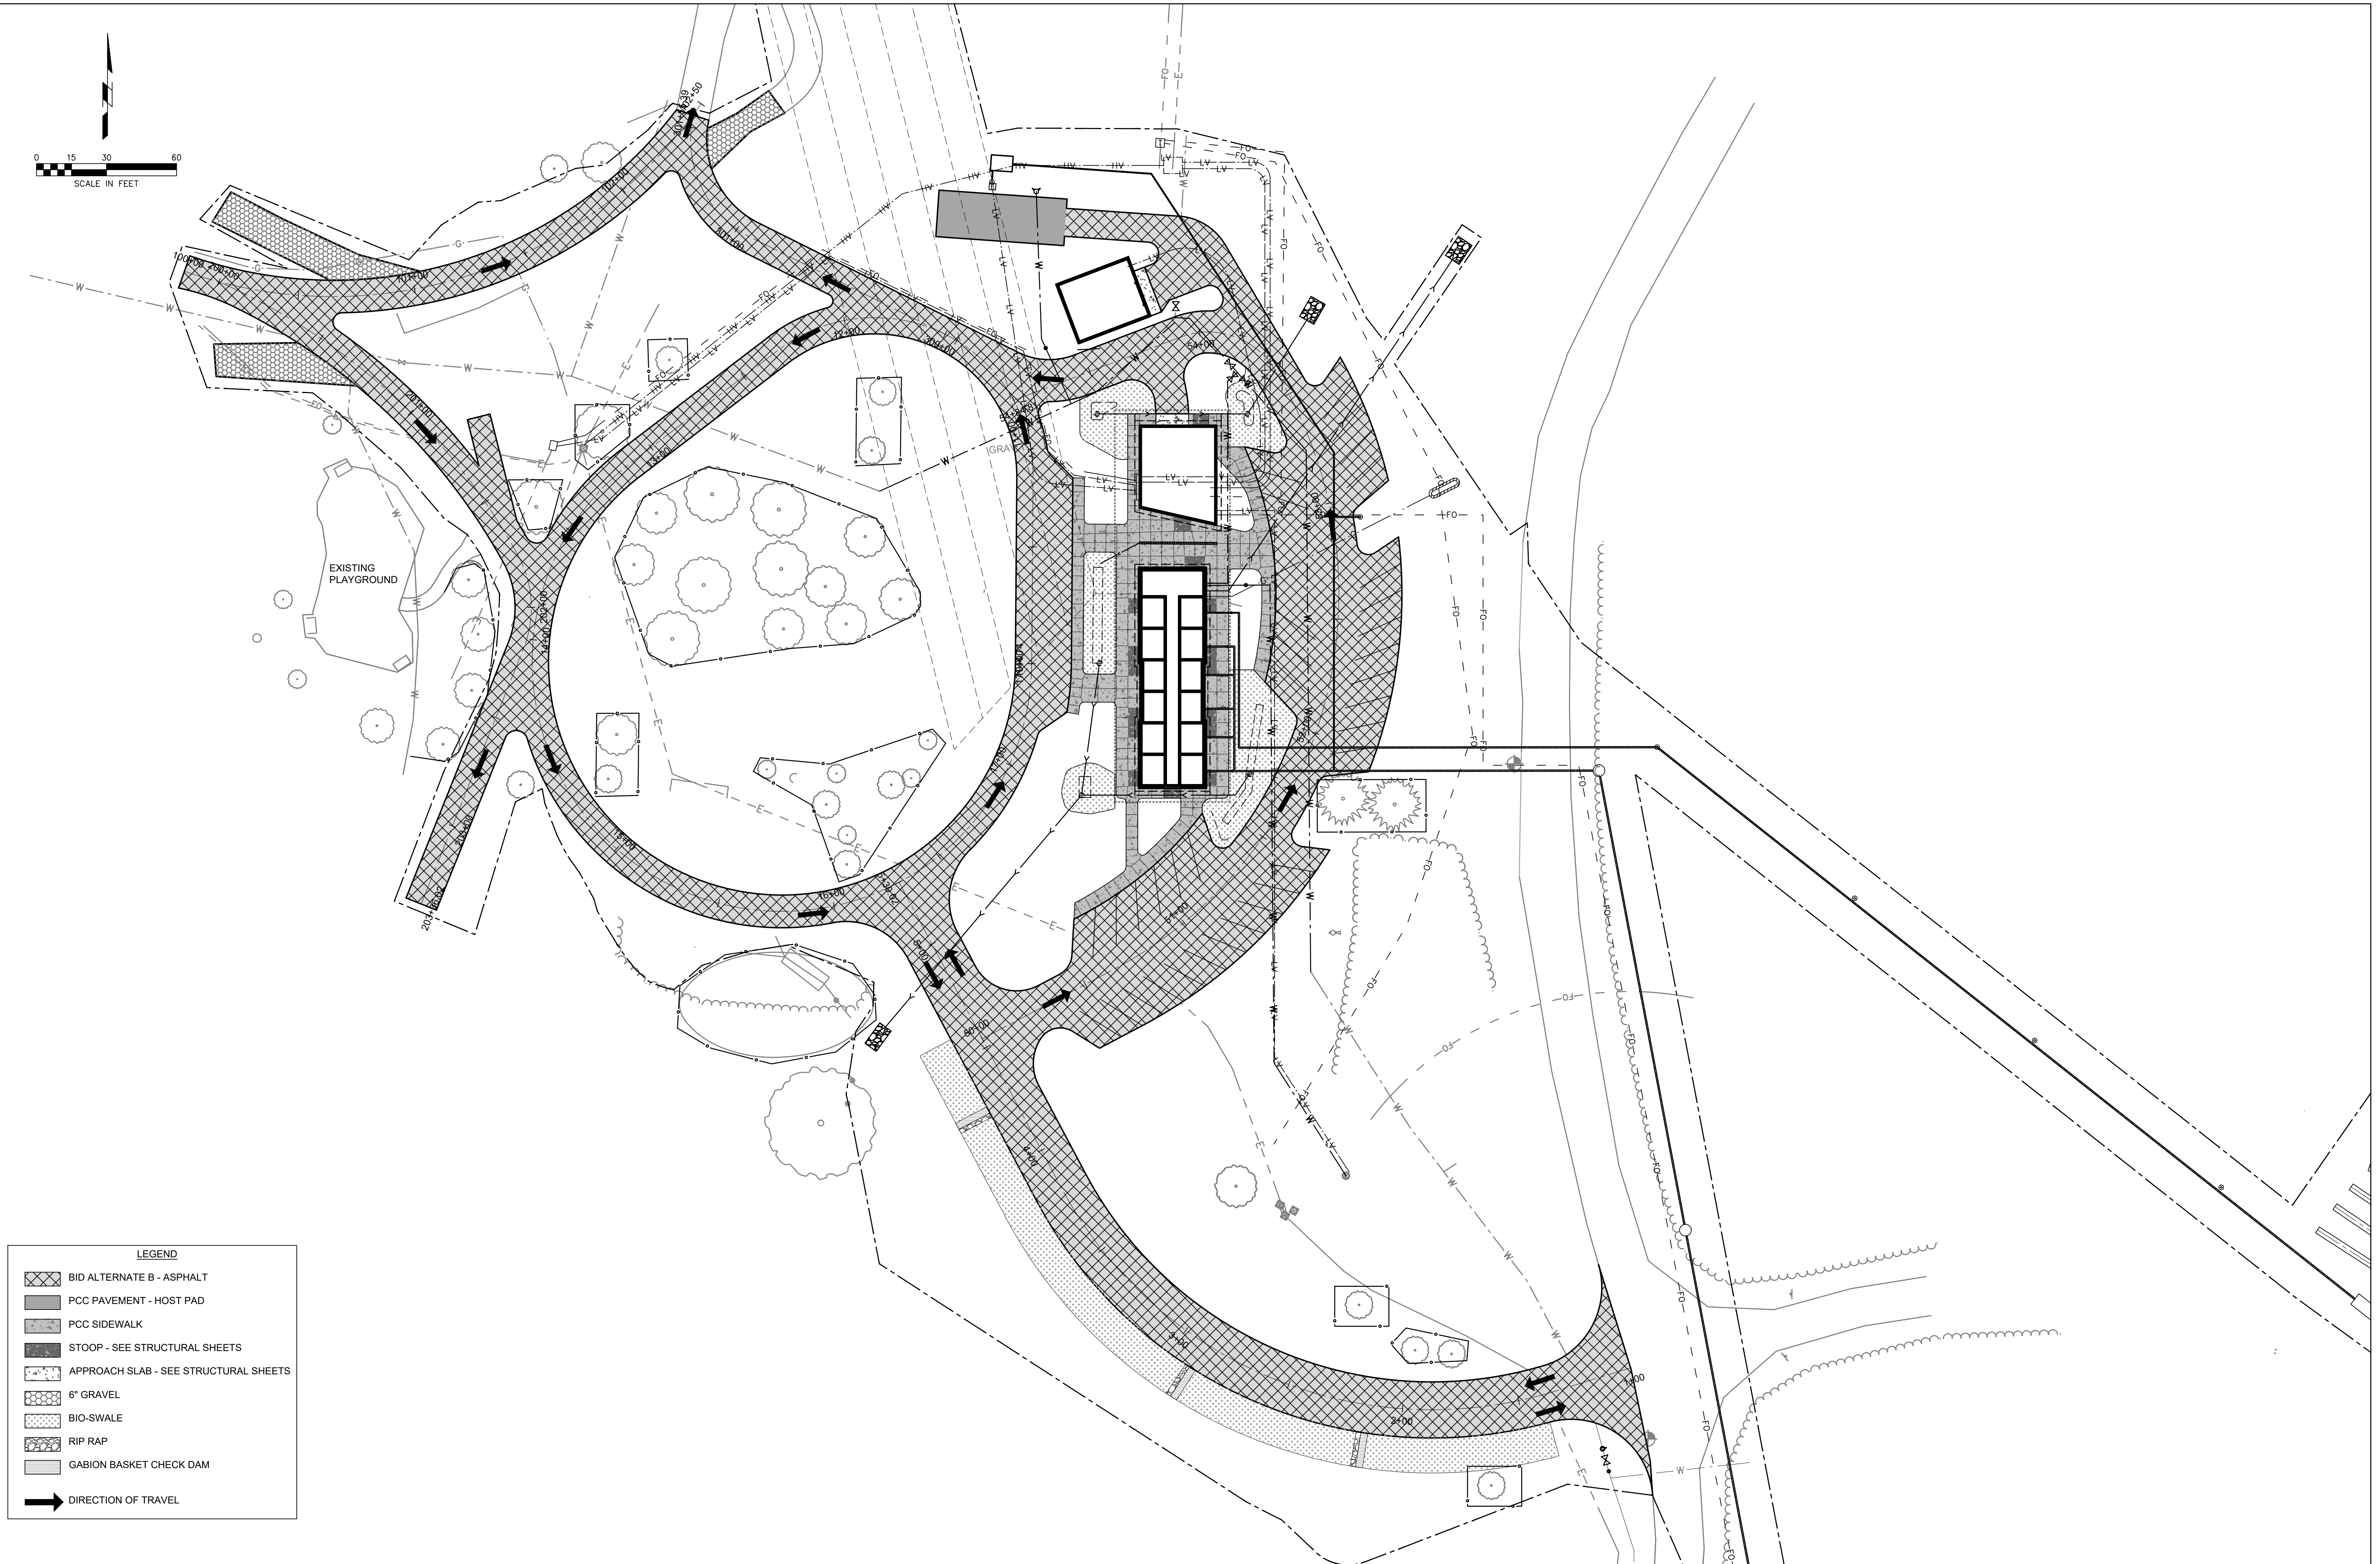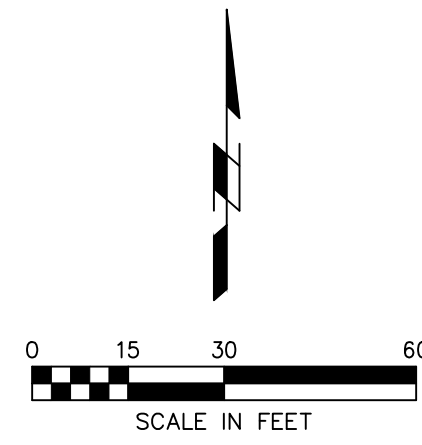

LEGEND


- BID ALTERNATE B - ASPHALT
- PCC PAVEMENT - HOST PAD
- PCC SIDEWALK
- STOOP - SEE STRUCTURAL SHEETS
- APPROACH SLAB - SEE STRUCTURAL SHEETS
- 6" GRAVEL
- BIO-SWALE
- RIP RAP
- GABION BASKET CHECK DAM
- DIRECTION OF TRAVEL


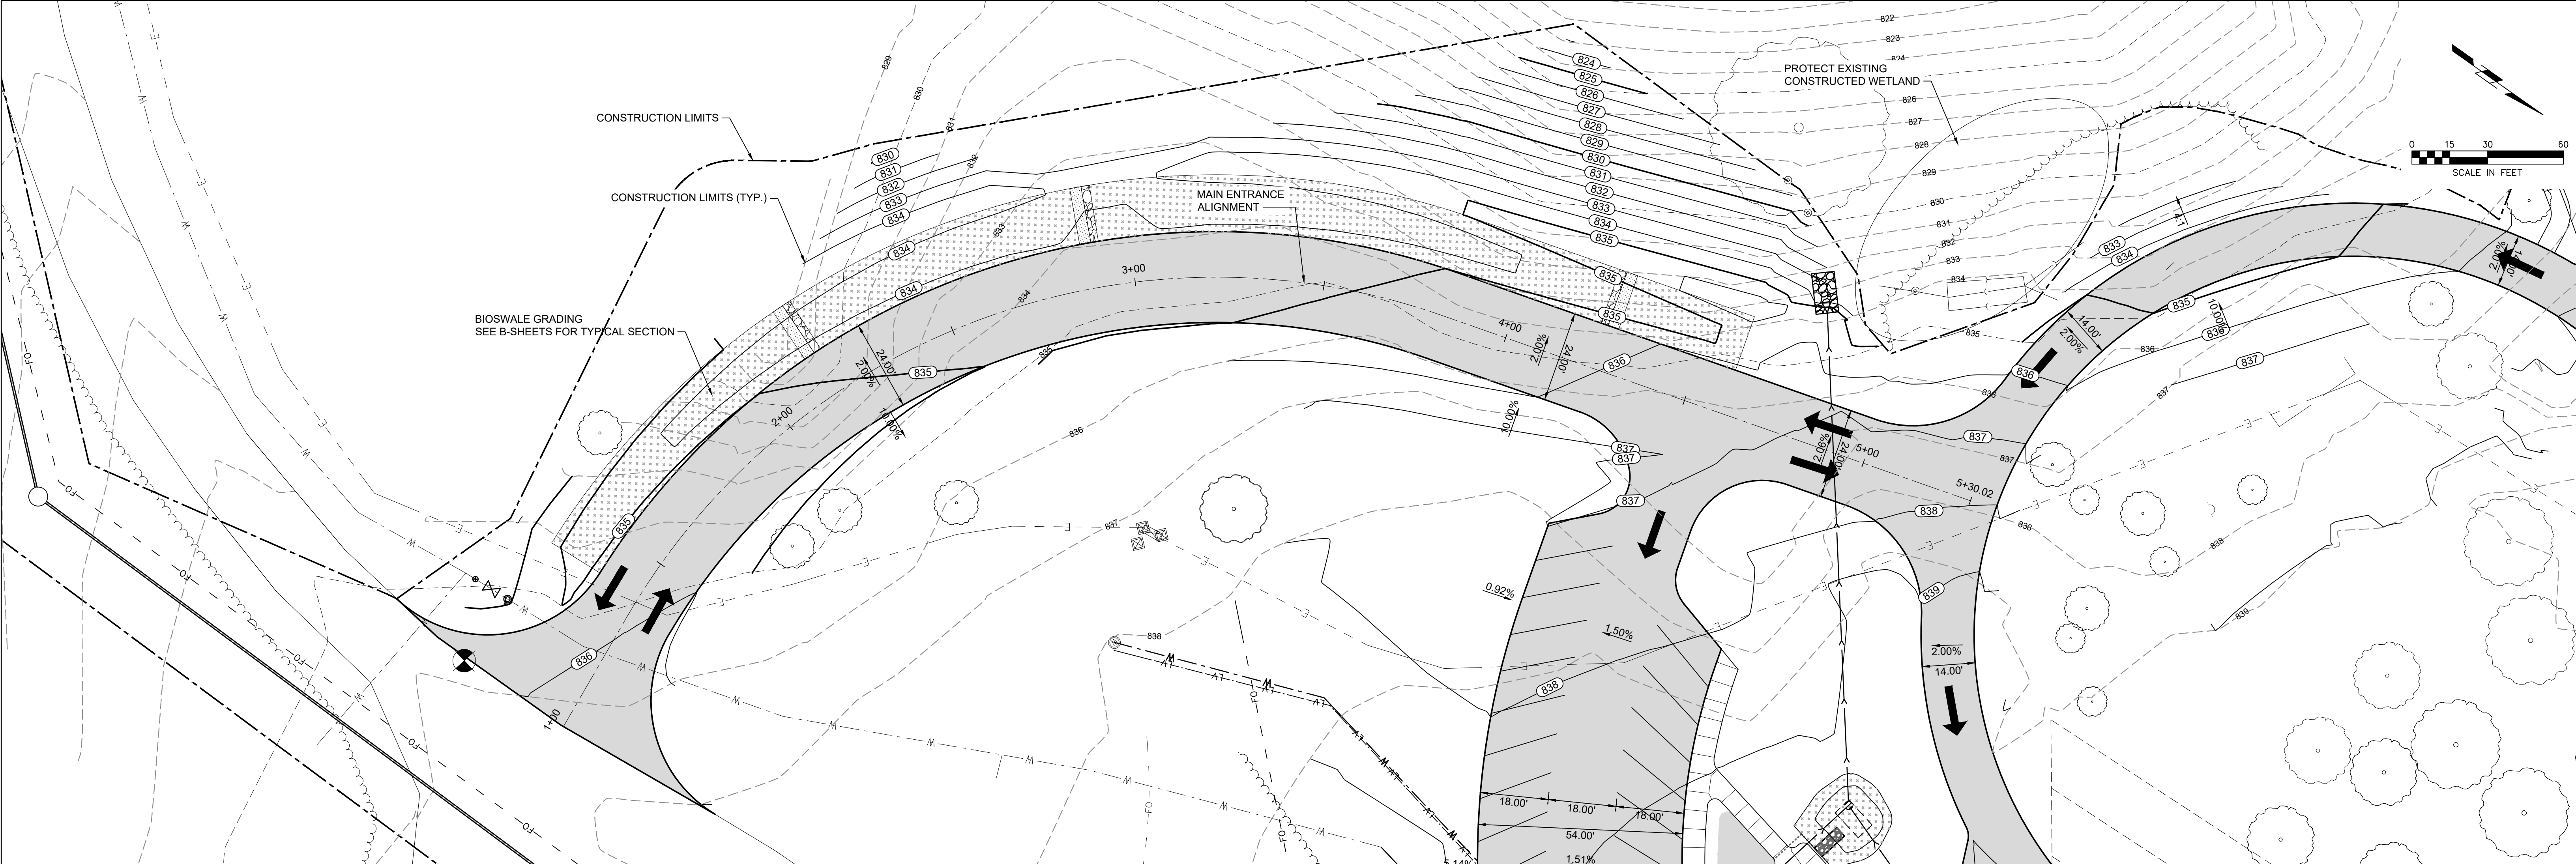


GENERAL NOTES:
1. CONTRACTOR TO PROVIDE A BID FOR ACC. PAVEMENT ALTERNATIVE IN THE AREA DELINEATED ON THE PLANS.

LEGEND
6" GRANULAR SUBBASE & 2 - 1/2" COURSES OF BITUMINOUS SEAL COAT (7" TOTAL)





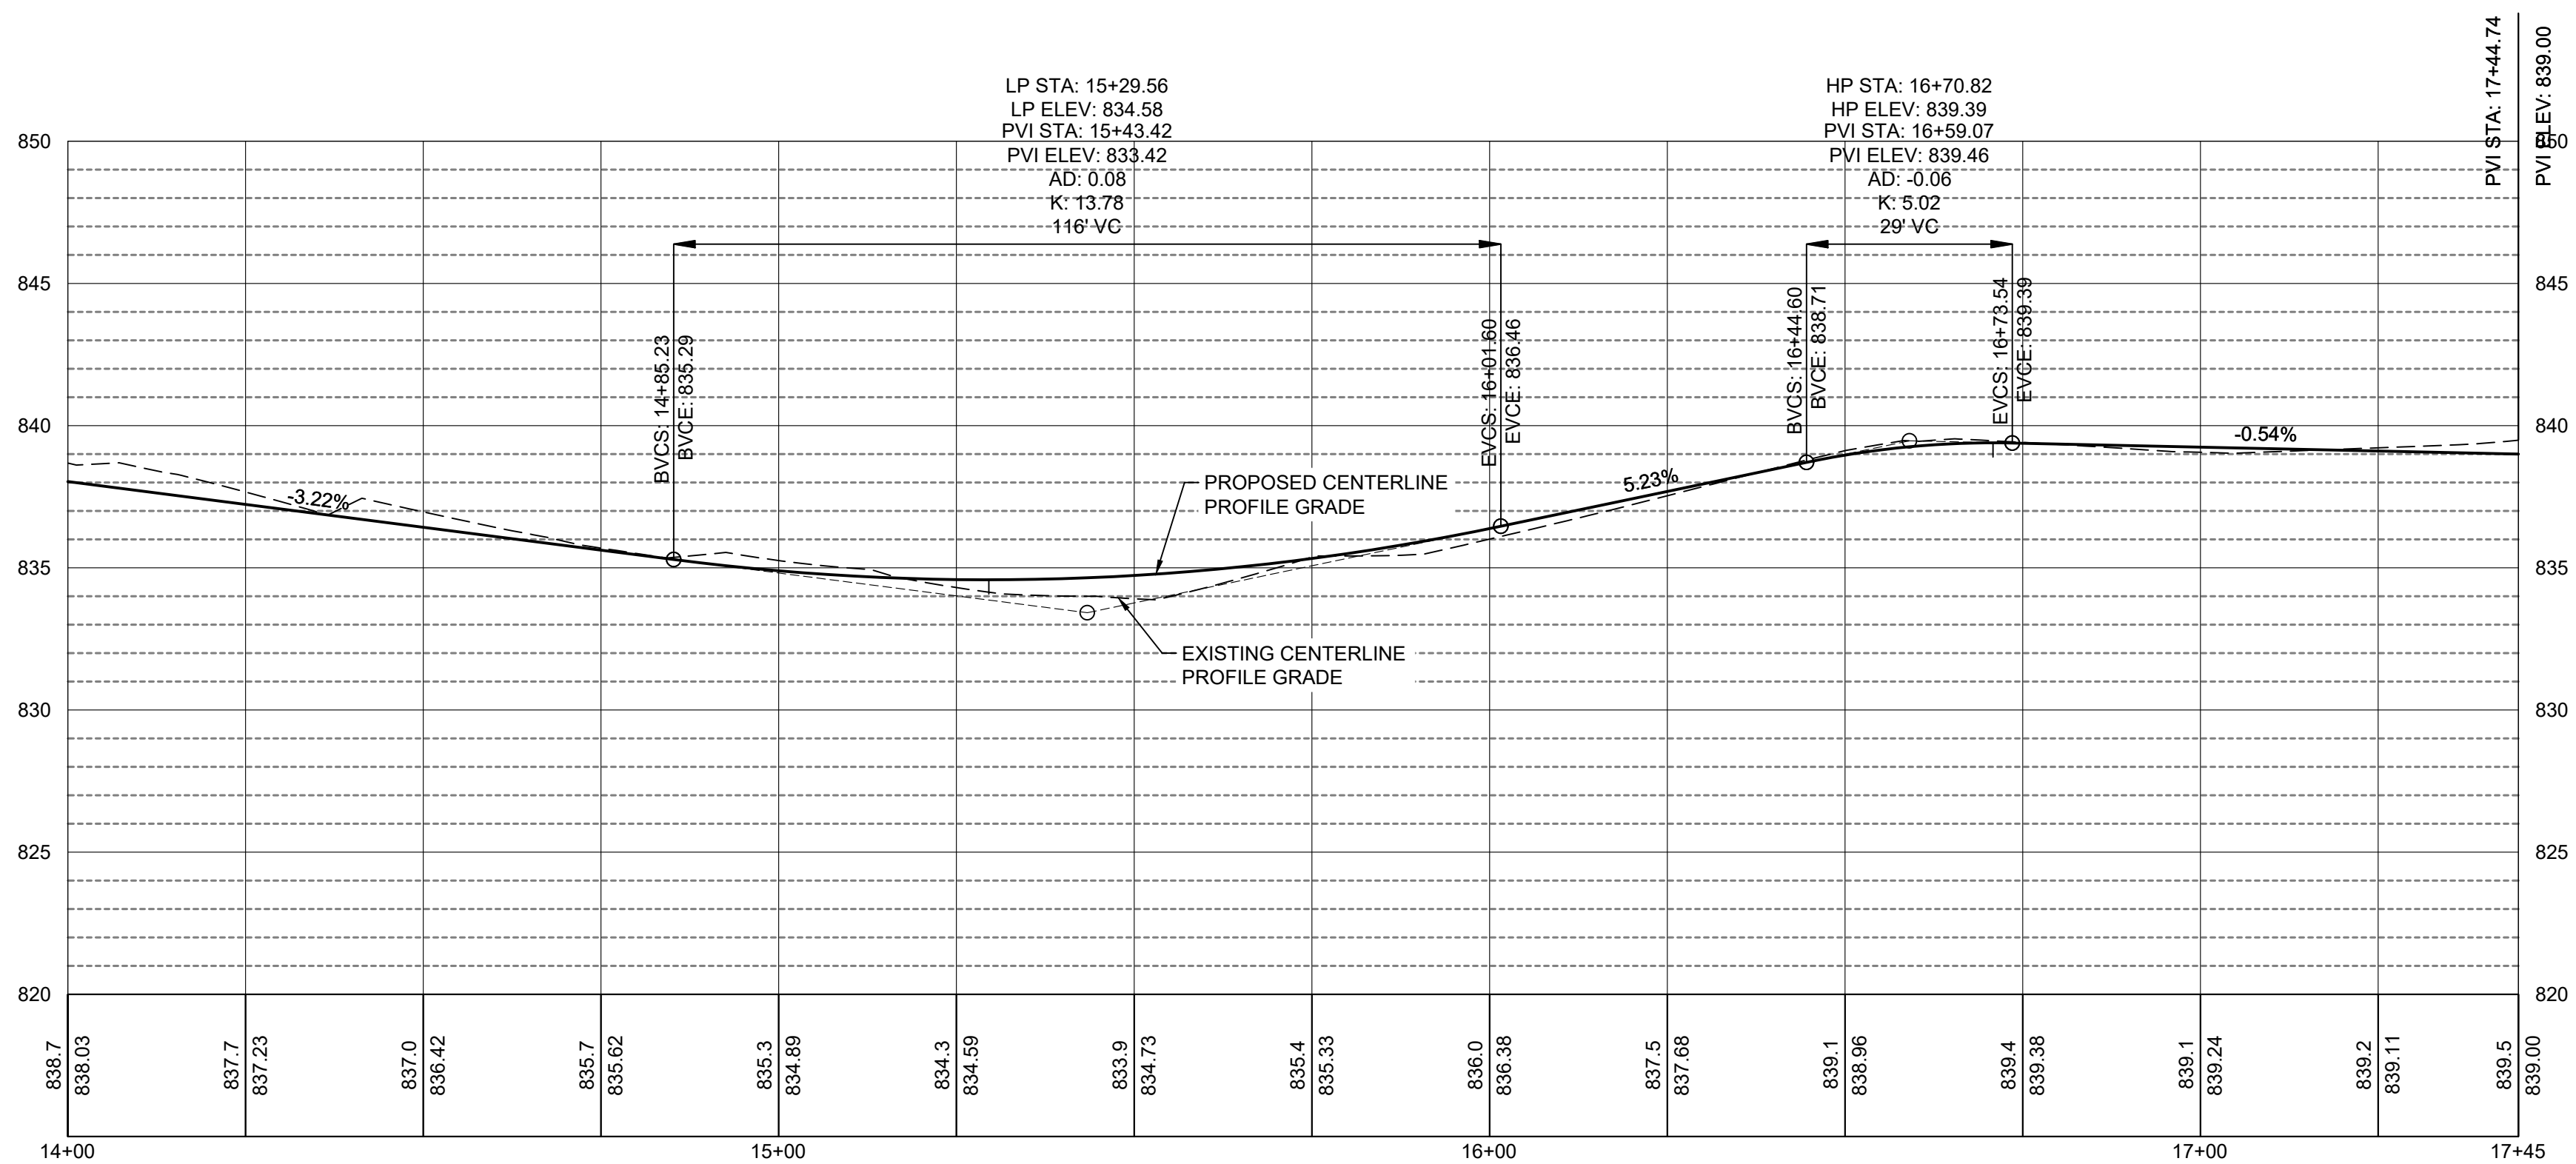

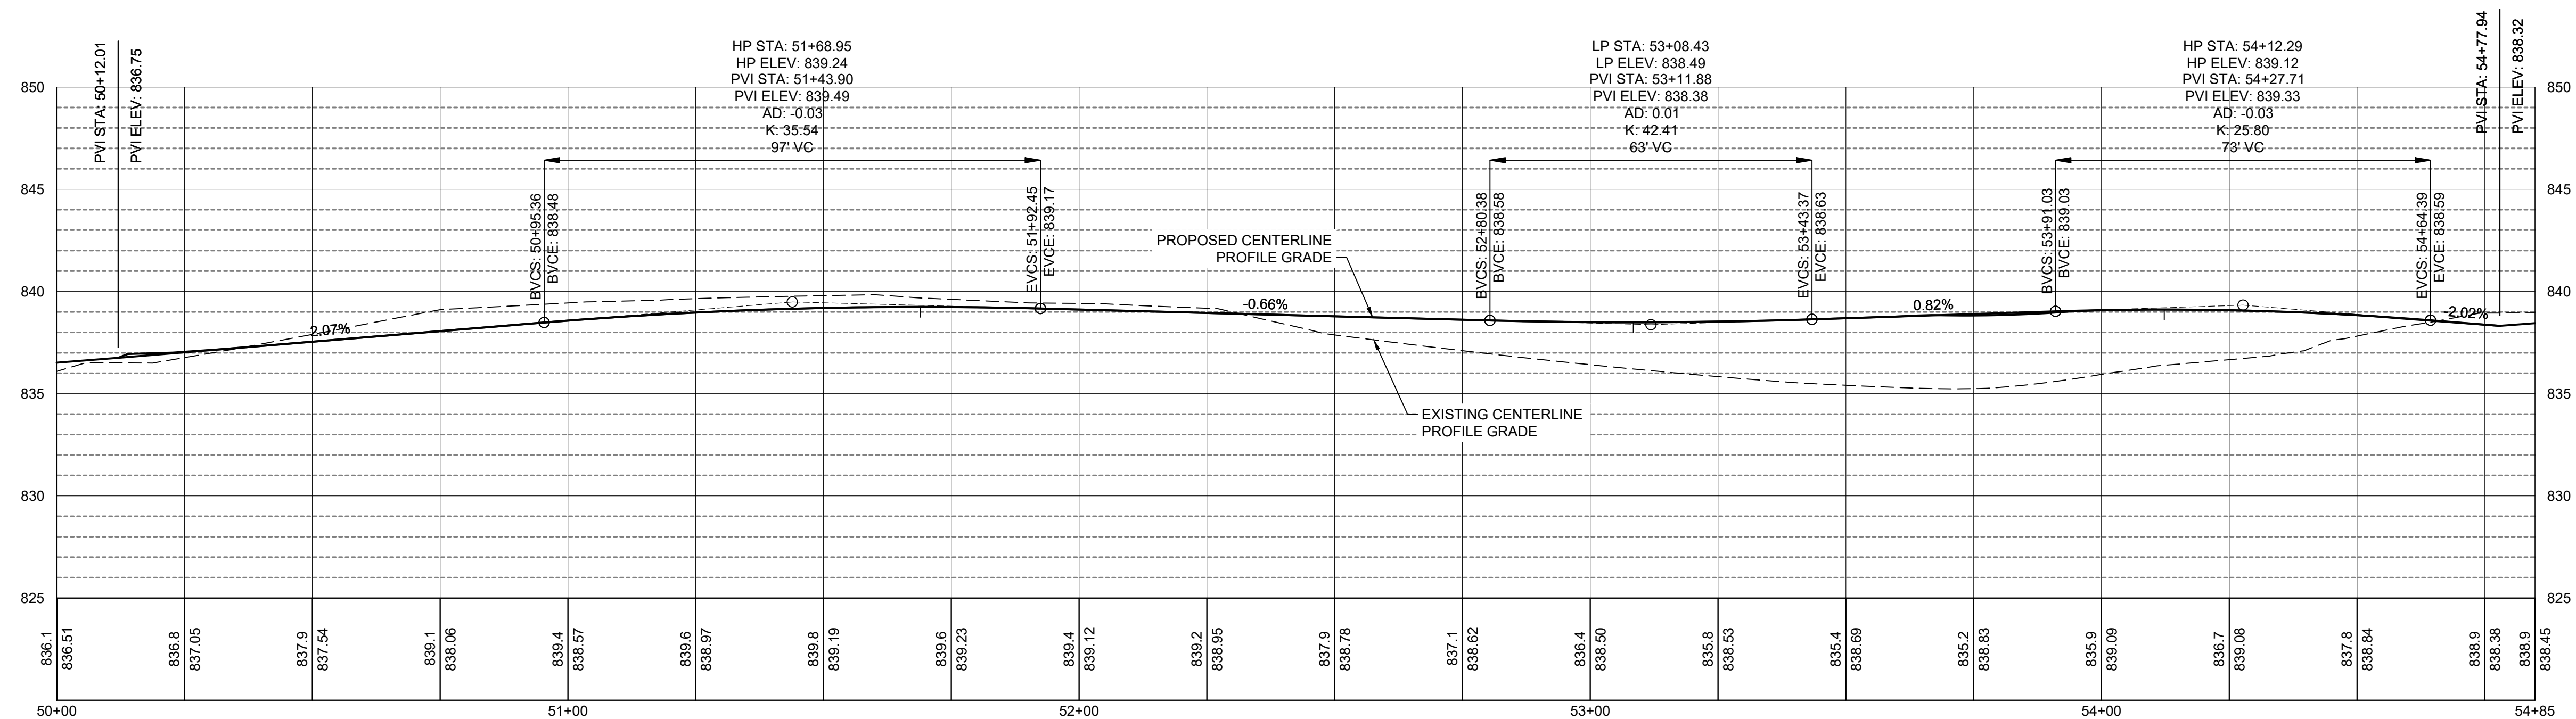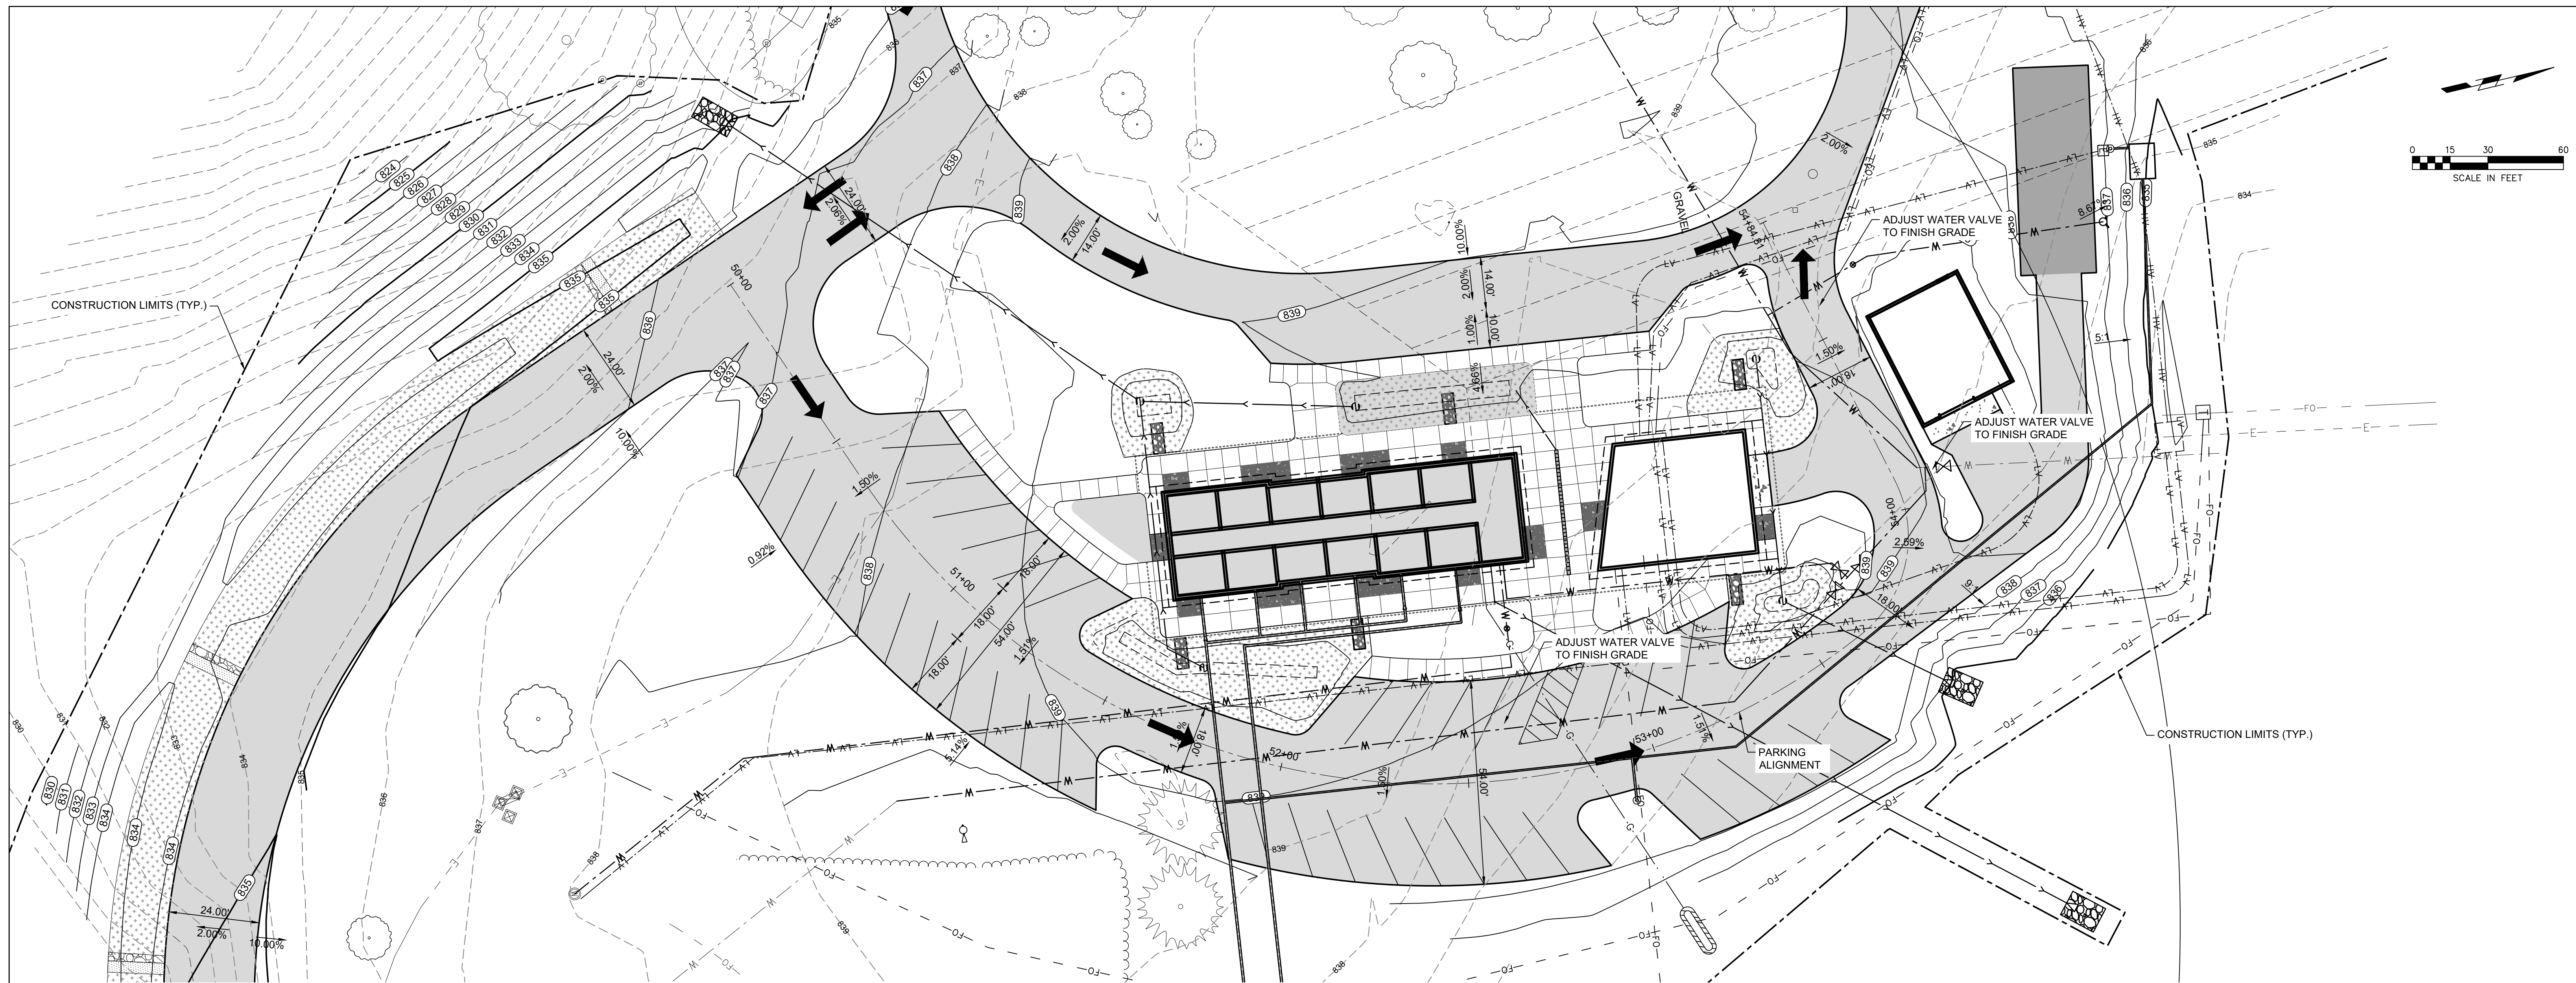



LEGEND



6" GRANULAR SUBBASE &
2 - 1/2" COURSES OF
BITUMINOUS SEAL COAT
(7" TOTAL)

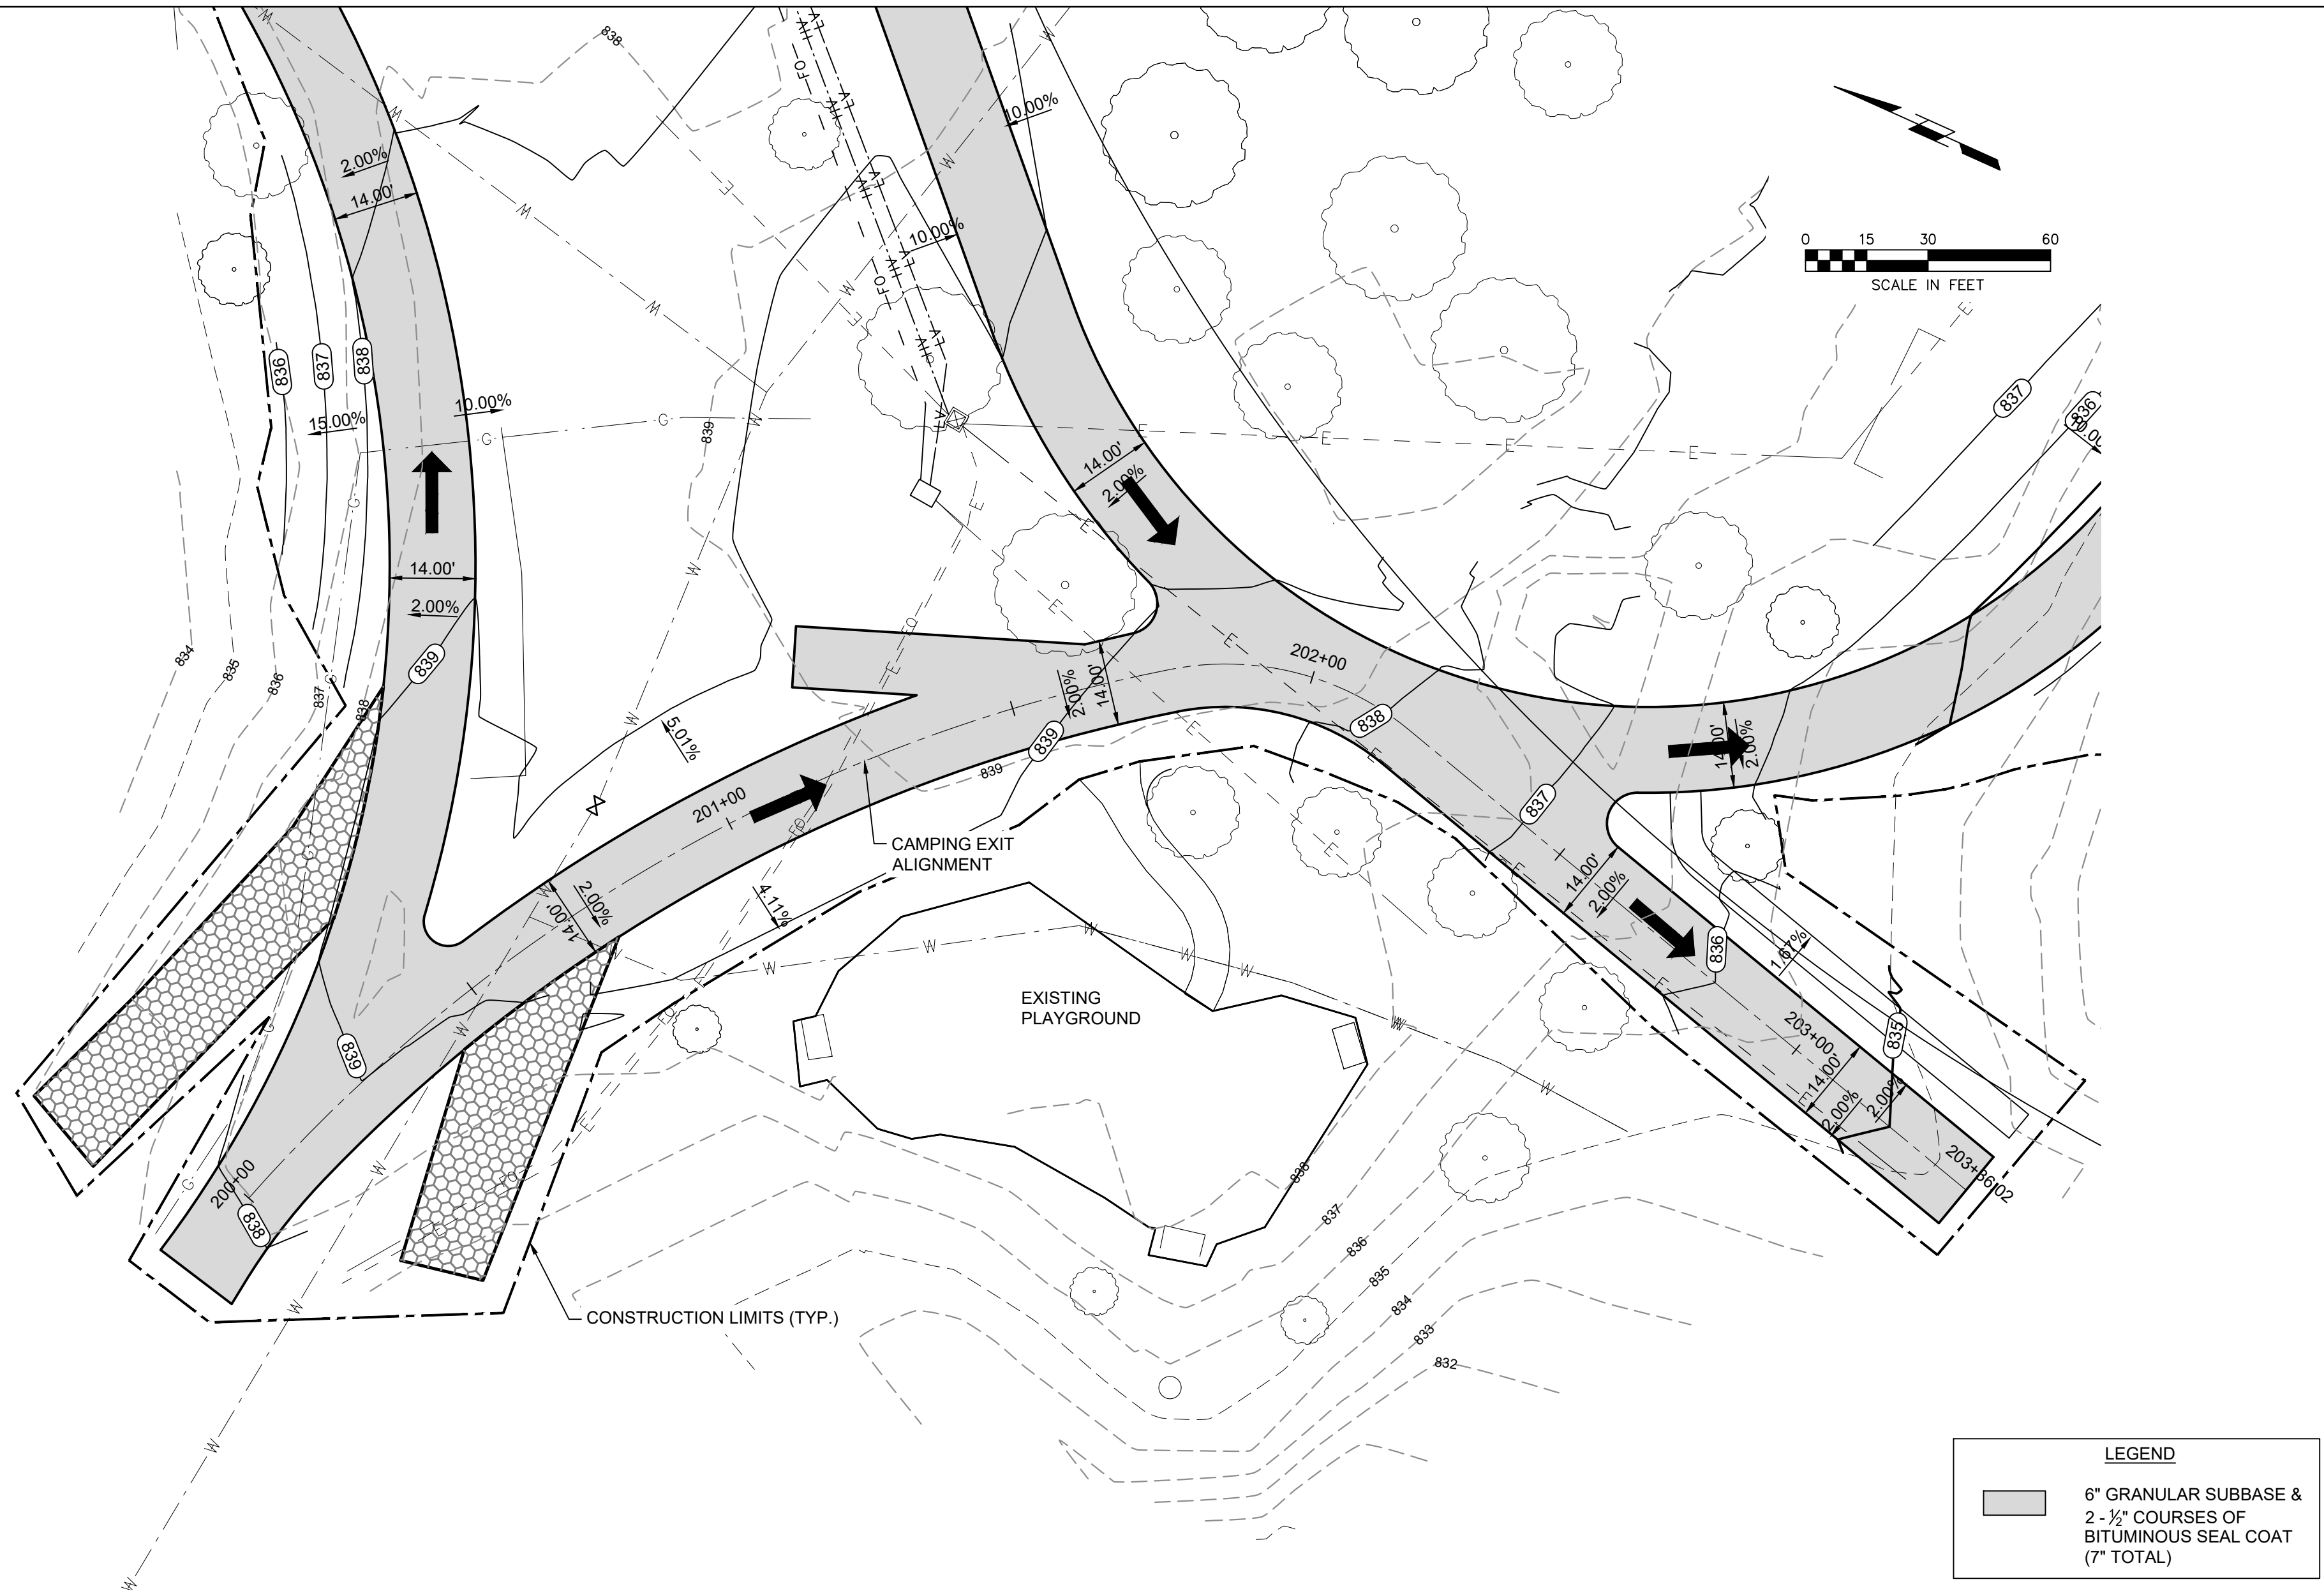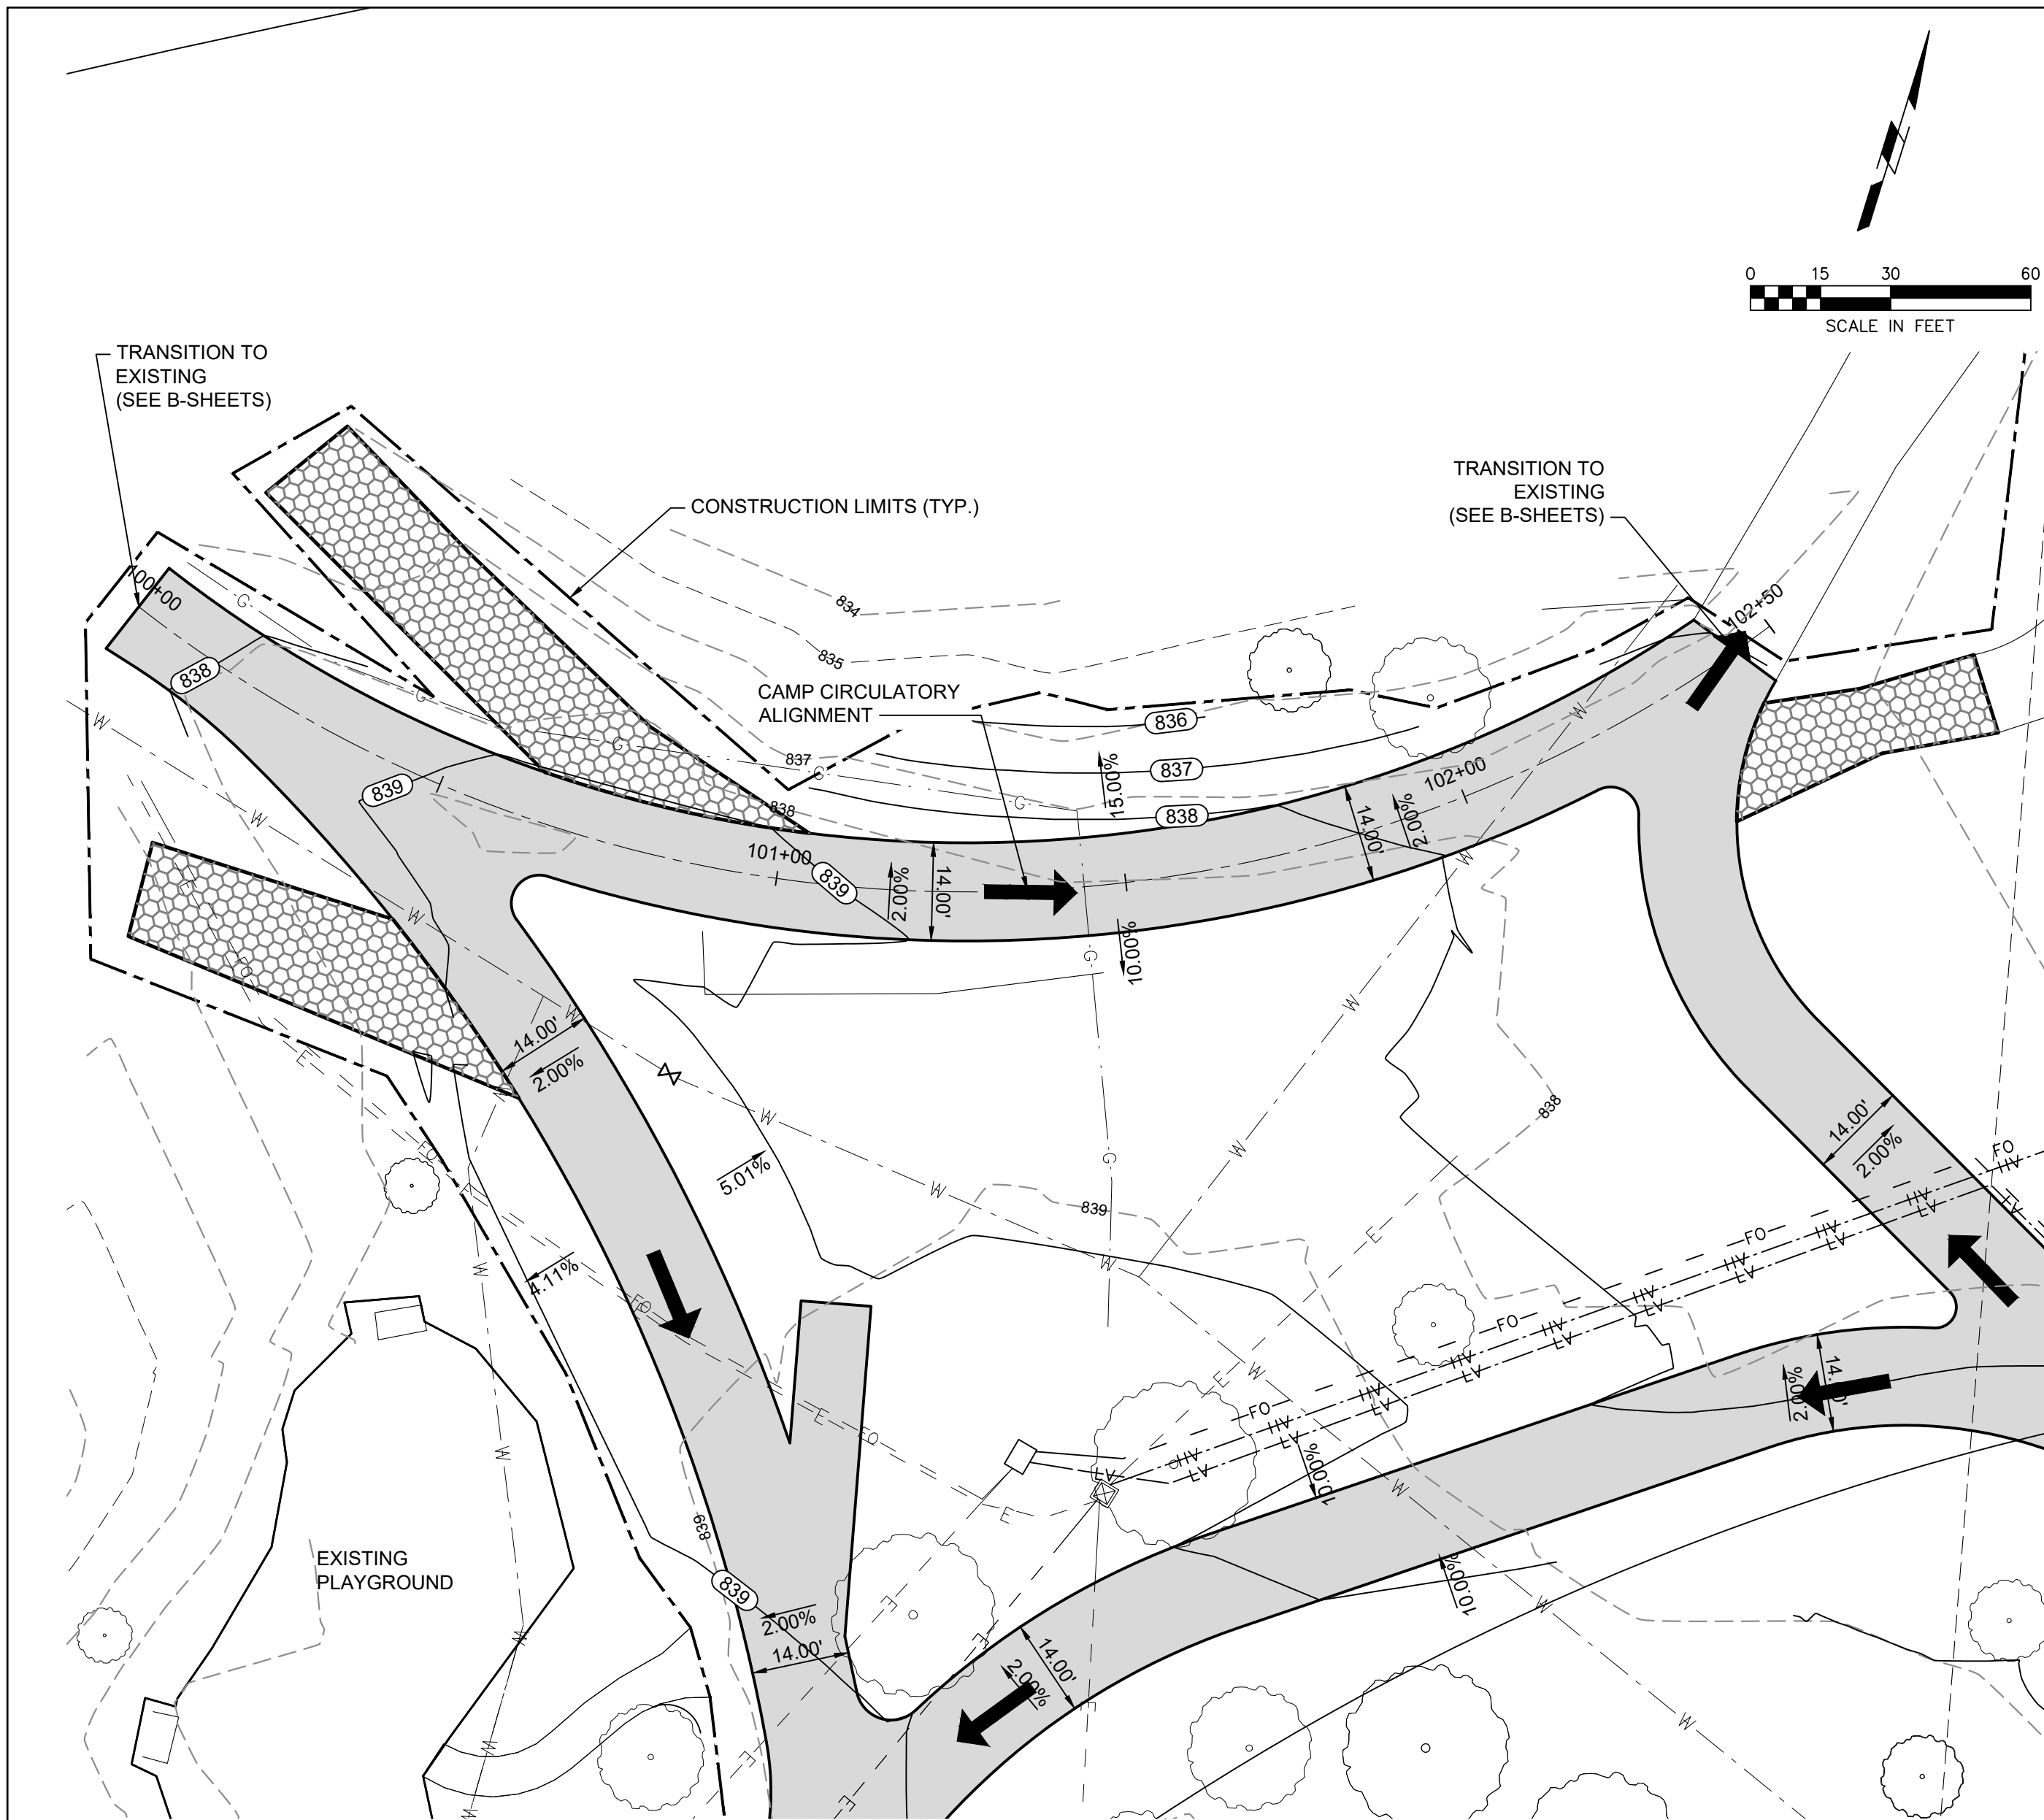

LEGEND


6" GRANULAR SUBBASE & 2 - 1/2" COURSES OF BITUMINOUS SEAL COAT (7" TOTAL)

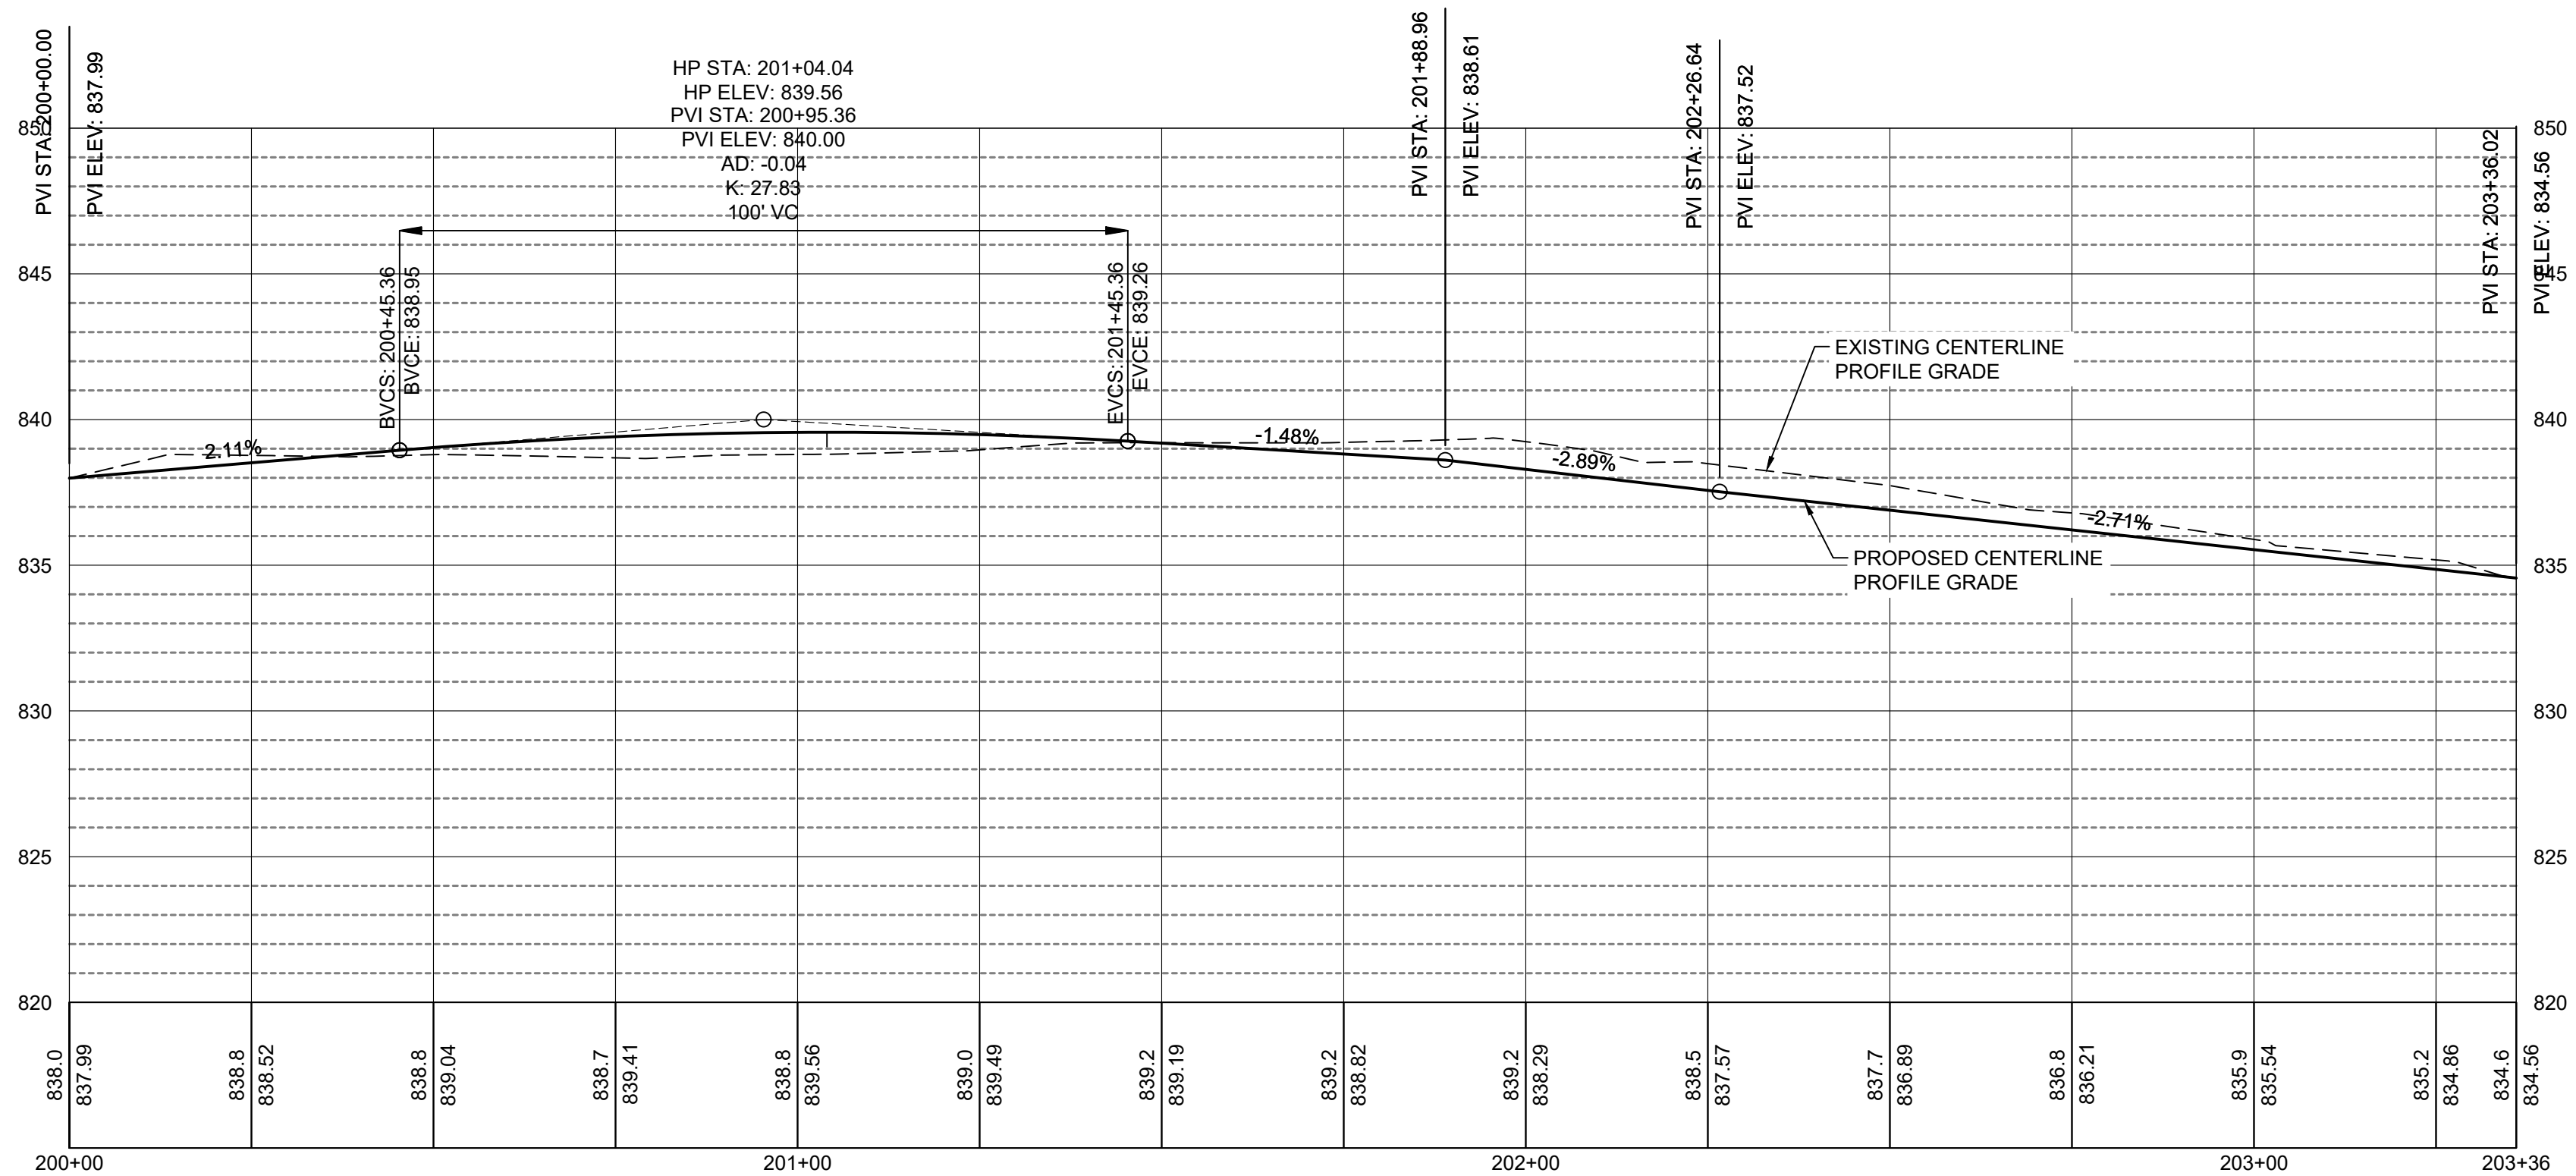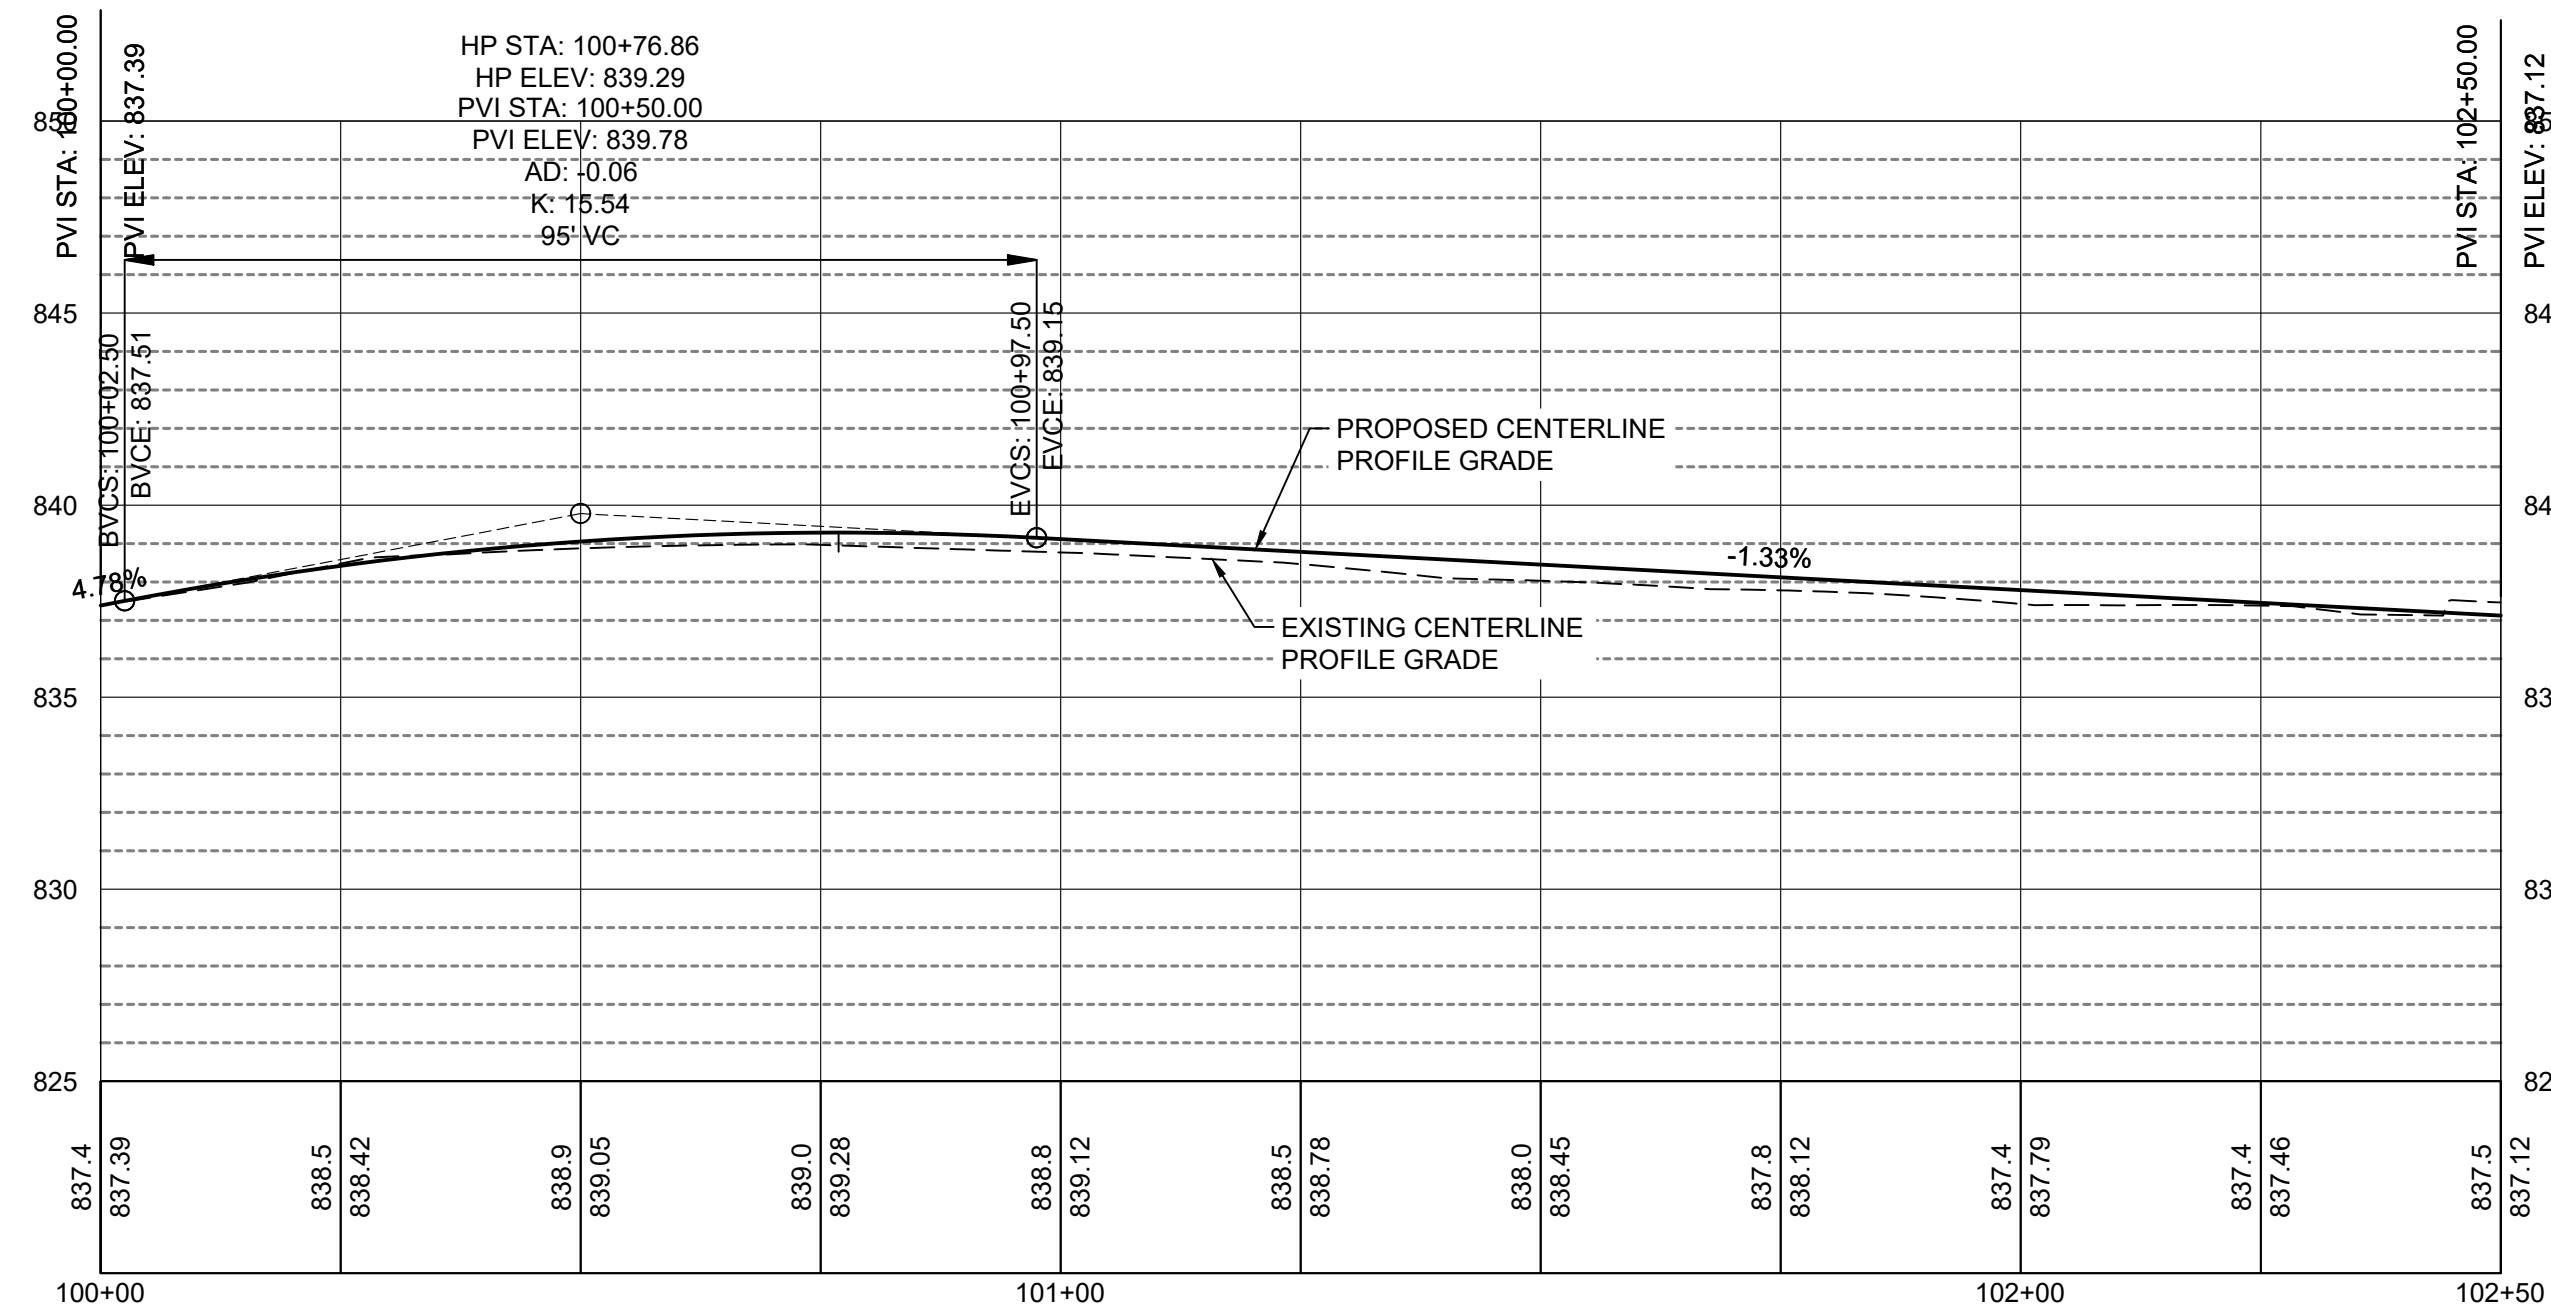

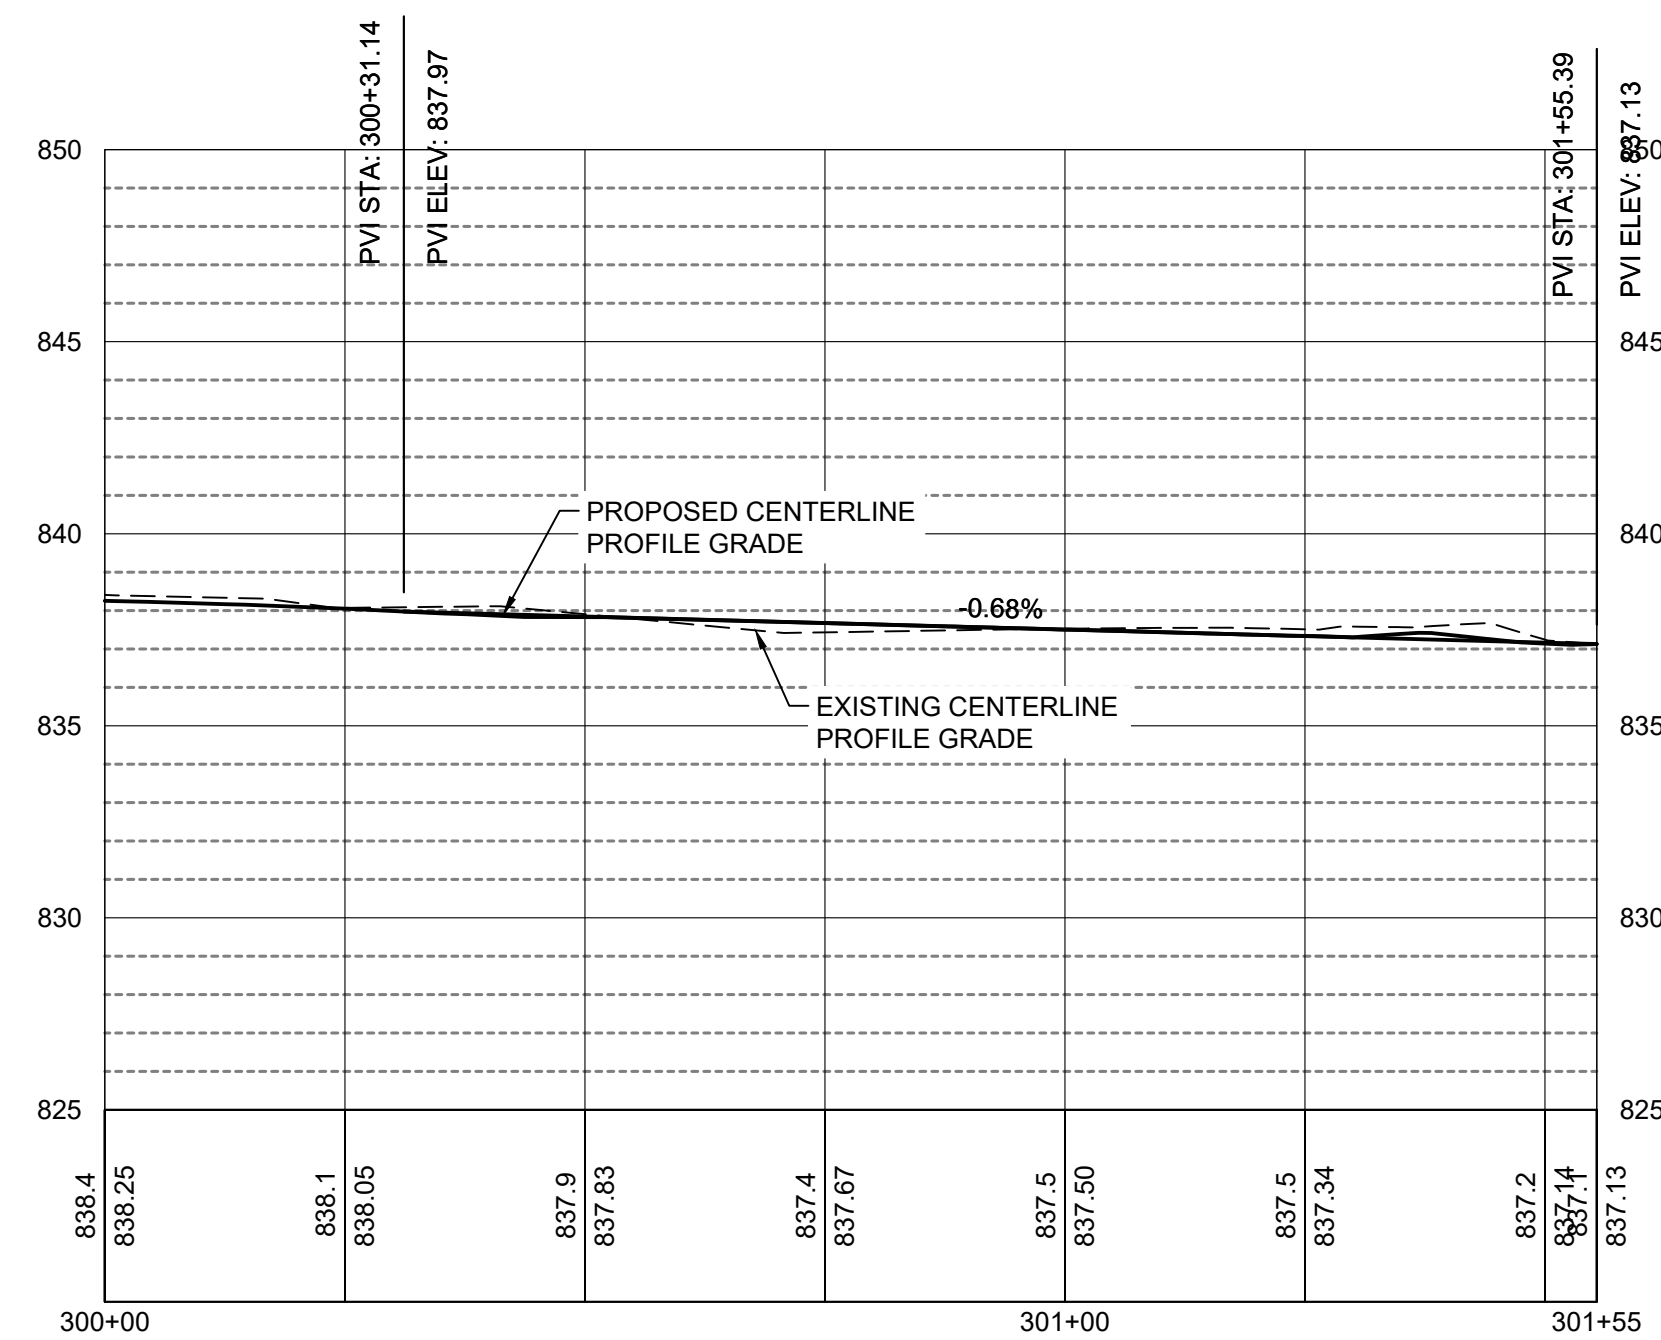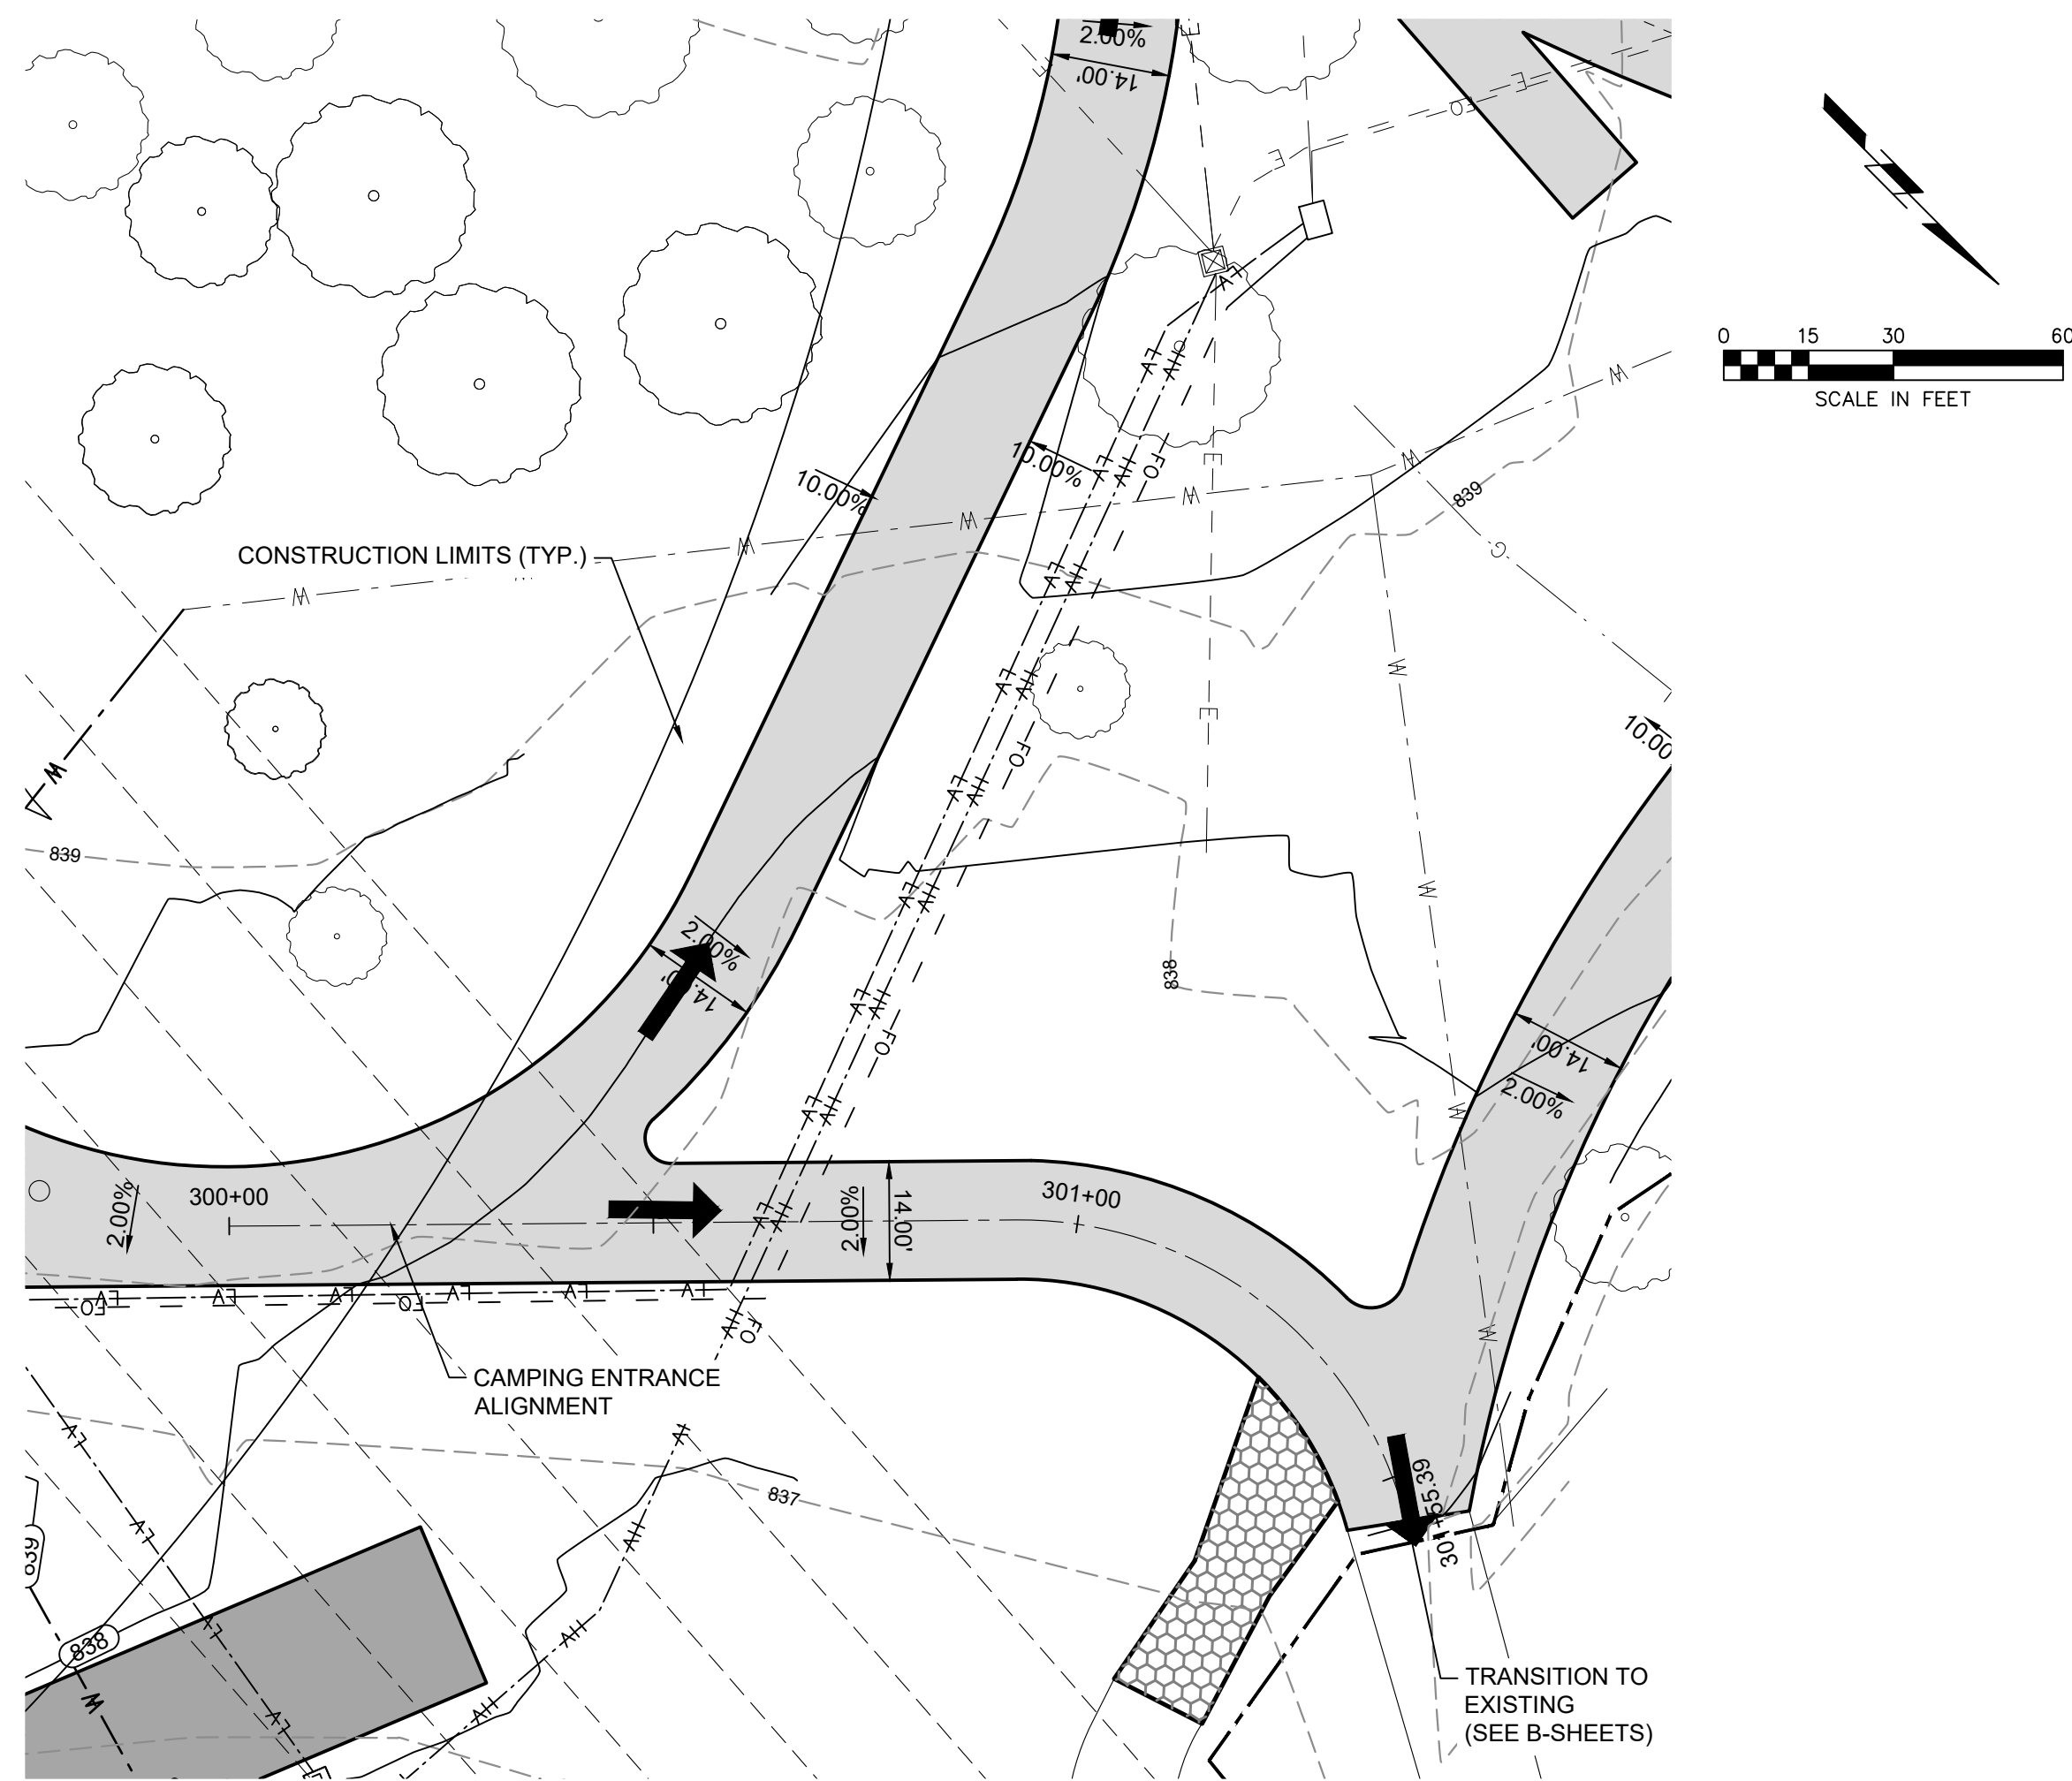

LEGEND

6" GRANULAR SUBBASE & 2 - ½" COURSES OF BITUMINOUS SEAL COAT (7" TOTAL)

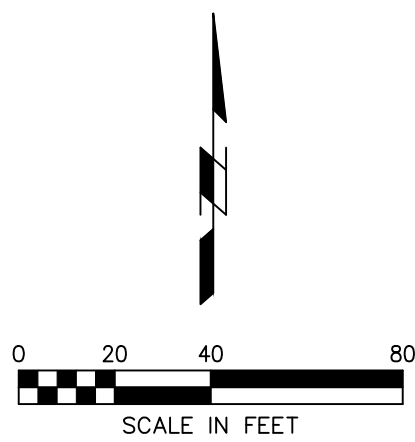

THE CONTRACTOR IS THE CO-APPLICANT FOR THE NPDES PERMIT AND IS REQUIRED TO DO ALL REQUIRED RECORD KEEPING. ALL RECORDS SHALL BE SUBMITTED TO THE OWNER'S REPRESENTATIVE AS THEY ARE PRODUCED.

SITE INFORMATION
TOTAL DISTURBED AREA: 8.69 AC

THE SEDIMENT CONTROLS IDENTIFIED ON THIS DRAWING MUST BE INSTALLED PRIOR TO SOIL-DISTURBING ACTIVITIES AND ARE TO REMAIN THROUGHOUT CONSTRUCTION. THESE ITEMS INCLUDE, BUT ARE NOT LIMITED TO, PERIMETER CONTROLS, STABILIZED CONSTRUCTION ENTRANCES, INTAKE PROTECTION, AREAS OF CONCENTRATED FLOW AND STOCKPILE PROTECTION.

SEED TYPE	PLANTING DATES
PERMANENT SEEDING	MARCH 1 - MAY 31 AUGUST 10 - SEPTEMBER 30
TEMPORARY SEEDING	JUNE 1 - AUGUST 9

NOTE:
1) ALL DISTURBED AREAS SHALL RECEIVE HYDROSEEDING
2) ALL SLOPES THAT EXCEED 25% SHALL SODDING

LEGEND

- PROJECT SITE/DISTURBED AREA
- INLET PROTECTION
- SILT FENCE SUDAS 9040.119 OR FILTER SOCKS SUDAS 9040.102 SHALL HAVE 'J' HOOKS AT MINIMUM 50' INCREMENTS
- STABILIZED CONSTRUCTION ENTRANCE/ EXIT SEE SUDAS 9040.120
- CONTRACTOR STAGING AREA FOR PORTABLE RESTROOM FACILITIES, TEMPORARY FUEL TANKS, WASTE CONTAINERS AND OTHER HAZARDOUS CHEMICALS. RELOCATE AS REQUIRED FOR CONSTRUCTION.
- TEMPORARY TOPSOIL STOCKPILE
- AMERICAN EXCELSIOR COMPANY CURLEX NETFEE TEMPORARY ROLLED EROSION CONTROL PRODUCT AREA = 1,955 SY
- CONCRETE, PAINT, AND GROUT WASHOUT AREA PER SUDAS SECT 11.050. CONTRACTOR TO HAUL OFF WASTE MATERIAL. SUGGESTED LOCATION. RELOCATE AS REQUIRED FOR CONSTRUCTION.
- SPILL KIT TO BE INSTALLED AND RELOCATED AS REQUIRED FOR CONSTRUCTION
- PORTABLE RESTROOM FACILITY LOCATION
- SWPPP DOCUMENT LOCATION
- EXISTING GRADE
- DIRECTION OF DRAINAGE

APPROXIMATE LOCATION OF EXISTING TOPSOIL STOCKPILE. CONTRACTOR TO USE THIS STOCKPILE LOCATION DURING CONSTRUCTION. WRAP STOCKPILE WITH 8" FILTER SOCK, TYP.

PROPOSED HOST PAD

PROPOSED FOOD SHED

PROPOSED STORAGE SHED

PROPOSED SHOWER HOUSE


CONTRACTOR TO DETERMINE PREFERRED LOCATION DURING EACH PHASE OF CONSTRUCTION. TYP. AFTER CONSTRUCTION, CONTRACTOR TO CLEAN THE SITE AND REMOVE ALL FOREIGN MATERIAL FROM THE SITE THAT IS NOT SPECIFIED TO REMAIN.

STORE SWPPP DOCUMENTS IN MAILBOX NEAR EDGE OF CONSTRUCTION OR WITHIN CONSTRUCTION TRAILER

INSTALL 12" COMPOST SOCK


INSTALL SILT FENCE PER SUDAS DETAIL 9040.119

INSTALL STABILIZED CONSTRUCTION ENTRANCE PER SUDAS DETAIL 9040.120

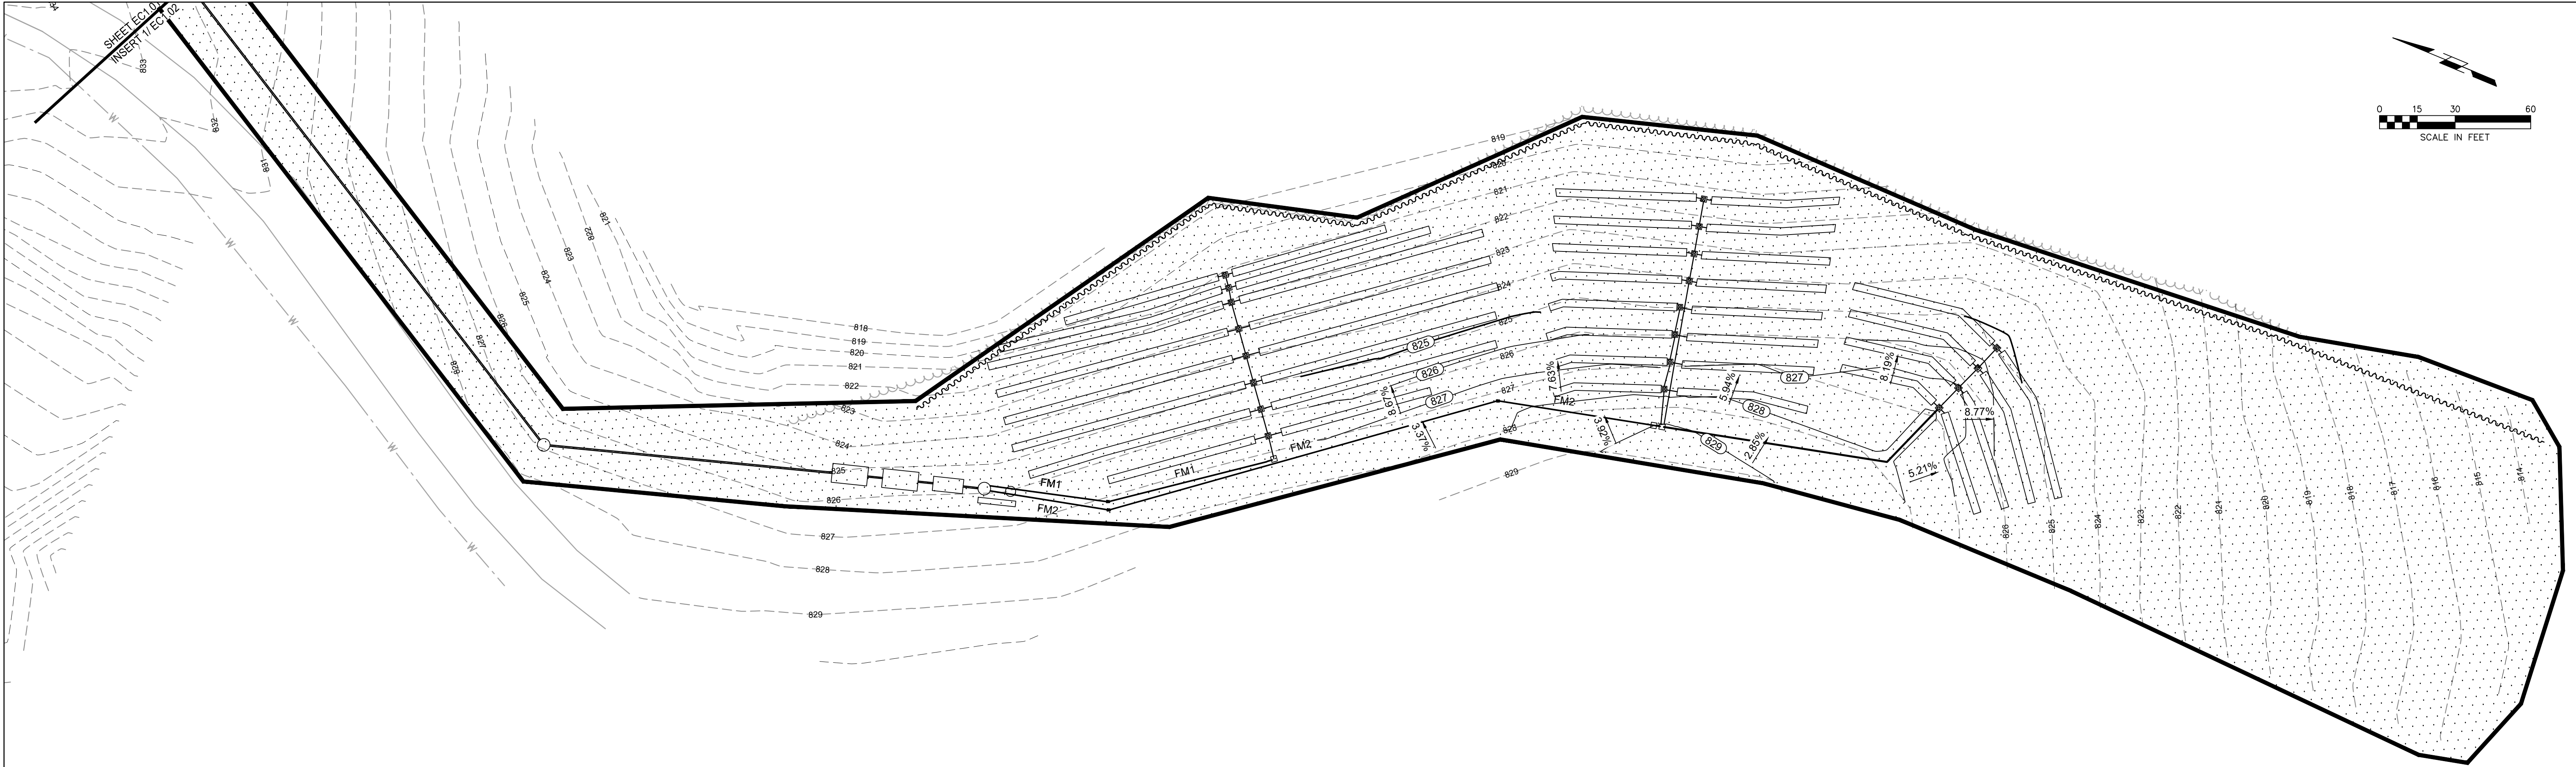

1 INSERT 1 - SEPTIC SYSTEM #1
1" = 30'



LEGEND	
	PROJECT SITE/DISTURBED AREA
	INLET PROTECTION
	SILT FENCE SUDAS 9040.119 OR FILTER SOCKS SUDAS 9040.102 SHALL HAVE 'J' HOOKS AT MINIMUM 50' INCREMENTS
	STABILIZED CONSTRUCTION ENTRANCE/ EXIT SEE SUDAS 9040.120
	CONTRACTOR STAGING AREA FOR PORTABLE RESTROOM FACILITIES, TEMPORARY FUEL TANKS, WASTE CONTAINERS AND OTHER HAZARDOUS CHEMICALS. RELOCATE AS REQUIRED FOR CONSTRUCTION.
	TEMPORARY TOPSOIL STOCKPILE
	AMERICAN EXCELSIOR COMPANY CURLEX NETFREE TEMPORARY ROLLED EROSION CONTROL PRODUCT
	CONCRETE, PAINT, AND GROUT WASHOUT AREA PER SUDAS SECT 11.050. CONTRACTOR TO HAUL OFF WASTE MATERIAL. SUGGESTED LOCATION. RELOCATE AS REQUIRED FOR CONSTRUCTION.
	SPILL KIT TO BE INSTALLED AND RELOCATED AS REQUIRED FOR CONSTRUCTION
	PORTABLE RESTROOM FACILITY LOCATION
	SWPPP DOCUMENT LOCATION
	EXISTING GRADE
	DIRECTION OF DRAINAGE


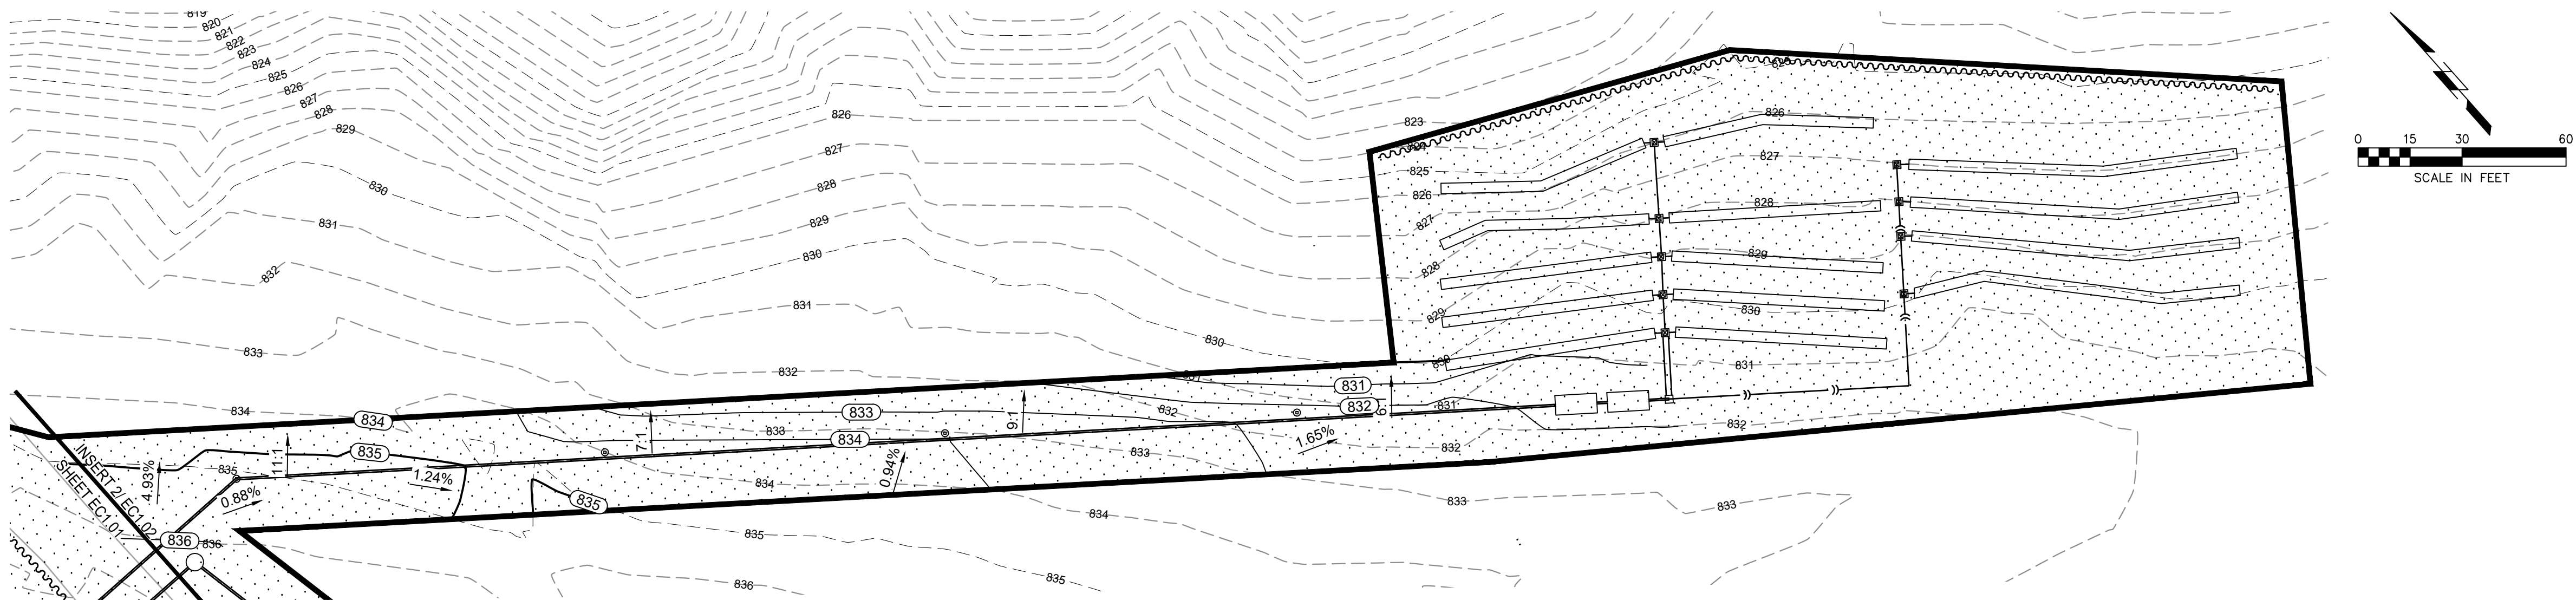


2 INSERT 2 - SEPTIC SYSTEM #2
1" = 30'

STORMWATER POLLUTION PREVENTION NOTES

- | | | | | |
|--|--|--|--|---|
| 1. EROSION/ SEDIMENTATION CONTROL MEASURES SHOULD BE INSTALLED BEFORE EARTH DISTURBING ACTIVITIES BEGIN AND ARE REQUIRED REGARDLESS OF THE TIME OF YEAR. THIS PLAN AND ITS ASSOCIATED REQUIREMENTS FOR THE PERMIT MUST BE IMPLEMENTED DURING WINTER MONTHS AS WELL. | 6. IF AFTER REPEATED FAILURE ON THE PART OF THE CONTRACTOR TO PROPERLY CONTROL SOIL EROSION, SEDIMENT AND/OR POLLUTION FROM THE PROJECT SITE, THE GOVERNING AUTHORITIES RESERVE THE RIGHT TO EFFECT NECESSARY CORRECTIVE MEASURES AND CHARGE ANY COSTS TO THE CONTRACTOR. | 12. CONSTRUCTION ACCESS POINTS TO THE SITE SHALL BE PROTECTED IN SUCH A WAY AS TO PREVENT TRACKING OF MUD OR SOIL ONTO PUBLIC THOROUGHFARES. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED IMMEDIATELY BY THE CONTRACTOR. | 18. SANITARY WASTE DISPOSAL: PORTABLE REST ROOM FACILITIES ARE ANTICIPATED TO BE PLACED ON-SITE. IN THE EVENT THAT PORTABLE REST ROOM FACILITIES ARE USED ON-SITE, THE CONTRACTOR IS REQUIRED TO INSTALL AN EROSION CONTROL DEVICE AROUND THE FACILITY TO MINIMIZE THE RADIUS OF THE AFFECTED ZONE IN THE EVENT OF A SPILL. WASTES SHALL BE COLLECTED AND DISPOSED OF IN COMPLETE COMPLIANCE WITH LOCAL, STATE AND FEDERAL REGULATIONS. PORTABLE RESTROOM FACILITIES MUST NOT BE LOCATED NEAR DRAINAGE WAYS AND SHALL BE STAKED INTO THE GROUND. | (IF USING FILTER SOCKS, STACK TWO (2) TALL). CONTRACTOR TO HAUL OFF ALL WASTE MATERIAL. ALL LOCATIONS OF CONCRETE, PAINT AND GROUT WASHOUT AREAS MUST BE PROVIDED BY THE CONTRACTOR AND IDENTIFIED ON THE PLAN (RELOCATE AS REQUIRED FOR CONSTRUCTION). THE CONTRACTOR IS REQUIRED TO INSTALL A SIGN THAT DESIGNATES THE WASHOUT AREA. |
| 2. IT IS THE CONTRACTOR'S RESPONSIBILITY TO CONTROL EROSION/SEDIMENTATION ON THE SITE AT ALL TIMES. THE CONTROL MEASURES SHOWN ON THE PLAN ARE A MINIMUM. THE CONTRACTOR SHALL PROVIDE ADDITIONAL EROSION/SEDIMENTATION CONTROL MEASURES AS NECESSARY TO FULFILL THIS REQUIREMENT. CONTRACTOR IS REQUIRED TO MAINTAIN SWPPP DOCUMENTATION. | 7. ALL BMPs AND CONTROLS SHALL CONFORM TO THE APPLICABLE FEDERAL, STATE, OR LOCAL REQUIREMENTS, STANDARDS, AND SPECIFICATIONS OR MANUAL OF PRACTICE. | 13. MAINTAIN SILT FENCING AT ALL TIMES IN AN UPRIGHT POSITION. CLEAN SILT FROM FENCING ON A REGULAR BASIS AS PER THE STANDARD SPECIFICATIONS. SILT FENCES <u>MUST</u> BE CLEANED OUT WHEN THEY ARE 50% FULL. | 19. IDENTIFICATION OF ALLOWABLE NON-STORMWATER DISCHARGES: DURING CONSTRUCTION, WHICH INCLUDES WATER FLUSHED FROM WATER LINES, PAVEMENT AND EQUIPMENT WASHING, AND GROUNDWATER (DEWATERING), SHOULD BE FILTERED WITH APPROPRIATE METHODS AND DIRECTED AWAY FROM DRAINAGE WAY. | 22. SPILL KIT: A SPILL KIT IS REQUIRED TO BE ON-SITE AND LOCATION NOTED ON THE STORMWATER POLLUTION PREVENTION PLAN. THE SPILL KIT SHOULD BE DESIGNED TO DEAL WITH ANY HAZARDOUS MATERIALS ON-SITE. |
| 3. THE CONTRACTOR IS REQUIRED TO USE STABILIZATION CONTROLS FOR AREAS THAT WILL NOT BE REDISTURBED FOR 14 DAYS OR MORE. STABILIZATION MEASURES WILL BE IMPLEMENTED IMMEDIATELY AFTER CONSTRUCTION ACTIVITY HAS CEASED IN THAT AREA. STABILIZATION MEASURES ARE REQUIRED TO PREVENT BOTH SEDIMENTATION AND EROSION. THE CONTRACTOR IS STRONGLY ENCOURAGED TO PROVIDE STABILIZATION CONTROLS FOR ALL DISTURBED AREAS ON SITE REGARDLESS OF THE TIME PERIOD BEFORE THEY WILL BE DISTURBED AGAIN. THE CONTRACTOR SHALL SEED DISTURBED AREAS AS SOON AS WORK IS COMPLETED AS INDICATED ON THE PLANS AND PROJECT MANUAL. | 8. ALL BMPs AND CONTROLS INSTALLED ON GREEN INFRASTRUCTURE SHALL REMAIN UNTIL STABILIZATION IS APPROVED BY THE OWNER. | 14. CONTRACTOR TO LOCATE/ RELOCATE SILT FENCING/ FILTER SOCKS AS NECESSARY THROUGHOUT THE PROJECT TO CONTROL EROSION/SEDIMENTATION. SILT FENCE INSTALLATION IS TO FOLLOW SUDAS 9040.119. FILTER SOCK INSTALLATION IS TO FOLLOW SUDAS 9040.102. | 20. POLLUTION AND SPILL PREVENTION PLANNING: POTENTIALLY HAZARDOUS MATERIALS ON THE CONSTRUCTION SITE INCLUDE FUEL, LUBRICANTS, CURING COMPOUNDS, FERTILIZERS, GREASE AND CLEANING SOLVENTS. ALL REASONABLE PRECAUTIONS WILL BE TAKEN TO PREVENT SPILLS. ANY SPILLED MATERIAL WILL IMMEDIATELY BE DIRECTED AWAY FROM STORM WATER INTAKES, DETENTION BASINS, OR DRAINAGE WAYS. SPILLED MATERIALS WILL BE CLEANED AND, IF NECESSARY, SOIL REMEDIATION PRACTICES WILL BE USED, A RECORD OF SPILLS WILL BE MAINTAINED BY THE MAIN CONTRACTOR. | 23. DUST CONTROL: THE CONTRACTOR SHALL IMPLEMENT DUST CONTROL MEASURES WHERE DUST IS GENERATED. FREQUENT WATERING OF THE SITE, SPRINKLED, VEGETATIVE COVER, MULCH, WINDBREAKS, TILLAGE, STONE AND SPRAY-ON CHEMICAL SOIL TREATMENTS (PALLIATIVES) ARE POSSIBLE DUST CONTROL MEASURES. IF THE DUST CONTROL IS NOT ACCEPTABLE IT SHALL BE CHANGED AS DIRECTED BY THE OWNER'S REPRESENTATIVE. |
| 4. THE CONTRACTOR SHALL USE CONTROL MEASURES AS REQUIRED TO KEEP SOILS FROM LEAVING THE SITE. | 9. IN THE EVENT THAT SOILS LEAVE THE SITE, CLEANUP OF ALL SURROUNDING ROADS, DRIVES, AND PARKING LOTS SHALL BE PERFORMED ON A DAILY BASIS AT A MINIMUM AND UPON REQUEST BY OWNER'S REPRESENTATIVE AT NO ADDITIONAL COST. PAVEMENT IS TO BE SCRAPPED OF DEBRIS AND MUD AND BROOMED CLEAN. MUD TRACKS ARE TO BE REMOVED AS THEY ARE CREATED. | 15. REMOVE ALL TEMPORARY EROSION/SEDIMENTATION CONTROLS NOT CALLED OUT TO REMAIN AFTER SITE HAS BEEN STABILIZED AND APPROVED BY THE OWNER'S REPRESENTATIVE. OWNER WILL REMOVE SILT FENCE AFTER SITE HAS STABILIZED. | 21. CONCRETE, PAINT AND GROUT WASHOUT AREA: THE WASHOUT AREA SHOULD BE AN APPROVED CONCRETE WASHOUT CONTAINER, COLLECTION BAG, OR WASHOUT BOX PER SUDAS 11.050. PROTECT WITH AN EROSION CONTROL DEVICE | 24. STOCKPILED MATERIALS: CONTRACTOR TO IDENTIFY ALL LOCATIONS OF STOCKPILED MATERIALS ON THE STORMWATER POLLUTION PREVENTION PLAN. CONTRACTOR SHALL PROVIDE ALL EROSION/SEDIMENTATION CONTROLS AS REQUIRED TO CONTAIN MATERIALS ON-SITE. AT A MINIMUM, THE CONTRACTOR IS REQUIRED TO PROVIDE SILT FENCE/FILTER SOCKS AROUND STOCKPILED SOILS BEFORE STOCKPILE IS RE-SPREAD. IF STOCKPILE SOILS WILL REMAIN INACTIVE FOR 14 DAYS OR MORE, THEY SHALL BE SEEDED OR TARPED BY THE CONTRACTOR. |
| 5. CONTRACTOR SHALL IMPLEMENT SITE SPECIFIC BEST MANAGEMENT PRACTICES (BMPs) AS SHOWN AND REQUIRED BY THE SWPPP/SECC. ADDITIONAL BEST MANAGEMENT PRACTICES SHALL BE IMPLEMENTED BY THE CONTRACTOR AS DICTATED BY SITE CONDITIONS OR THE PROJECT GOVERNING AUTHORITIES AT | 10. IF DURING CONSTRUCTION OPERATIONS ANY LOOSE MATERIALS ARE DEPOSITED IN THE FLOW LINE OF GUTTERS, DRAINAGE STRUCTURES, OR DITCHES SUCH THAT THE NATURAL FLOW LINE OF WATER IS OBSTRUCTED, THIS LOOSE MATERIAL SHALL BE REMOVED. | 16. CONTRACTOR TO USE EXTREME CAUTION WHILE INSTALLING SILT FENCE OR OTHER EROSION CONTROL DEVICES SO AS NOT TO DAMAGE UNDERGROUND UTILITIES. | | 25. THE CONTRACTOR SHALL AMEND THE SWPPP WHENEVER THERE IS A CHANGE IN DESIGN, CONSTRUCTION, OPERATION OR MAINTENANCE OF A STORMWATER BMP. |
| | 11. ALL SEDIMENT SHALL BE PREVENTED FROM ENTERING ANY EXISTING STORM DRAINAGE SYSTEMS BY THE USE OF INLET PROTECTION OR OTHER APPROVED FUNCTIONAL METHODS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR | 17. EROSION CONTROL BLANKETS SHALL BE USED IN AREAS OF 4:1 SLOPE OR STEEPER AND ANY AREAS STABILIZED IN THE FALL FOR OVERWINTERING. OWNER WILL FURNISH AND INSTALL ALL EROSION CONTROL BLANKET AND SEEDING | | |

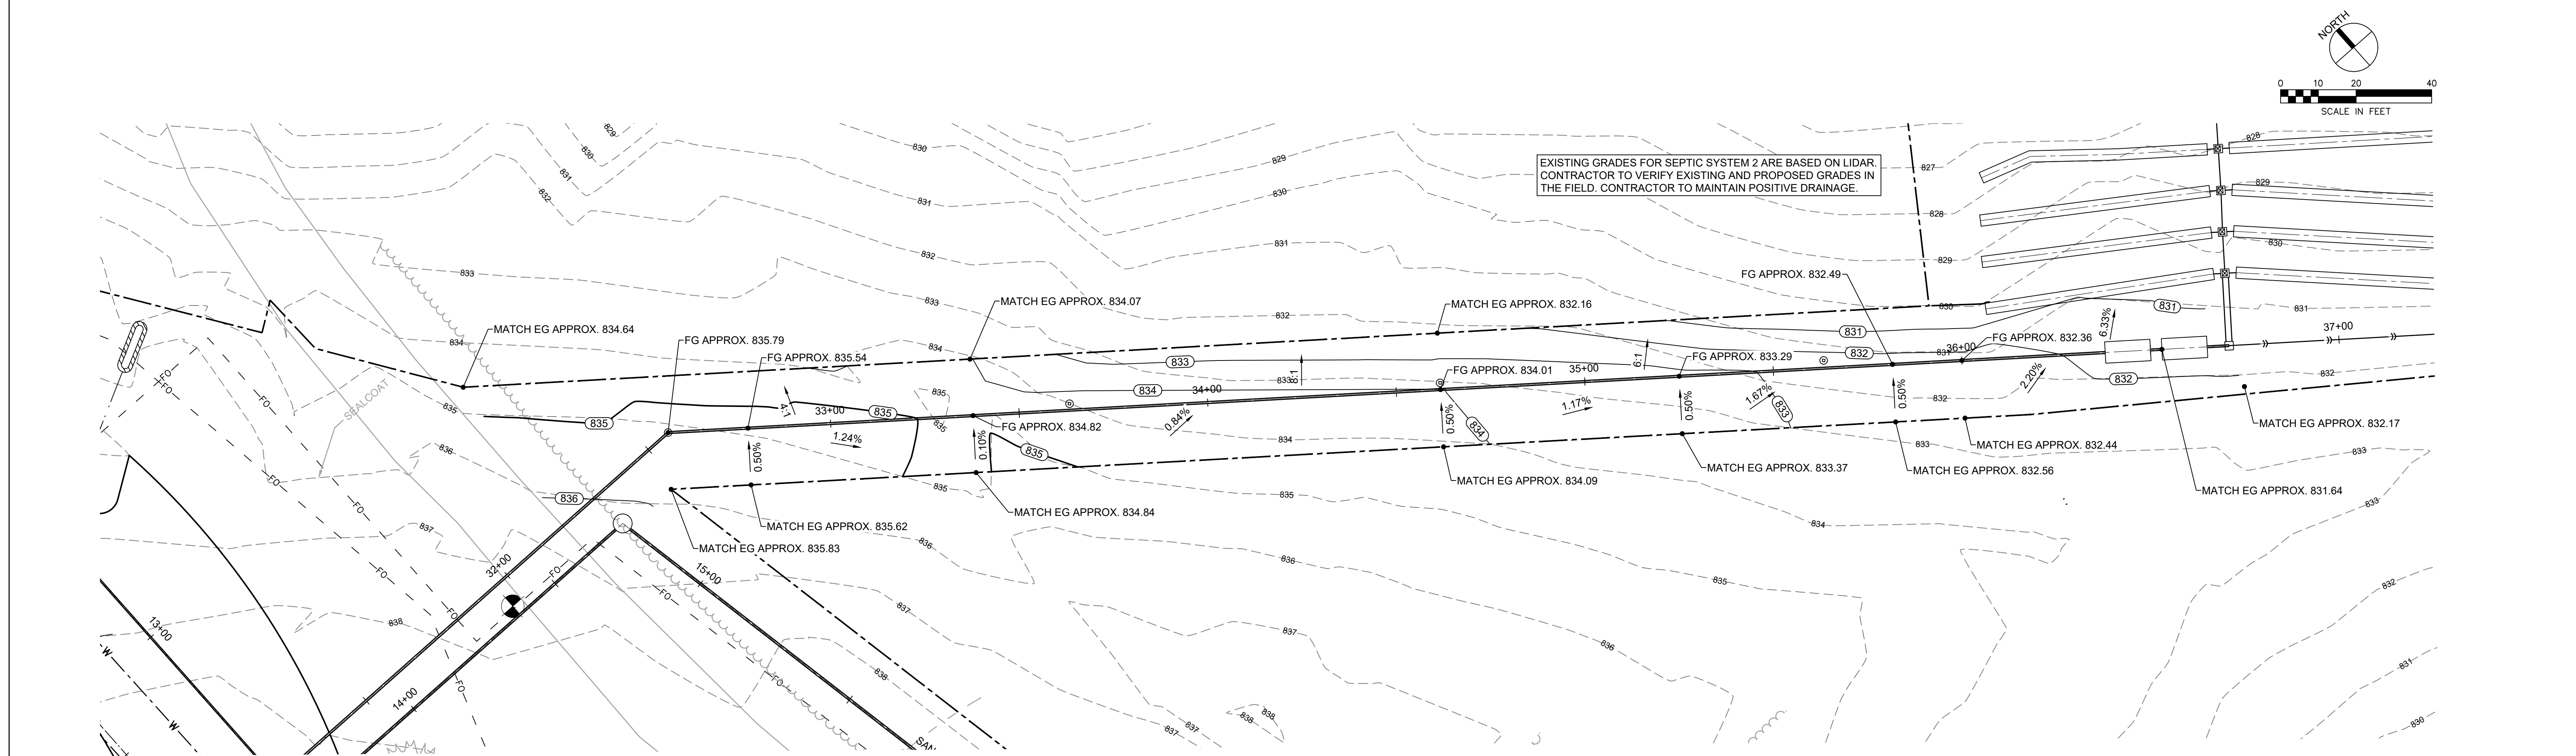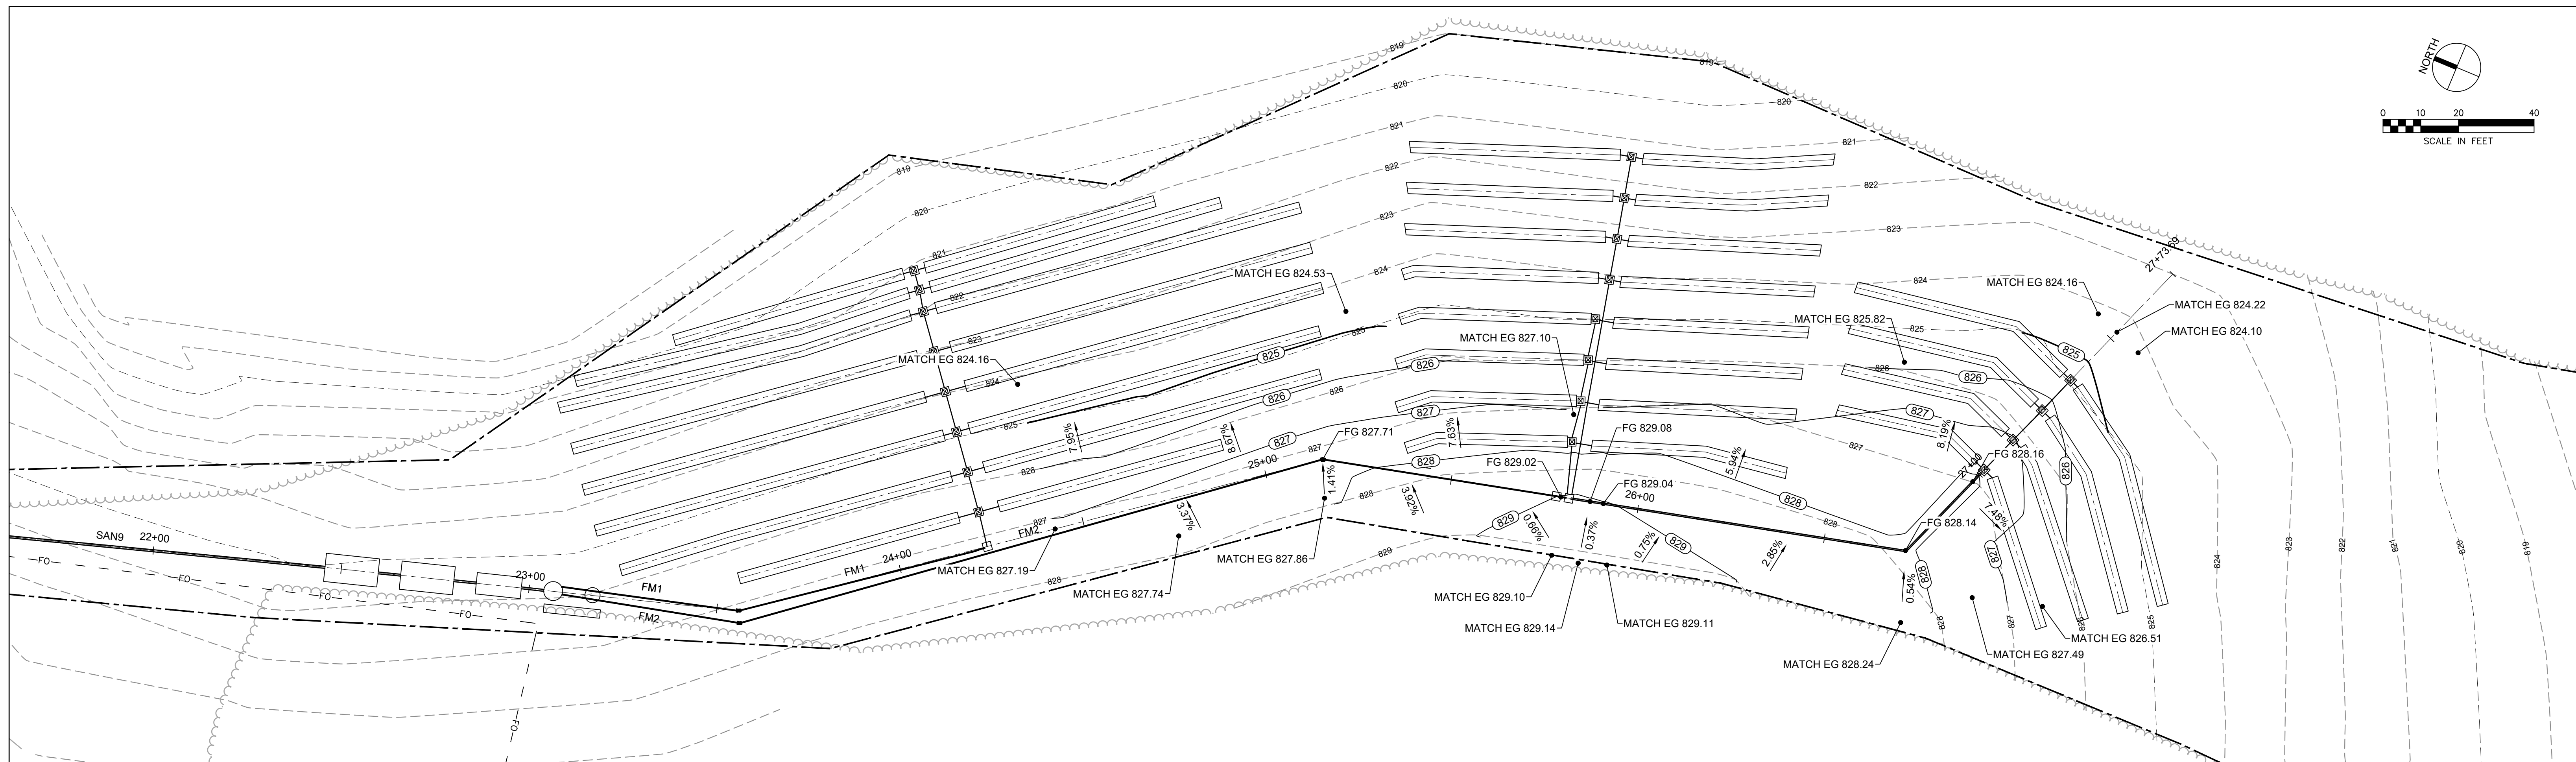

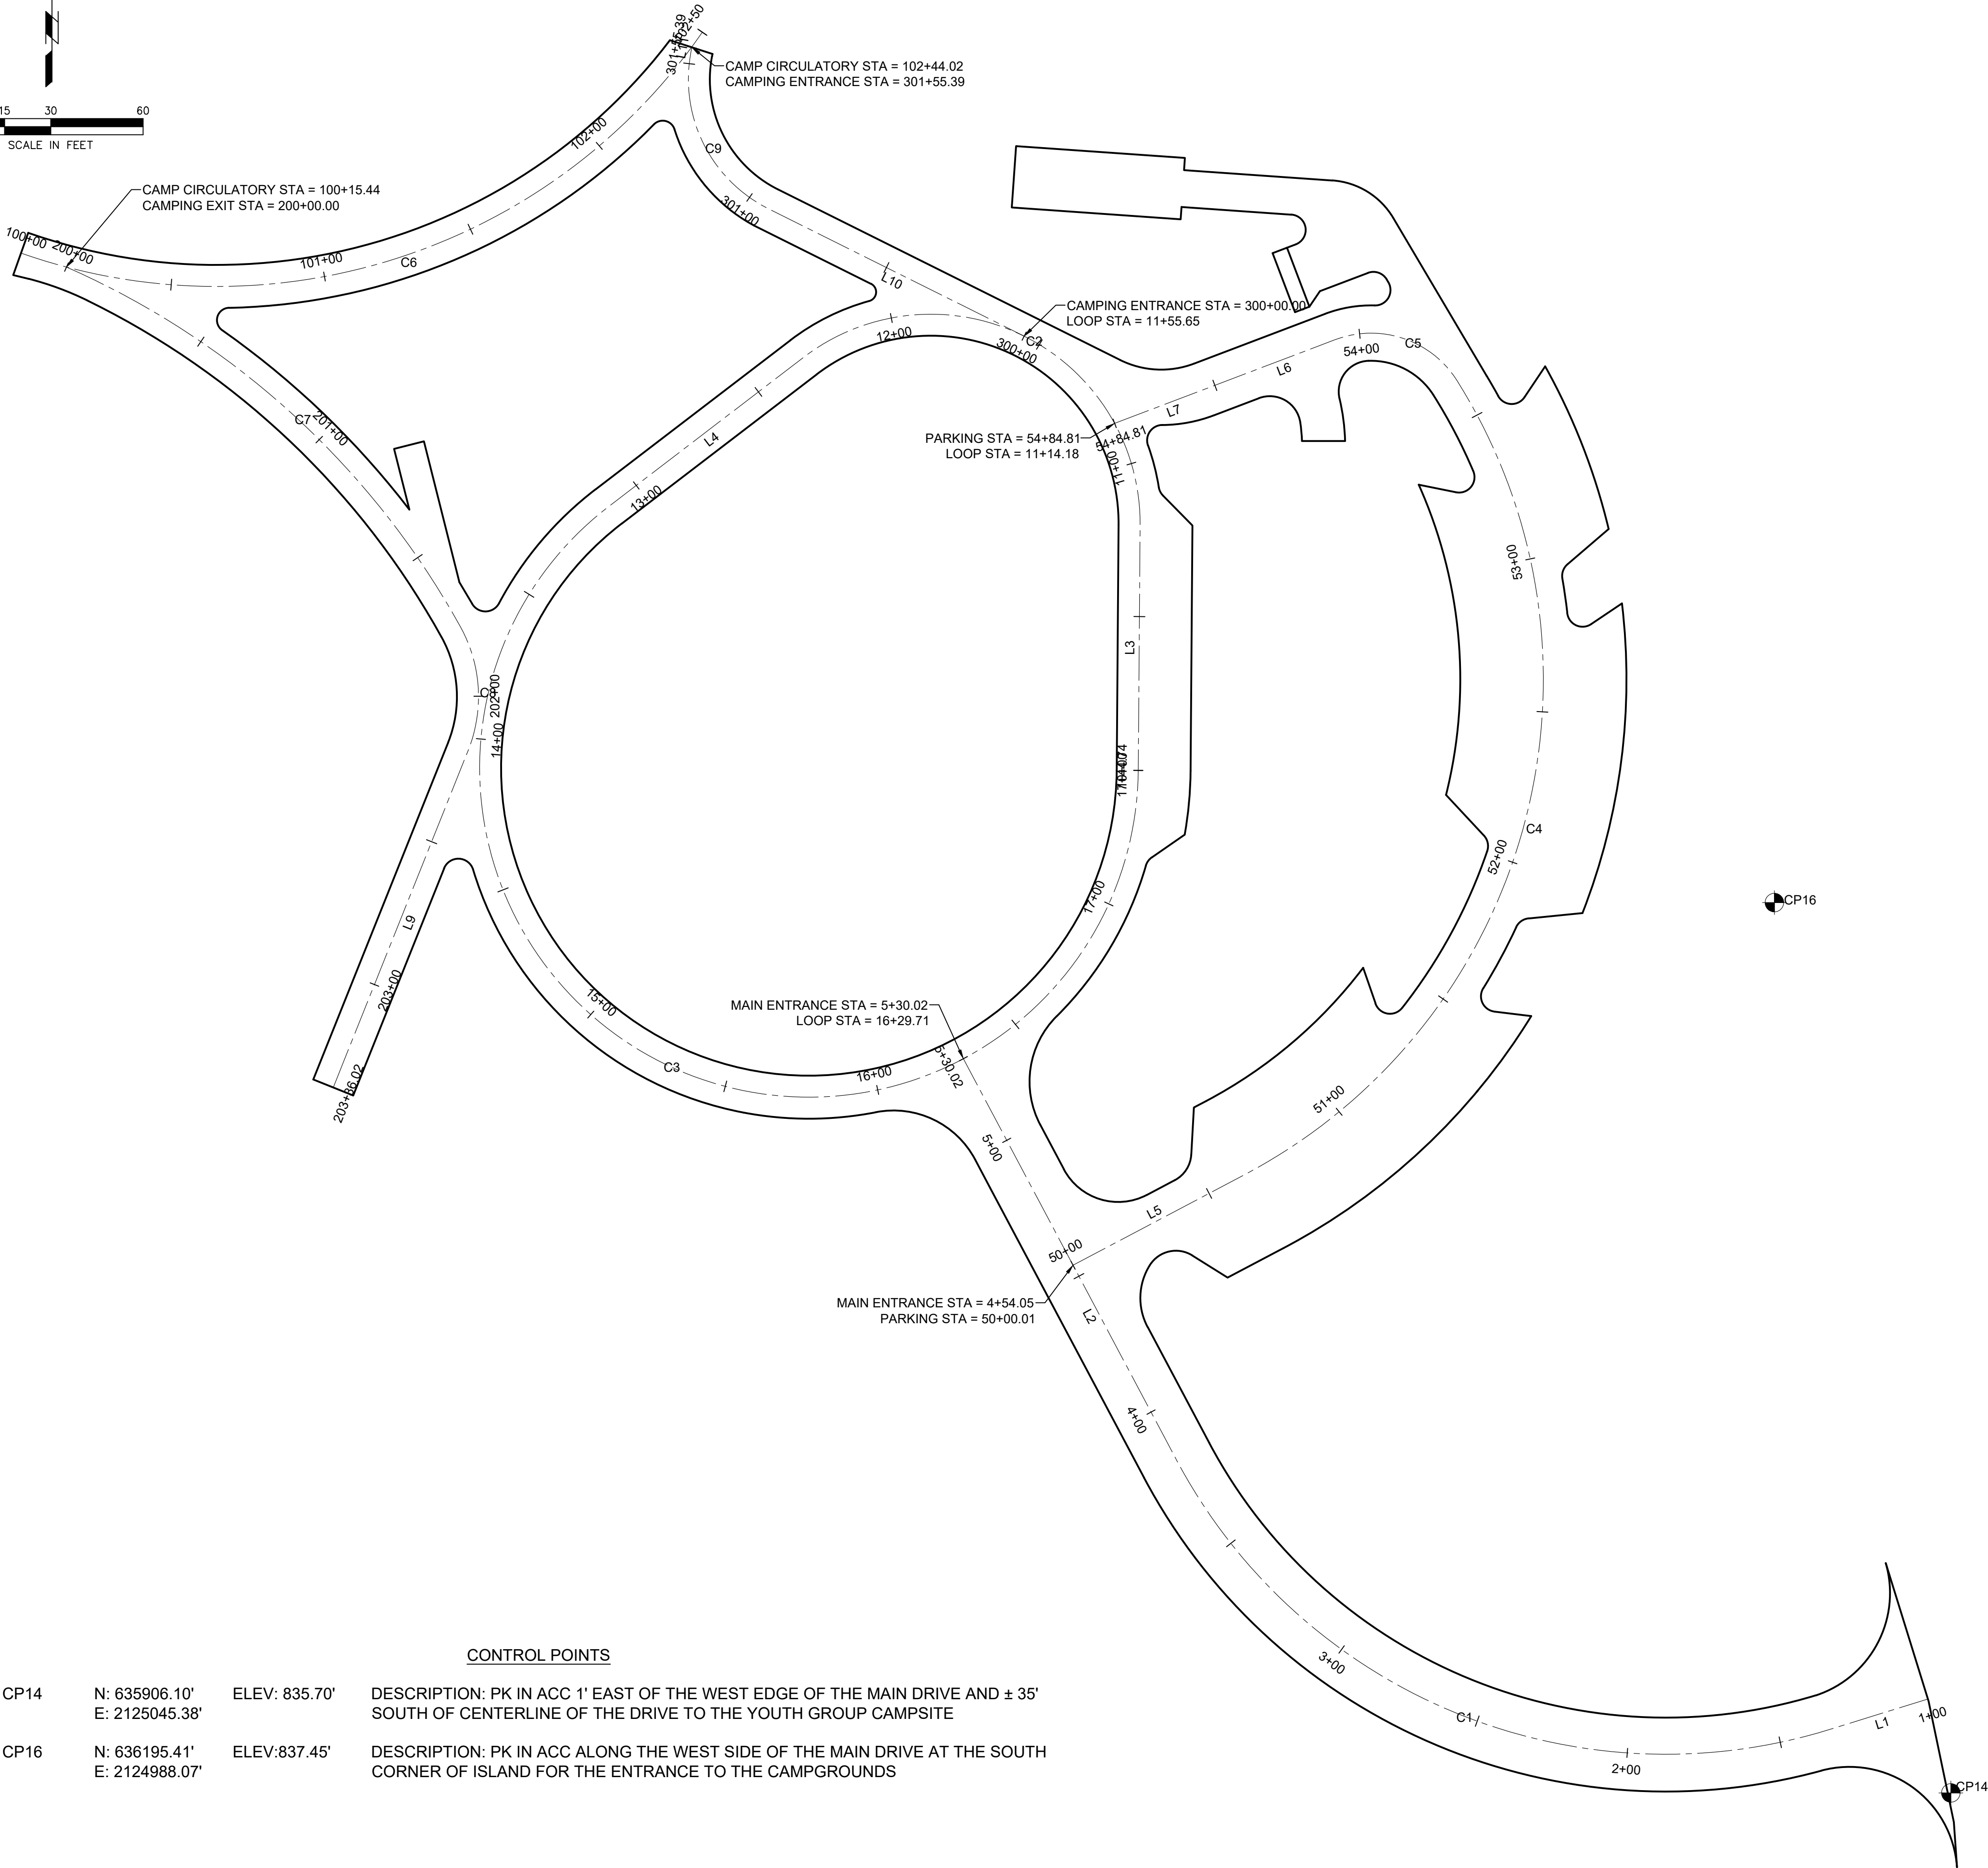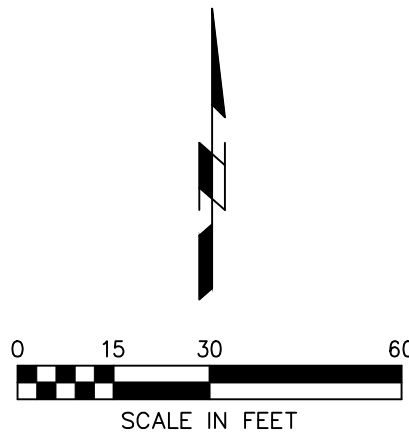

CONTROL POINTS

CP14	N: 635906.10' E: 2125045.38'	ELEV: 835.70'	DESCRIPTION: PK IN ACC 1' EAST OF THE WEST EDGE OF THE MAIN DRIVE AND ± 35' SOUTH OF CENTERLINE OF THE DRIVE TO THE YOUTH GROUP CAMPSITE
CP16	N: 636195.41' E: 2124988.07'	ELEV: 837.45'	DESCRIPTION: PK IN ACC ALONG THE WEST SIDE OF THE MAIN DRIVE AT THE SOUTH CORNER OF ISLAND FOR THE ENTRANCE TO THE CAMPGROUNDS

MAIN ENTRANCE ALIGNMENT						
SEGMENT #	LENGTH	RADIUS	LINE/CHORD DIRECTION	DELTA (Δ)	START POINT	END POINT
L1	33.30'		S72° 45' 37.89"W		N = 635936.63 E = 2125037.93	N = 635926.76 E = 2125006.13
C1	249.03'	180.00'	N67° 36' 15.81"W	79° 16' 12.60"	N = 635926.76 E = 2125006.13	N = 636014.25 E = 2124793.81
L2	147.69'		N27° 58' 09.50"W		N = 636014.25 E = 2124793.81	N = 636144.69 E = 2124724.54

LOOP ALIGNMENT						
SEGMENT #	LENGTH	RADIUS	LINE/CHORD DIRECTION	DELTA (Δ)	START POINT	END POINT
L3	79.74'		N00° 26' 20.18"E		N = 636238.37 E = 2124781.36	N = 636318.11 E = 2124781.97
C2	151.76'	68.00'	N63° 29' 52.53"W	127° 52' 25.42"	N = 636318.11 E = 2124781.97	N = 636372.63 E = 2124672.64
L4	79.74'		S52° 33' 54.76"W		N = 636372.63 E = 2124672.64	N = 636324.16 E = 2124609.32
C3	433.50'	107.00'	S63° 29' 52.53"E	232° 07' 34.58"	N = 636324.16 E = 2124609.32	N = 636238.37 E = 2124781.36

PARKING ALIGNMENT						
SEGMENT #	LENGTH	RADIUS	LINE/CHORD DIRECTION	DELTA (Δ)	START POINT	END POINT
L5	63.06'		N62° 10' 35.52"E		N = 636077.59 E = 2124760.16	N = 636107.02 E = 2124815.93
C4	299.94'	182.00'	N14° 57' 53.39"E	94° 25' 24.26"	N = 636107.02 E = 2124815.93	N = 636365.09 E = 2124884.91
C5	45.23'	33.00'	N71° 30' 50.55"W	78° 32' 03.62"	N = 636365.09 E = 2124884.91	N = 636378.34 E = 2124845.29
L8	157.66'		N81° 22' 29.10"E		N = 637443.83 E = 2125081.85	N = 637467.48 E = 2125237.73
L6	37.53'		S69° 13' 07.65"W		N = 636378.34 E = 2124845.29	N = 636365.02 E = 2124810.21
L7	39.06'		S69° 13' 07.65"W		N = 636365.02 E = 2124810.21	N = 636351.16 E = 2124773.69

CAMP CIRCULATORY ALIGNMENT						
SEGMENT #	LENGTH	RADIUS	LINE/CHORD DIRECTION	DELTA (Δ)	START POINT	END POINT
C6	250.00'	192.00'	N72° 01' 37.64"E	74° 36' 13.97"	N = 636406.47 E = 2124418.37	N = 636478.28 E = 2124639.73

CAMPING ENTRANCE ALIGNMENT						
SEGMENT #	LENGTH	RADIUS	LINE/CHORD DIRECTION	DELTA (Δ)	START POINT	END POINT
L10	92.81'		N63° 30' 31.86"W		N = 636379.50 E = 2124744.29	N = 636420.90 E = 2124661.22
C9	60.85'	47.00'	N26° 25' 11.79"W	74° 10' 40.13"	N = 636420.90 E = 2124661.22	N = 636471.66 E = 2124636.00
L11	1.73'		N10° 40' 08.28"E		N = 636471.66 E = 2124636.00	N = 636473.36 E = 2124636.32

CAMPING EXIT ALIGNMENT						
SEGMENT #	LENGTH	RADIUS	LINE/CHORD DIRECTION	DELTA (Δ)	START POINT	END POINT
C7	176.44'	271.00'	S47° 35' 53.26"E	37° 18' 09.90"	N = 636401.95 E = 2124433.13	N = 636285.06 E = 2124561.13
C8	41.64'	47.00'	S03° 33' 58.34"E	50° 45' 39.93"	N = 636285.06 E = 2124561.13	N = 636244.85 E = 2124563.63
L9	117.94'		S21° 48' 51.63"W		N = 636244.85 E = 2124563.63	N = 636135.36 E = 2124519.80



LEGEND



- PHASE 1 CAMP ACCESS
- PHASE 2 CAMP ACCESS
- PHASE 3 CAMP ACCESS





- MAJOR WORK ITEMS PER PHASE:
- PHASE 1:
 - BUILDING DEMOLITION
 - UTILITY REMOVAL
 - INSTALL WATER LINE
 - PROPOSED CAMP ENTRANCE
 - PROPOSED ROADS USED IN PHASE 2
 - PHASE 2:
 - SITE GRADING
 - SUBBASE & PAVEMENT PREP
 - REMOVE EXISTING ENTRANCE
 - REMOVE EXISTING ROADS
 - PHASE 3:
 - BUILDINGS
 - PARKING LOT
 - SIDEWALKS
 - REMAINING PAVING

GENERAL NOTES:
1. CONTRACTOR TO PROVIDE MINIMUM 7 BUSINESS DAY NOTICE TO OWNER PRIOR TO ANY ACCESS OR UTILITY DISRUPTIONS/CLOSURES.

CONSTRUCTION ACCESS DURING PHASE 2 & 3 OF CONSTRUCTION. PUBLIC ACCESS TO CAMPGROUND DURING PHASE 1 OF CONSTRUCTION. PUBLIC ACCESS AND CONSTRUCTION ACCESS TO BE SEPARATE LOCATIONS.



CONSTRUCTION ACCESS DURING PHASE 1 OF CONSTRUCTION. PUBLIC ACCESS TO CAMPGROUND DURING PHASE 2 & 3 OF CONSTRUCTION. PUBLIC ACCESS AND CONSTRUCTION ACCESS TO BE SEPARATE LOCATIONS.

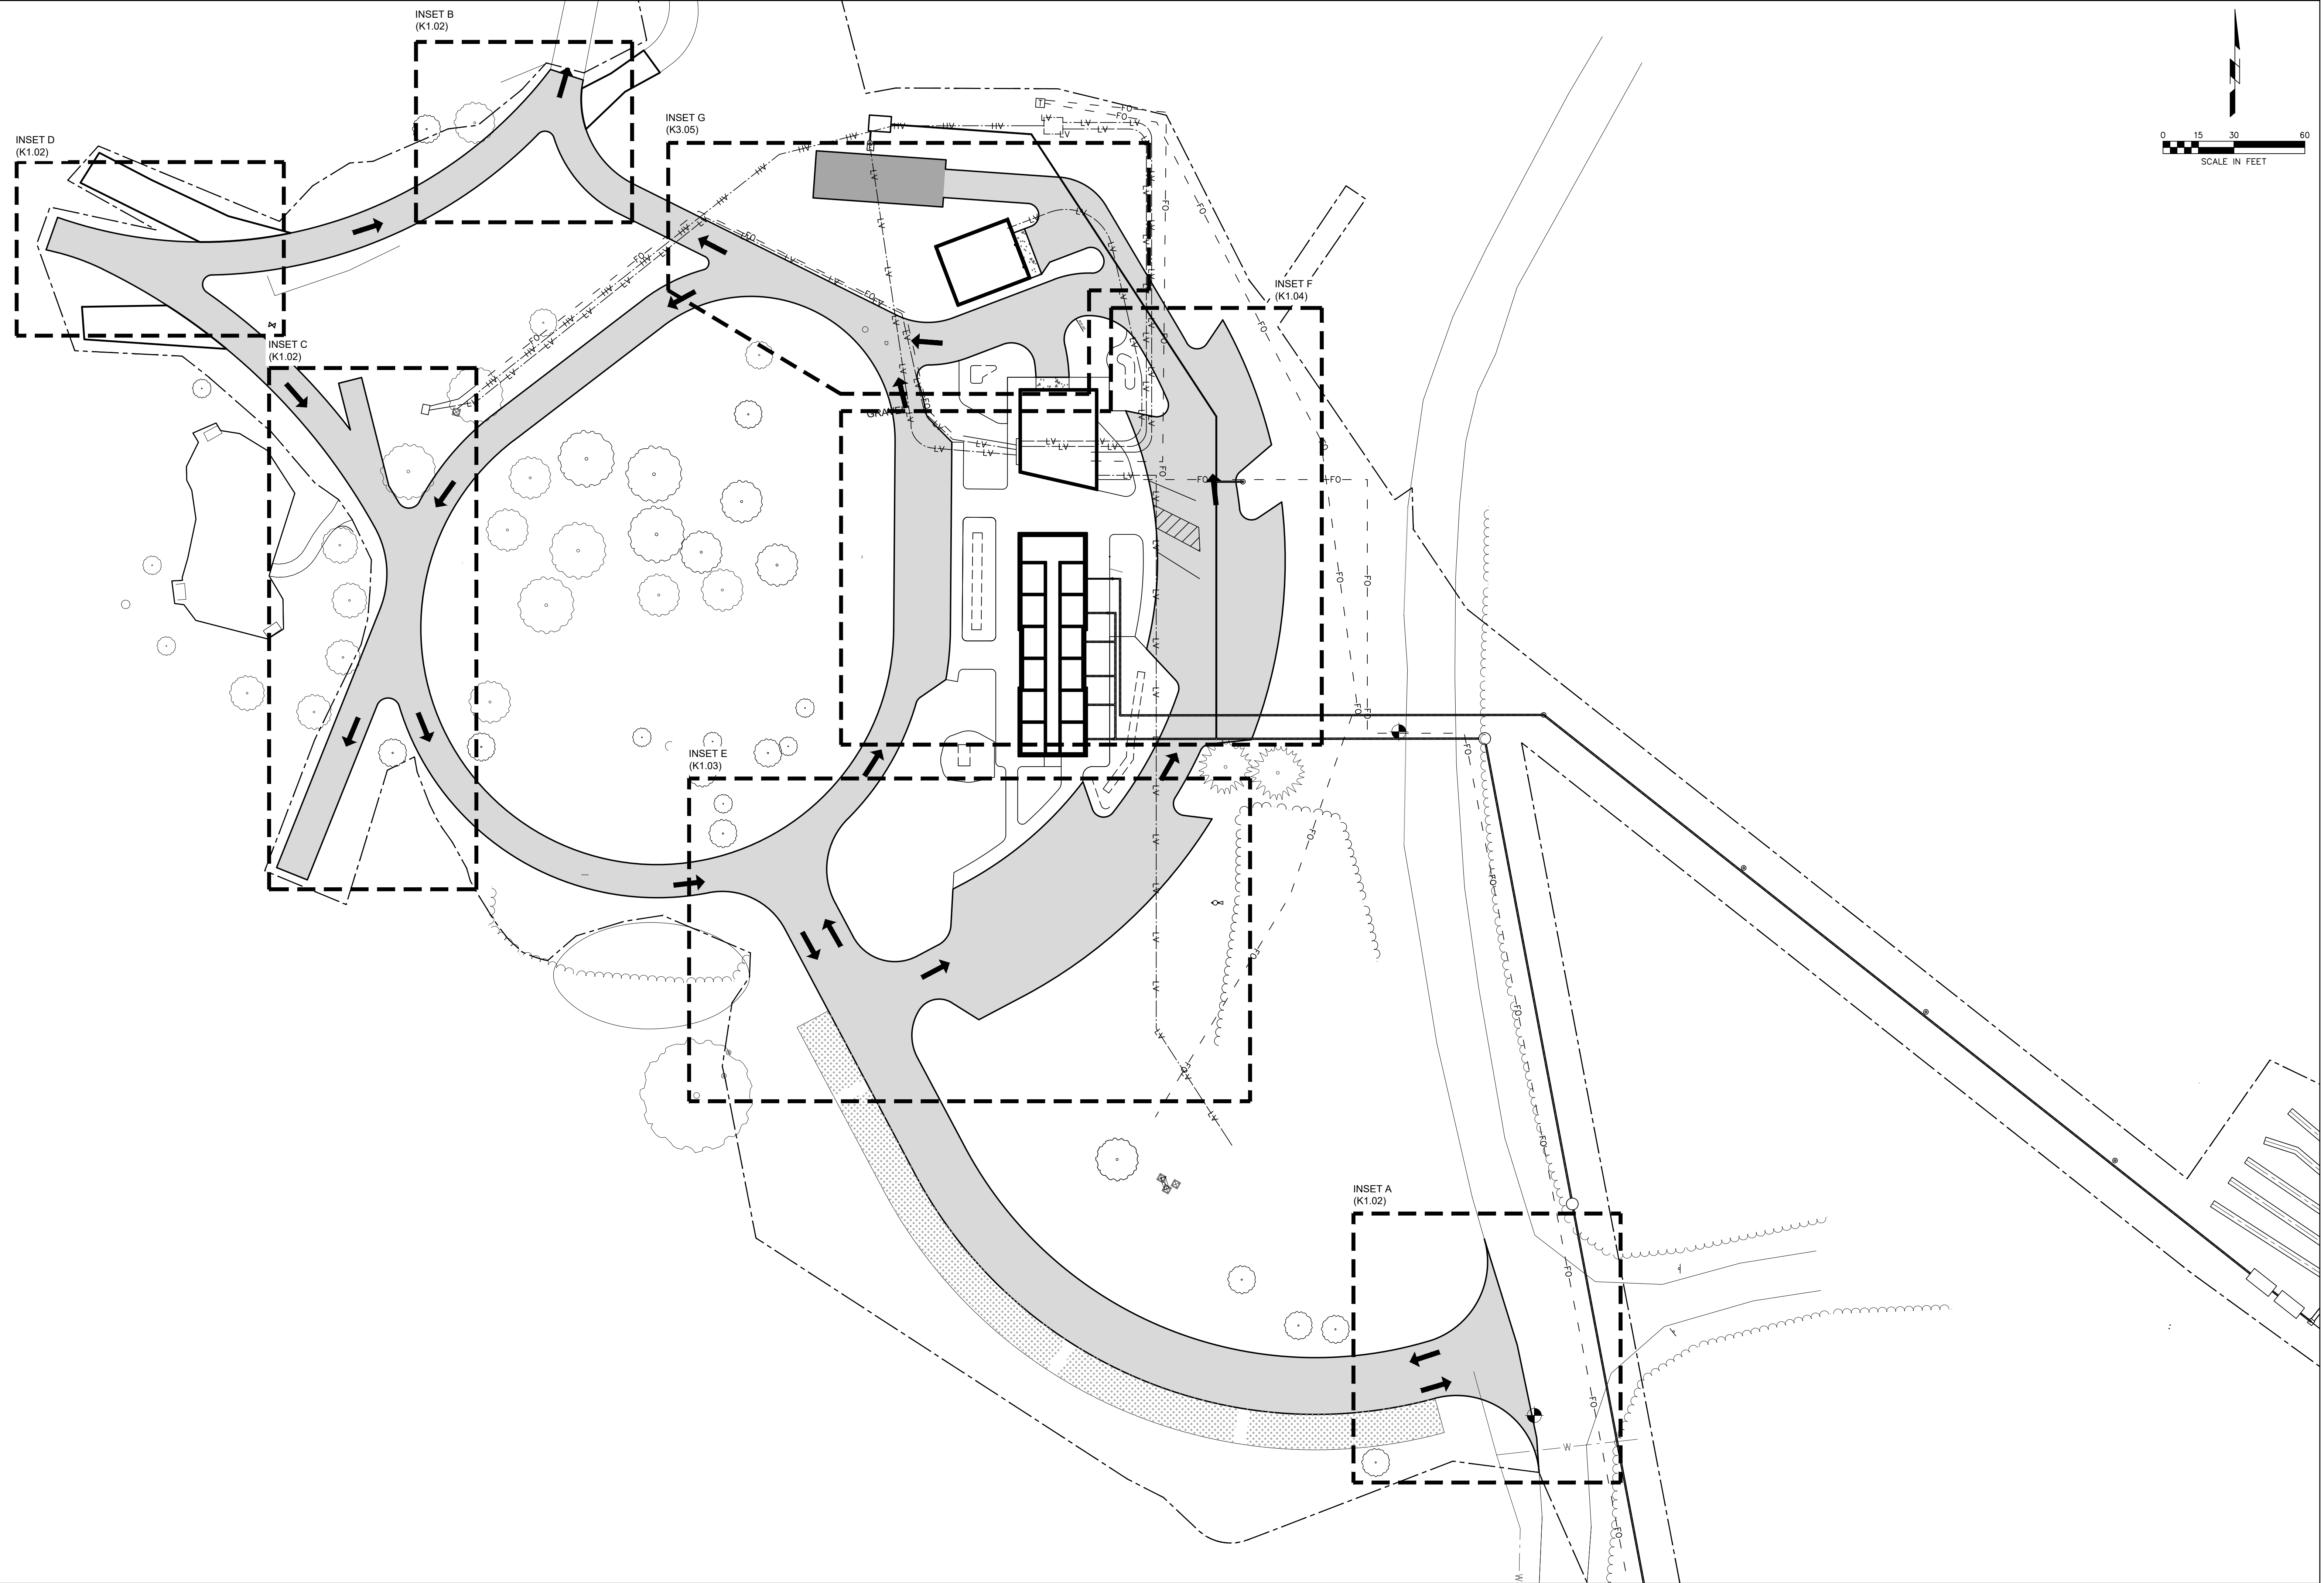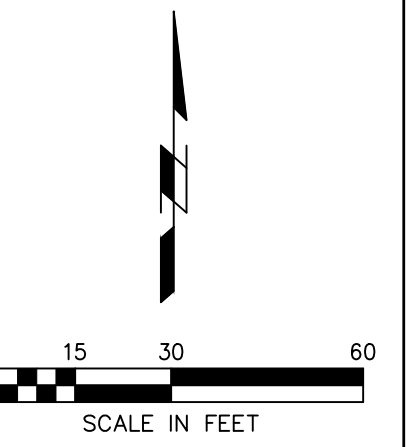

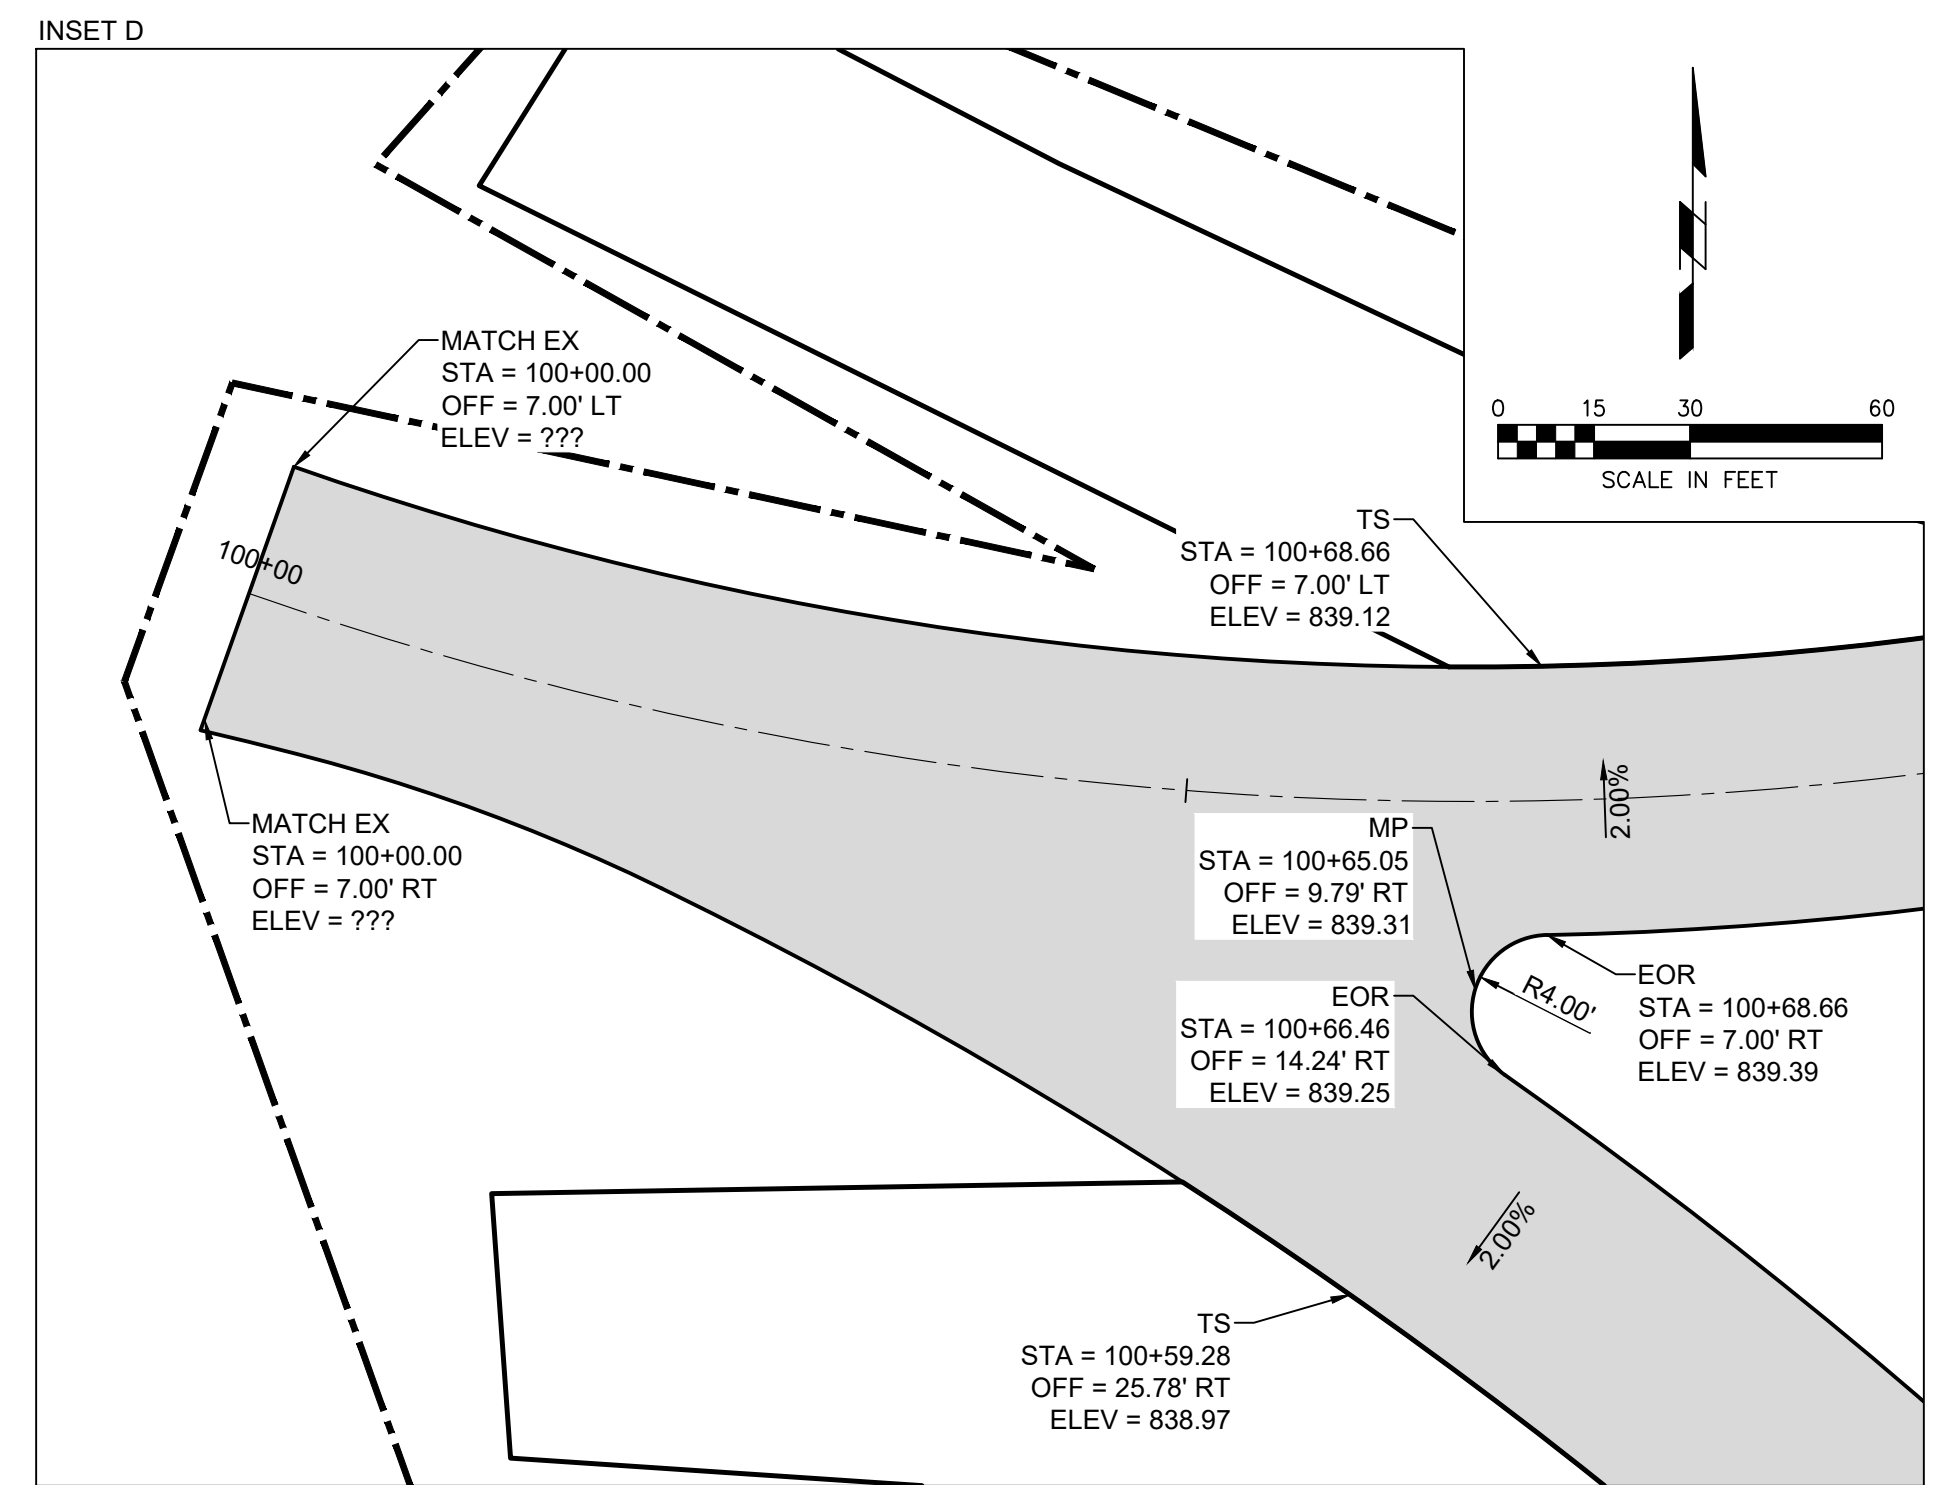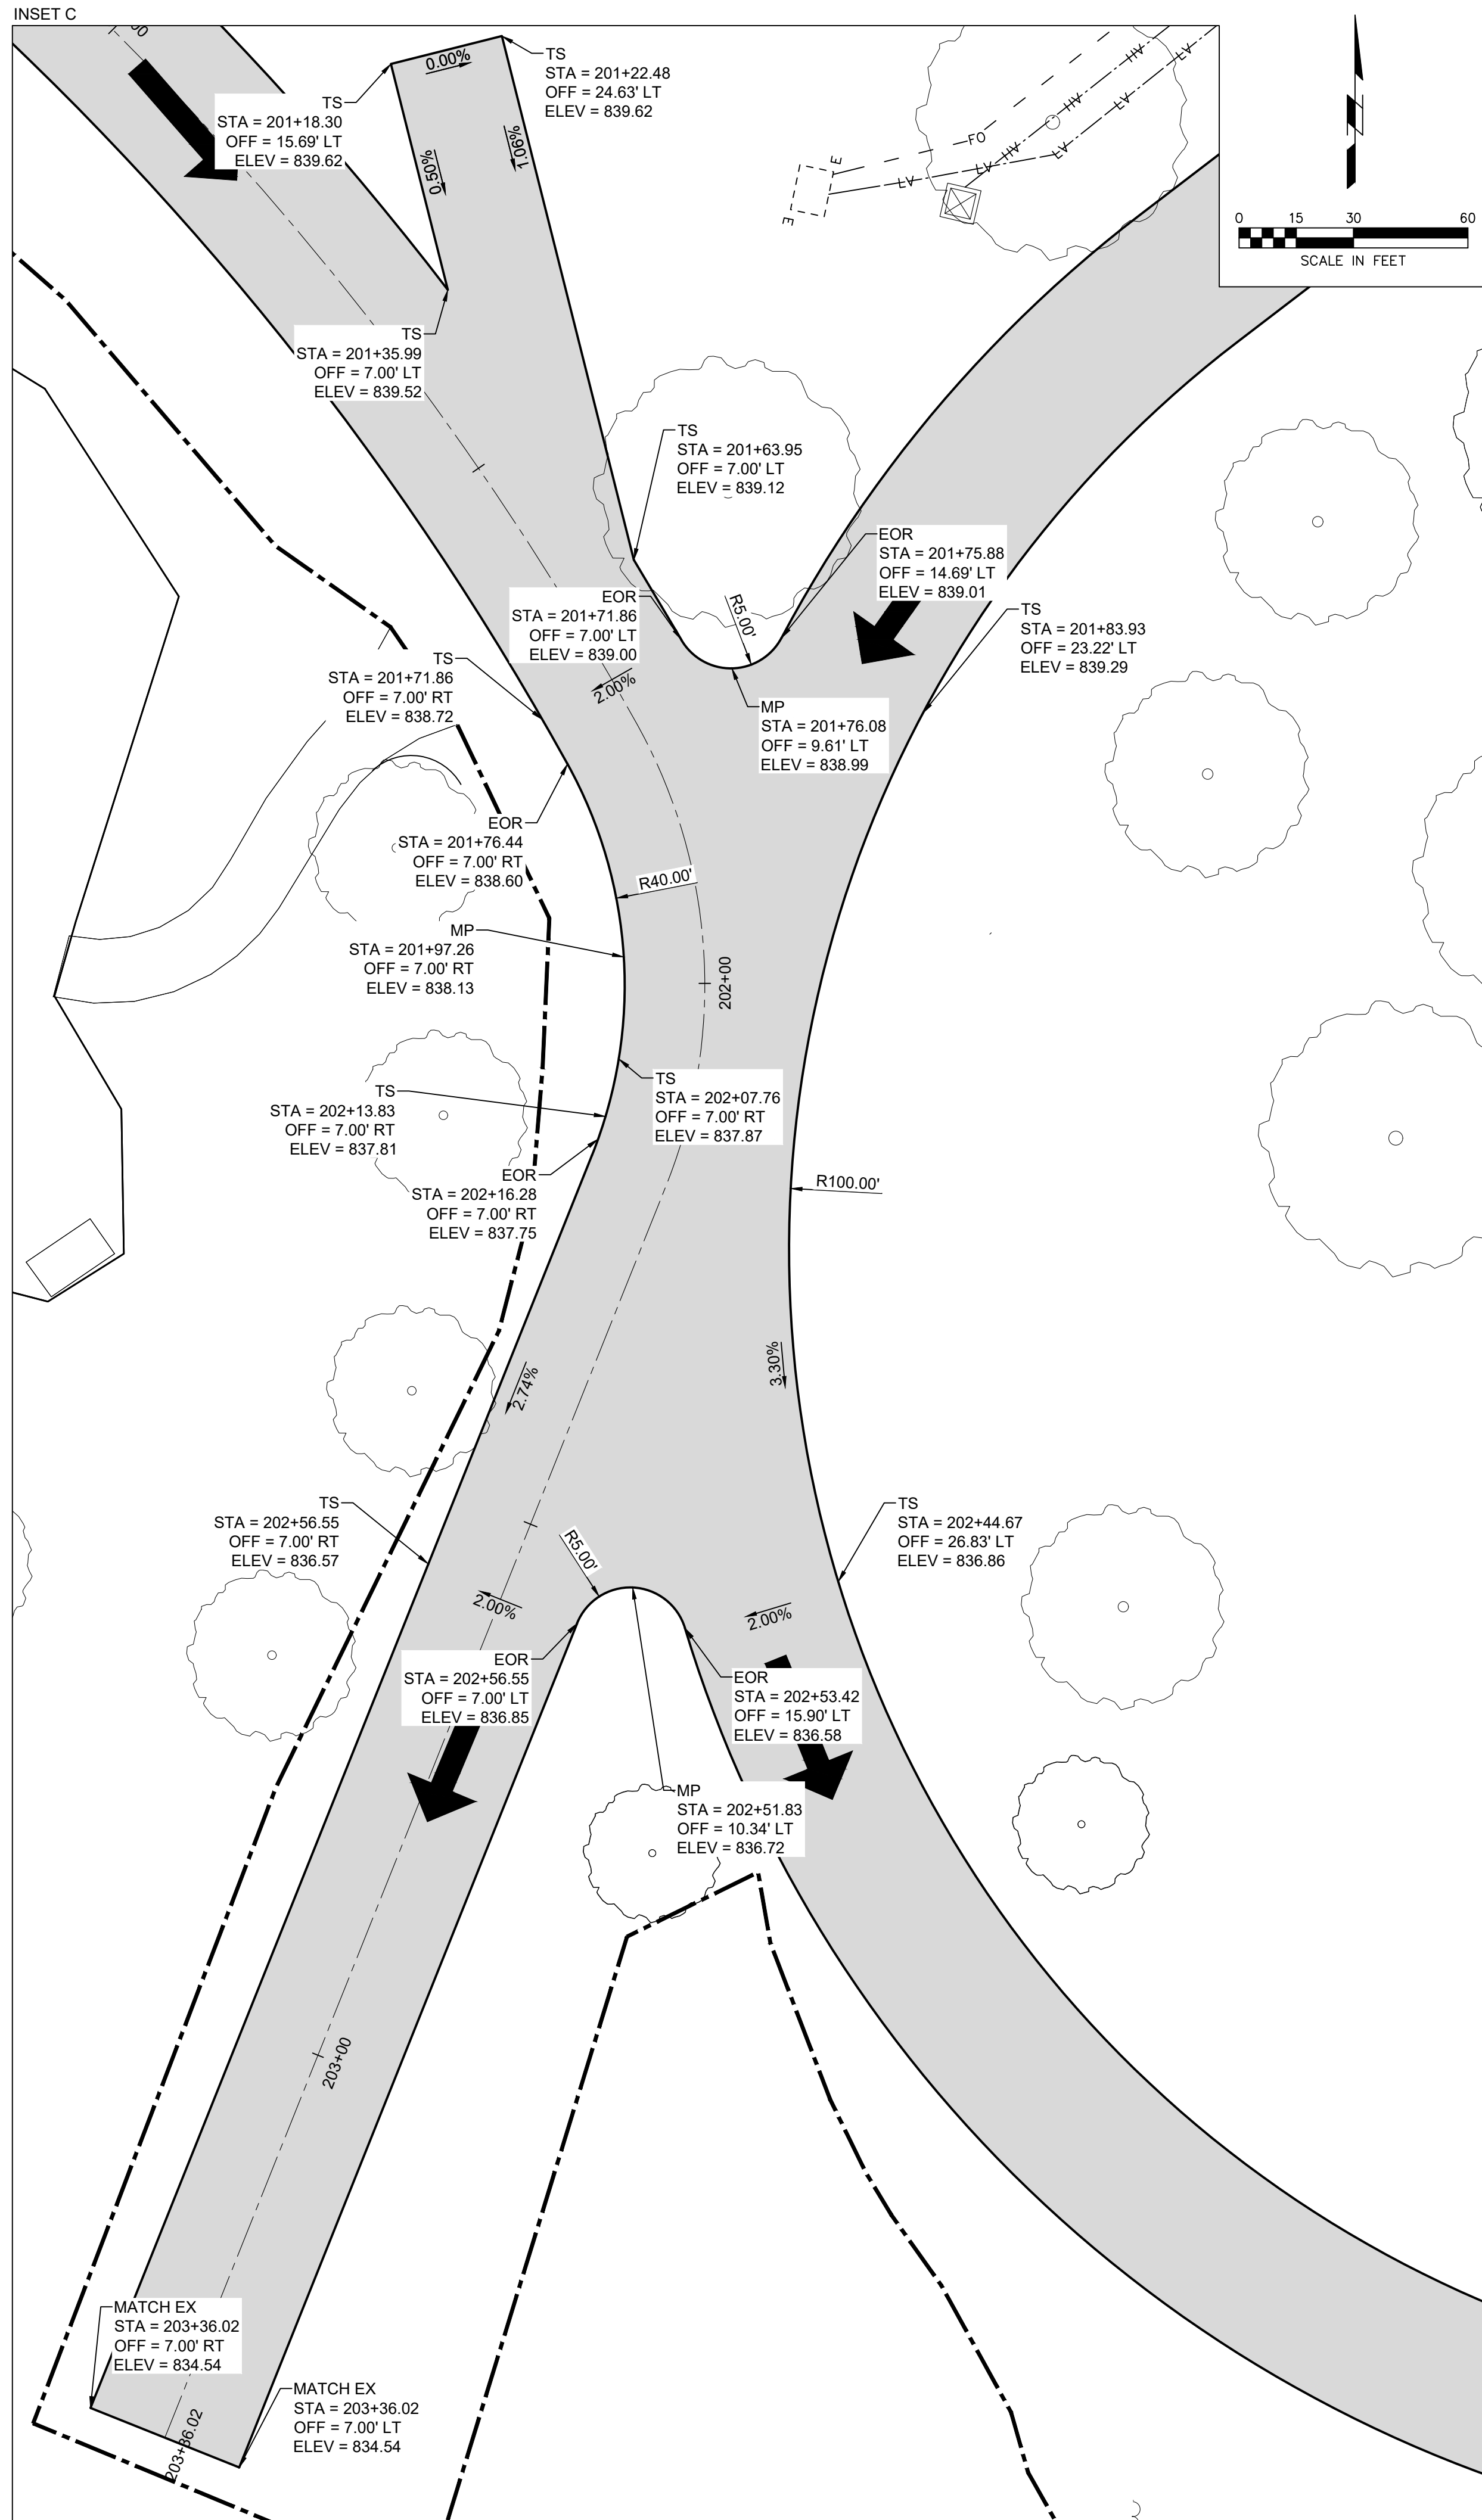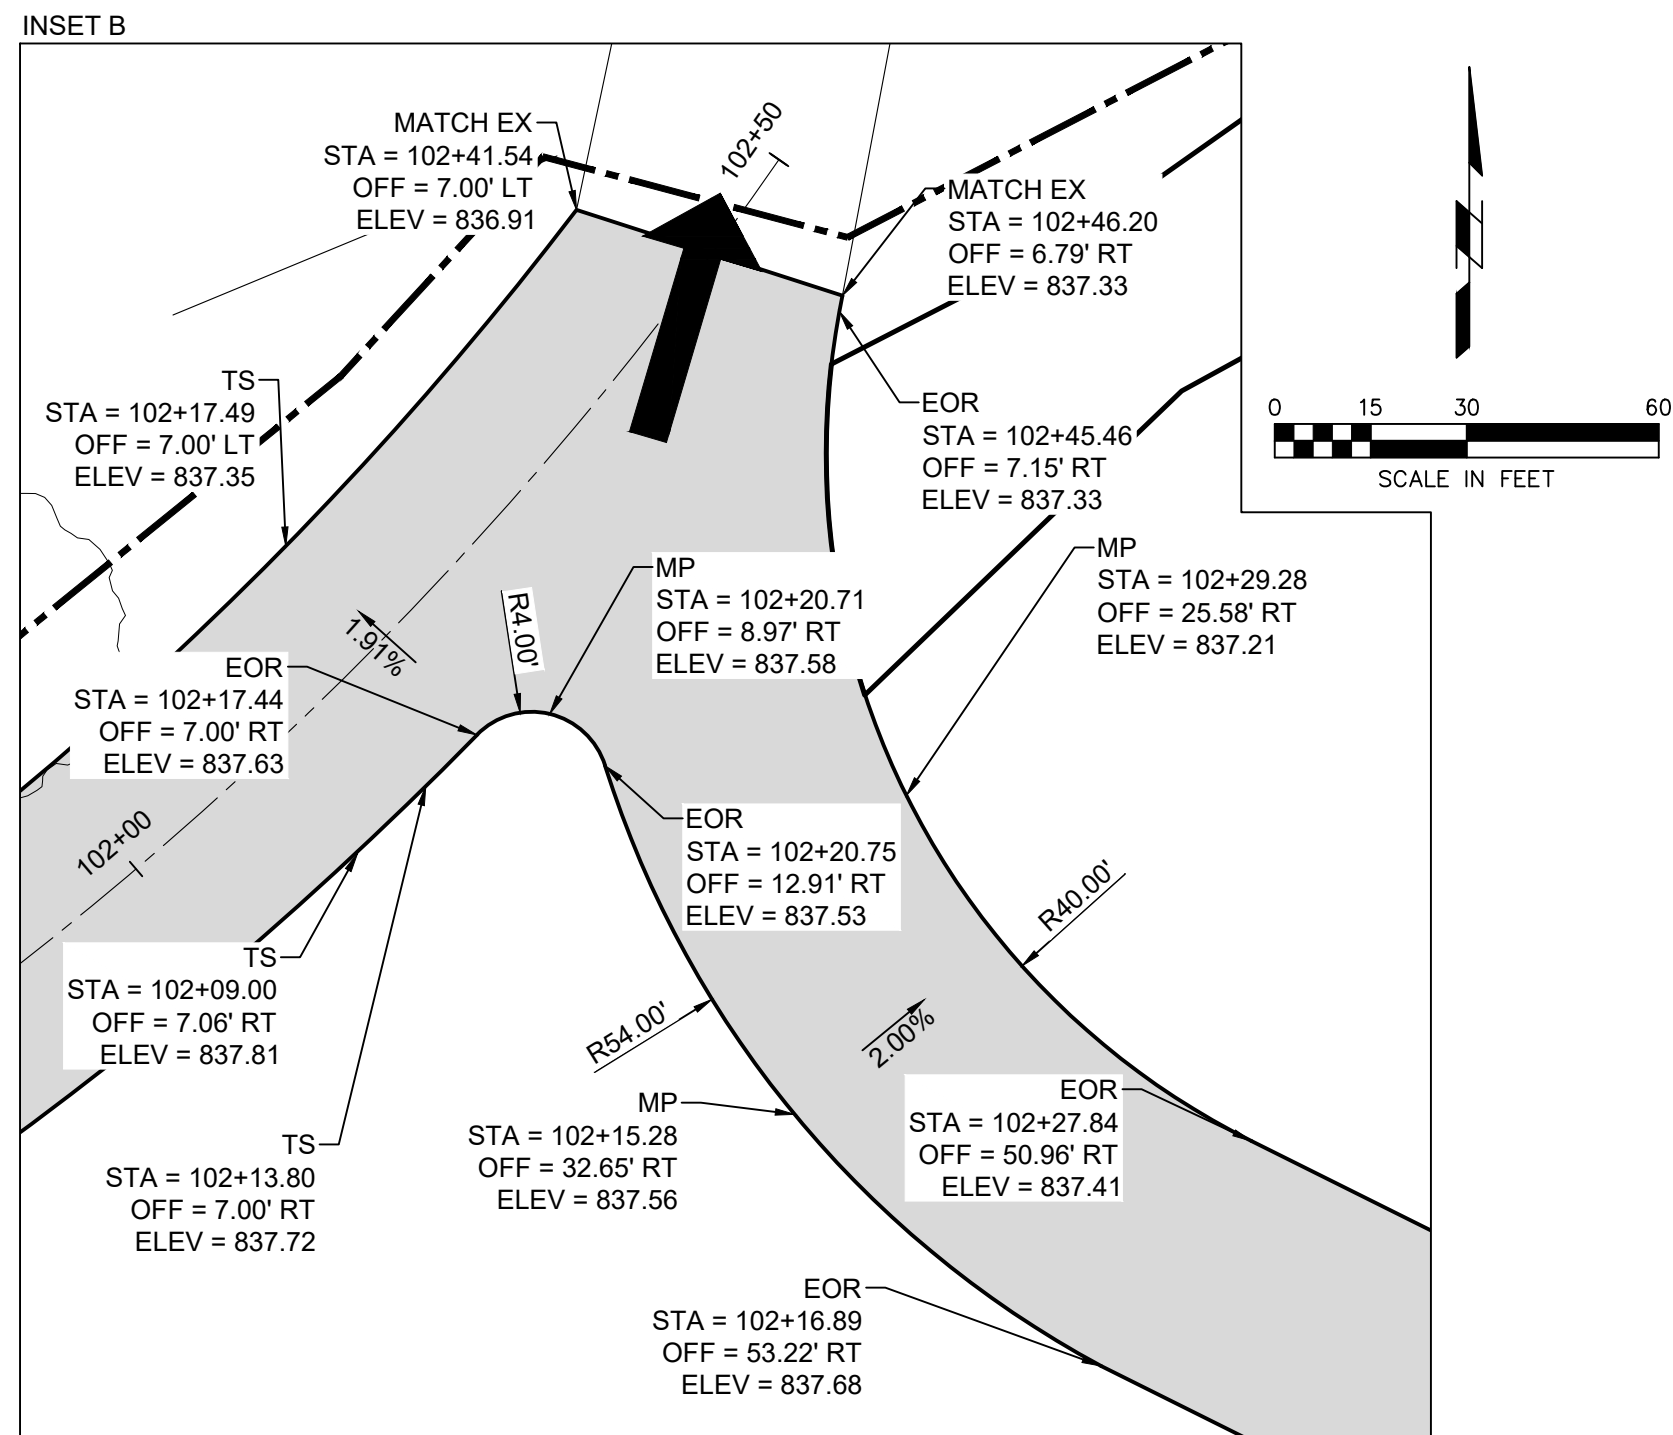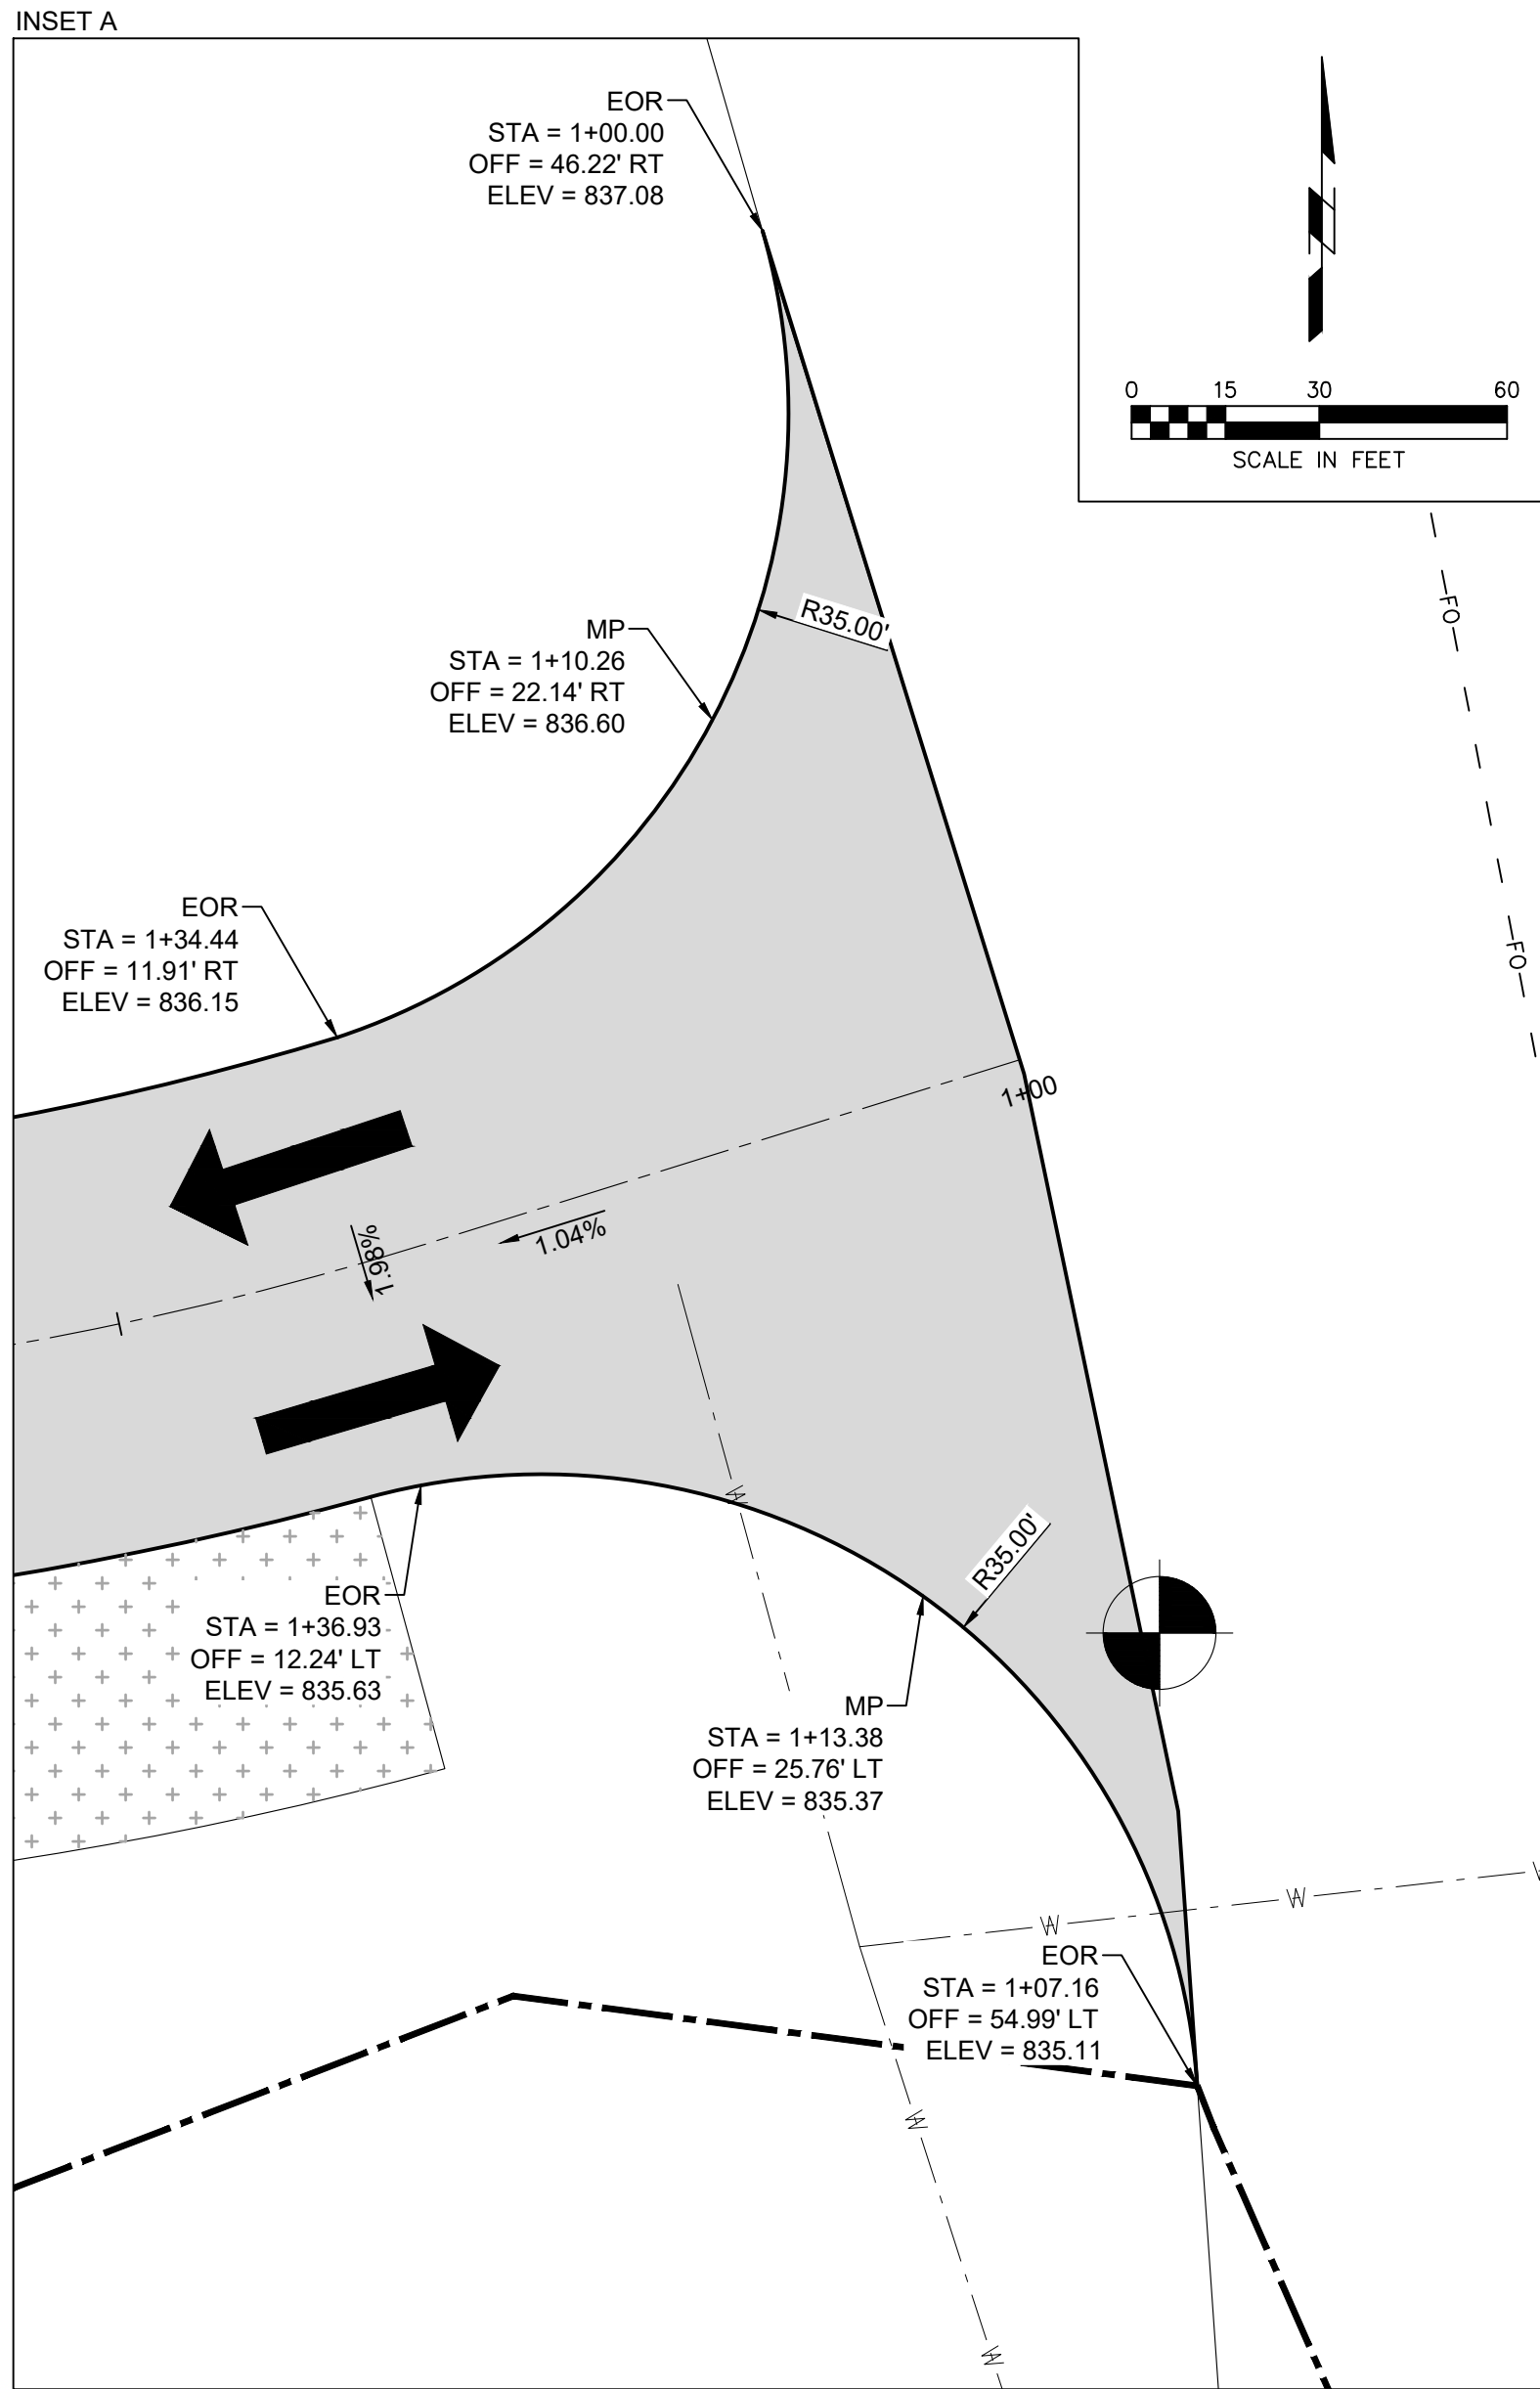




LEGEND

EOR = END OF RADIUS
MP = MIDPOINT
TS = TOP OF SEAL COAT



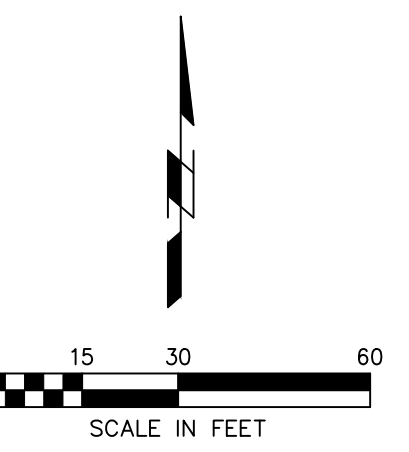
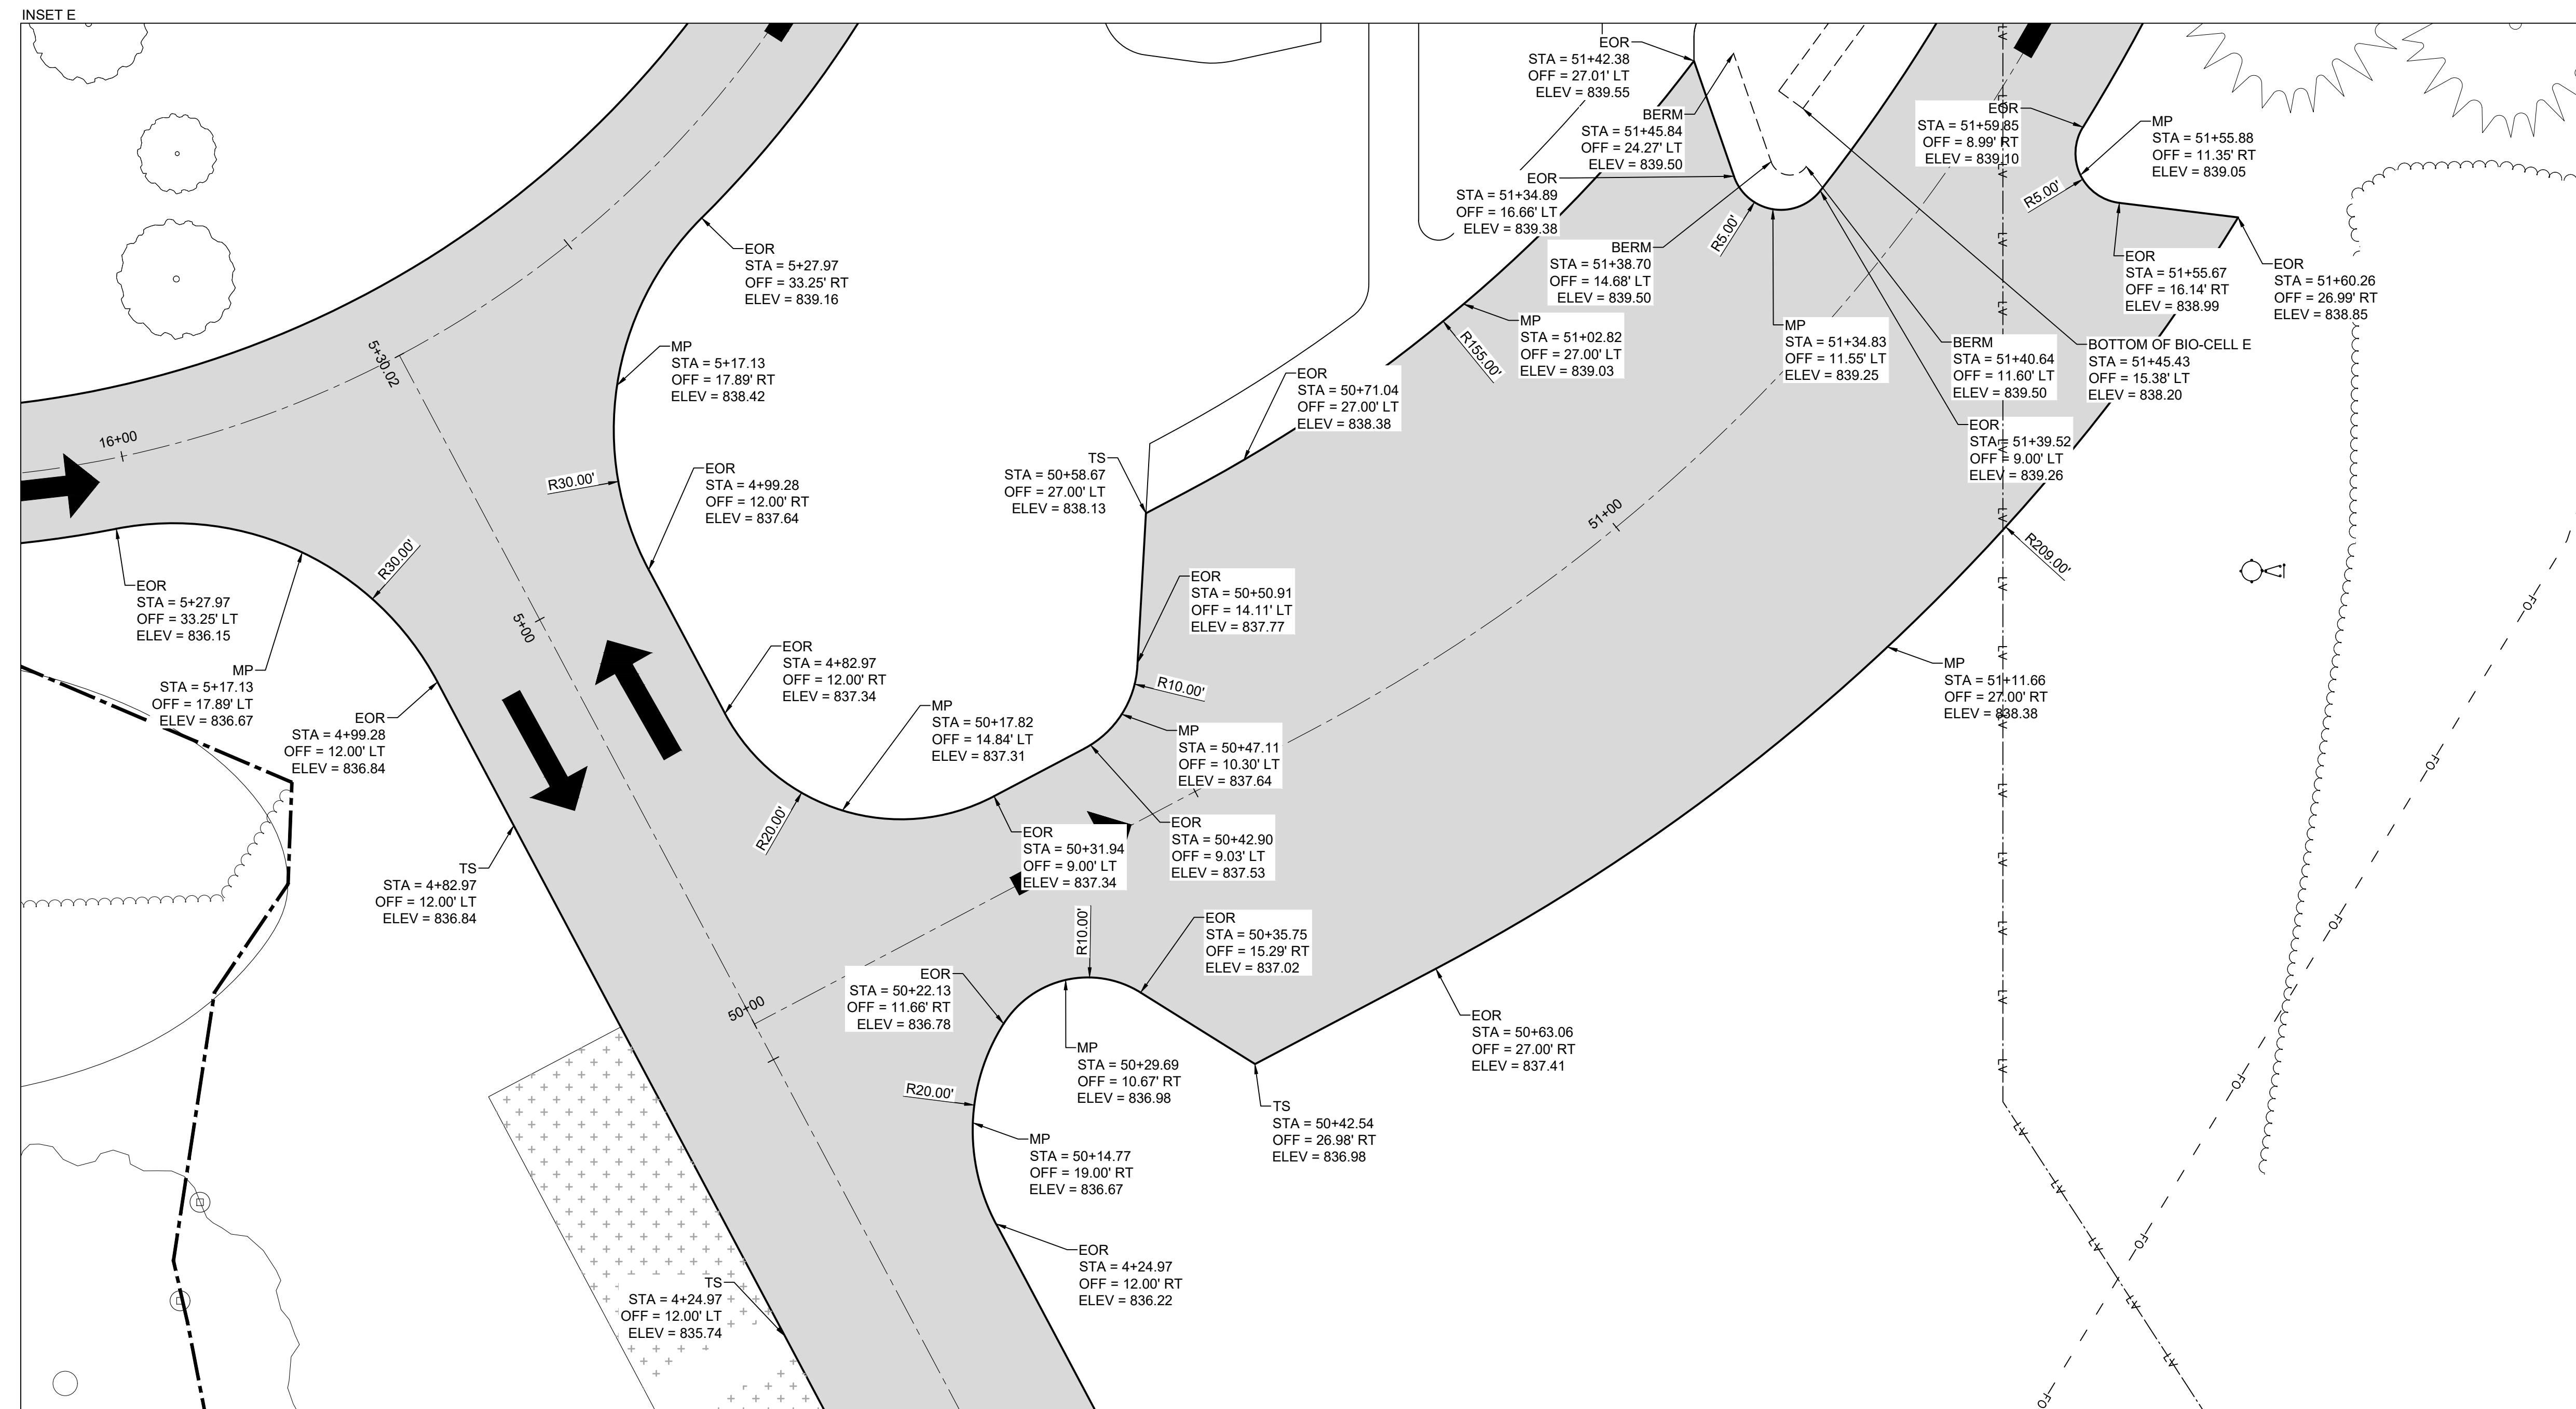


<u>LEGEND</u>	
EOR =	END OF RADIUS
MP =	MIDPOINT
TS =	TOP OF SEAL COAT

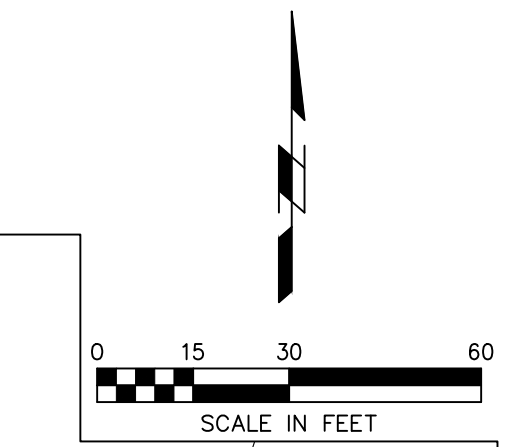

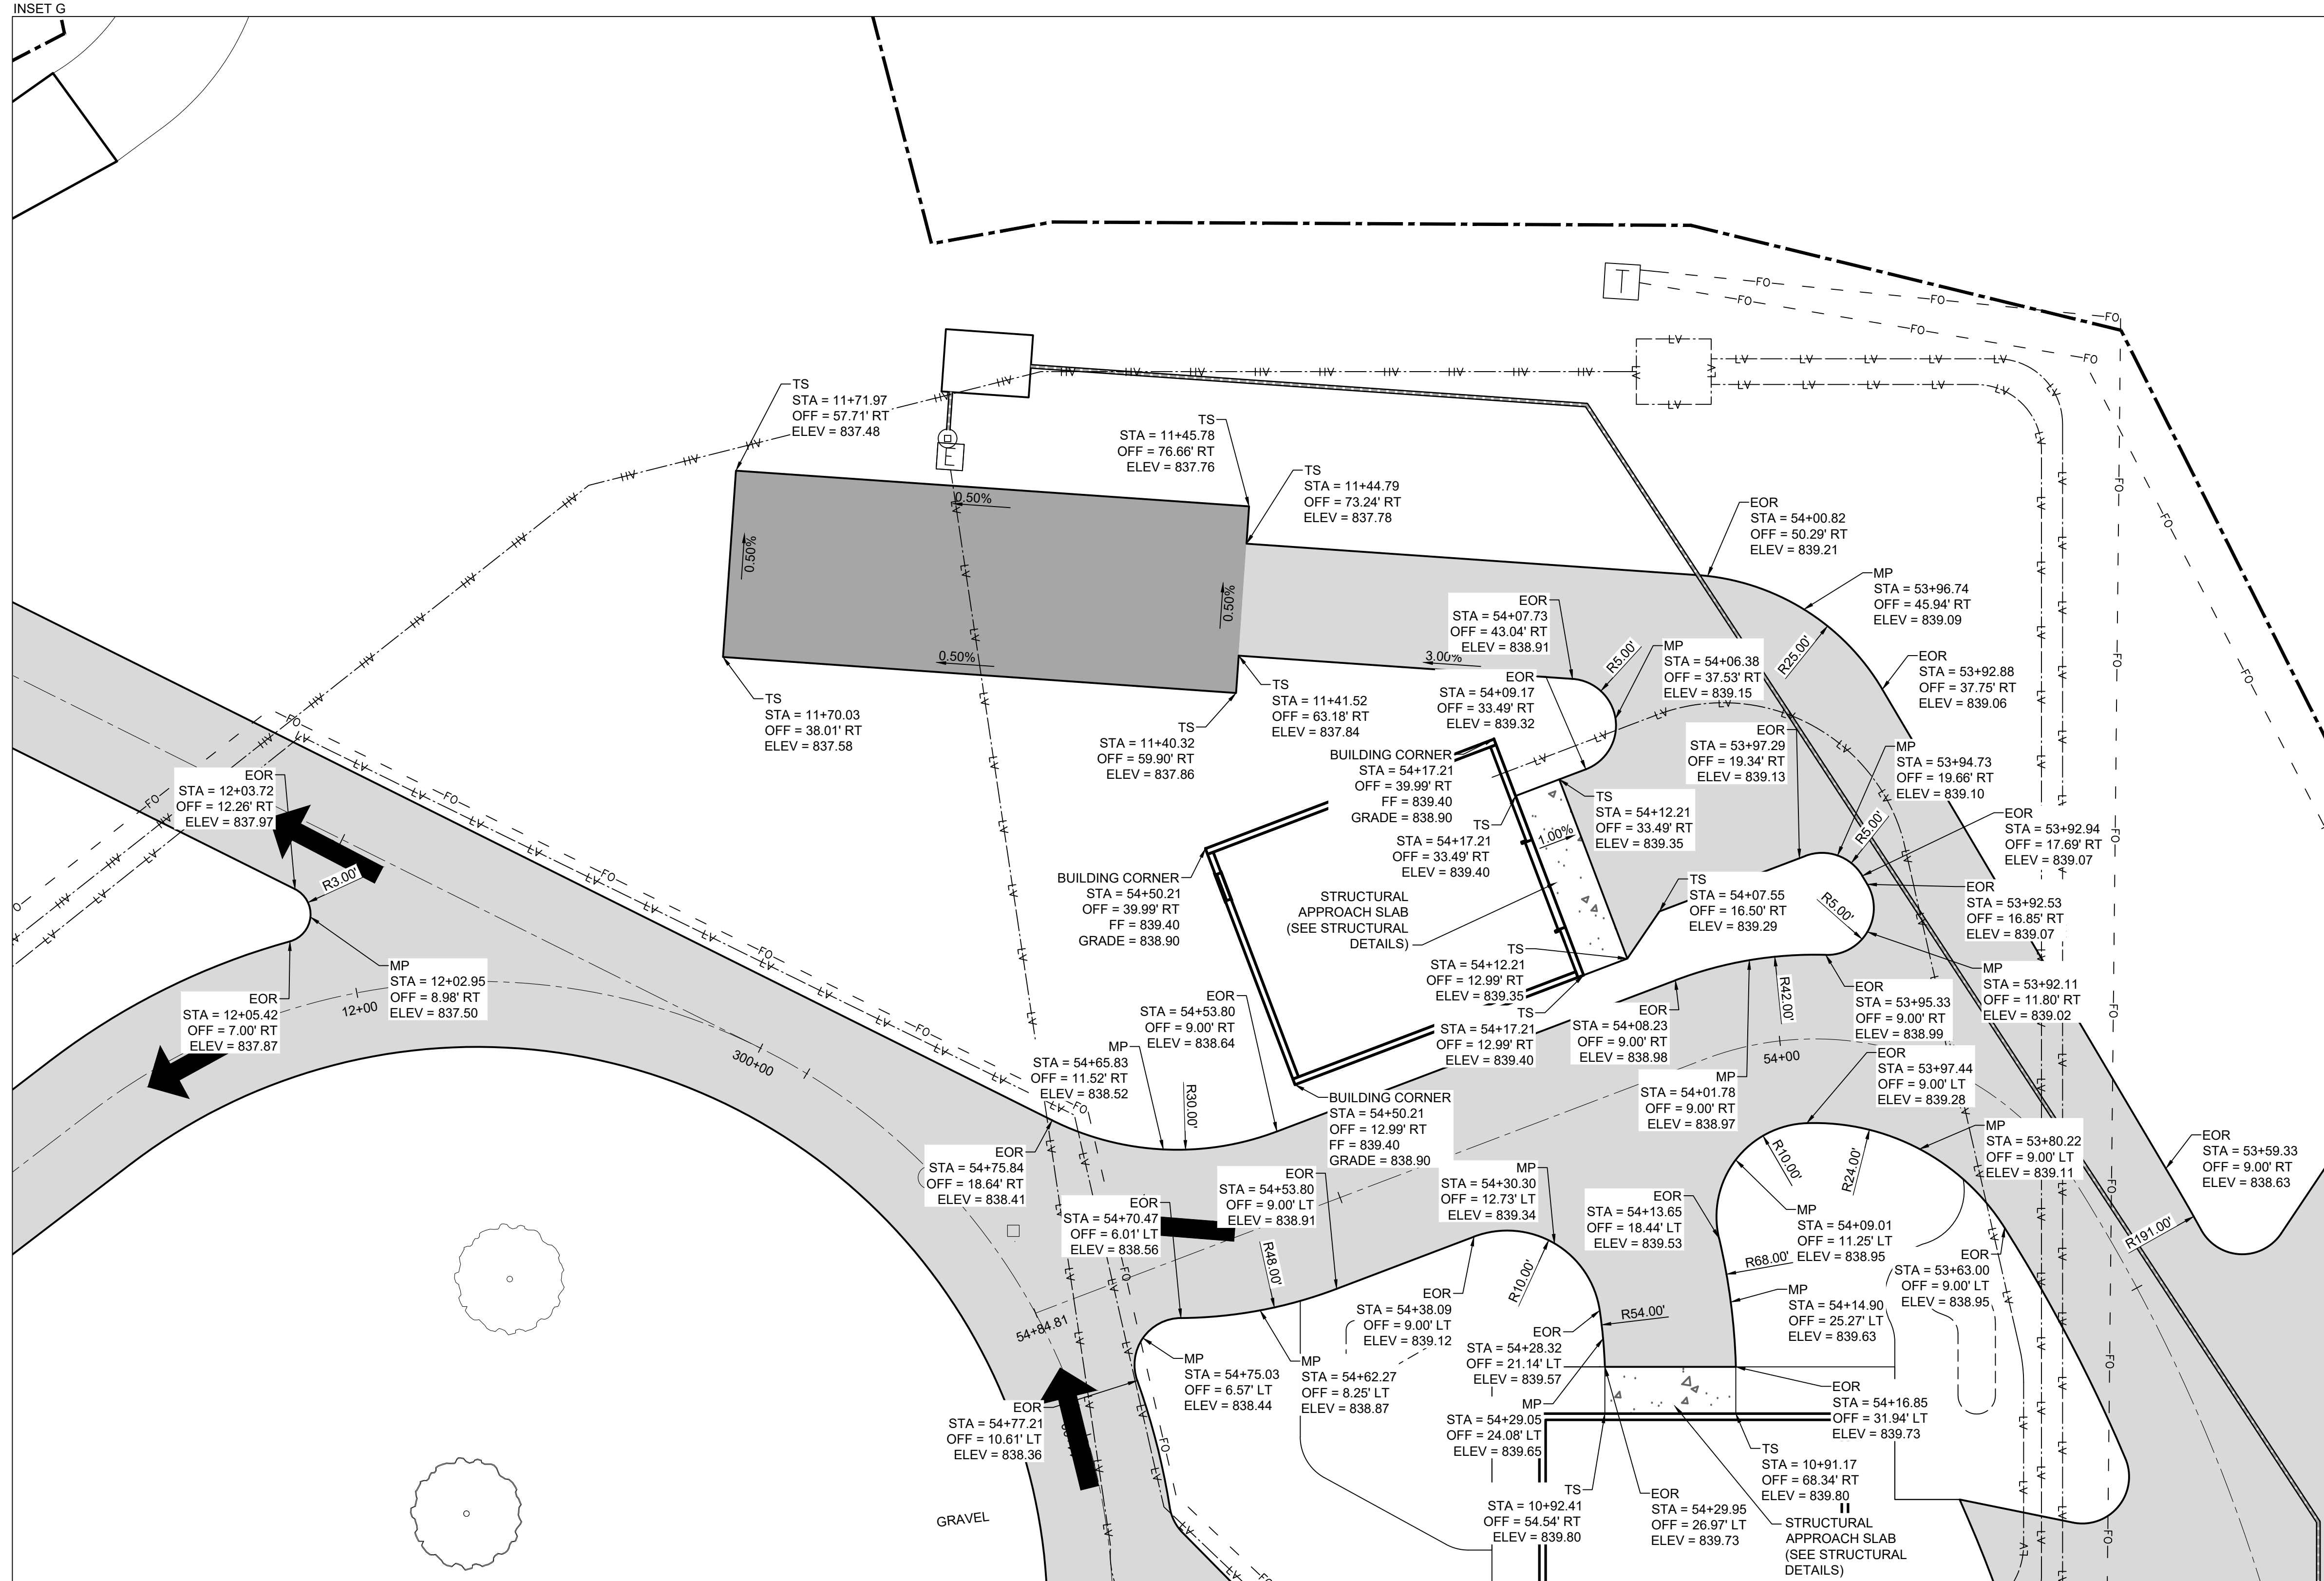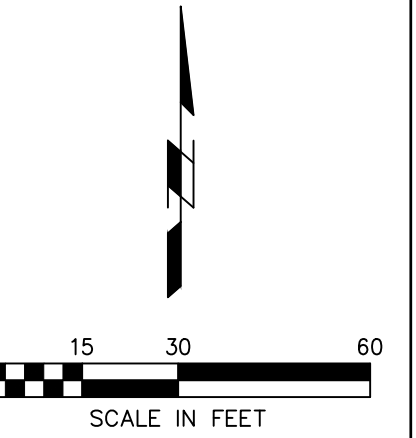

LEGEND	
EOR	= END OF RADIUS
MP	= MIDPOINT
TS	= TOP OF SEAL COAT

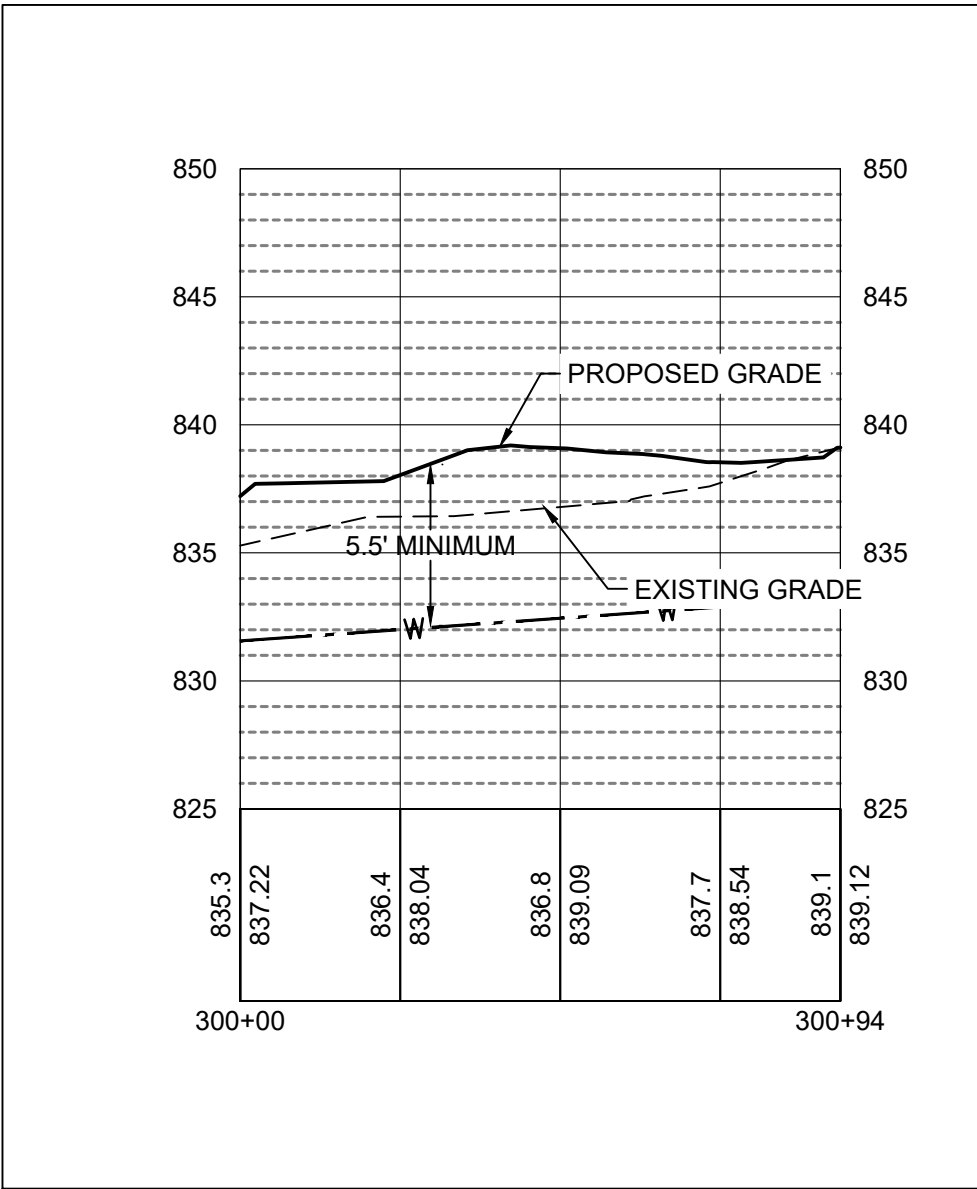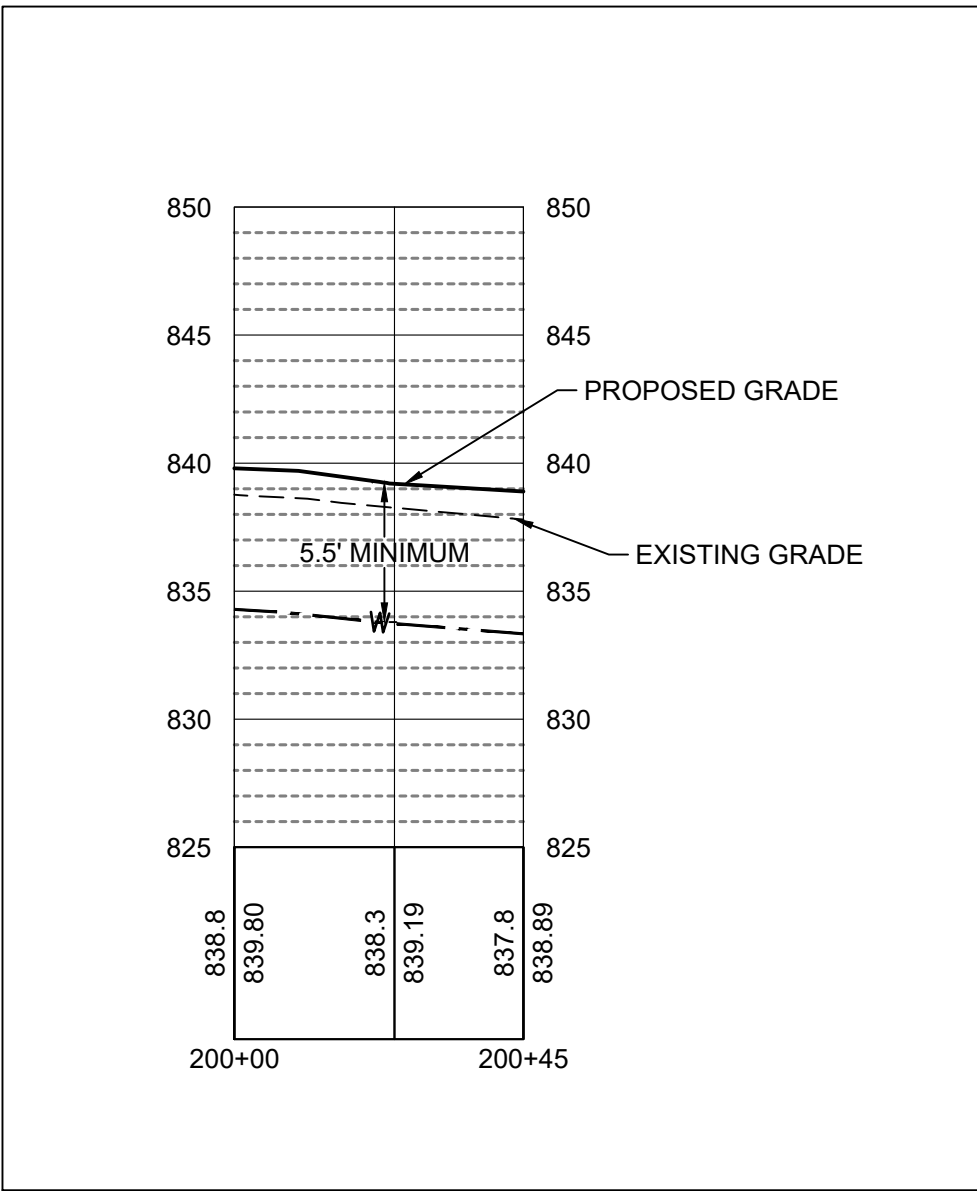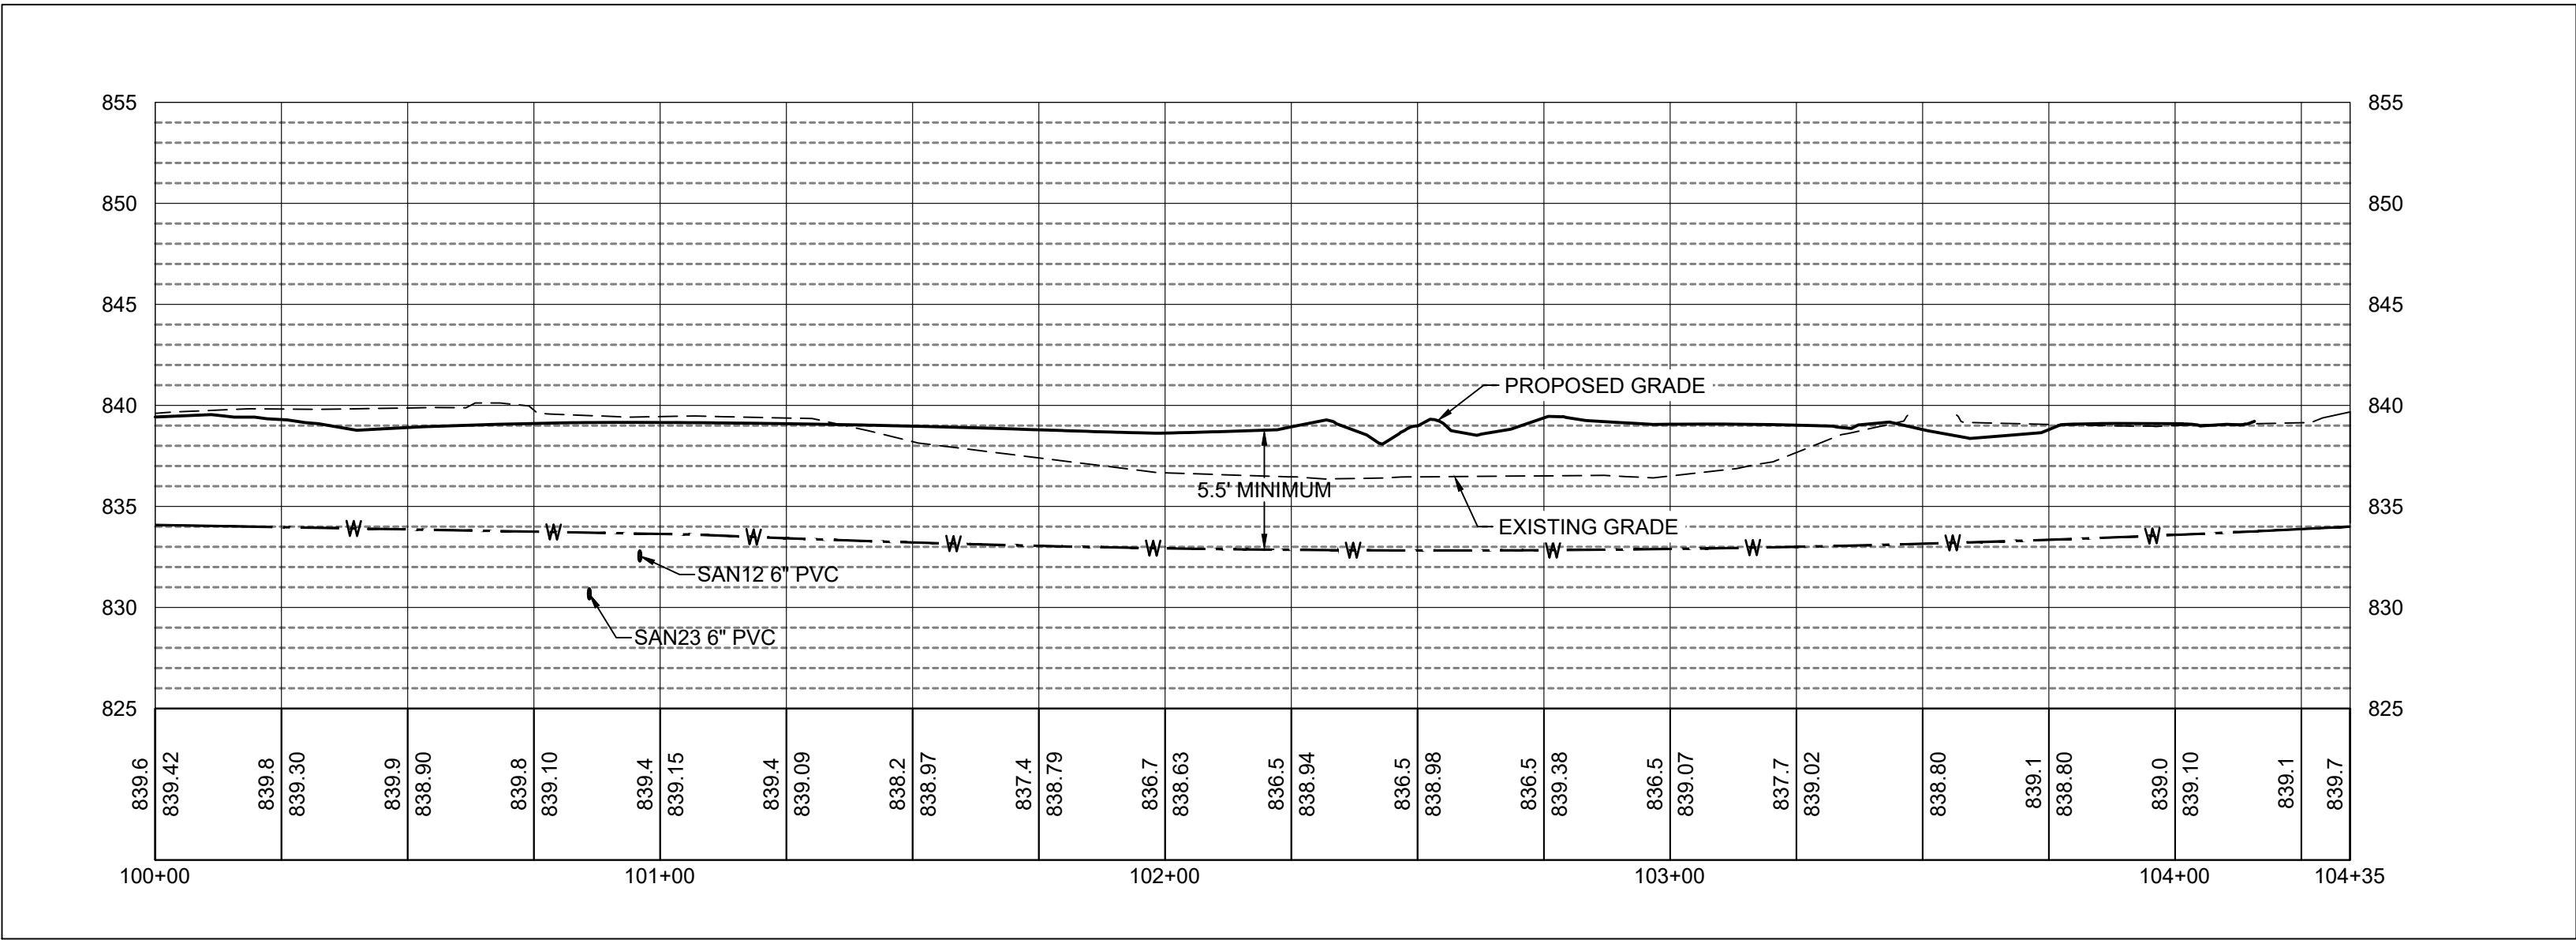
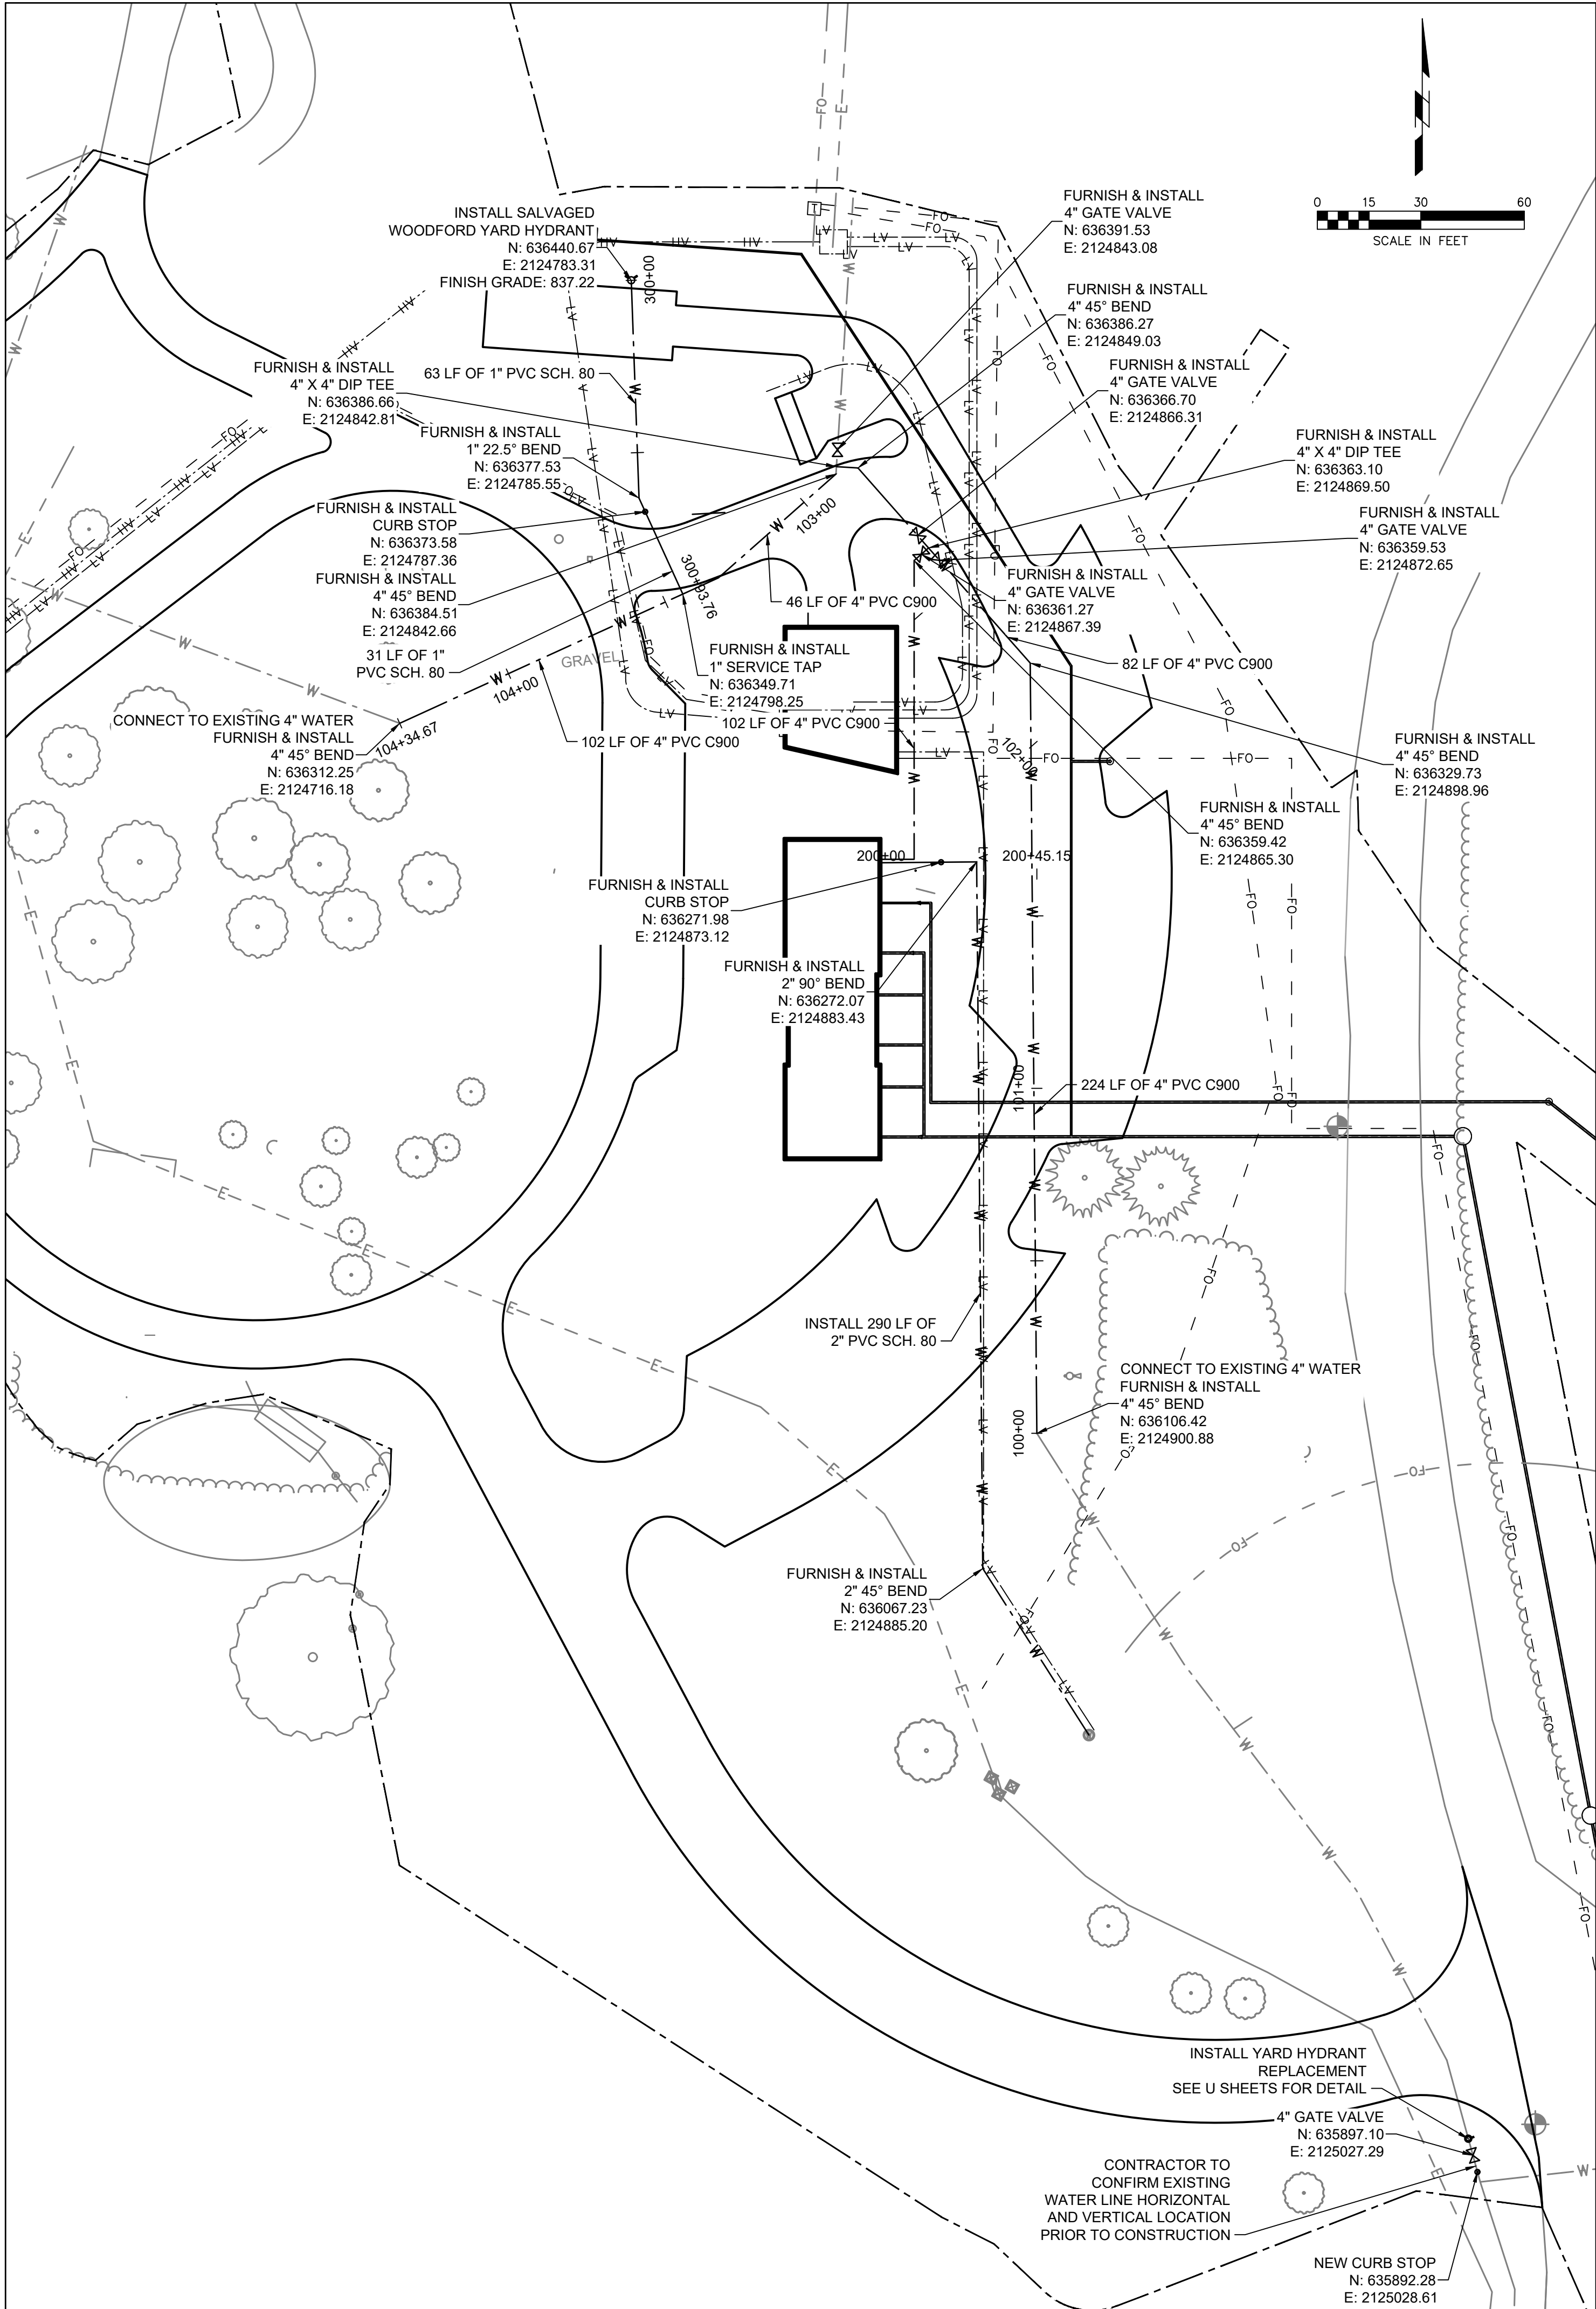



WATER NOTES

- ALL UNDERGROUND FITTINGS SHALL BE POLY-WRAPPED.
- LEAD JOINTS ARE NOT PERMITTED.
- MINIMUM HYDRANTS DEPTH OF BURY FOR WATER MAIN SHALL BE 5.5 FEET BELOW FINISHED GRADE. GATE VALVES AND CURB STOPS SHALL BE CONSTRUCTED TO MAINTAIN 5.5' TO 6' MAX. DEPTH UNLESS OTHERWISE NOTED.
- INSTALL SINGLE THHN-12 GA. TRACER WIRE WITH WATER PIPING (TAPE TO PIPE). TRACER WIRE TO BE EXTENDED IN CONDUIT TO 1'-0" ABOVE GROUND SURFACE AT FIRE HYDRANTS AND SHALL BE CONNECTED TO A 6'-0" X 1/2"Ø GROUND ROD AT CONNECTION TO MAIN AND AT DEAD ENDS. TRACER WIRE TO EXTEND UP INTO BUILDING AT SERVICE CONNECTIONS.
- ALL WATER MAIN, FILLINGS, VALVES, AND HYDRANTS SHALL BE INSTALLED WITH 8 MIL. POLYETHYLENE ENCASEMENT PER AWWA C105.
- WATER MAIN TRENCHES AND WATER SERVICE UNDER EXISTING OR PROPOSED STREETS SHALL BE BACKFILLED WITH GRANULAR BACKFILL UP TO THE SURFACING SUBGRADE ELEVATION.
- CONTRACTOR SHALL PERFORM HYDROSTATIC TEST, DISINFECTION, AND BACTERIOLOGICAL TESTS ON COMPLETED WATER MAIN ACCORDING TO SUDA STANDARD SPECIFICATIONS PRIOR TO FINAL ACCEPTANCE OF THE PROJECT.
- SEPARATION BETWEEN WATER AND SEWER LINES SHALL BE A MINIMUM OF 10 FEET WHEN RUNNING PARALLEL. AT CROSSINGS, A MINIMUM OF 1.5 FEET SHALL BE MAINTAINED WITH A FULL 20-FOOT SECTION OF GASKETED PIPE CENTERED ABOVE OR BELOW THE WATER MAIN.
- BASIS OF PAYMENT FOR ALL WATER MAINS AND FORCE MAINS SHALL BE BY THE LINEAL FOOT ALONG THE INSTALLED PIPELINE. ALL OPERATIONS, FITTINGS AND BEDDING SHALL BE INCIDENTAL TO THE IN-PLACE PIPE, UNLESS SPECIFICALLY EXCEPTED.
- THE CONTRACTOR WILL MAINTAIN A RECORD DRAWING SET WITH WITNESS DIMENSIONS TO ALL SERVICE LINES, VALVES, EXISTING WATER LINES, ETC. THESE DRAWINGS WILL BE SUBMITTED TO THE ENGINEER PRIOR TO FINAL ACCEPTANCE.
- ALL WATER MAIN TRENCHES WILL RECEIVE CAUTION TAPE 2'-0" BELOW FINAL GRADE. THE 2" WIDE BLUE TAPE WILL READ "CAUTION - PIPELINE BURIED BELOW".
- ALL VALVES SHALL BE PLACED IN A CONCRETE POURED TO SPRING LINE OF PIPE WITH A SIZE OF 8" X 16" RESTING ON A SUITABLY COMPACTED SUBGRADE. VALVES SHALL BE SET PLUMB AND LEVEL WITH VALVE BOXES COVERS ADJUSTED TO FINISHED GRADE.
- ALL THRUST BLOCK JOINT RESTRAINTS WILL BE READY MIXED 3000 PSI PORTLAND CEMENT CONCRETE PLACED BETWEEN VALVE, BEND, ETC. AND UNDISTURBED EARTH. ALL APPURTENANCES SHALL BE COVERED WITH HEAVY DUTY POLYETHYLENE FILM PRIOR TO PCC PLACEMENT. NO BLOCKS, TIMBERS OR OTHER DEVICES WILL BE ALLOWED. CONSULT ENGINEER FOR NUMBER OF CUBIC YARDS OF PCC REQUIRED AT EACH LOCATION.

TESTING

- GENERAL
 - ENGINEER OR OWNER'S REPRESENTATIVE WILL OBSERVE ALL TESTS AND SAMPLINGS.
 - THE CONTRACTOR WILL SUPPLY ALL PERSONNEL AND EQUIPMENT NECESSARY FOR ALL TESTING.
 - CONTACT ENGINEER FOR SPECIFICS OF ANY TEST OR PROCEDURE.
- BACTERIOLOGICAL
 - TEST SHALL BE IN ACCORDANCE WITH AWWA C651.
 - SAMPLING TAPS SHALL BE A CORPORATION COCK WITH COPPER TUBE GOOSENECK OR AS SHOWN IN AWWA 651 (FIGURE 1).
 - UPON SUCCESSFUL COMPLETION OF TEST, ENTIRE LINE SHALL BE FLUSHED UNTIL CHLORINE LEVELS REACH NORMAL EXISTING LEVELS.
- PRESSURE
 - WATER PRESSURE TEST AT 1.5 TIMES AREA OPERATING PRESSURE HELD FOR 1 HOUR.
- LEAKAGE
 - AS WITH PRESSURE TEST AND HELD FOR 2 HOURS (CONCURRENTLY). AMOUNT OF WATER ADDED TO MAINTAIN PRESSURE LEVEL FACTORED INTO FORMULA TO DETERMINE ALLOWABLE LEAKAGE AMOUNT. SEE ENGINEER FOR ADDITIONAL INFORMATION, IF REQUIRED.

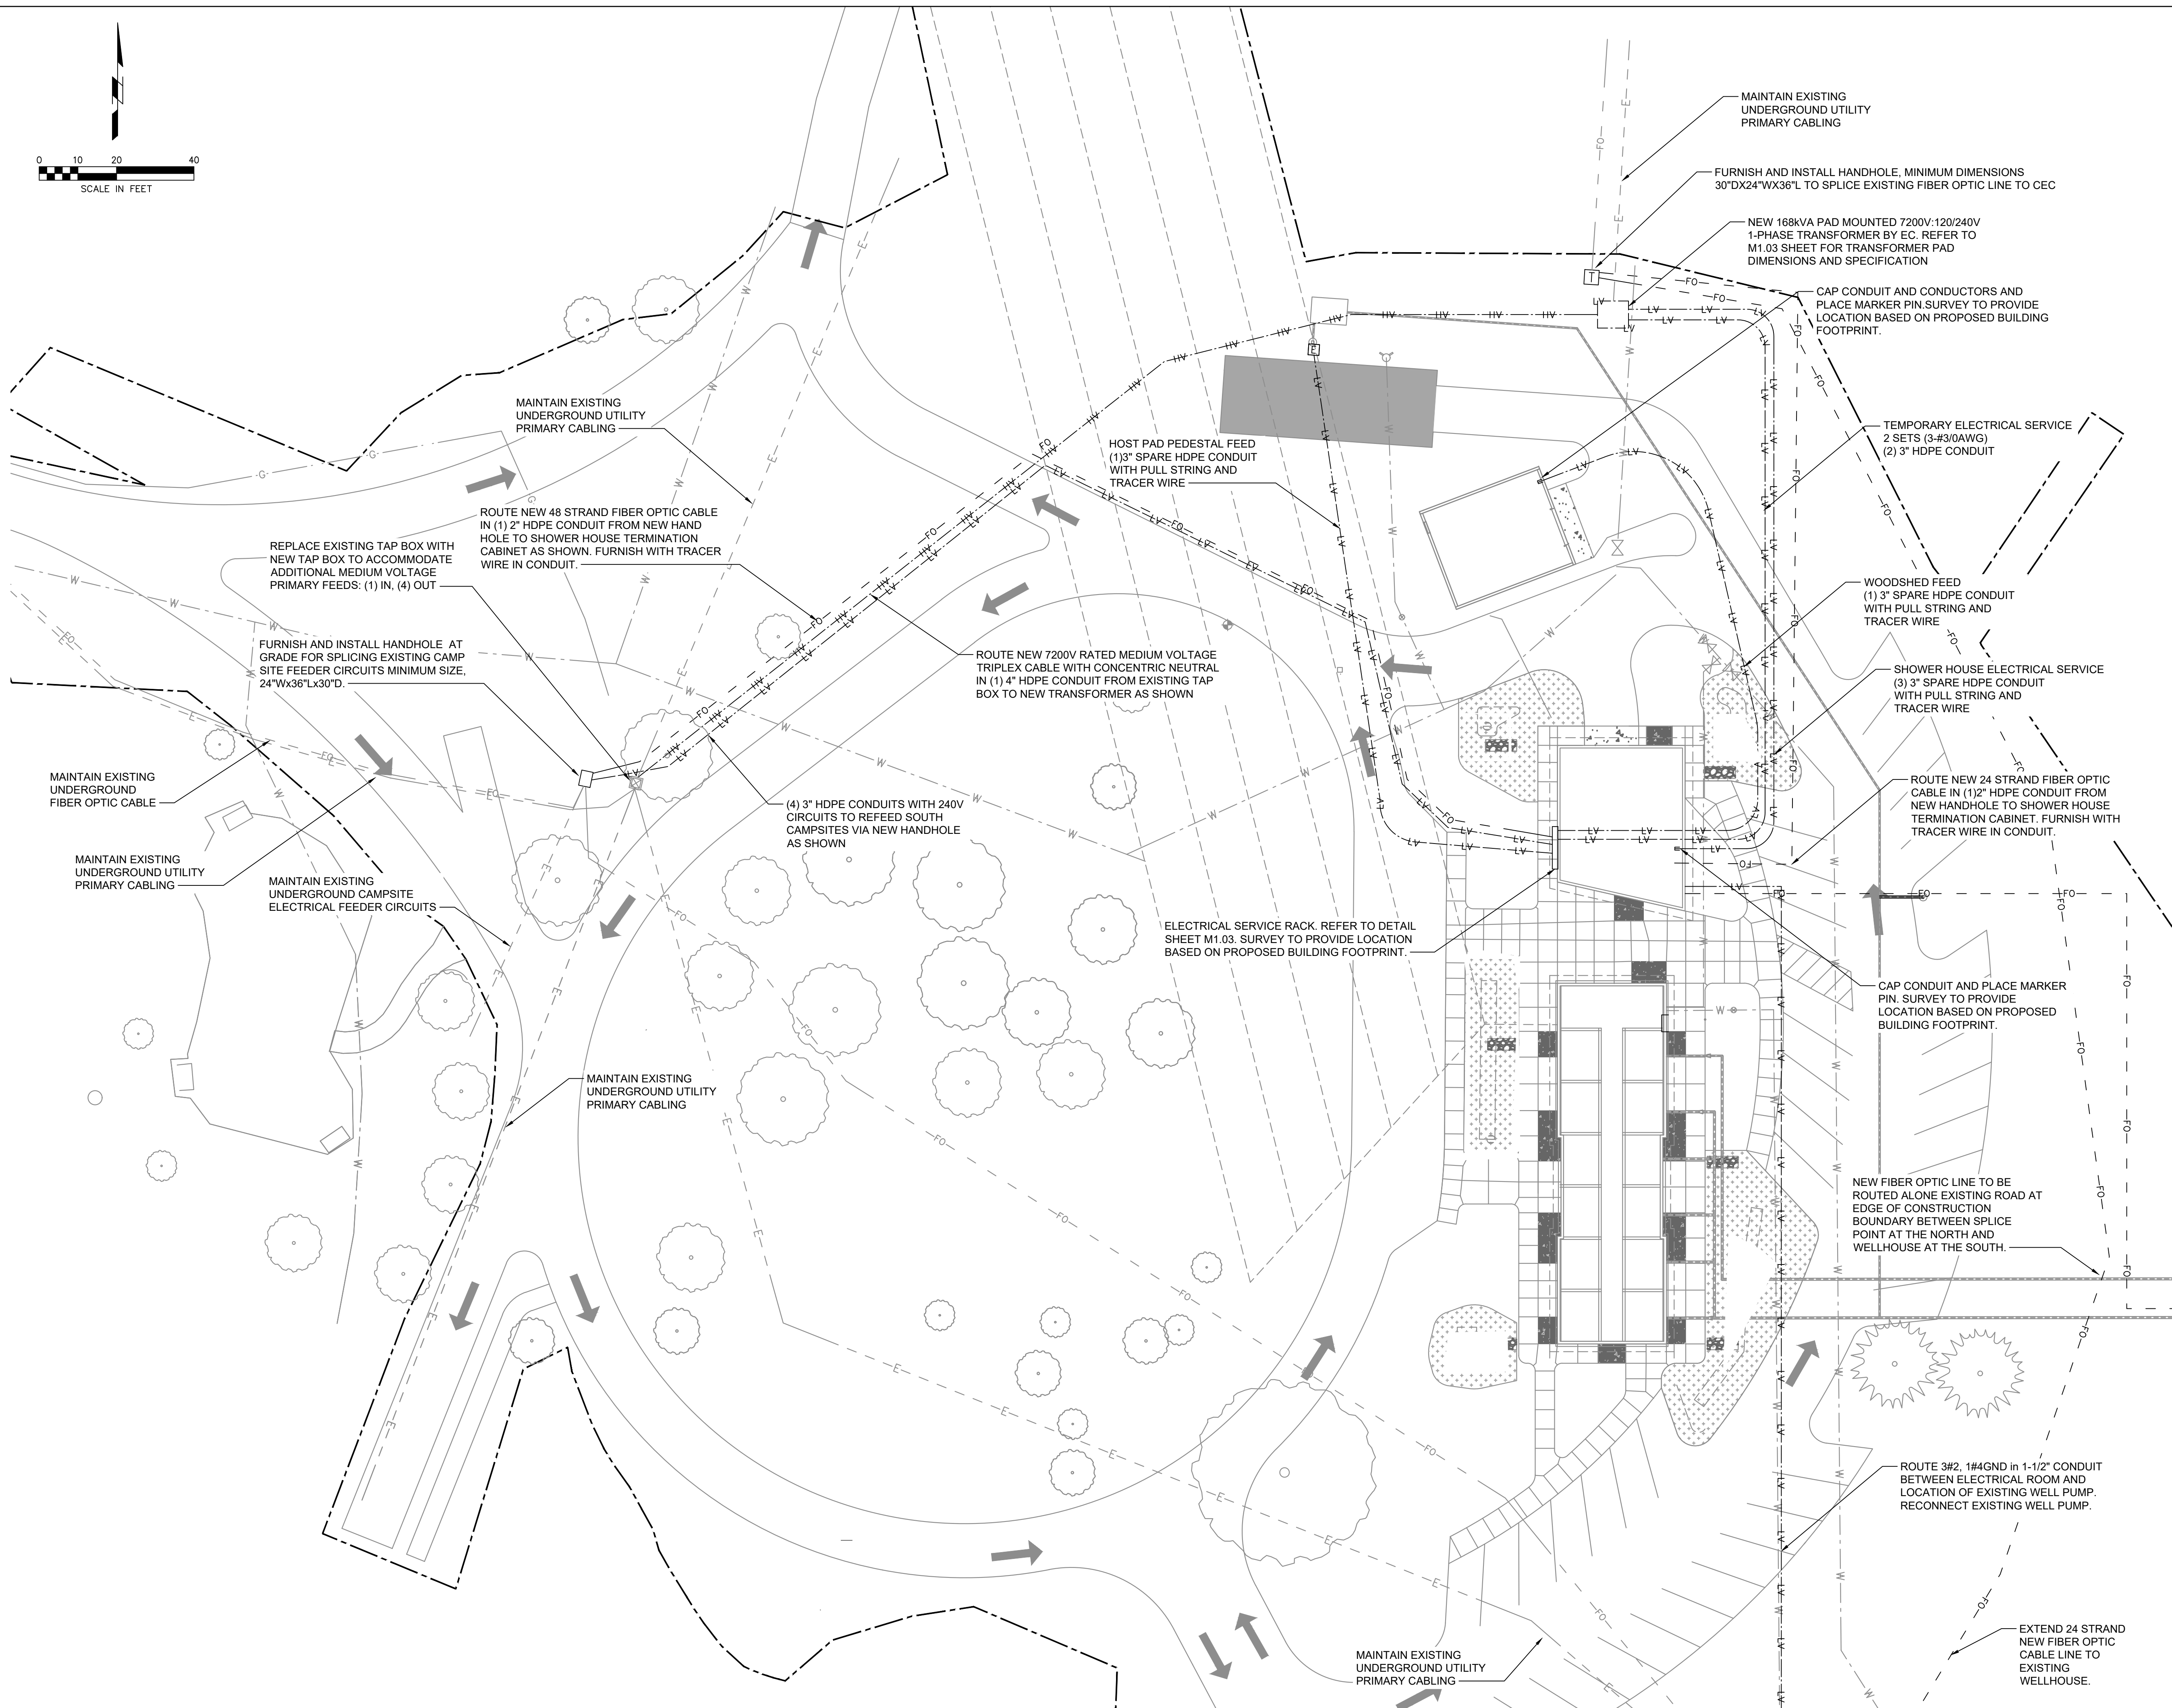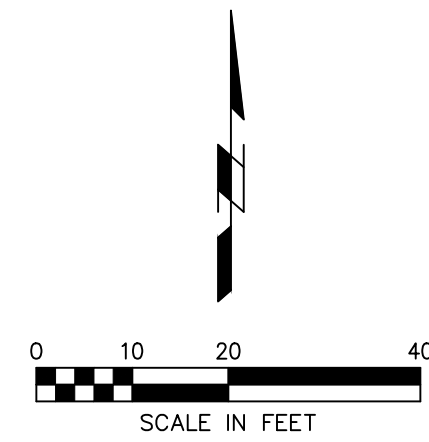


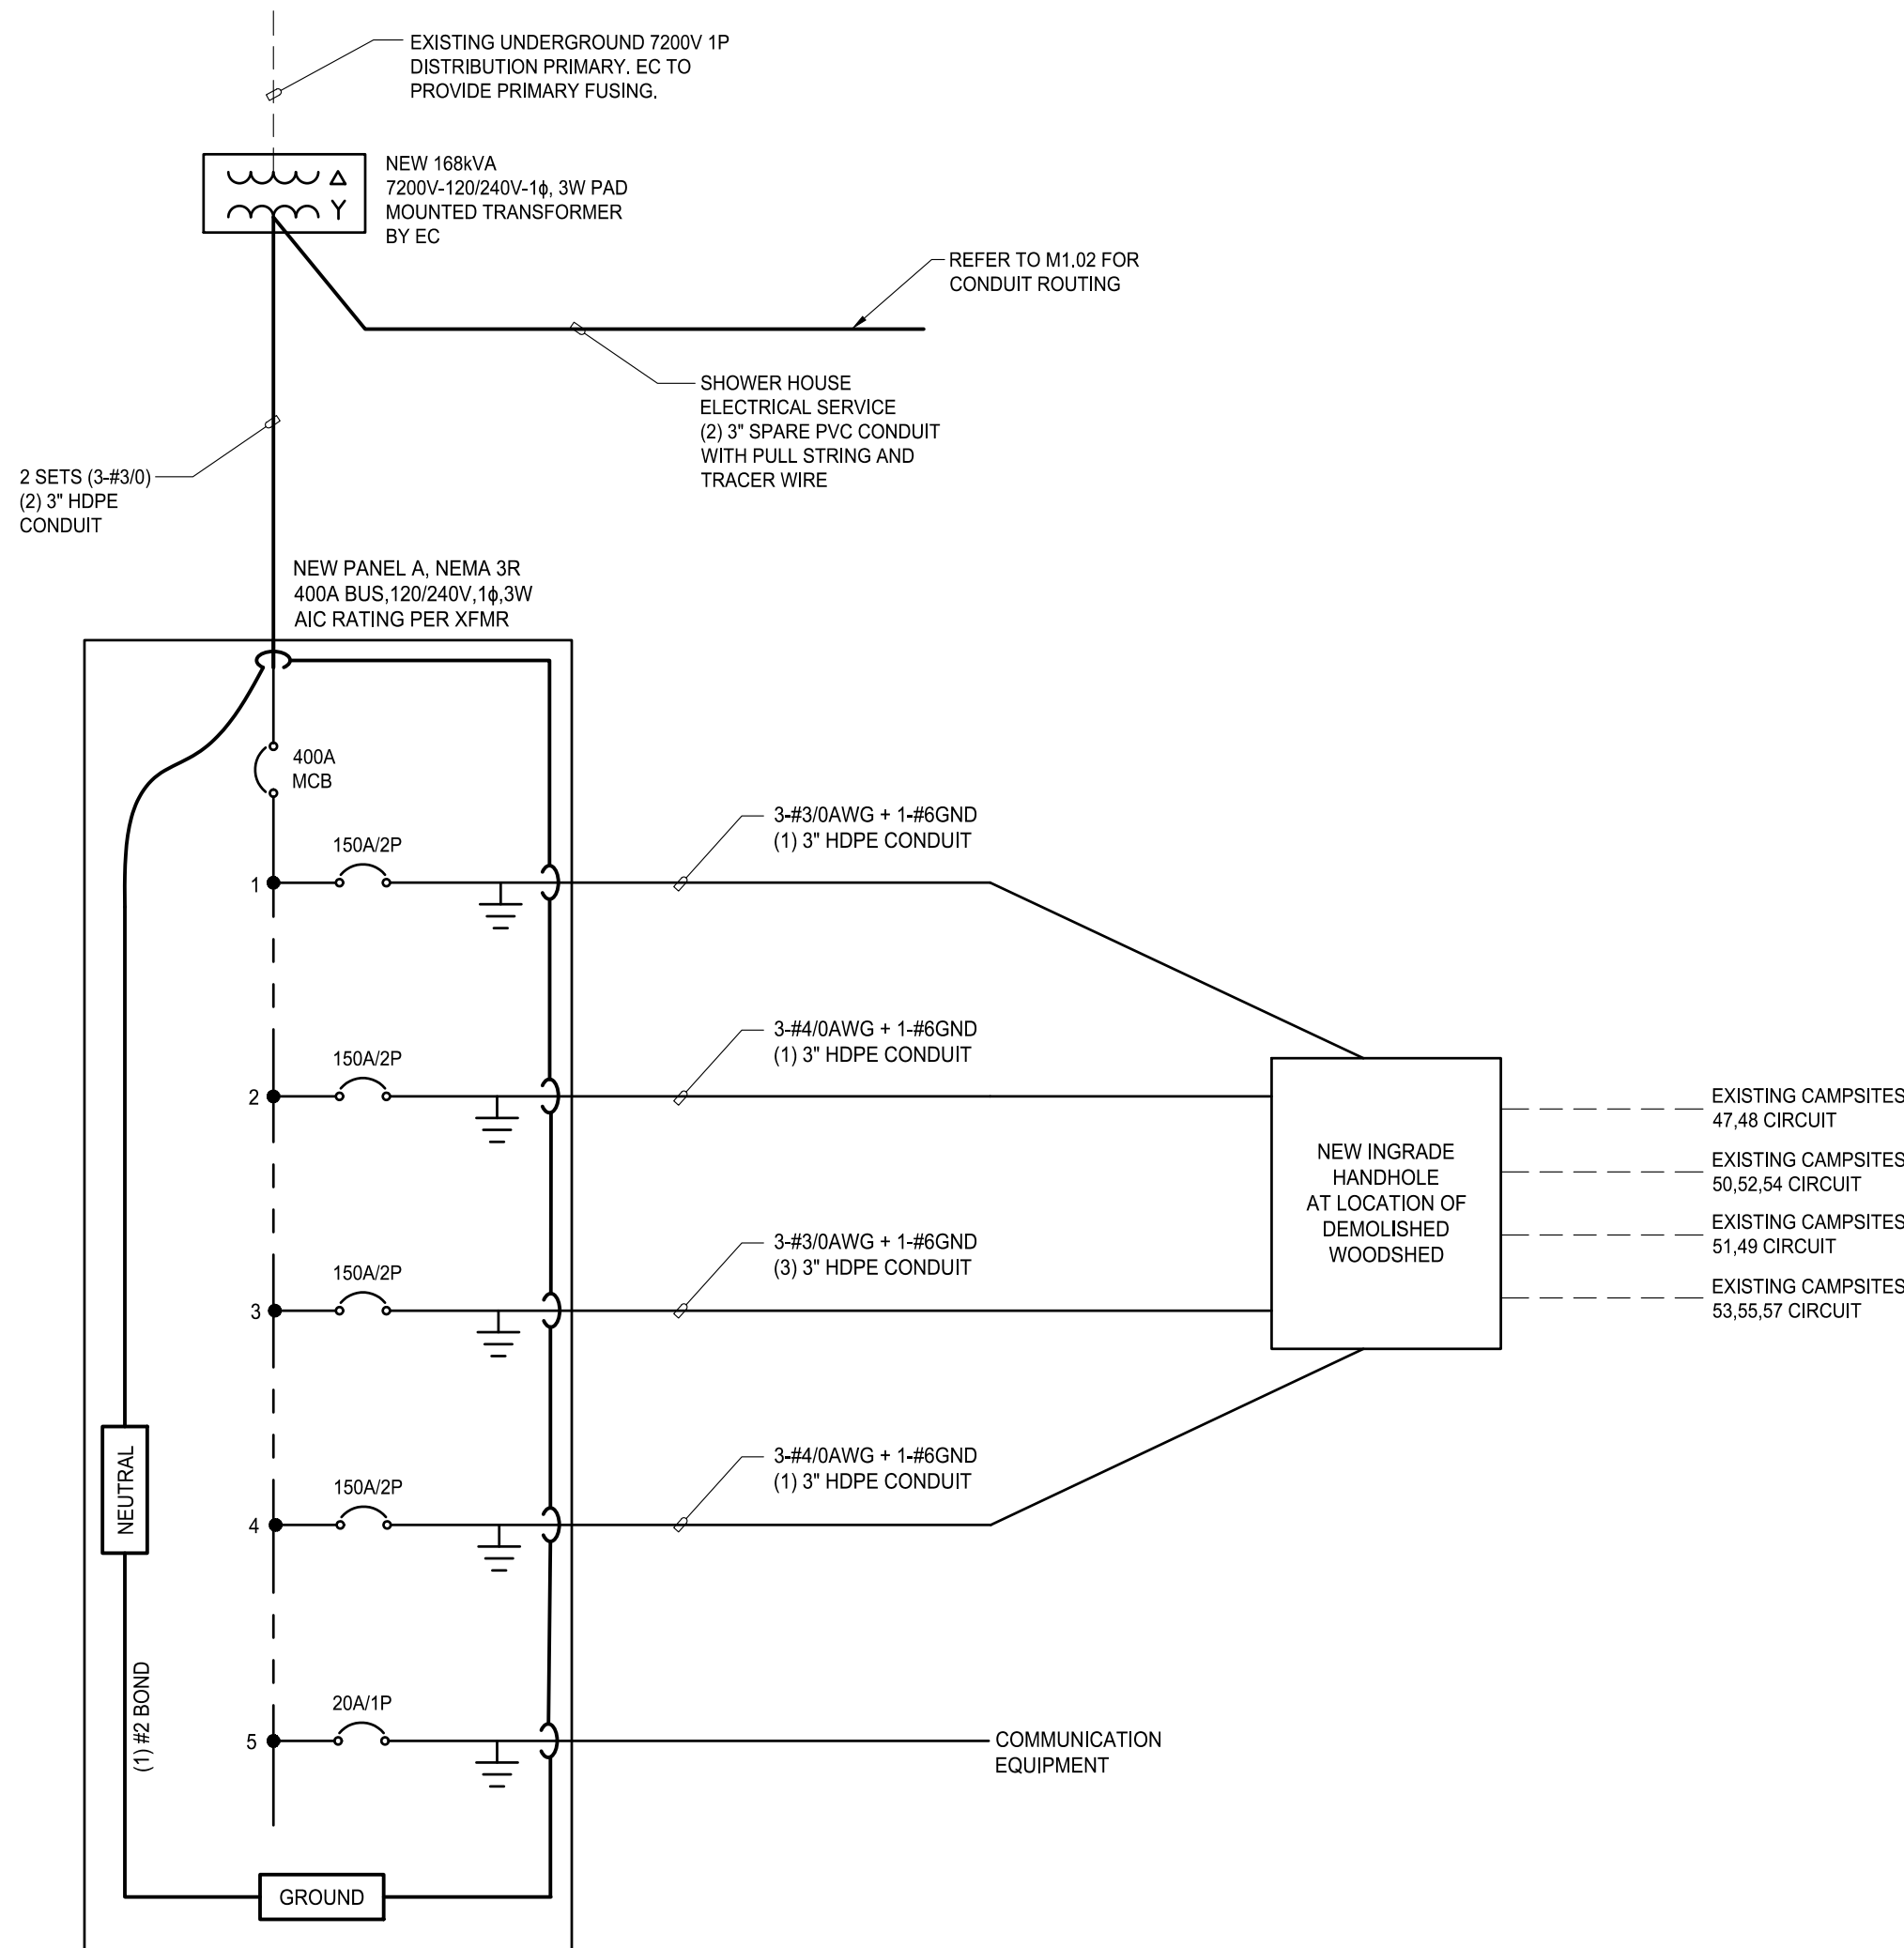

1 ONE-LINE DIAGRAM


SCALE: NONE

- NOTES:
- ALL MEDIUM VOLTAGE CABLING IN THE PARK IS OWNED BY JOHNSON COUNTY CONSERVATION. ANY BURIED MEDIUM VOLTAGE CABLE MUST BE HANDLED BY LICENSED CONTRACTOR CERTIFIED TO WORK AT DISTRIBUTION VOLTAGE. THIS INCLUDES UNDERGROUND SPLICING, ABOVE GRADE TAP BOXES, SETTING OF TRANSFORMERS AND ANY OTHER WORK NECESSARY TO COMPLETE THIS PROJECT.
 - NEW NEMA 3R PANEL MOUNTED TO RACK TO FEED EXISTING CAMPSITE CIRCUITS VIA NEW HANDHOLE IN LOCATION AS SHOWN ON SHEET M1.02. REFER TO ELECTRICAL RACK DETAIL THIS SHEET FOR MOUNTING INFORMATION.

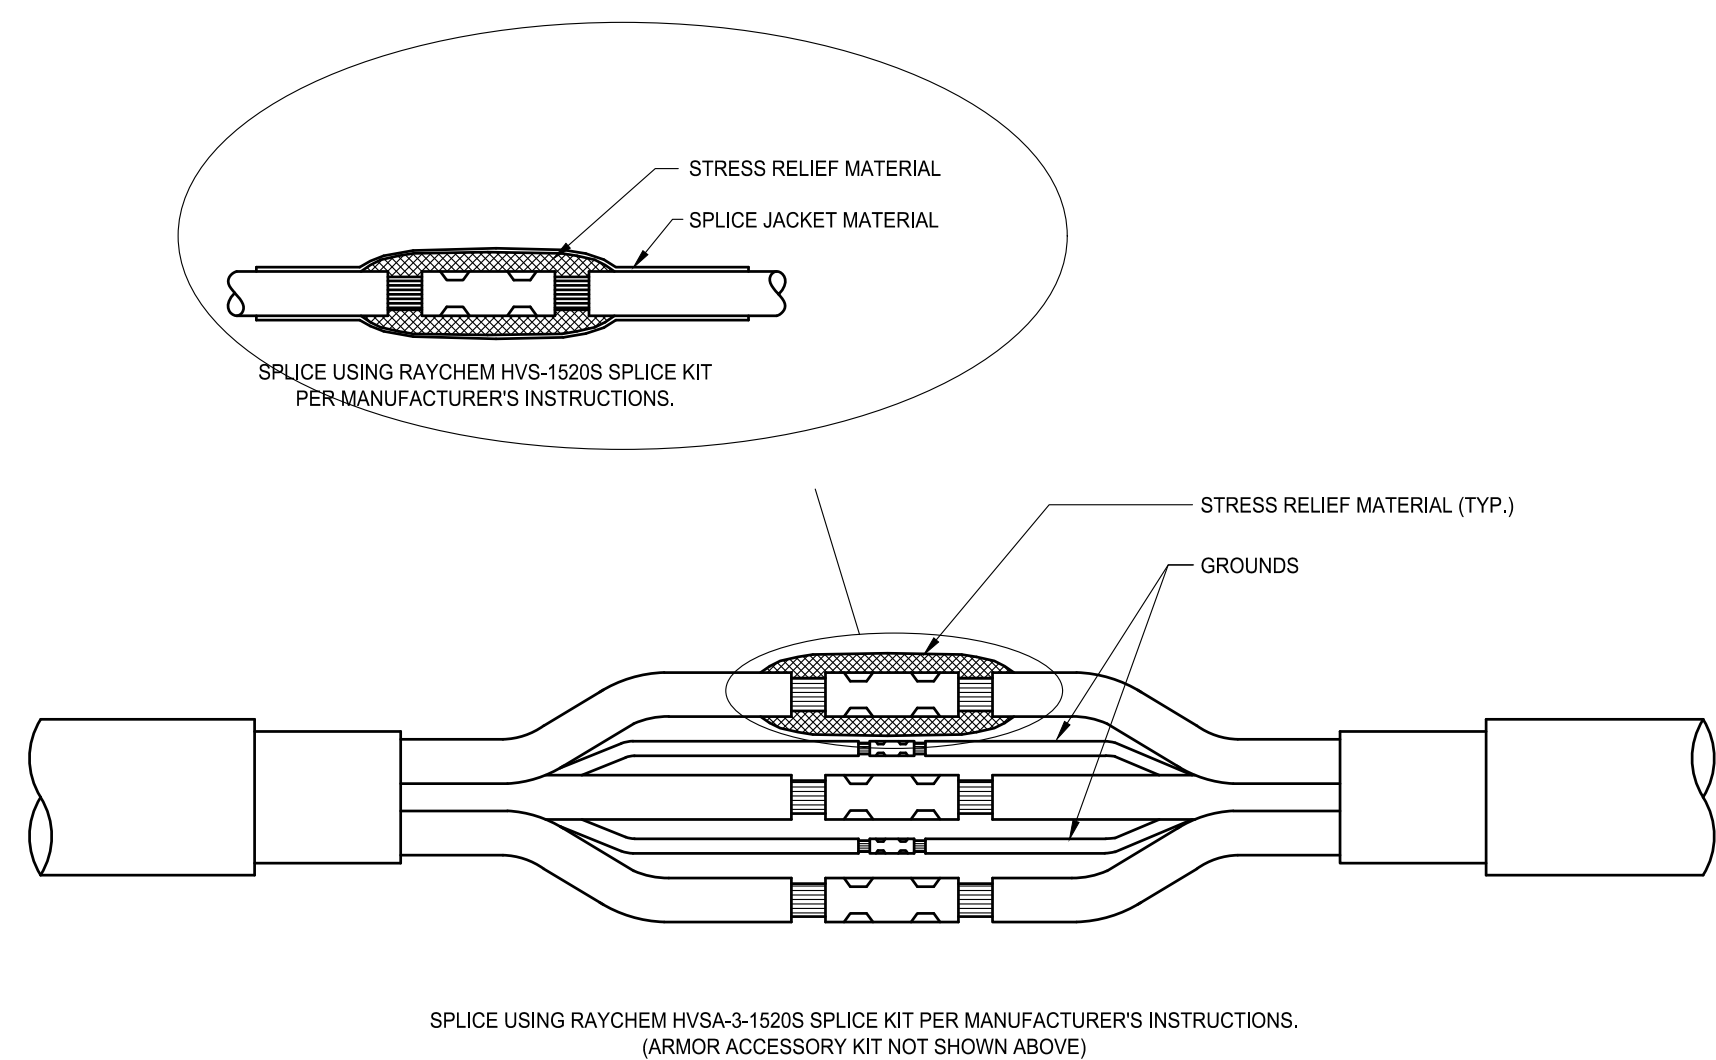

8 TYPICAL 3Ø, ARMORED 15KV CABLE SPLICE DETAIL

SCALE: NONE

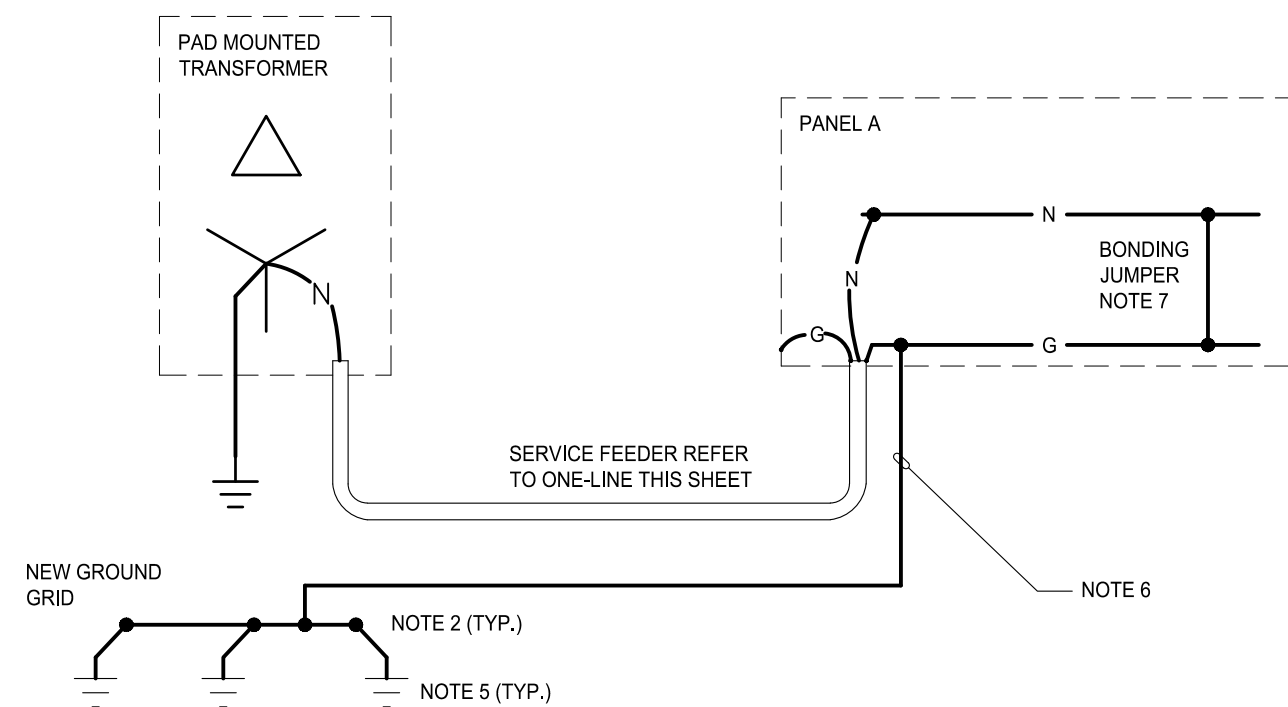


2 TYPICAL GROUNDING SYSTEM DETAIL

SCALE: NONE

GROUNDING SYSTEM NOTES:

- CONDUITS SHALL BE SECURED TO PANELBOARDS AND JUNCTION BOXES WITH LOCKING WEDGES OR LOCK NUTS. PROVIDE EXPANSION COUPLING.
- BURIED OR INACCESSIBLE GROUND CONNECTIONS MAY BE EXOTHERMIC WELD.
- NOT USED
- NOTE USED
- GROUND RODS SHALL BE 3/4"x10" COPPER CLAD STEEL DRIVER MIN. 24" BELOW FINISH GRADE.
- SIZE GROUNDING ELECTRODE AND EQUIPMENT GROUNDING CONDUCTORS PER NEC ARTICLE 250.
- PROVIDE BONDING JUMPER SIZE PER NEC 250.66

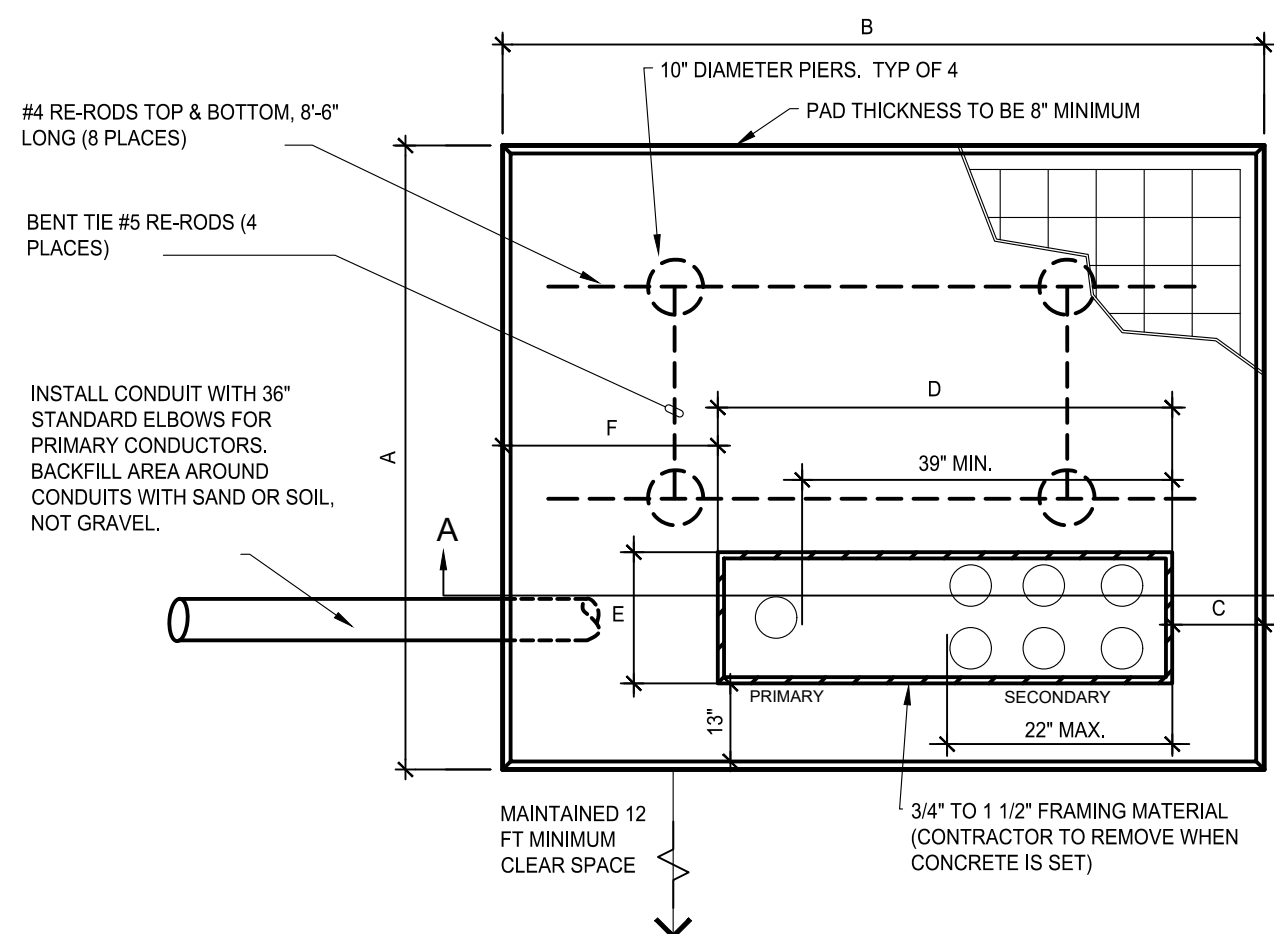


NOTES:

- THE CONTRACTOR SHALL INSTALL A CONCRETE TRANSFORMER PAD FOR THE UNDERGROUND SERVICE SINGLE PHASE TRANSFORMER.
- A CLEAR SPACE OF 10' SHALL BE MAINTAINED IN FRONT OF THE TRANSFORMER TO PROVIDE WORKING SPACE FOR HOT-STICK OPERATION OF THE TRANSFORMER.
- ADDITIONAL TRANSFORMER PAD FOUNDATION WALL SHALL BE USED FOR LOCATIONS HAVING POOR SOIL CONDITIONS OR A LARGE NUMBER OF SECONDARY CABLES.
- VERIFY EXACT SIZE OF TRANSFORMER WITH APPROVED SUBMITTAL PRIOR TO ANY PAD WORK.
- ALL CONDUITS SHALL ENTER THROUGH THE WINDOW OPENING PROVIDED IN THE PAD FOUNDATION. THESE CONDUITS SHALL BE CUT OFF SO THE TOP OF THE CONDUIT IS FLUSH WITH THE SURFACE OF THE CONCRETE PAD.
- ALL METALLIC CONDUITS SHALL BE FITTED WITH AN INSULATING BUSHING.
- CONCRETE MIX SHALL HAVE A MINIMUM STRENGTH OF 4000 LB/SQ. IN. AFTER 28 DAYS.
- THE TOP OF PAD SHALL BE LEVEL AND ALL EDGES AND CORNERS ROUNDED OFF.
- THE PAD SHALL BE REINFORCED WITH #4 WIRE, 4"x4" WELDED MESH OR EQUIVALENT MATERIALS WITH ADDITIONAL 3/8" REINFORCING RODS AROUND THE CABLE OPENING. THE MESH SHALL NOT BE LESS THAN 1" FROM THE EDGES AND OPENING, AND 2" BELOW THE SURFACE. IF THE #4 WIRE, 4"x4" MESH IS NOT AVAILABLE, 2 LAYERS OF #10 WIRE, 6"x6" MESH, HORIZONTALLY STAGGERED, MAY BE SUBSTITUTED FOR THE #4 WIRE.

PAD DIMENSION SCHEDULE		PAD MINIMUM DIMENSIONS*					
1-PHASE KVA	SERV. SIZE	A	B	C	D	E	F
75-500	120/240V	84"	96"	10"	55"	13"	31"

PRIMARY CONDUITS SHALL BE CENTERED ALONG BACK EDGE OF BOX-OUT. ALL CONDUITS SHALL EXTEND 1" MAX ABOVE TOP OF PAD (TYPICAL)


* PROVIDE PAD SIZE AS REQUIRED FOR TRANSFORMER THAT IS PROVIDED, BASED ON APPROVED SUBMITTAL

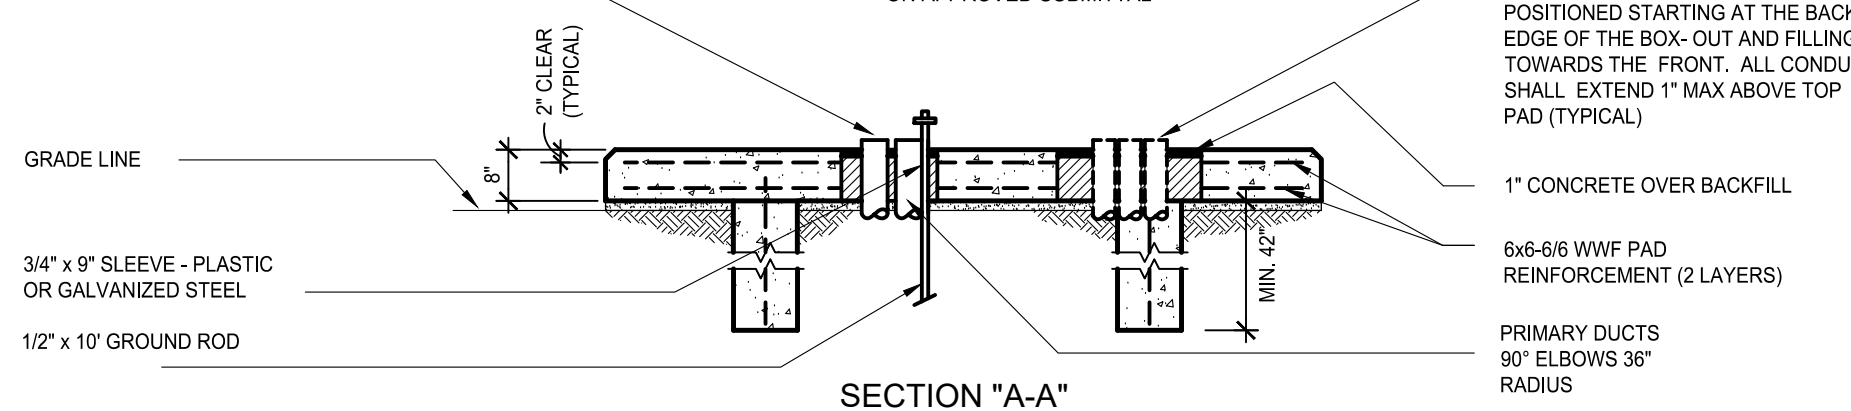

ACCEPTABLE OPTION TO OBTAIN AND INSTALL A SINGLE PHASE TRANSFORMER BOX FROM THE LOCAL REC UTILITY IN PLACE OF POUR-IN-PLACE TRANSFORMER PAD.


3 TYPICAL TRANSFORMER PAD DETAIL (FOR BIDDING PURPOSES)

SCALE: NONE

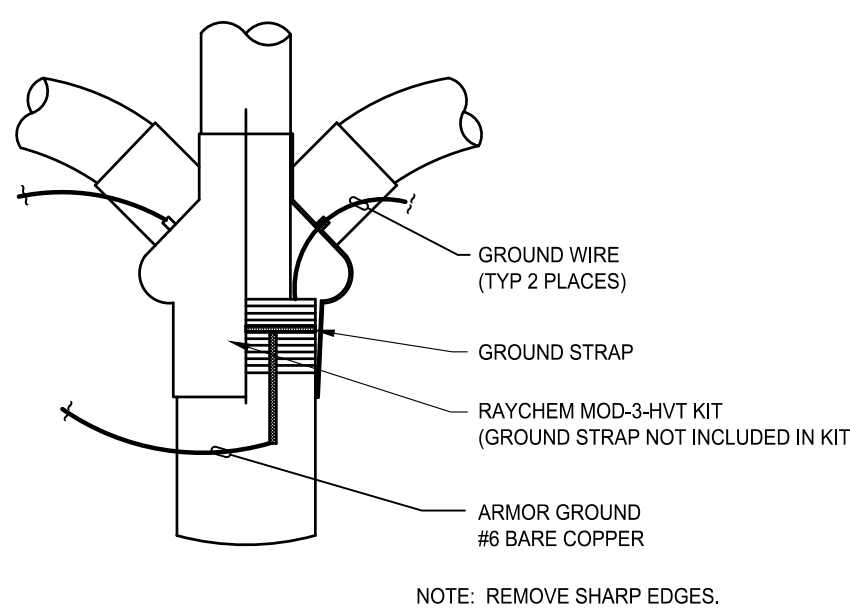


7 15KV MULTICONDUCTOR ARMORED CABLE BREAKOUT

SCALE: NONE

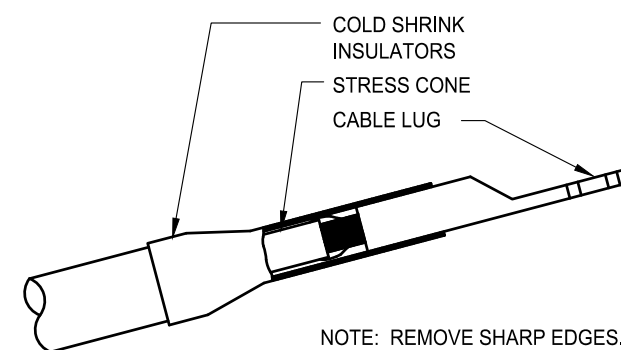

6 TYPICAL CABLE LUG TERMINATION


SCALE: NONE

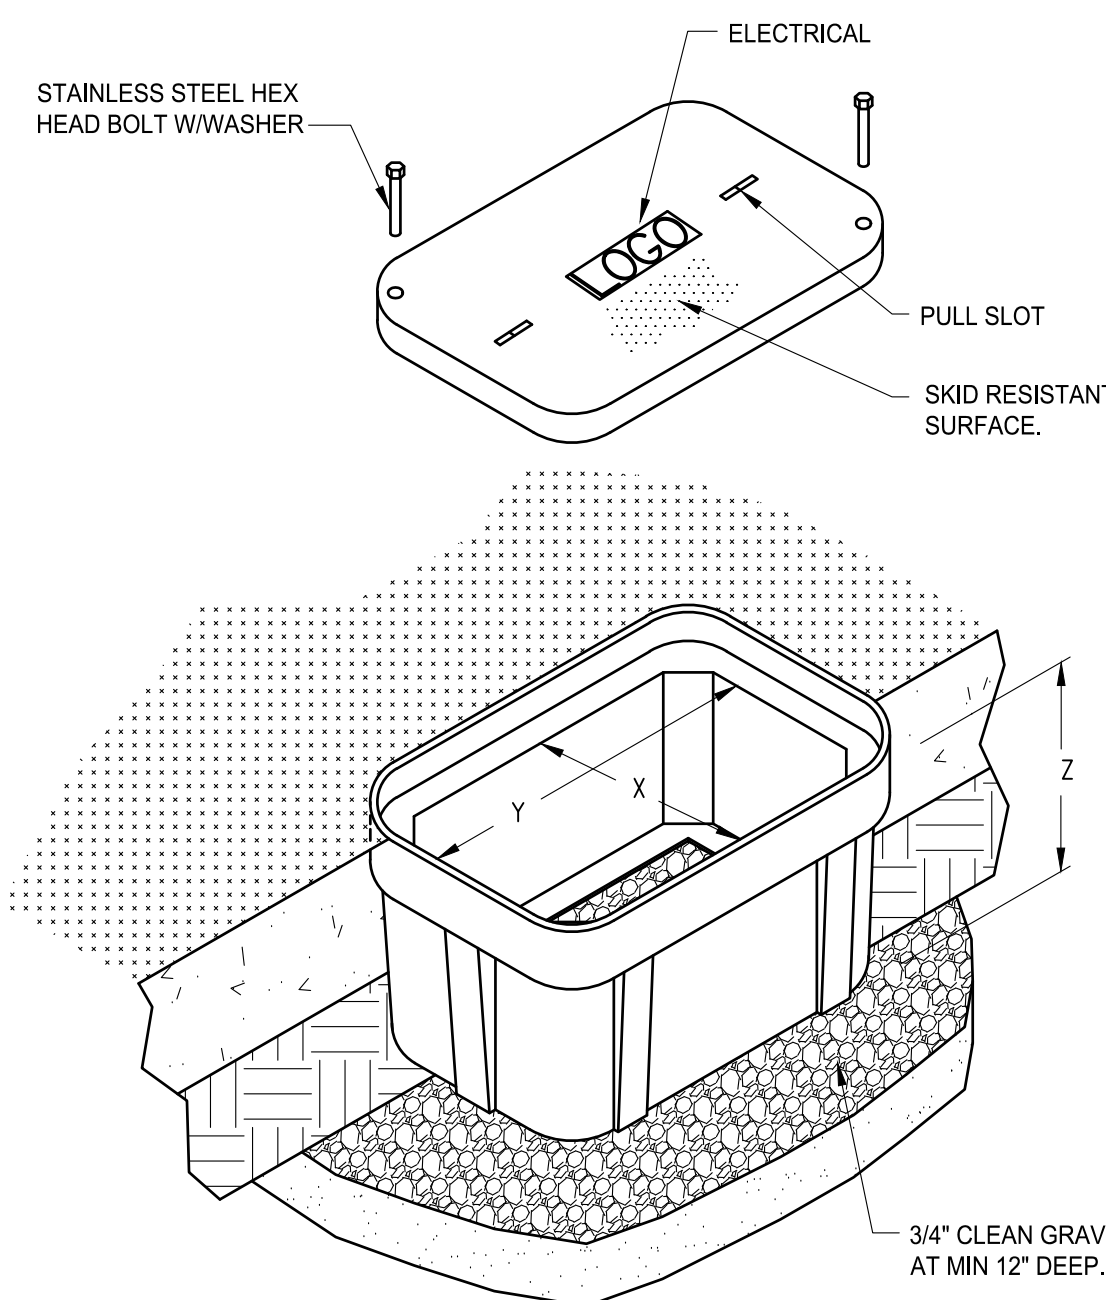

- NOTES:
- SWEEP CONDUITS UP THROUGH PEA GRAVEL AND OPEN BOTTOM OF HANDHOLE.
 - PULLBOX DIMENSIONS SHALL BE DETERMINED BY EC TO MEET NEC 314 FILL PERCENTAGES.

4 TYPICAL HANDHOLE DETAIL







SCALE: NONE

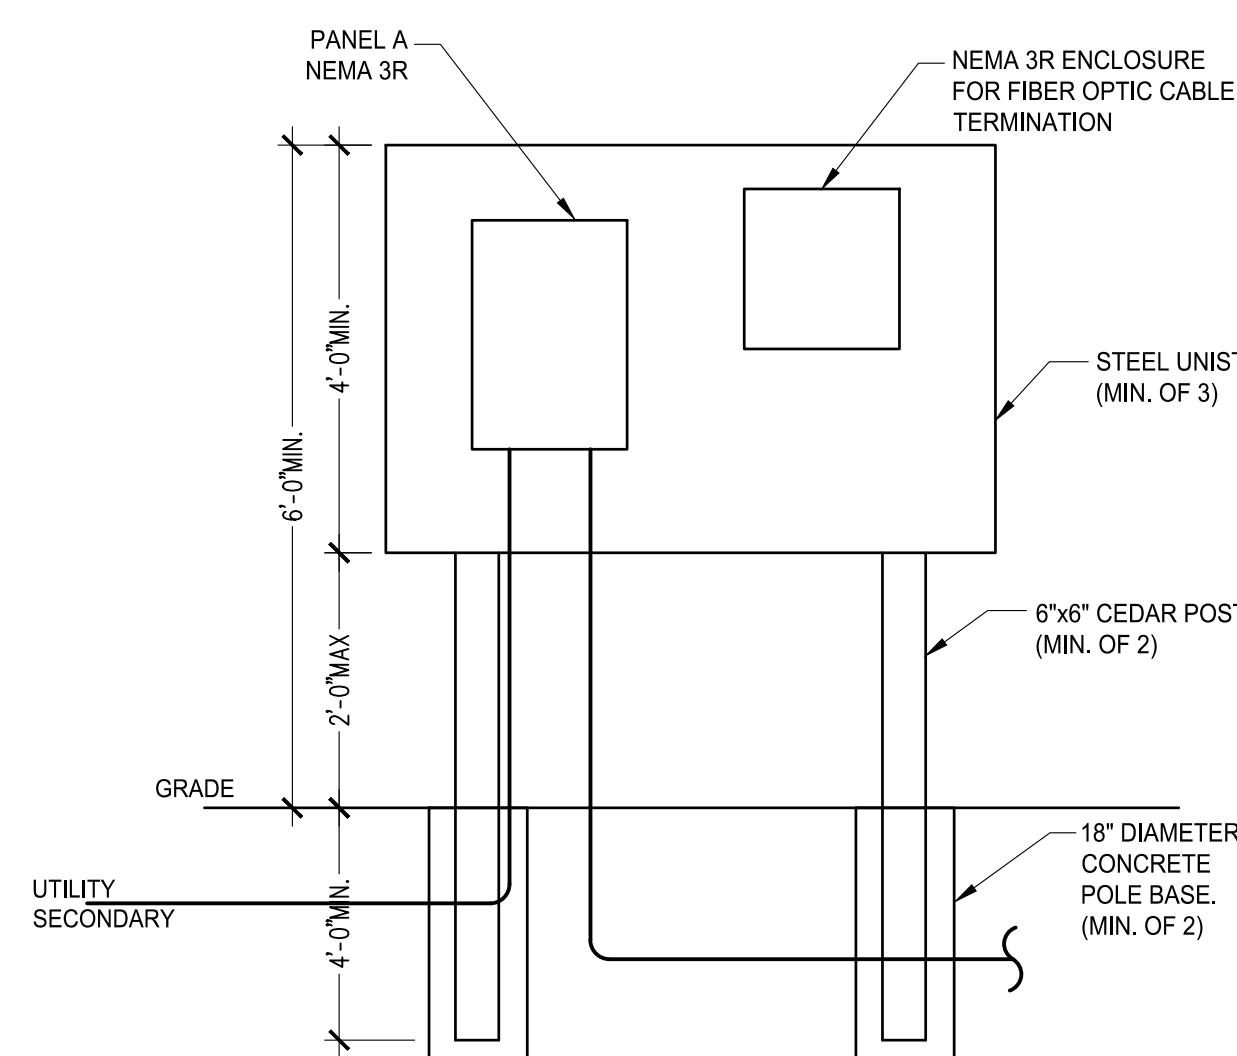



- NOTES:
- EC SHALL DESIGN THE STRUCTURE BASED ON LAYOUT FOR EQUIPMENT SUPPLIED, INCLUDING BUT NOT LIMITED TO THE WIDTH AND NUMBER OF POSTS.
 - NOT ALL REQUIRED CONDUITS SHOWN
 - FASTEN UNISTRUT TO POSTS WITH GALVANIZED HARDWARE

5 ELECTRICAL SERVICE RACK DETAIL

SCALE: NONE

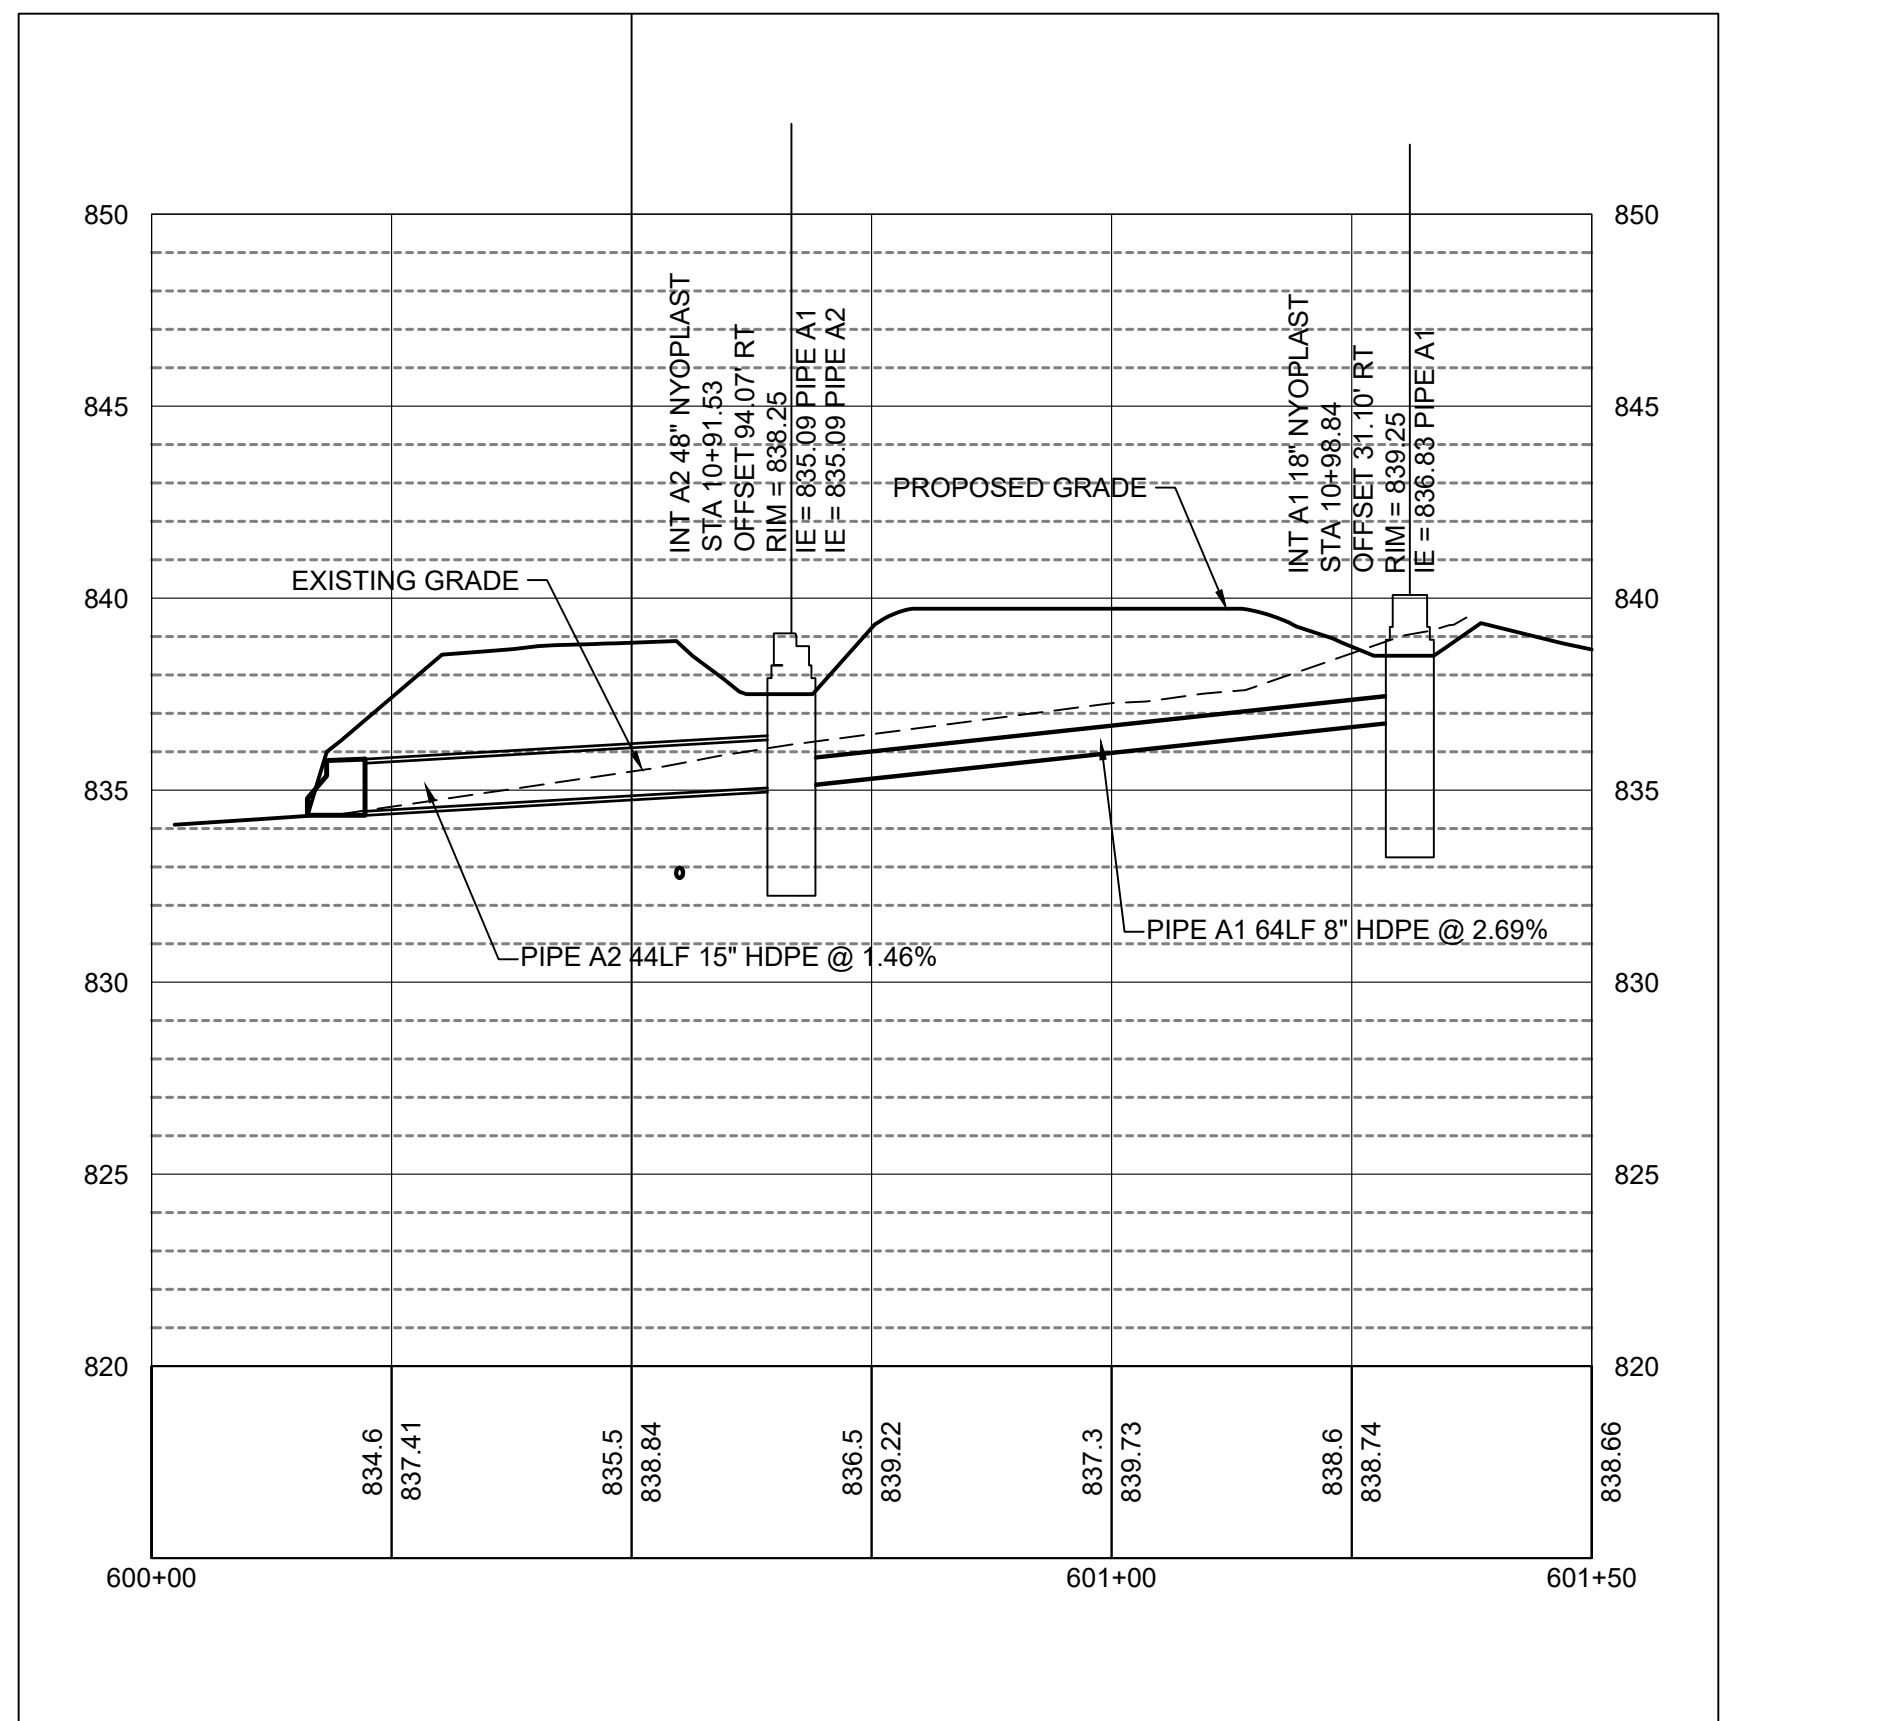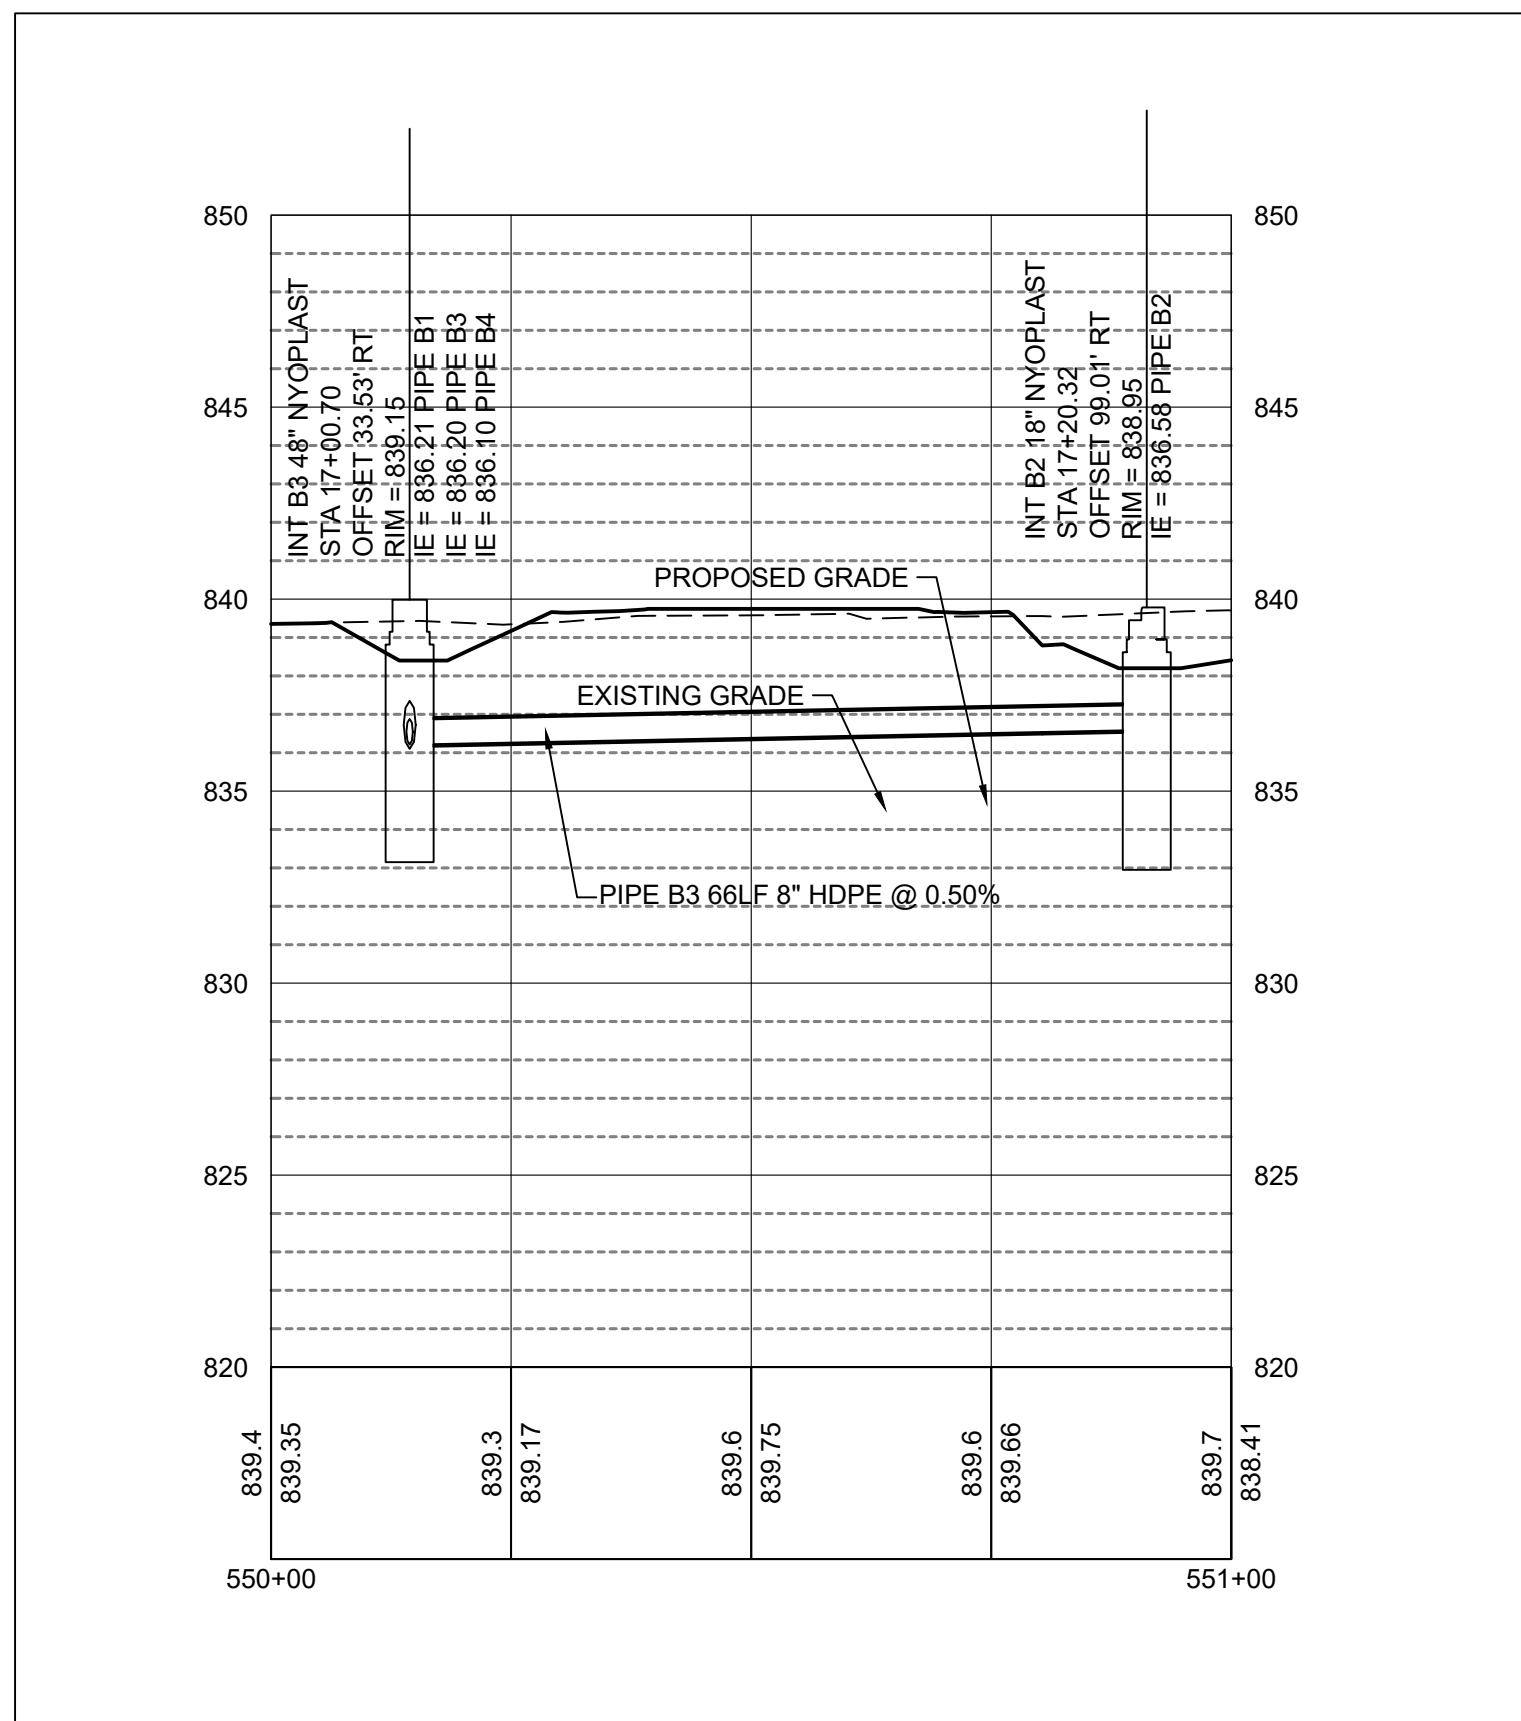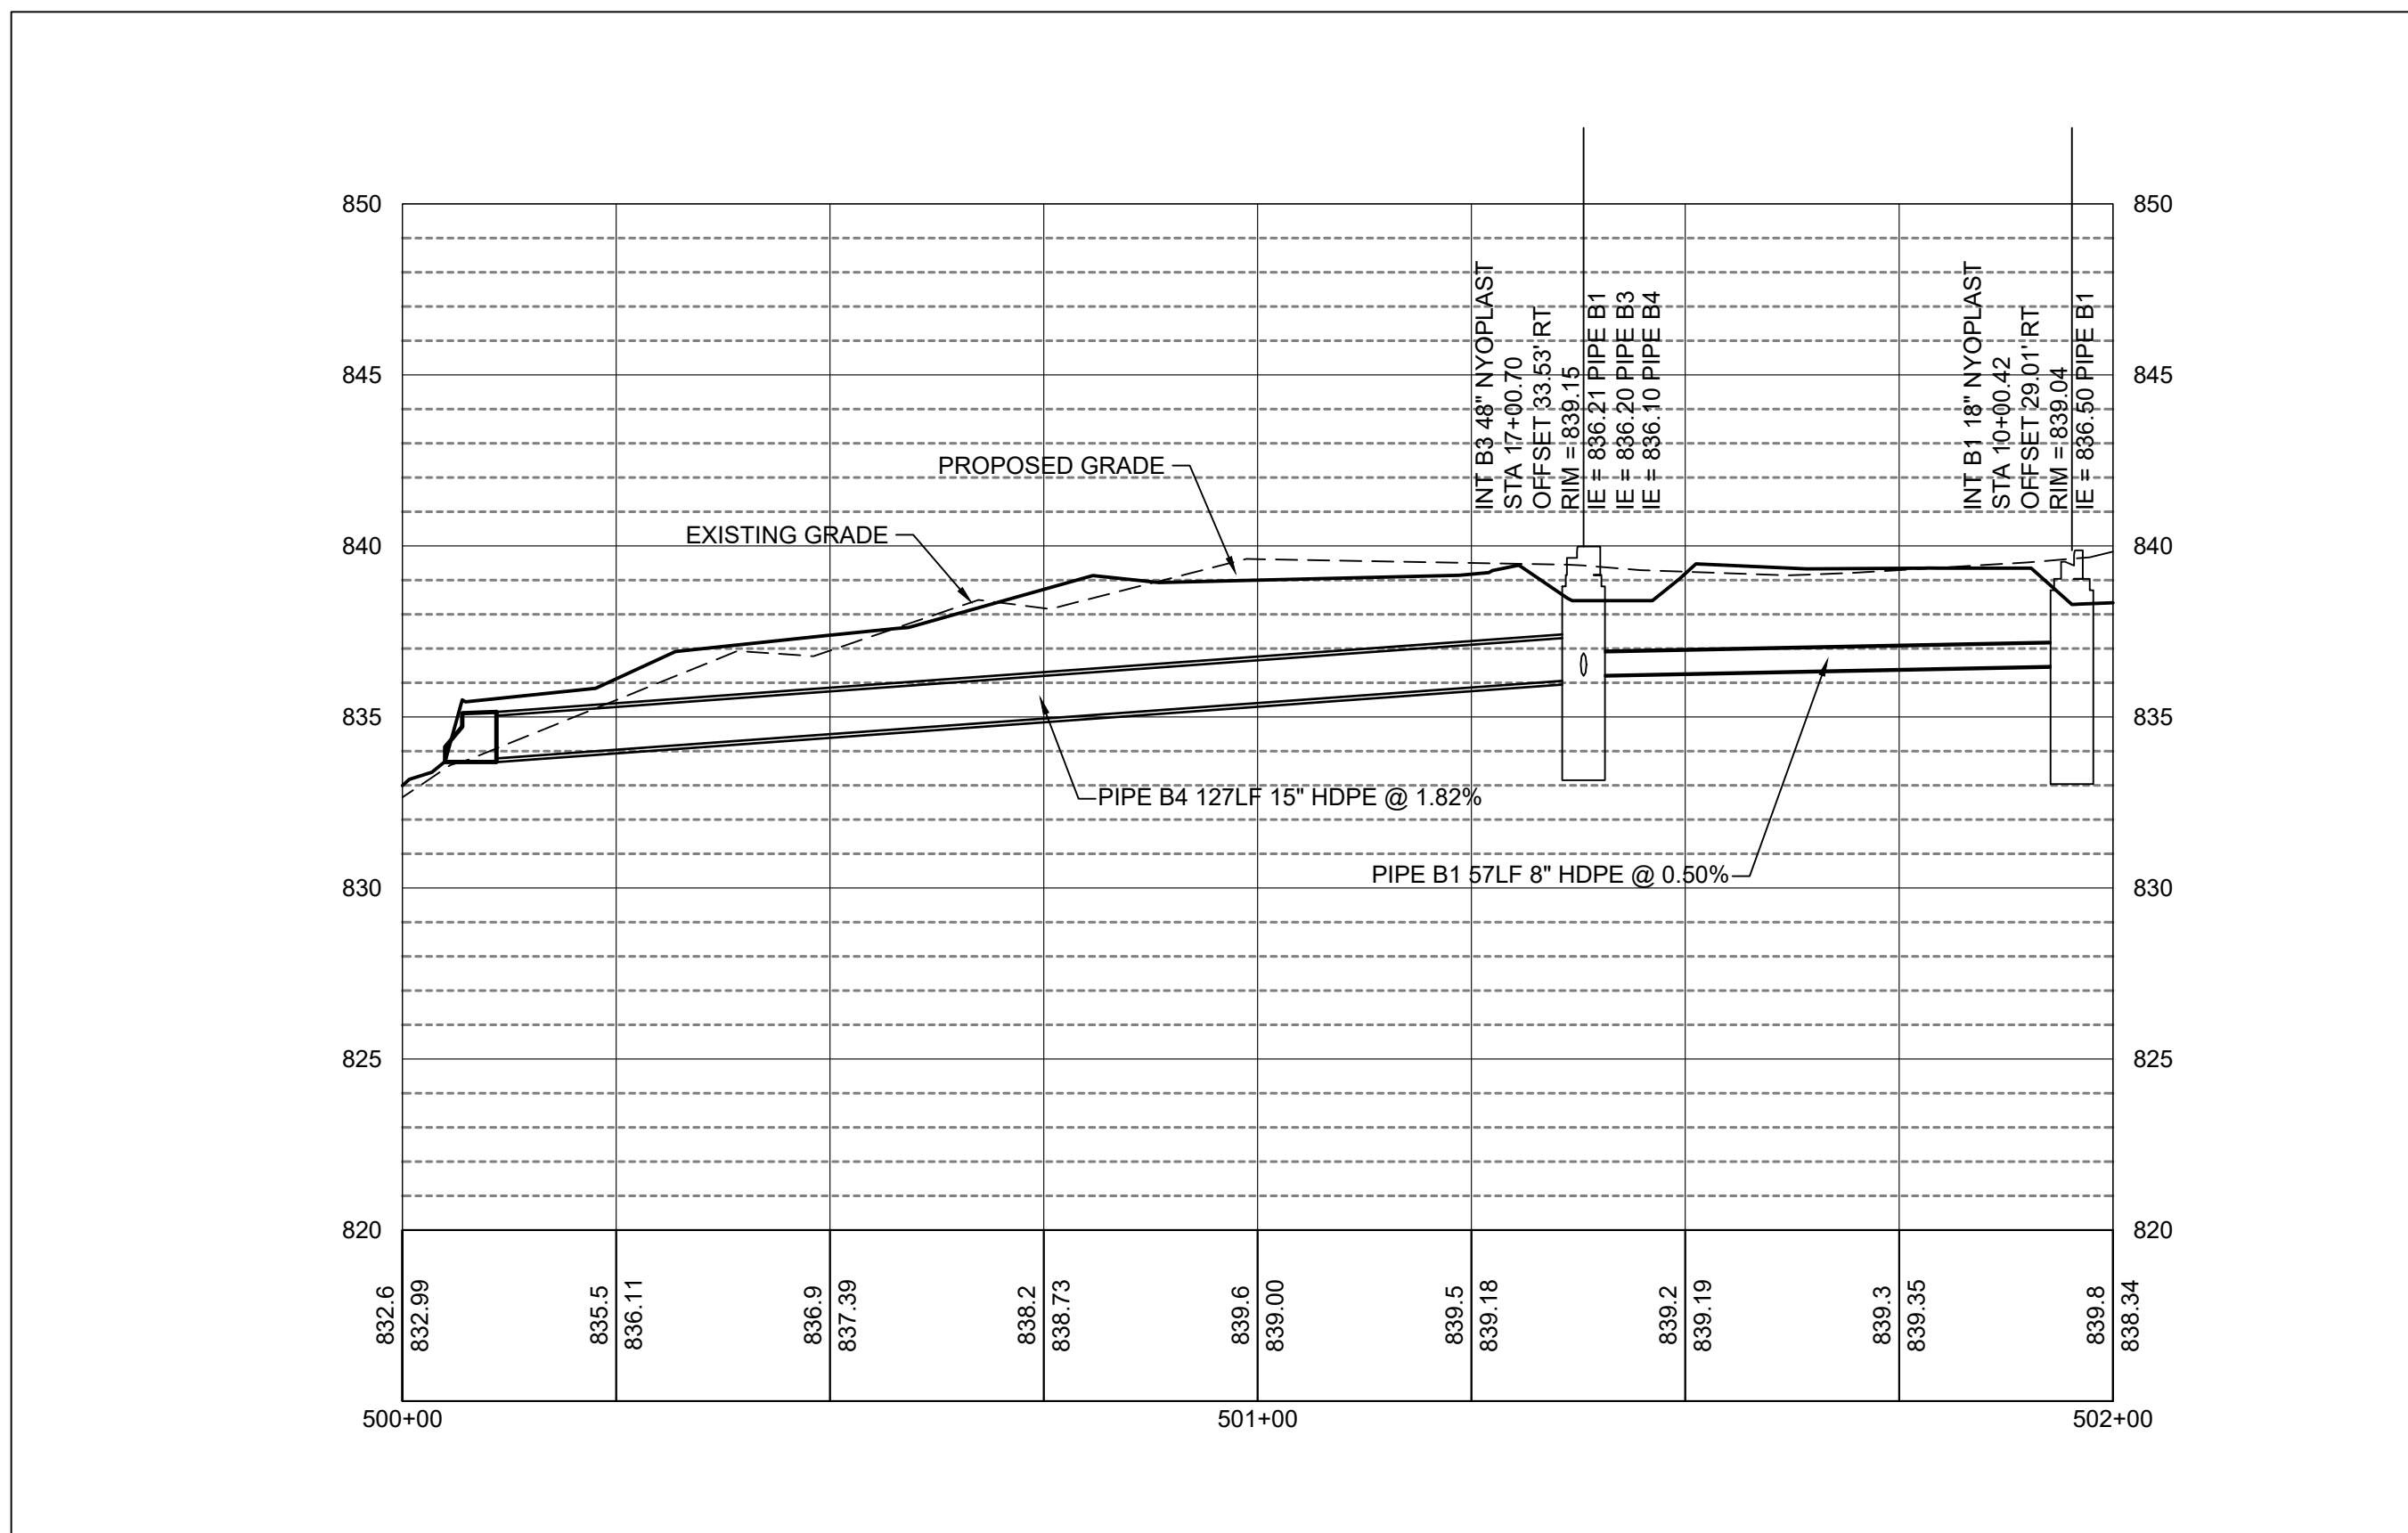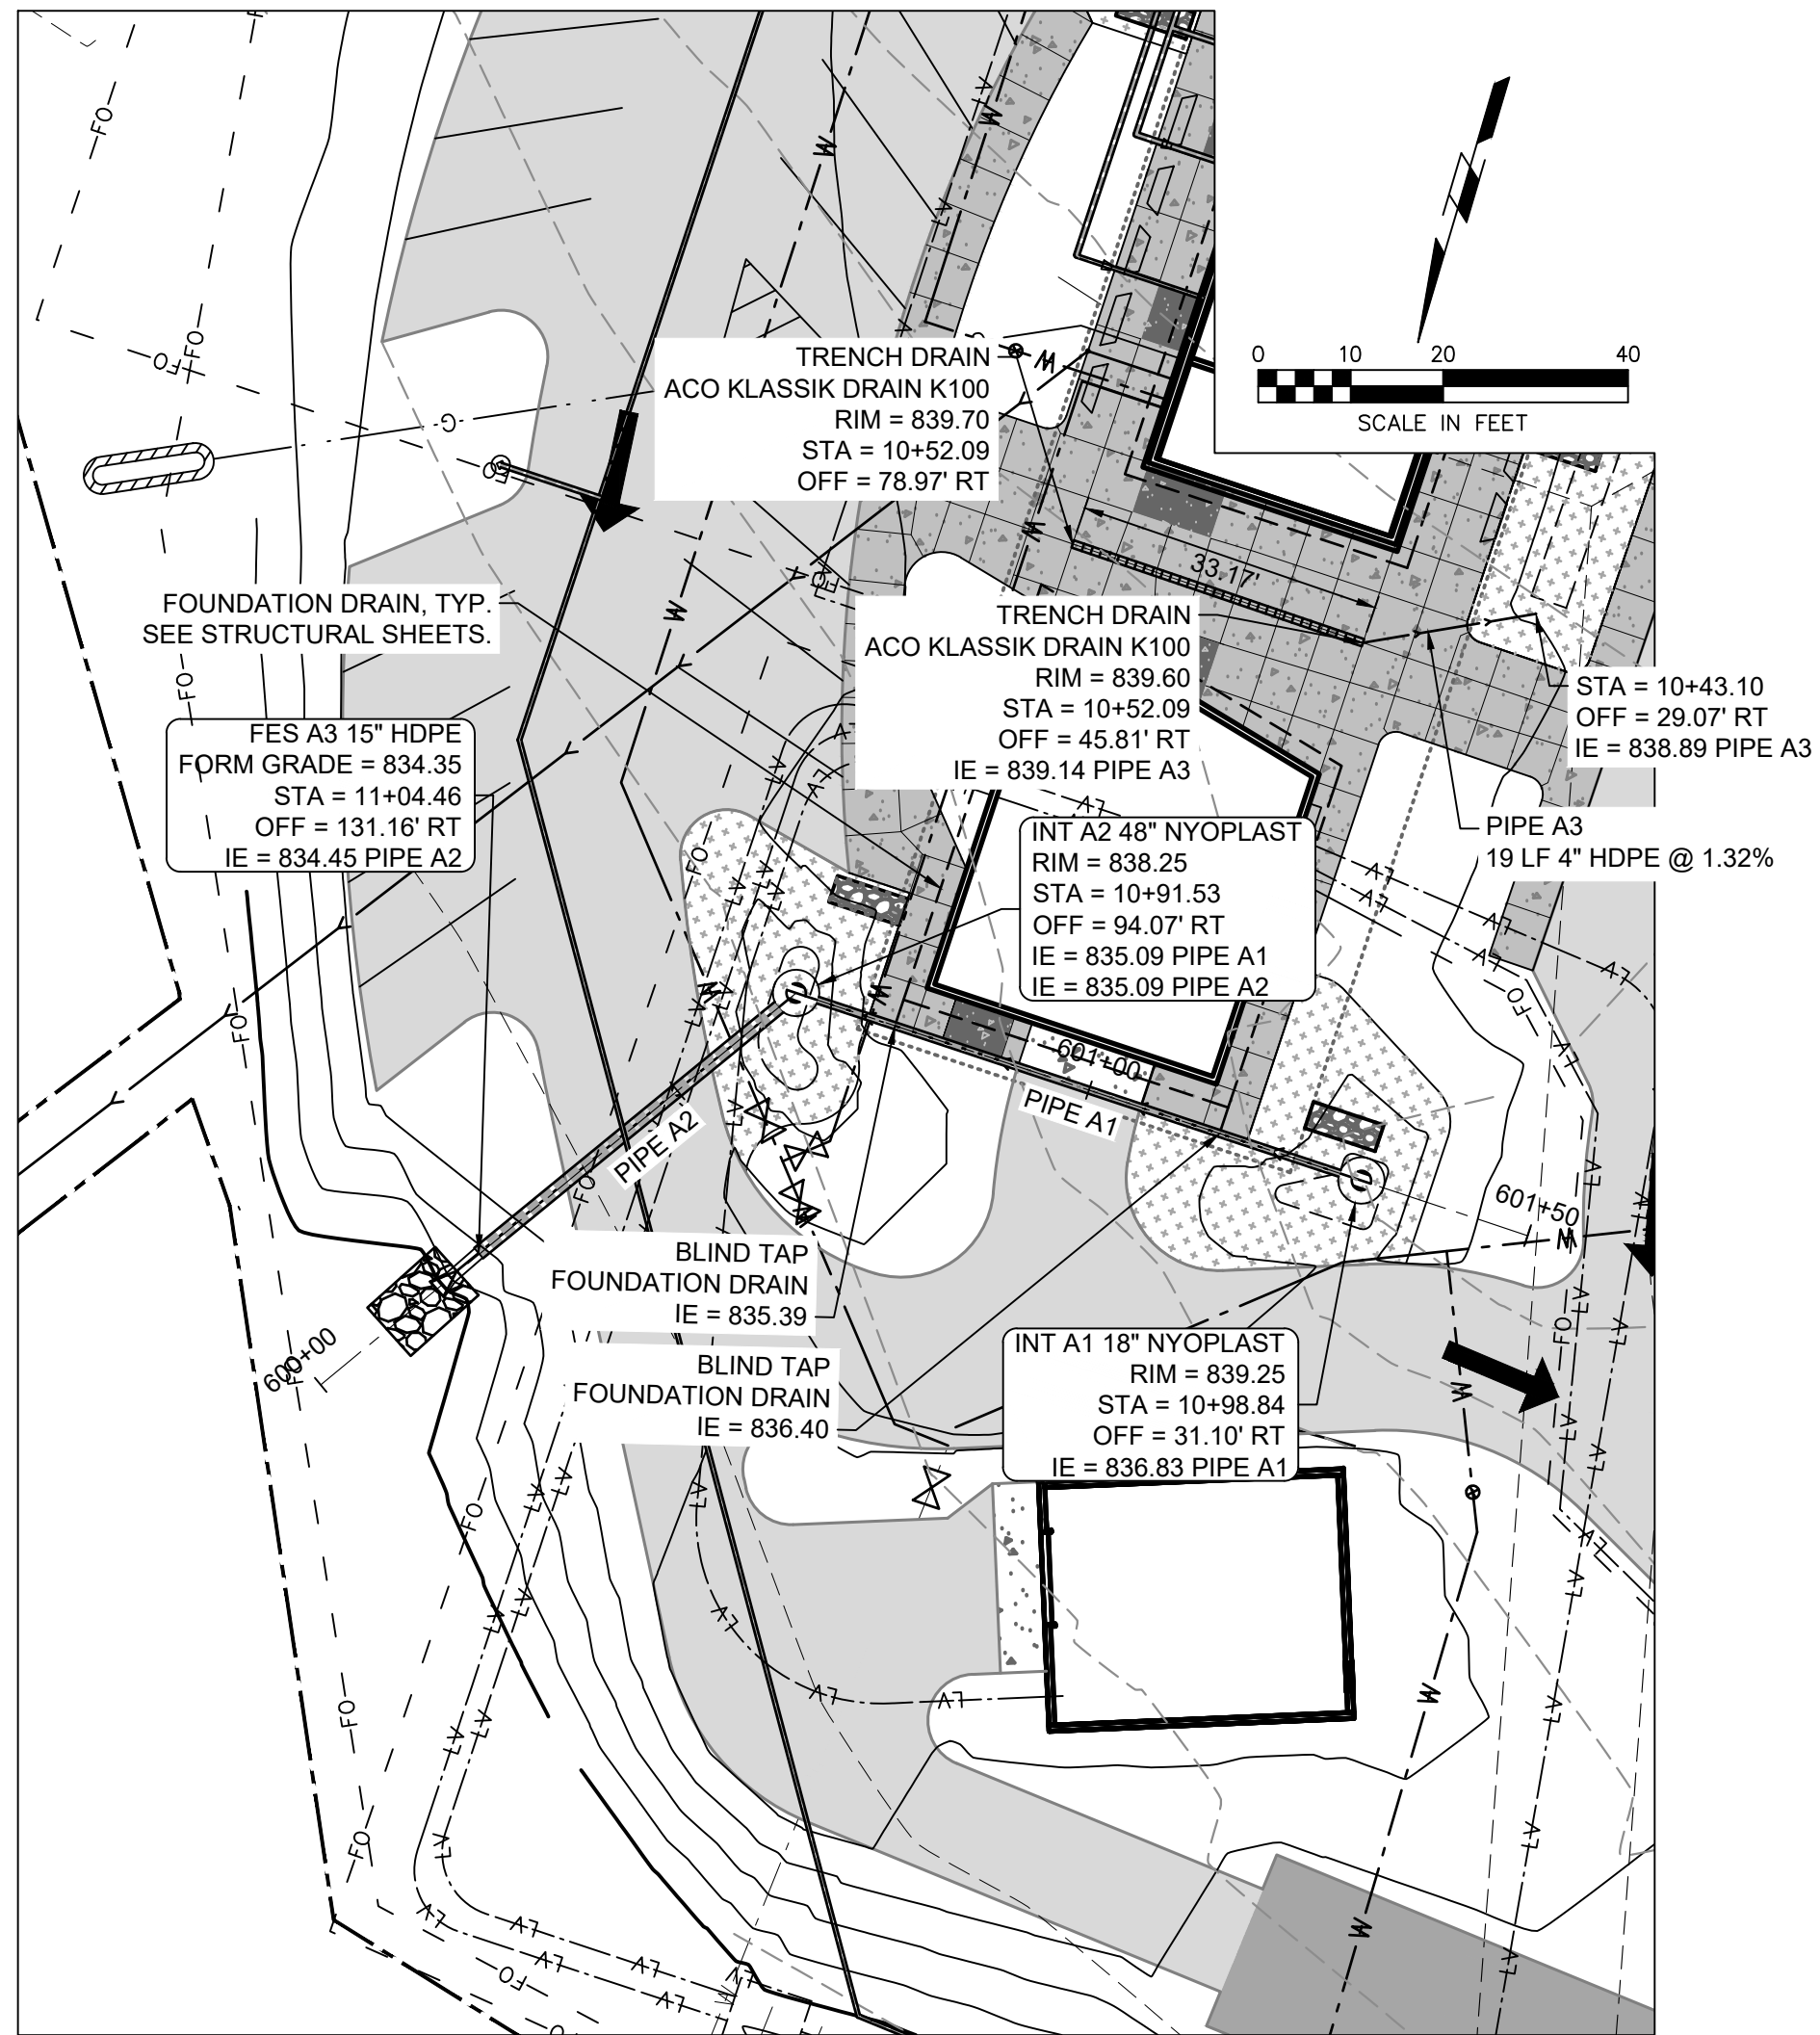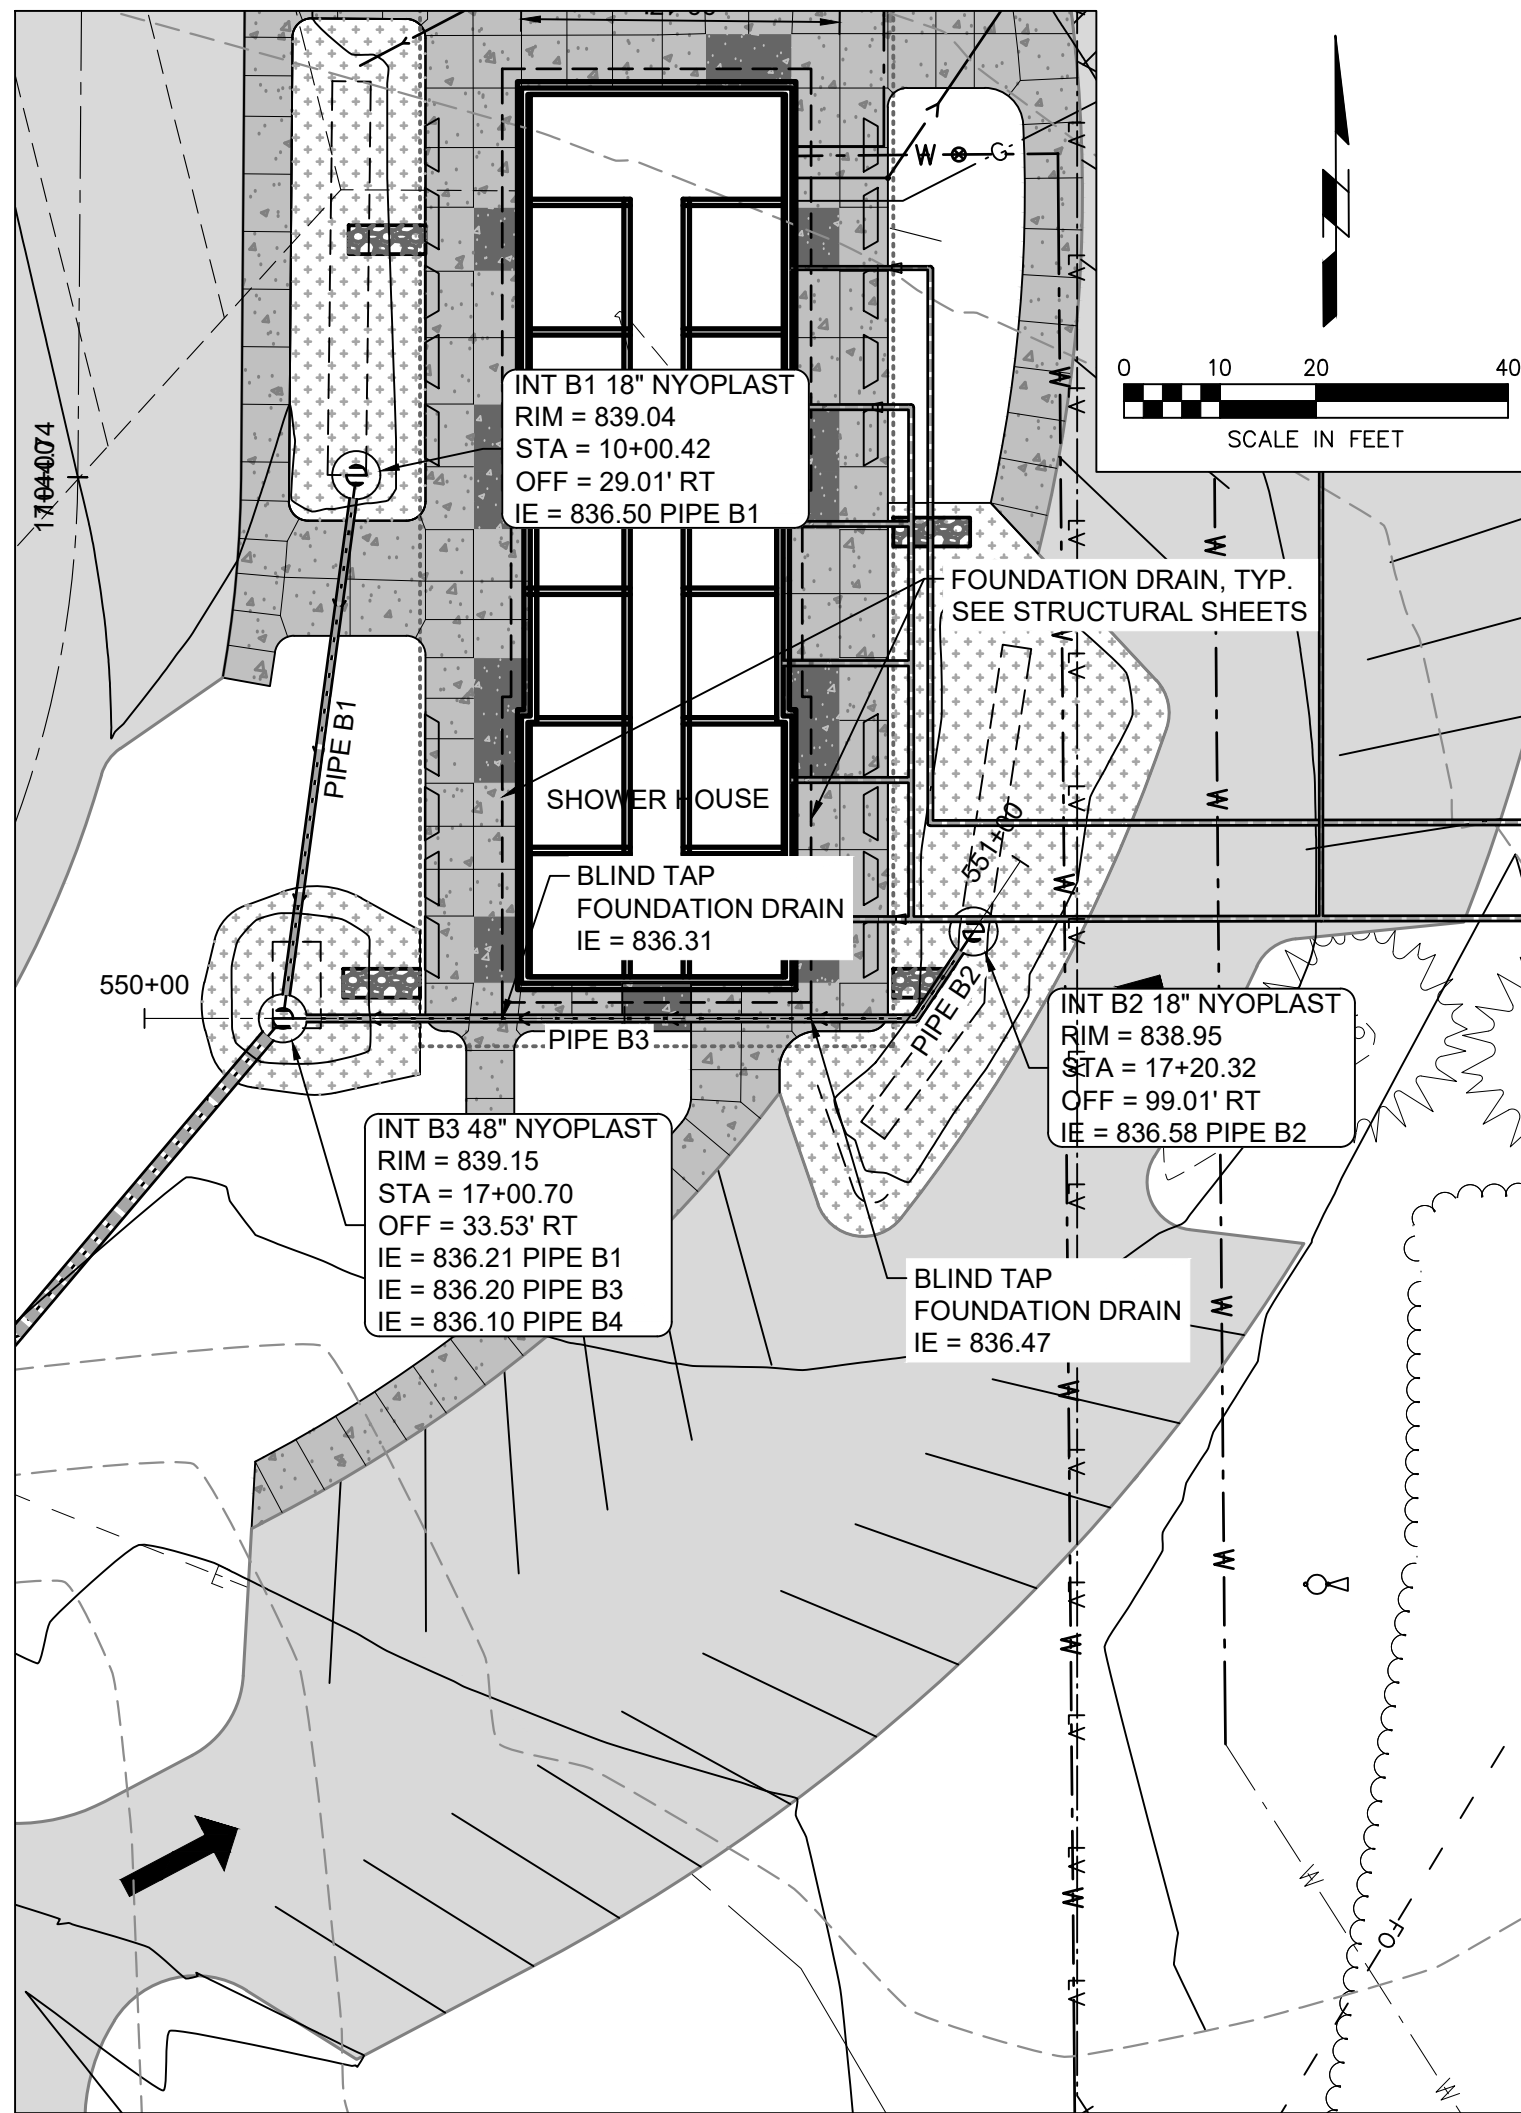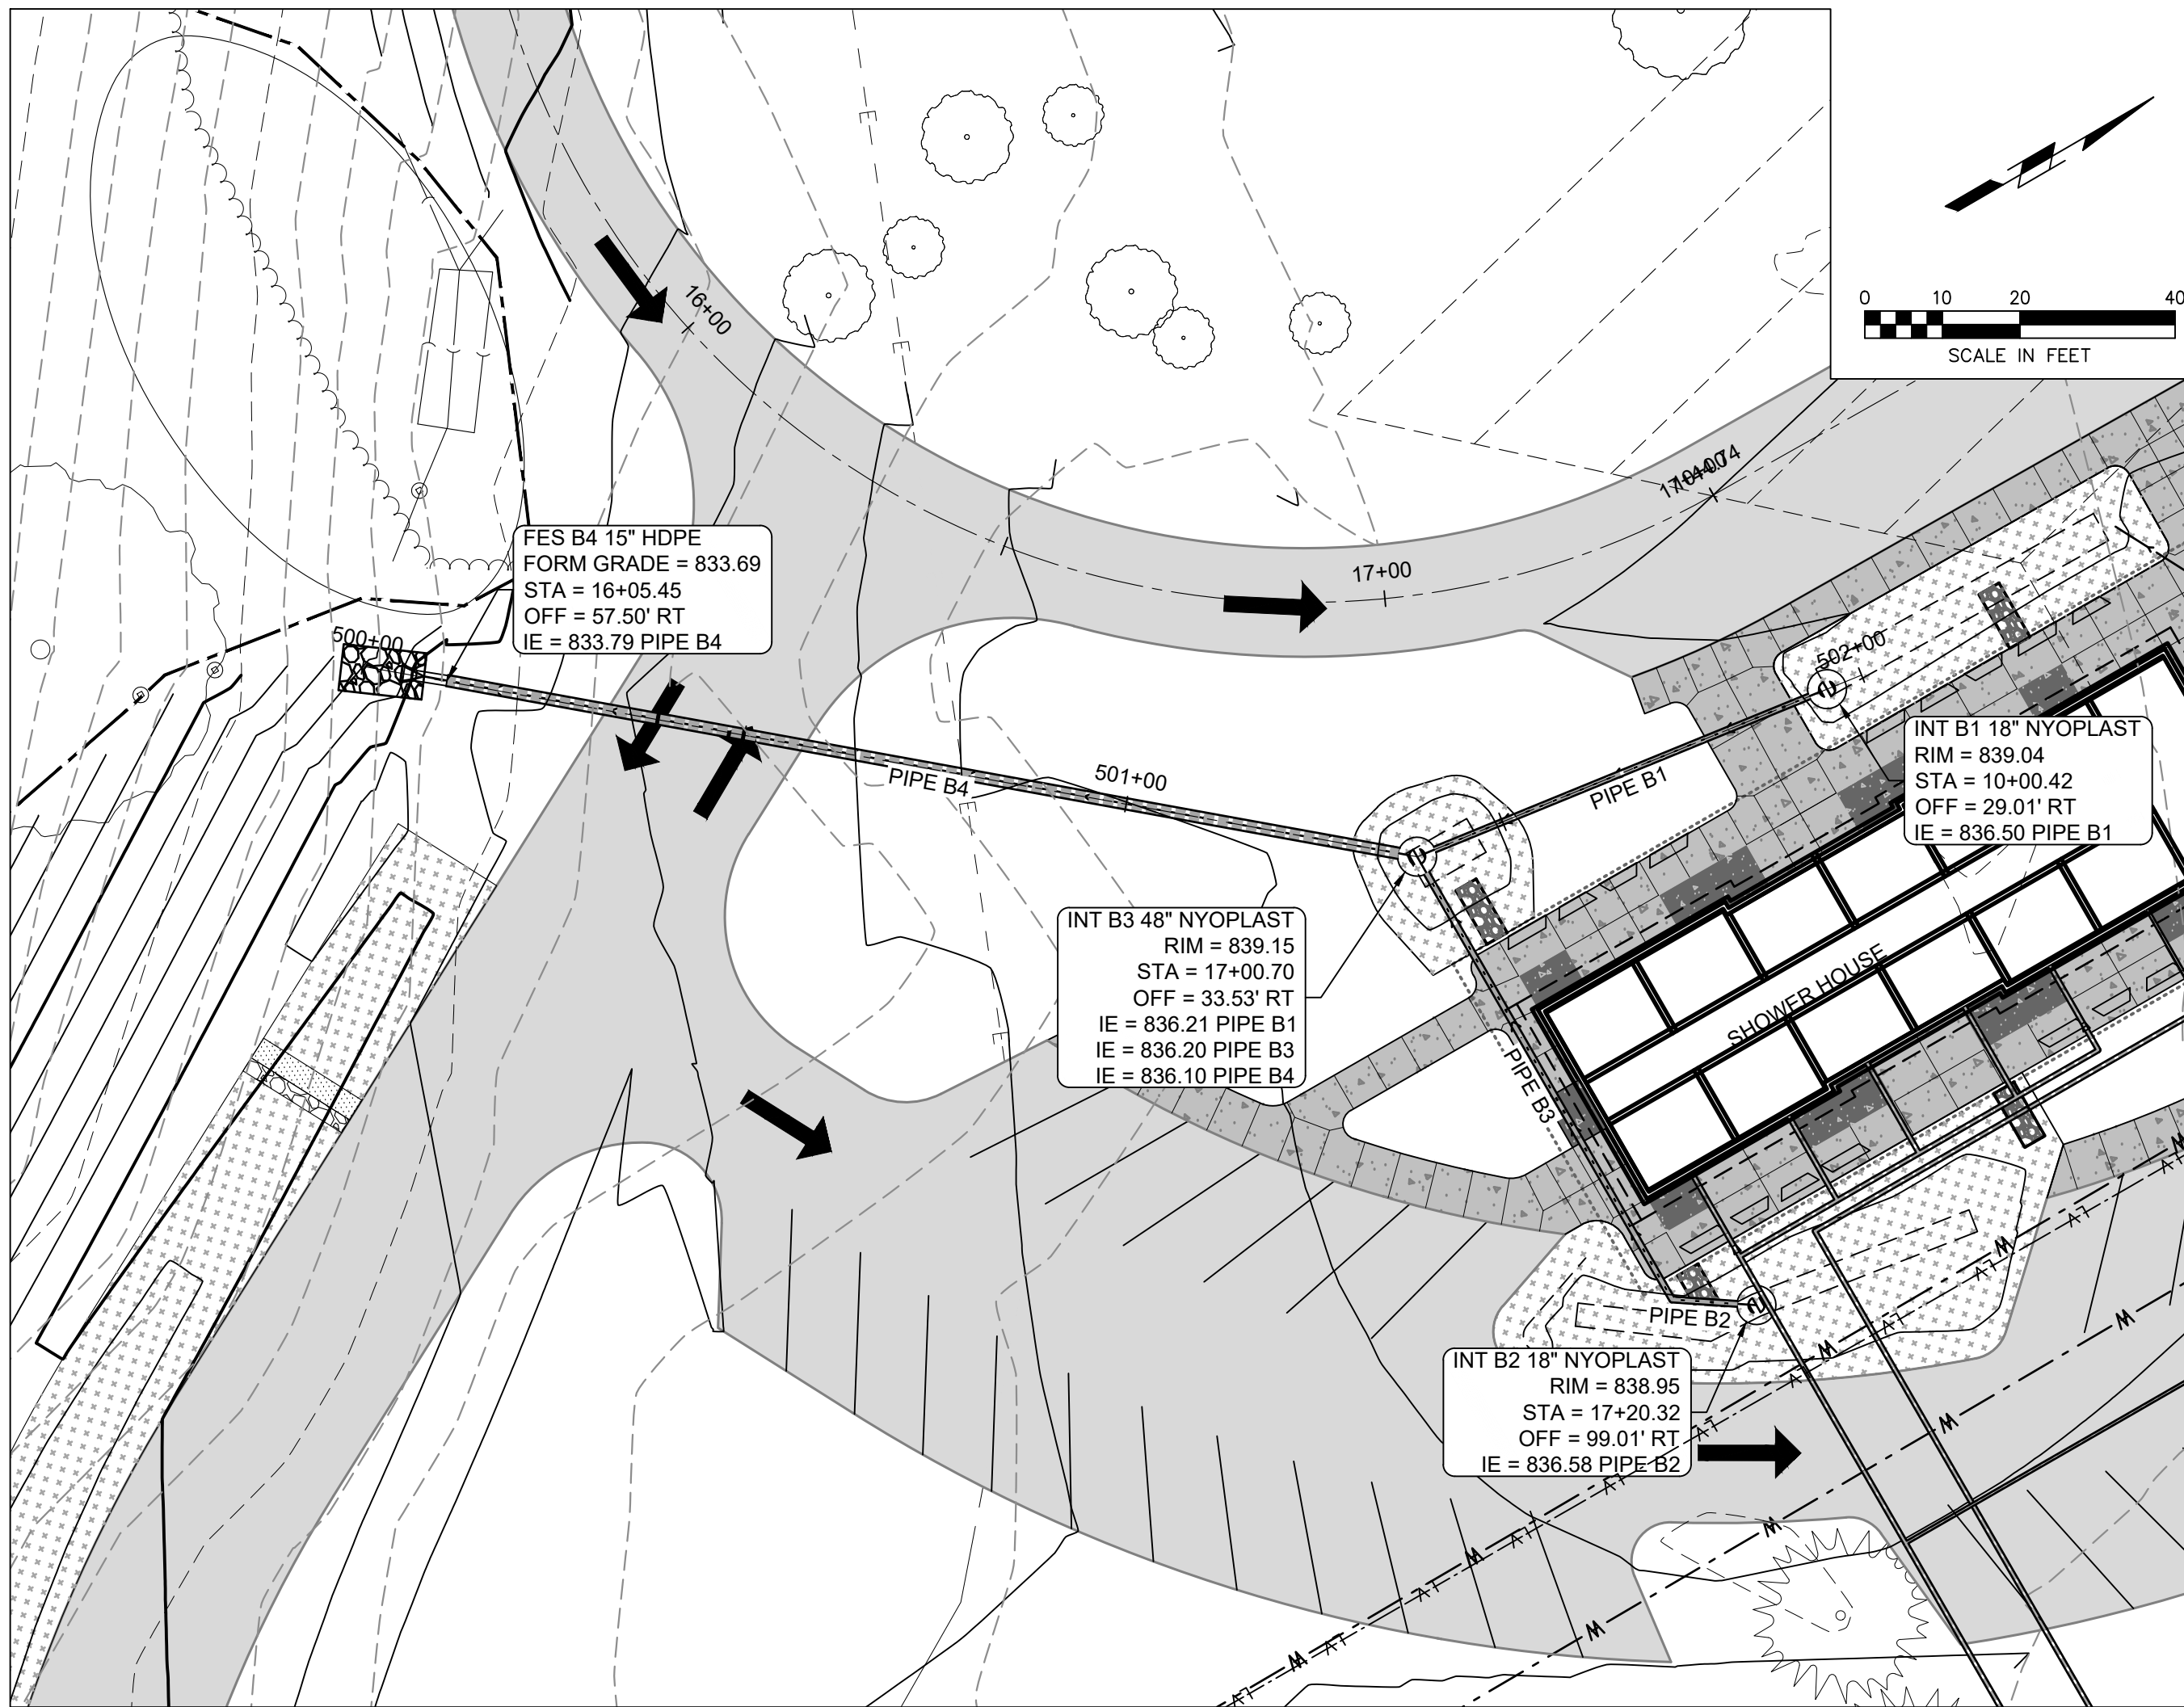

NOTE: SEE U-SHEETS FOR INTAKE DETAILS

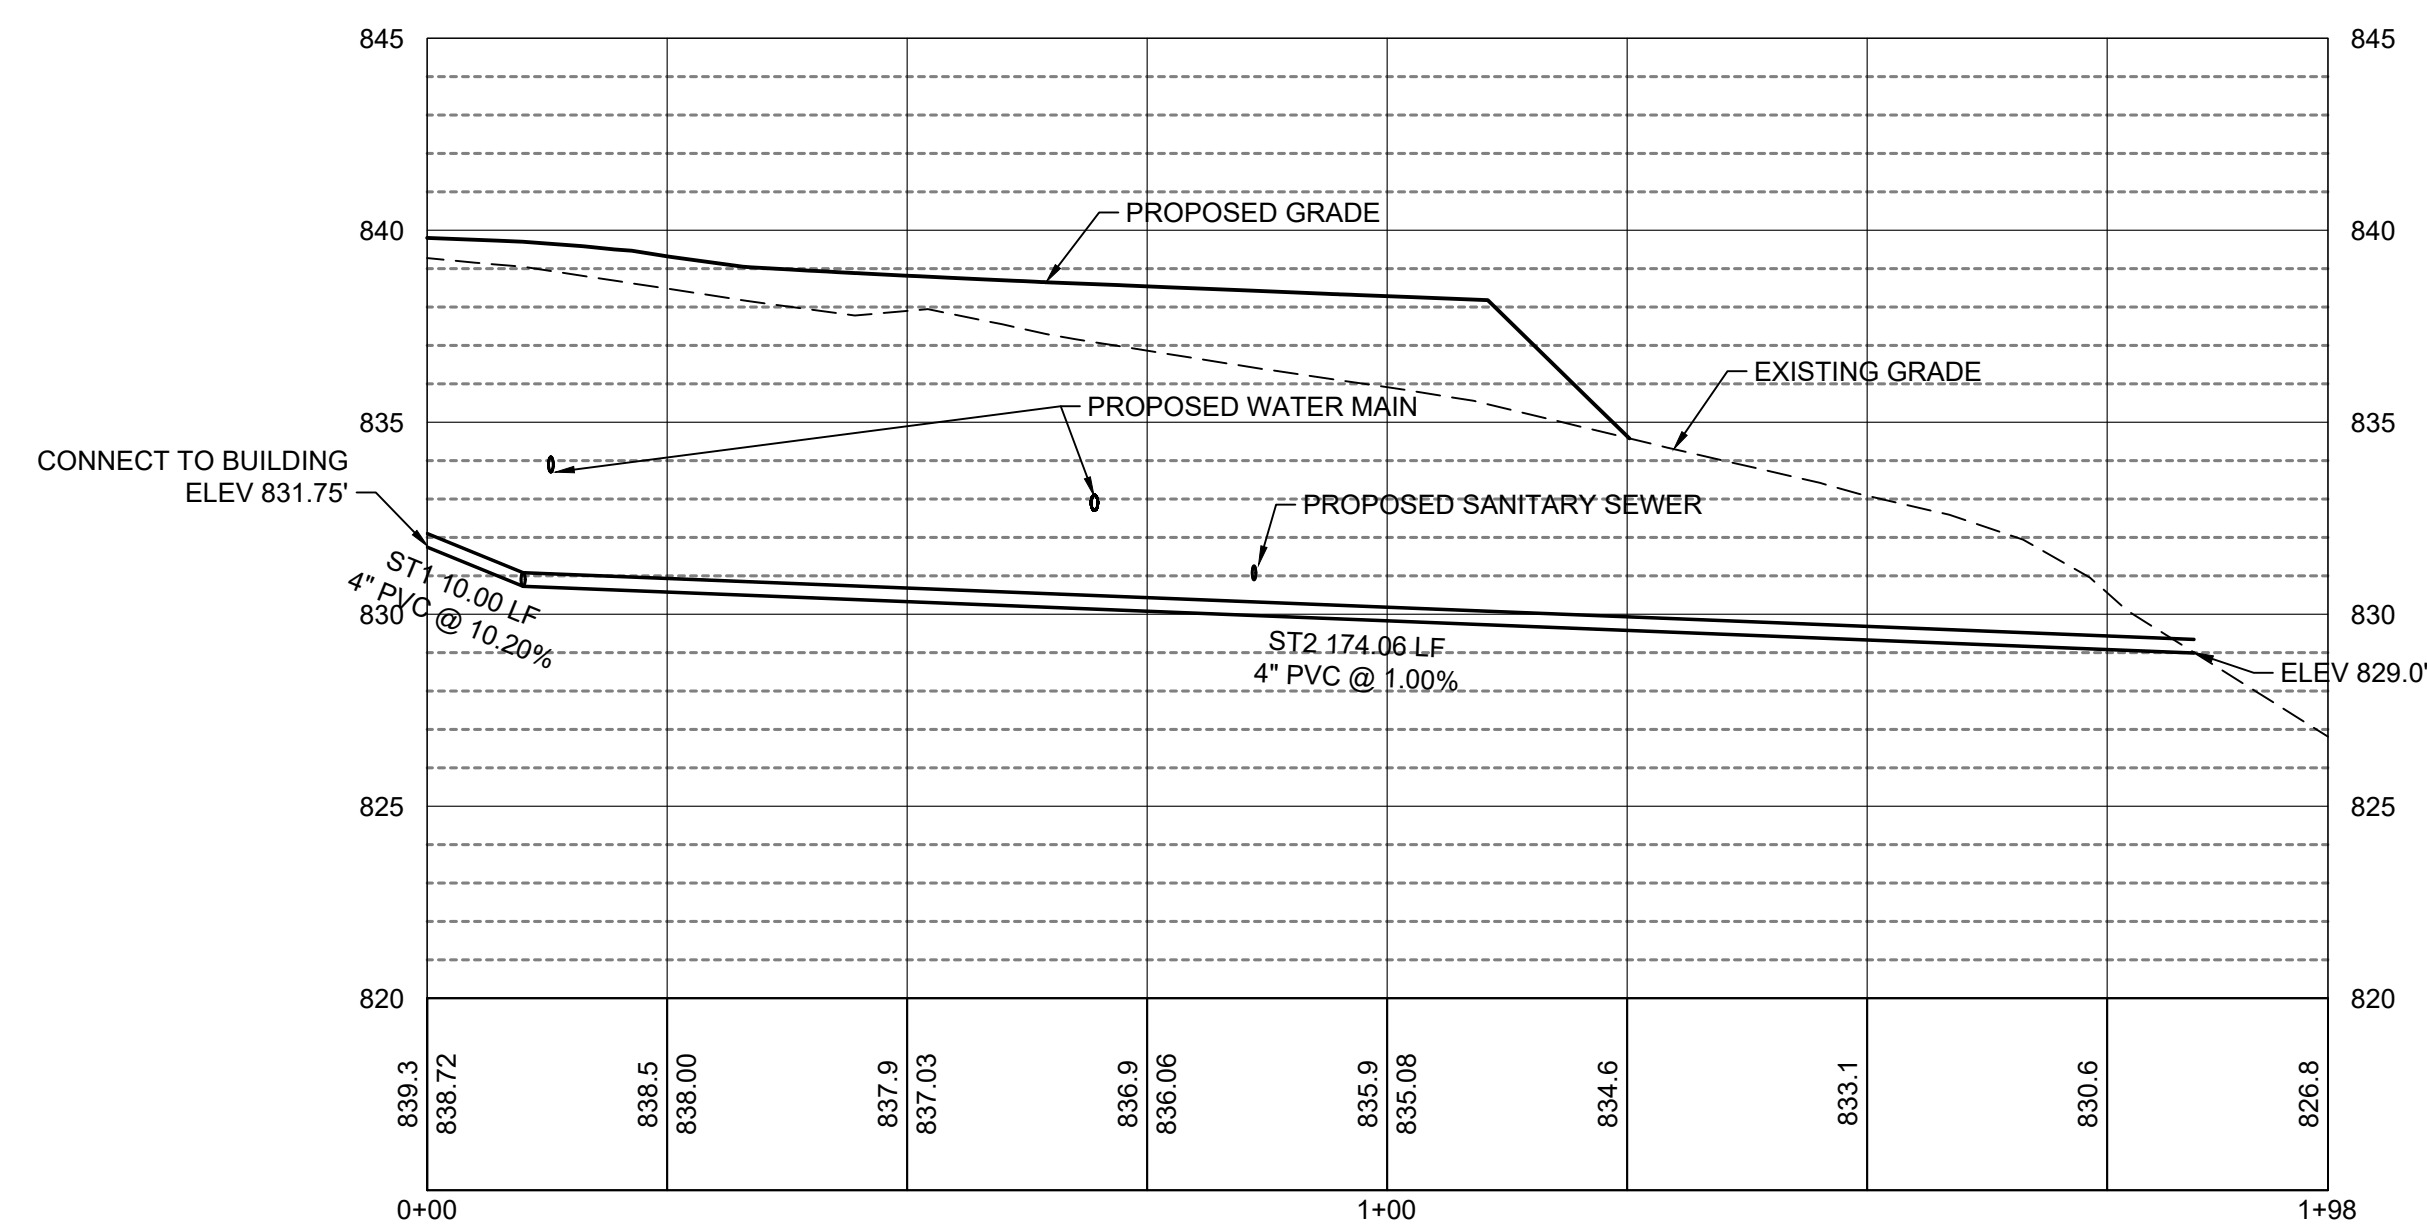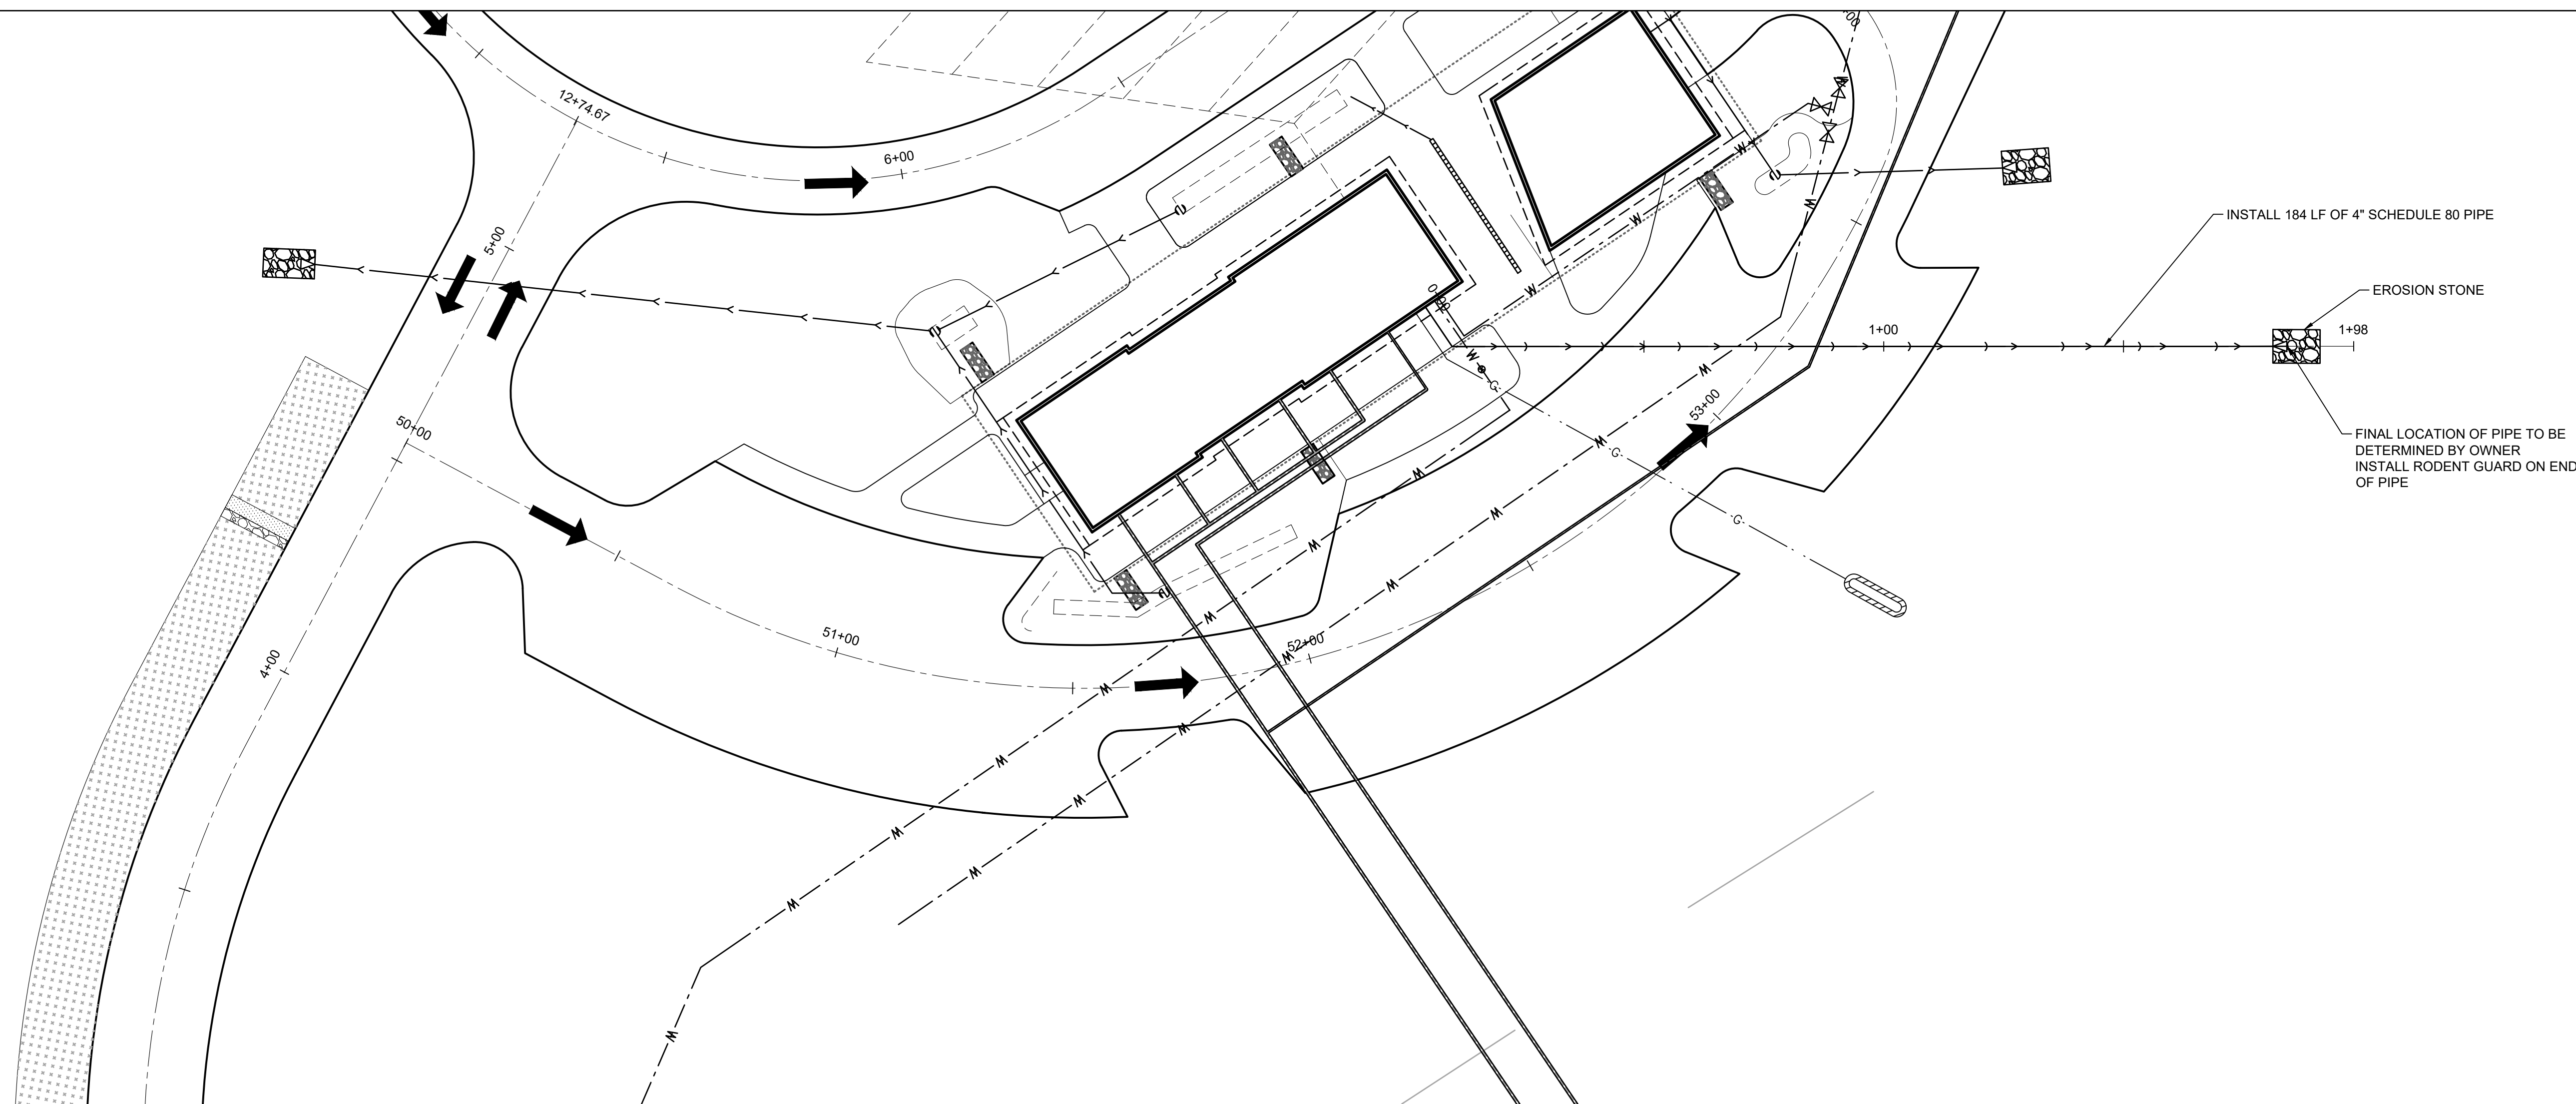

NOTE: SEE U-SHEETS FOR INTAKE DETAILS

GENERAL INFORMATION

- CONSTRUCTION NOT SPECIFICALLY DETAILED OR SPECIFIED WITHIN THE PLANS OR IN THE PROJECT SPECIFICATIONS SHALL CONFORM TO THE IOWA DEPARTMENT OF NATURAL RESOURCES AND THE FEDERAL ENVIRONMENTAL PROTECTION AGENCY SANITARY SEWERAGE SPECIFICATIONS.
- IOWA CODE 480, UNDERGROUND FACILITIES INFORMATION, REQUIRES VERBAL NOTICE TO IOWA ONE-CALL 1-800-292-8989, NOT LESS THAN 48 HOURS BEFORE EXCAVATING, EXCLUDING WEEKENDS AND HOLIDAYS
- NOTIFY KENT PARK A MINIMUM OF 48 HOURS PRIOR TO BEGINNING CONSTRUCTION.
- THE CONTRACTOR SHALL PROVIDE TRAFFIC AND PEDESTRIAN CONTROL MEASURES (SIGNS, BARRICADES, FLAGGERS, ETC.) THROUGH OUT ALL CONSTRUCTION.
- IT IS THE CONTRACTOR'S RESPONSIBILITY TO ASCERTAIN EXISTING FIELD CONDITIONS BEFORE BIDDING ON THIS PROJECT. ORDERING MATERIALS, AND BEGINNING CONSTRUCTION.
- CONTRACTOR SHALL COORDINATE WITH PRIVATE UTILITIES REGARDING RELOCATION, ADJUSTMENT OR TEMPORARY SUPPORT OF THEIR FACILITIES.
- MAINTAIN POSITIVE DRAINAGE ON THE SITE THROUGHOUT THE PROJECT DURATION.
- SITE CLEAN-UP SHALL BE PERFORMED ON A DAILY BASIS. SIDEWALKS, PARKING LOTS, ROADWAYS, ETC. SHALL BE KEPT CLEAN AT ALL TIMES. CONTROL DUST SPREADING FROM ALL WORK AND STAGING AREAS.
- ALL OPEN EXCAVATIONS SHALL BE PROTECTED AS PER REGULATORY REQUIREMENTS.
- KEEP ADJACENT PUBLIC STREETS FREE FROM SOIL AND DEBRIS GENERATED BY THE PROJECT.
- PROTECT EXISTING UTILITIES DURING CONSTRUCTION.
- PROTECT ALL EXISTING FEATURES (INCLUDING BUT NOT LIMITED TO WALLS, TREES, LANDSCAPING, DRIVEWAYS, SIDEWALKS, CURBS, PAVEMENT, UTILITIES, ETC.) NOT SPECIFICALLY NOTED FOR REMOVAL. FEATURES NOT DESIGNATED FOR REMOVAL THAT ARE DAMAGED OR REMOVED BY THE CONTRACTOR SHALL BE REPLACED BY THE CONTRACTOR AT THE CONTRACTOR'S EXPENSE.
- THE MEANS AND METHODS OF THE WORK AND THE SAFETY OF THE CONTRACTOR'S EMPLOYEES ARE SOLELY THE RESPONSIBILITY OF THE CONTRACTOR.
- NO WORK SHALL BE PERFORMED BEYOND THE PROJECT LIMITS WITHOUT PRIOR AUTHORIZATION FROM THE OWNER'S REPRESENTATIVE.
- THE LOCATIONS OF UTILITY MAINS, STRUCTURES AND SERVICE CONNECTIONS PLOTTED ON THIS DRAWING ARE APPROXIMATE ONLY AND WERE OBTAINED FROM RECORDS MADE AVAILABLE TO SHIVE-HATTERY, INC. THERE MAY BE OTHER EXISTING UTILITY MAINS, STRUCTURES AND SERVICE CONNECTIONS NOT KNOWN TO SHIVE-HATTERY, INC. AND NOT SHOWN ON THIS DRAWING. THE VERIFICATION, EXISTENCE, AND THE DETERMINATION OF THE EXACT LOCATION OF UTILITY MAINS, STRUCTURES, AND SERVICE CONNECTIONS SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR, AND SHALL BE COMPLETED PRIOR TO ANY CONSTRUCTION.
- NOTIFY UTILITY COMPANIES WITH FACILITIES SHOWN ON THE PLANS OR KNOWN TO BE WITHIN CONSTRUCTION LIMITS OF THE SCHEDULE PRIOR TO EACH STAGE OF CONSTRUCTION. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL UNCOVER EXISTING UTILITIES AT CRITICAL LOCATIONS TO VERIFY EXACT HORIZONTAL AND VERTICAL LOCATION.
- A PRE-CONSTRUCTION MEETING SHALL BE HELD FOLLOWING ISSUANCE OF THE NOTICE TO PROCEED BUT PRIOR TO COMMENCING WORK.
- ANY WORK REQUIRED TO COMPLETE THE SCOPE OF THIS PROJECT BUT NOT SET FORTH AS A SPECIFIC BID ITEM, SHALL BE CONSIDERED INCIDENTAL TO THE PROJECT. NO ADDITIONAL COMPENSATION SHALL BE ALLOWED FOR THE COMPLETION OF THIS WORK.
- IT IS INTENDED THAT ALL COSTS OF MATERIALS, EQUIPMENT, TOOLS, LABOR AND INCIDENTALS BE PAID FOR UNDER THE ITEMS LISTED ON THE BIDDERS PROPOSAL. THE CONTRACTOR SHALL EXAMINE ALL DRAWINGS, SPECIFICATIONS, SPECIAL PROVISIONS AND THE JOB SITE. IF ANY DISCREPANCIES OR DELETIONS OCCUR IN THE CONTRACT DOCUMENTS, THE CONTRACTOR SHALL REPORT TO SHIVE-HATTERY, INC. IN WRITING AND OBTAIN WRITTEN CLARIFICATION AND/OR INSTRUCTIONS ON HOW TO PROCEED.
- FOR ITEMS SPECIFIED WITH AN "APPROVED EQUIVALENT" OR "APPROVED EQUAL", THE APPROVAL SHALL BE BY THE ENGINEER.
- THE CONTRACTOR WILL BE RESPONSIBLE FOR ALL GRADING AND SEEDING ACTIVITIES. ENSURE AREA TO BE SEEDED IS RELATIVELY SMOOTH. SOW SEED ONLY AT TIMES OF THE YEAR WHEN TEMPERATURE, MOISTURE, AND CLIMATIC CONDITIONS WILL PROMOTE GERMINATION AND PLANT GROWTH.

SANITARY SEWERAGE INFORMATION

- FORCE MAIN MATERIAL SHALL BE PVC 2"-SDR 21 OR STRONGER.
- CONTRACTOR IS RESPONSIBLE FOR VERIFYING ANY EXISTING UTILITIES WHERE SANITARY SEWERAGE WILL BE CROSSING PRIOR TO ANY CONSTRUCTION.

SPECIFICATIONS

- MANHOLES SHALL CONFORM TO APPLICABLE SECTIONS OF SUDAS DIVISION 6, SECTION 6010 (MATERIAL AND INSTALLATION) AND SECTION 6030 (TESTING).
- SEPTIC TANKS AND HOLDING TANKS SHALL MEET DEPARTMENT OF NATURAL RESOURCES (DNR) 567 CHAPTER 69.
- DRAIN FIELD MATERIAL AND INSTALLATION SHALL MEET DNR CHAPTER 69: 69.9(3) AND 69.9(4).

PUMP TANK, PUMP AND CONTROL NOTES:

- PUMP TANK SHALL BE A CONCRETE 2,500 GALLON DOUBLE COMPARTMENT SEPTIC TANK MEETING CHAPTER 69 REQUIREMENTS. THE DIVIDING WALL SHALL HAVE A 6 INCH DIAMETER OR SQUARE HOLE IN THE CENTER WALL 12 INCHES ABOVE THE BOTTOM OF THE TANK.
- THE RISERS SHALL BE 2 (TWO) CONCRETE STORM SEWER PIPE 20" - 24 INCHES IN DIAMETER WITH IRON BOLT DOWN LID AND FRAME. RISERS SHALL BE ONE PIECE WITH WATER TIGHT SEAL AT TANK LID.
- PUMPS SHALL BE TWO (2) CLARUS MODEL 5035-0022 (25 FOOT CORD). LOOPS OF WIRE CORD SHALL BE HANGING INSIDE RISER TO ALLOW PUMPS TO BE REMOVED WITHOUT DISCONNECTING CORD OR WIRES. A J-BOX MAY BE USED INSIDE RISER FOR WIRE CONNECTIONS.
- PUMP VAULT SHALL BE A ZOELLER STEP DUPLEX PUMP FILTER AND PUMP CHAMBER. VAULT SHALL REST/SIT ON TANK BOTTOM. LENGTH OF VAULT TO MATCH SELECTED TANK DEPTH. THE VAULT INLET SHALL BE CUT AT 24 INCHES ABOVE TANK BOTTOM.
- DISCHARGE ASSEMBLY SHALL BE RIDGE DISCHARGE ASSEMBLY FOR DUPLEX PUMPS 2 INCH SCH 40 PVC WITH 3 FOOT COLD WEATHER EXTENSION KIT WITH DUAL DISCHARGE PIPES. THE DISCONNECT COUPLING SHALL BE WITHIN 12 INCHES OF THE LID FOR REMOVAL.
- FLOAT TREE SHALL BE FOR 3 FLOATS (OFF-ON-ALARM). ADDITIONAL FLOAT CORD SHALL BE LOOPED INSIDE RISER FOR REMOVAL OF FLOATS WITHOUT DISCONNECTING ANY CORDS/WIRES.
- A 3/16 INCH DIAMETER WEEP HOLE SHALL BE DRILLED INTO PUMP RISER PIPES THAT SPRAYS WATER DOWN INTO VAULT. THE WEEP HOLE SHALL BE A 6 TO 12 INCHES BELOW THE BOTTOM OF THE TANK LID.
- THE OUTLET PIPE FROM THE PUMPS SHALL BE 42 INCHES MINIMUM BELOW RISER LID.
- FLOAT SETTINGS:
 - OFF - SET AT 2 INCHES ABOVE INLET HOLE
 - ON - SET AT 10 INCHES ABOVE "OFF"
 - ALARM - SET AT 6 INCHES ABOVE "ON"
- USE CONDUIT FOR CABLES FROM RISER TO CONTROL PANEL.

LATERAL FIELD INSTALLATION



- THE SEPTIC TANK AND LATERAL FIELD INSTALLER MUST HAVE A CERTIFIED INSTALLER OF ONSITE WASTEWATER TREATMENT SYSTEMS (COWTWS) CREDENTIAL.
- CONTRACTOR REQUIRED TO HAVE ON SITE MEETING WITH OWNER AND ENGINEER REPRESENTATIVES PRIOR TO START OF CONSTRUCTION. THE LATERAL FIELDS SHOWN ARE SCHEMATIC IN NATURE. CONTRACTOR TO COORDINATE WITH OWNER AND ENGINEER TO DETERMINE FINAL LATERAL FIELD LAYOUT TO MEET TOTAL REQUIRED LATERAL LENGTH.
- ONLY INSTALL THE LATERALS WHEN THE SOIL MOISTURE IS SATISFACTORY. THE SATISFACTORY MOISTURE SHALL BE CHECKED 2 - 3 INCHES BELOW THE BOTTOM OF THE TRENCH. TAKE A SAMPLE OF THE SOIL AT THIS DEPTH AND WORK THE SOIL TO MAKE THE SOIL A UNIFORM SAMPLE. ROLL INTO A SMALL BALL ABOUT THE SIZE OF A MARBLE. TRY TO ROLL THE BALL INTO A SMALL PENCIL SHAPE WIRE ABOUT 3/16 INCH IN DIAMETER. IF THE WIRE CAN BE FORMED AND NOT CRUMBLE APART THE SOIL IS TOO WET AND THE LATERAL TRENCHES MUST NOT BE EXCAVATED AT THIS TIME. IF THE WIRE CRUMBLES APART BEFORE REACHING 3/16 INCH THE SOIL IS OKAY TO EXCAVATE THE TRENCHES.
- NEVER INSTALL THE LATERALS WHEN THERE IS FROST IN THE GROUND.





SANITARY SEWER INFORMATION



PIPE NUMBER	PIPE SIZE	FROM	TO	SLOPE	LENGTH
SAN 1	4" PVC	CLEANOUT	SEPTIC TANK 1	-2.00%	4.00'
SAN 2	4" PVC	SEPTIC TANK 1	BEND 1-2	-1.00%	59.55'
SAN 3	4" PVC	BEND 1-2	BEND 1-3	-0.87%	142.78'
SAN 4	4" PVC	BEND 1-3	WYE 1-5	-0.90%	136.42'
SAN 5	6" PVC	WYE 1-5	SANMH5	-1.00%	113.54'
SAN 6	6" PVC	SAN MH5	SAN MH4	-1.00%	200.38'
SAN 7	6" PVC	SAN MH4	SAN MH3	-1.00%	201.07'
SAN 8	6" PVC	SAN MH3	SAN MH2	-1.00%	255.32'
SAN 9	6" PVC	SAN MH2	SEPTIC TANK	-1.30%	114.96'
SAN 10	4" PVC	SHOWER HOUSE	BEND 2-1	-1.00%	14.42'
SAN 11	6" PVC	BEND 2-1	BEND 2-2	-2.27%	57.82'
SAN 12	6" PVC	BEND 2-2	SAN CO 2-1	-0.80%	179.19'
SAN 13	6" PVC	SAN CO 2-1	SEPTIC TANK 2	-0.80%	381.10'
SAN 14	4" PVC	SHOWER HOUSE	BEND 1-1	-3.77%	12.42'
SAN 15	6" PVC	BEND 1-1	WYE 1-1	-1.00%	12.17'
SAN 16	6" PVC	WYE 1-1	WYE 1-2	-1.00%	14.50'
SAN 17	6" PVC	WYE 1-2	WYE 1-3	-1.00%	12.17'
SAN 18	6" PVC	WYE 1-3	WYE 1-4	-1.00%	14.50'
SAN 19	4" PVC	SHOWER HOUSE	WYE 1-1	-4.42%	13.33'
SAN 20	4" PVC	SHOWER HOUSE	WYE 1-2	-5.55%	13.33'
SAN 21	4" PVC	SHOWER HOUSE	WYE 1-3	-6.93%	12.42'
SAN 22	4" PVC	SHOWER HOUSE	WYE 1-4	-8.33%	12.00'
SAN 23	6" PVC	WYE 1-4	WYE 1-5	-7.86%	42.70'
SAN 24	4" PVC	FM 2	SAN25	-1.00%	89.74'
SAN 25	4" PVC	SAN24	DRAINAGE FIELD	-1.00%	28.80'
FM 1	1-1/2" PVC	PUMP	D-BOX	BACK TO PUMP	112.00'
FM 2	1-1/2" PVC	PUMP	D-BOX	BACK TO PUMP	272.00'

*MINMUM 42" BURY DEPTH.
SLOPE BACK TO PUMP TANK.



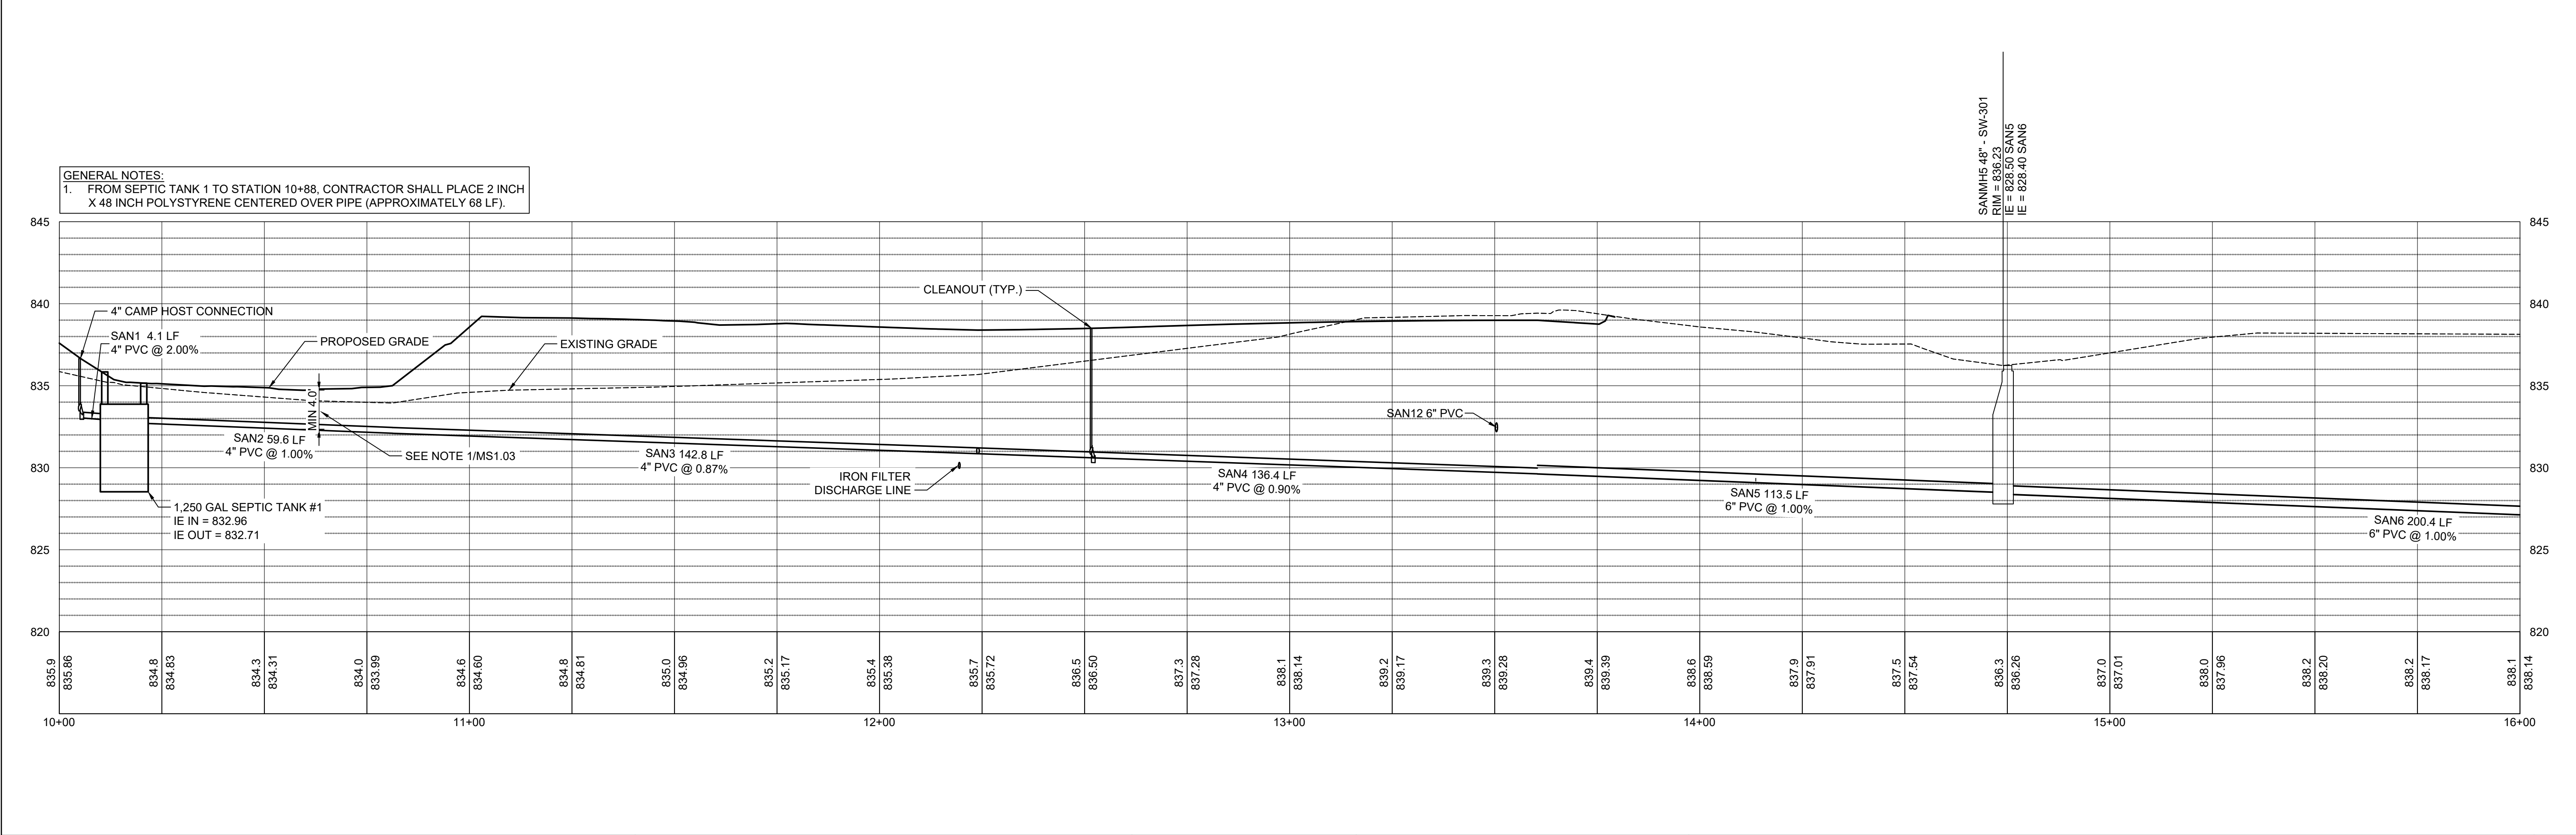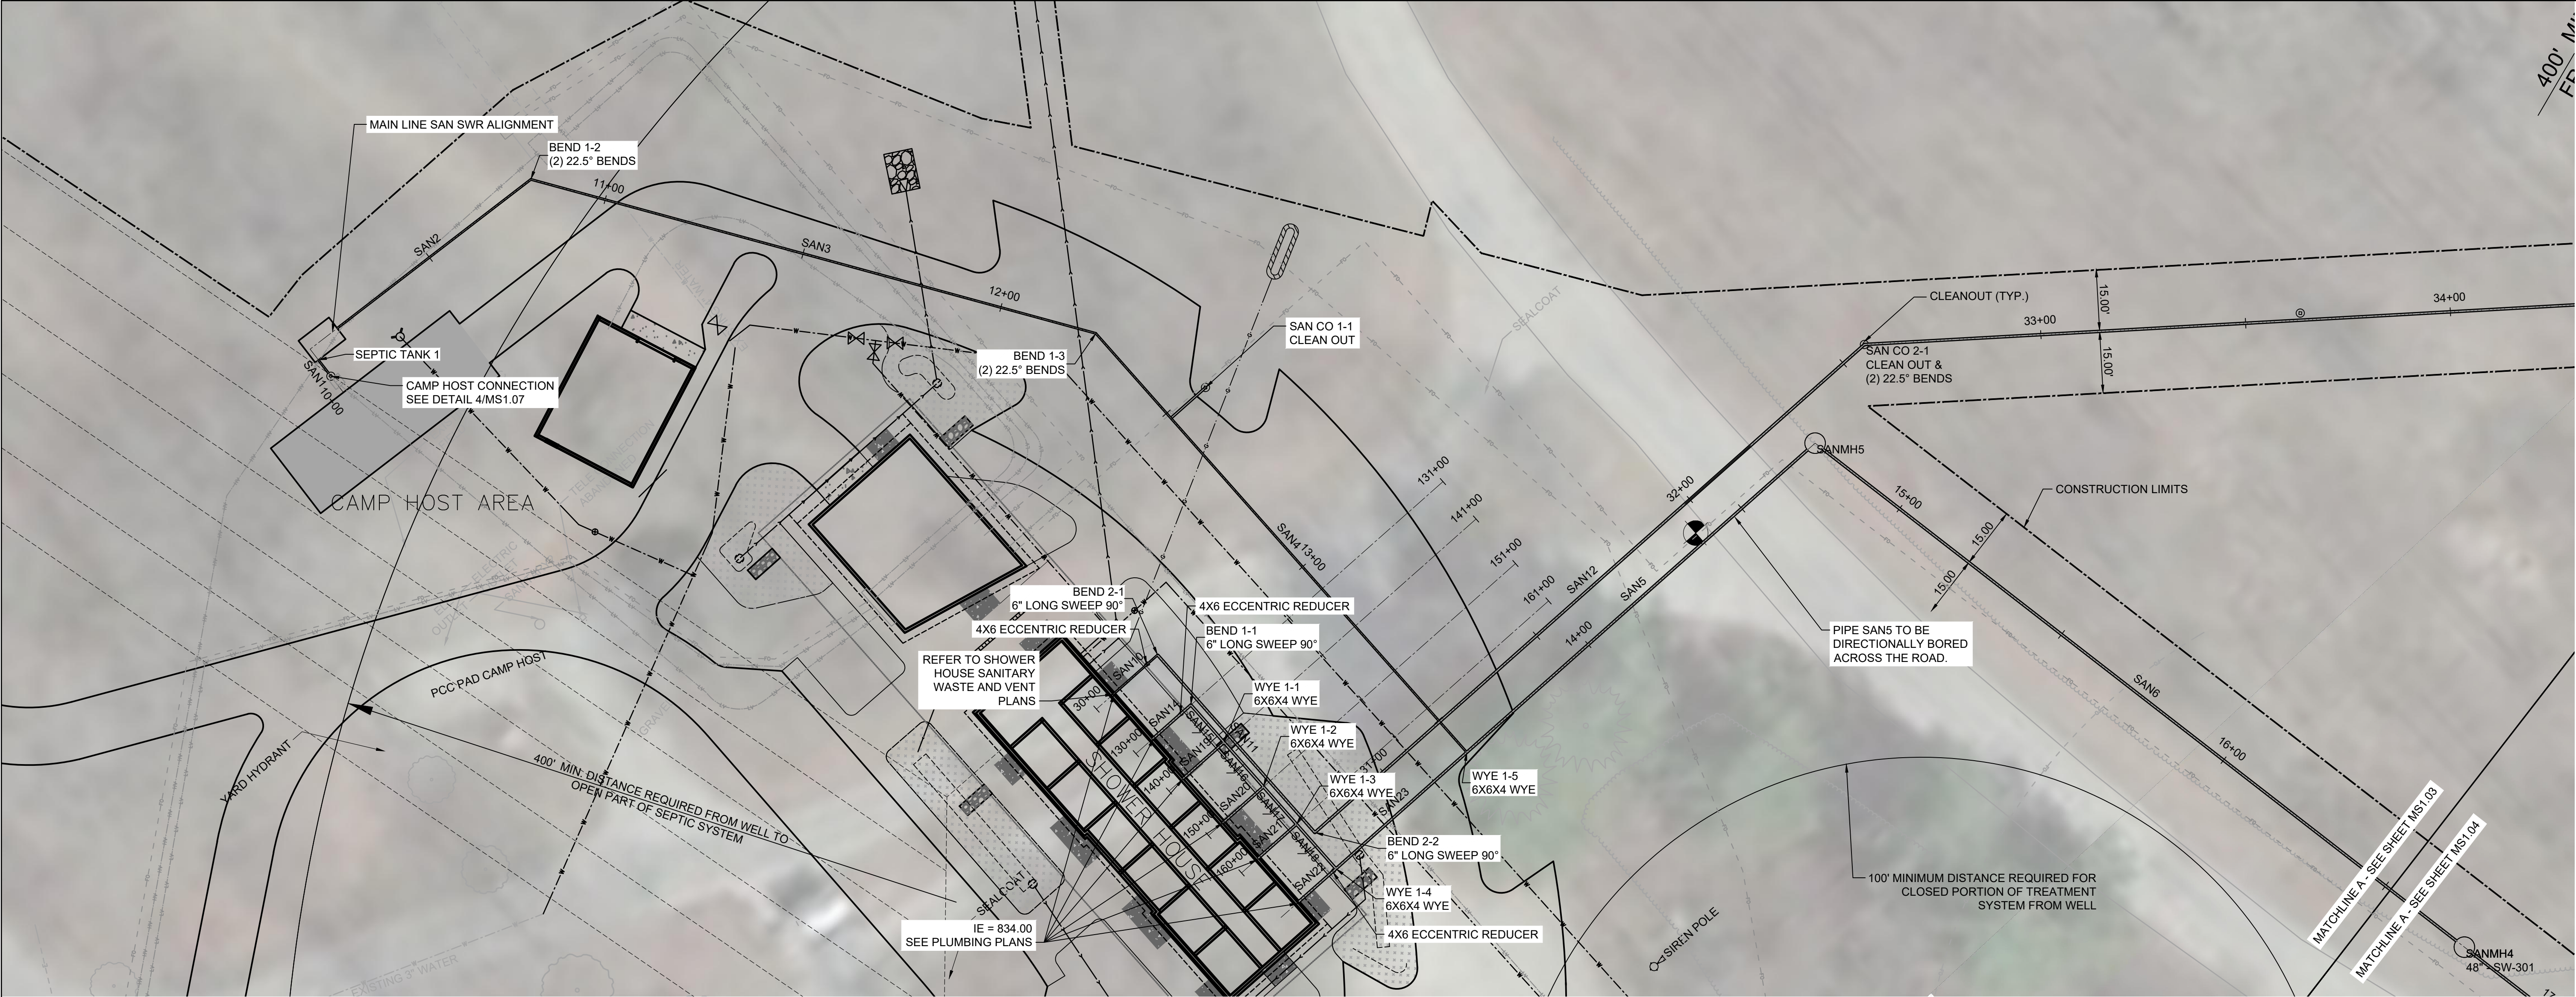

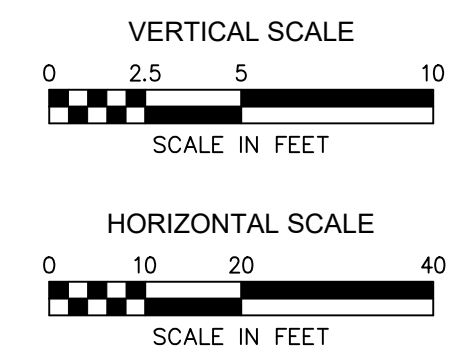
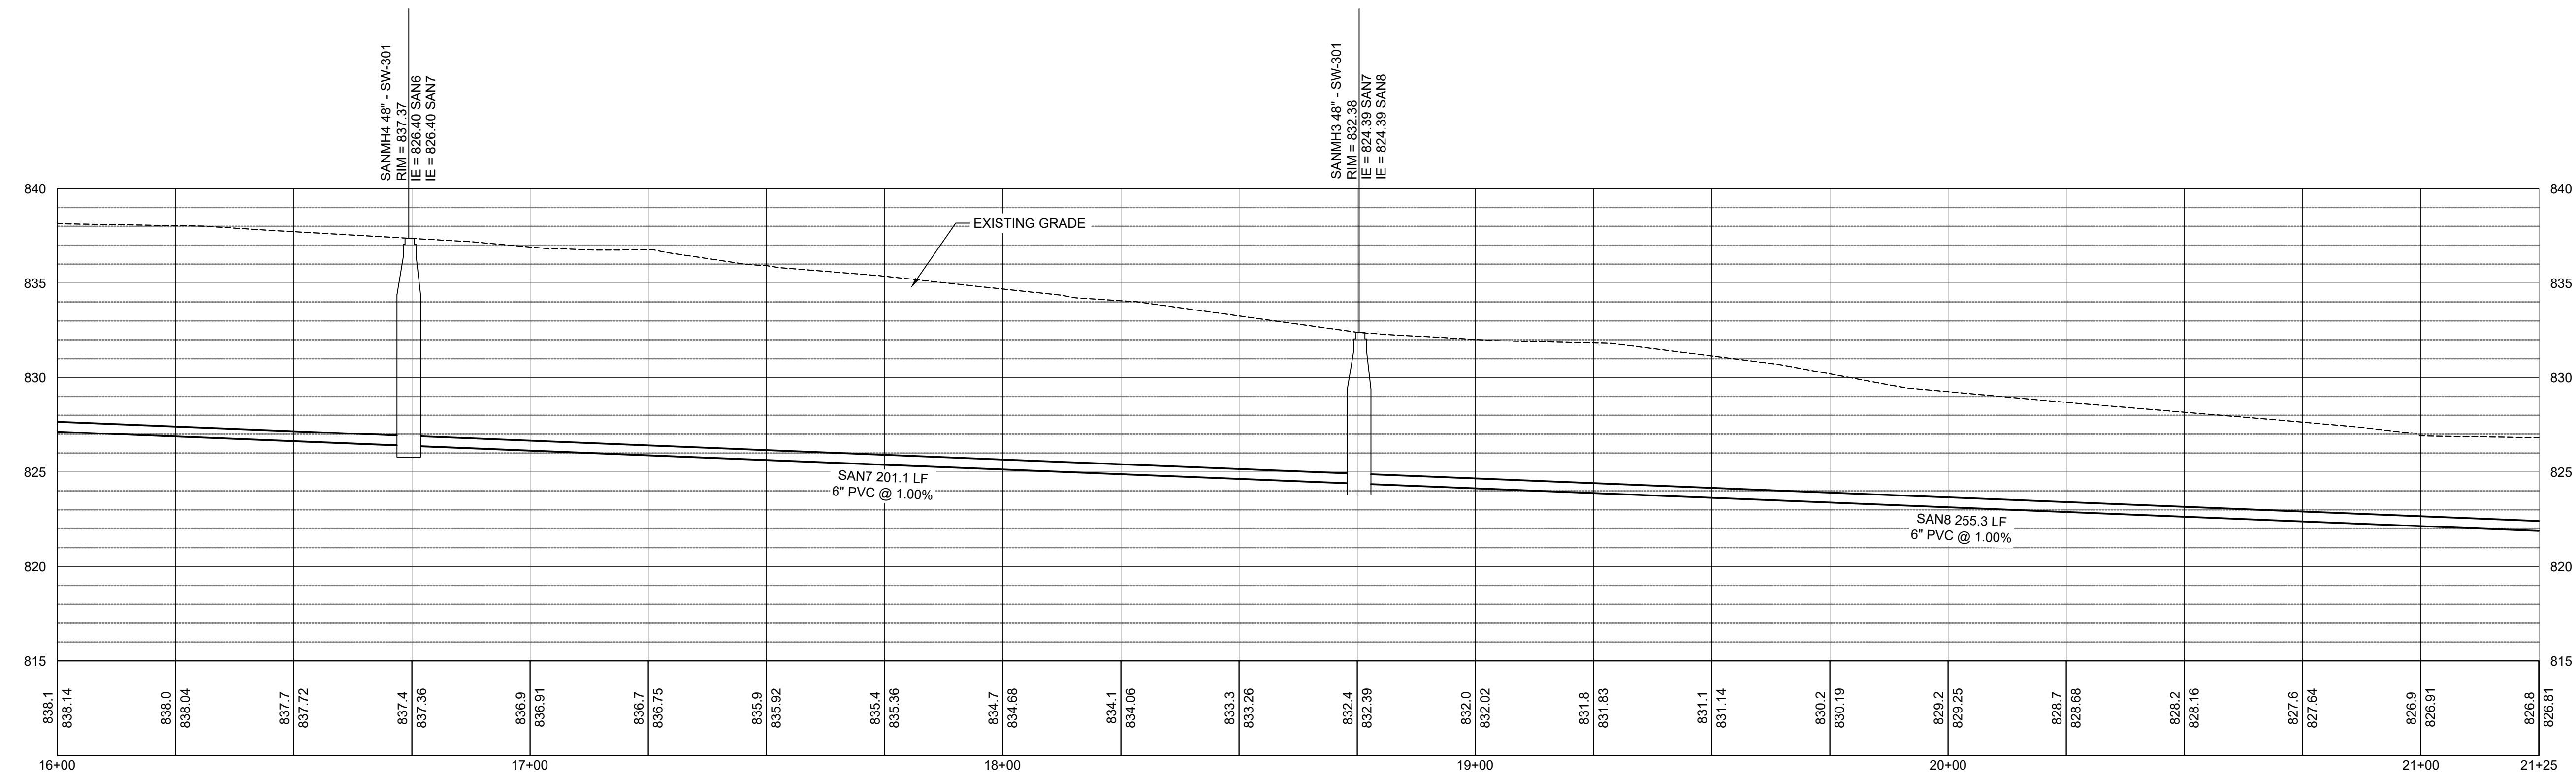
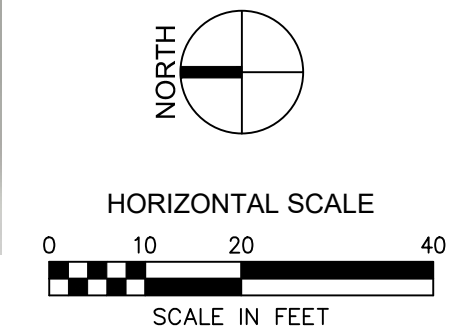
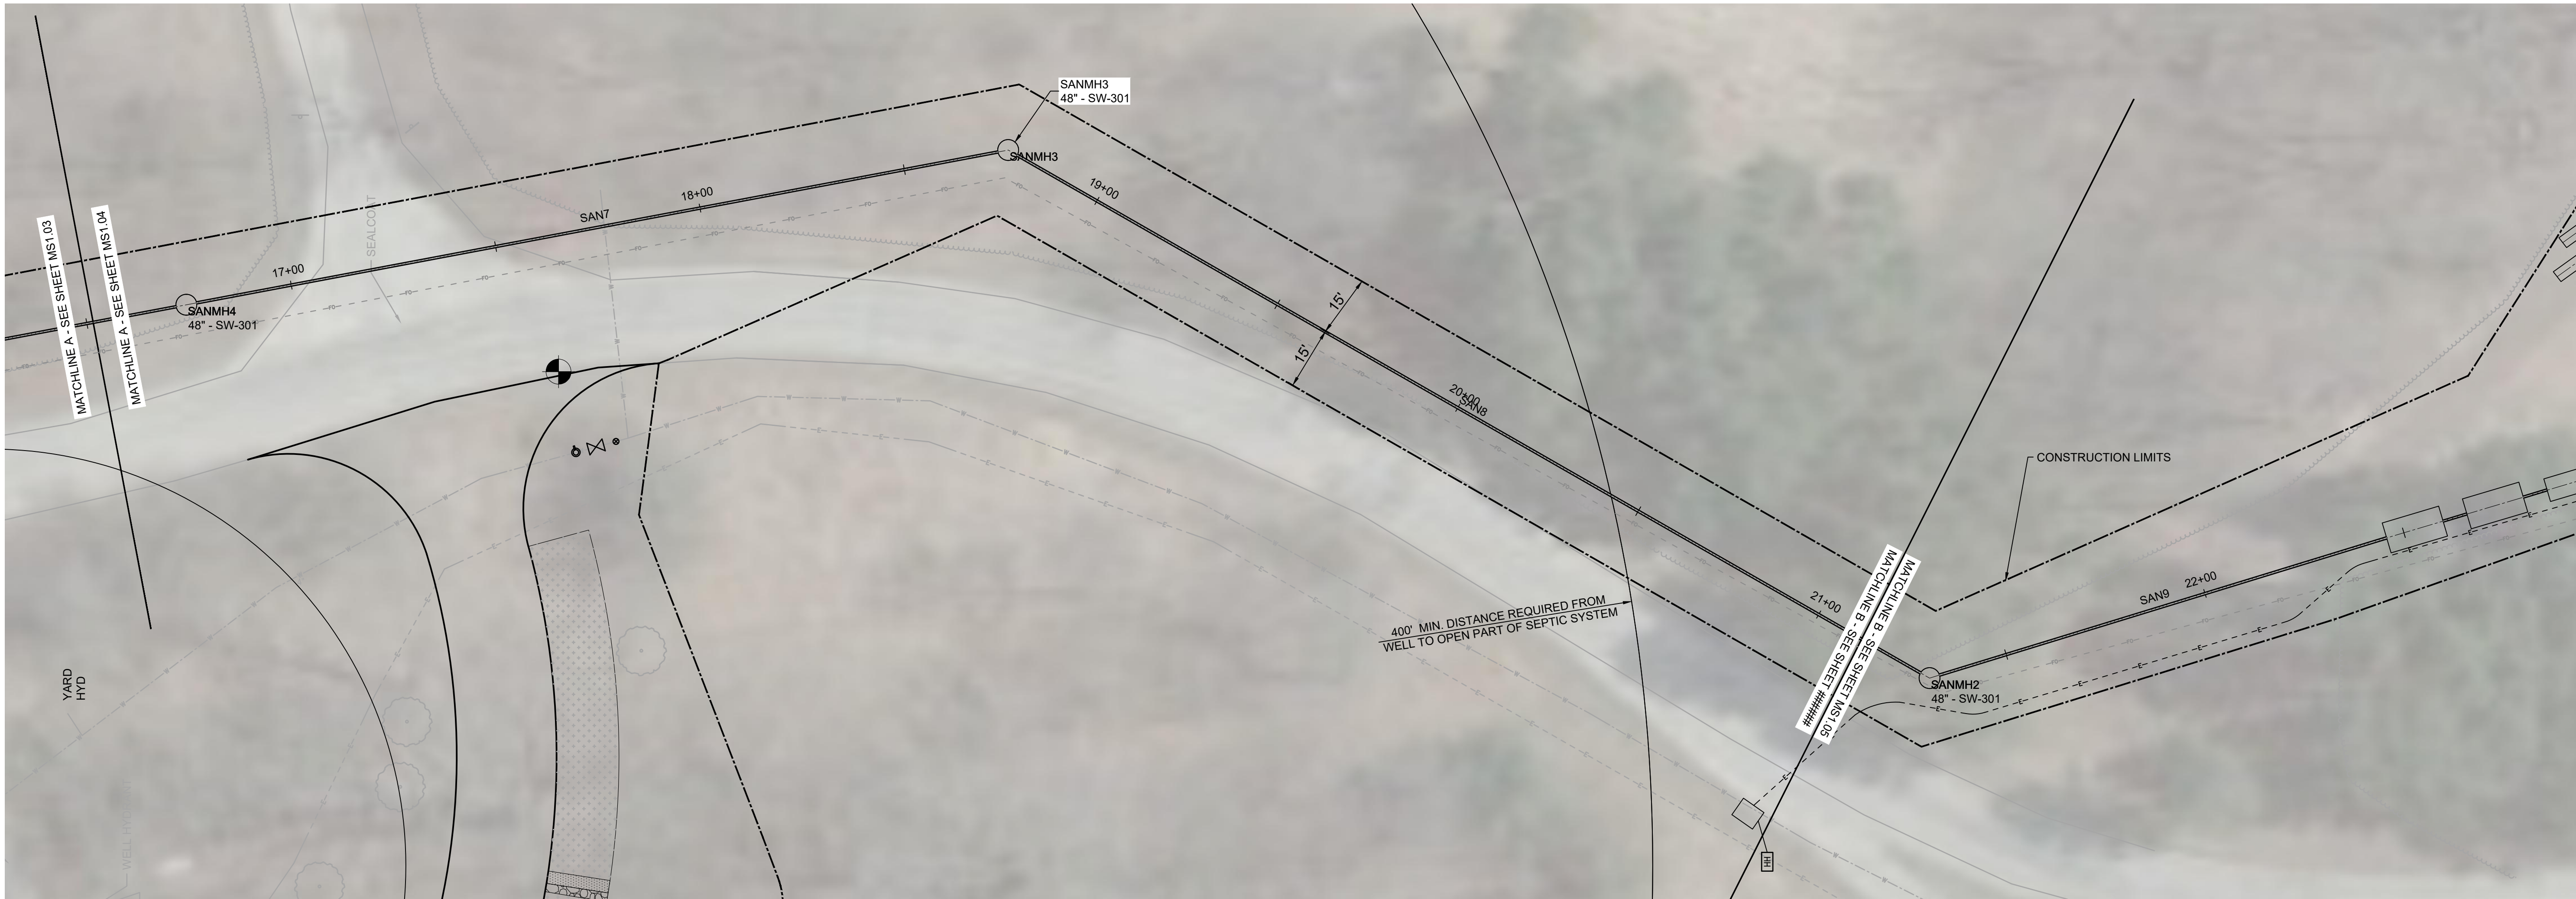


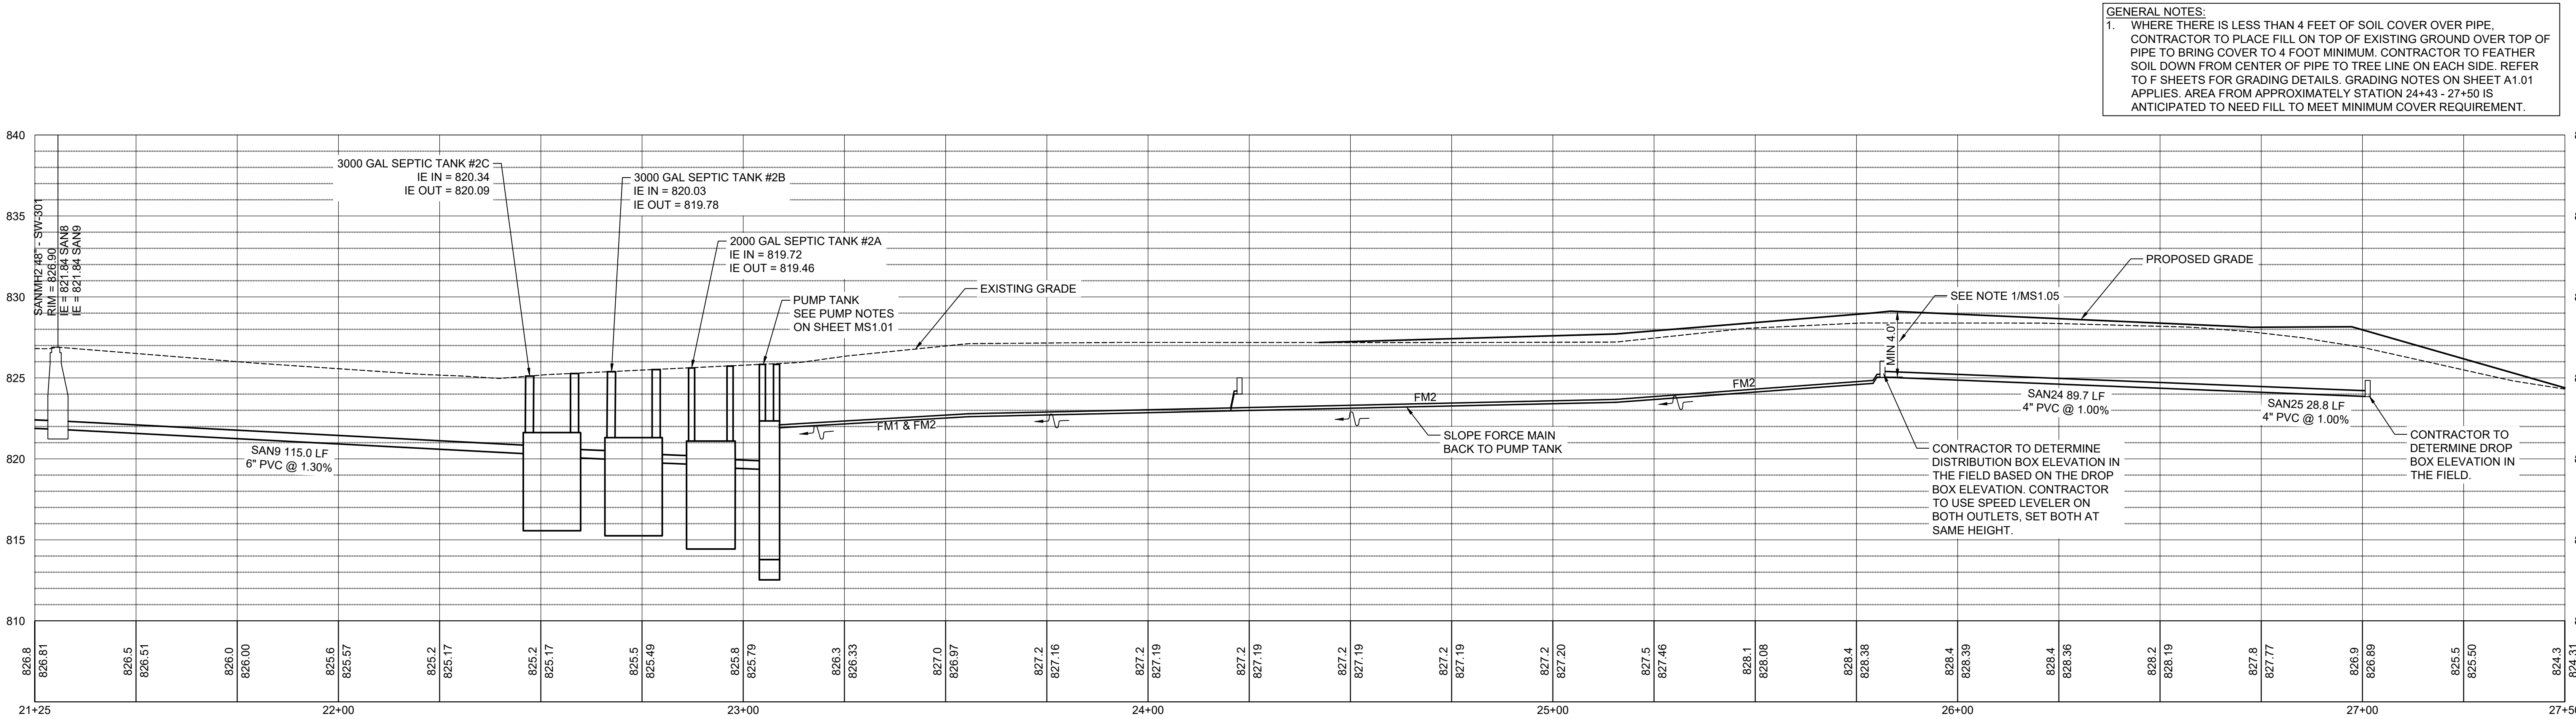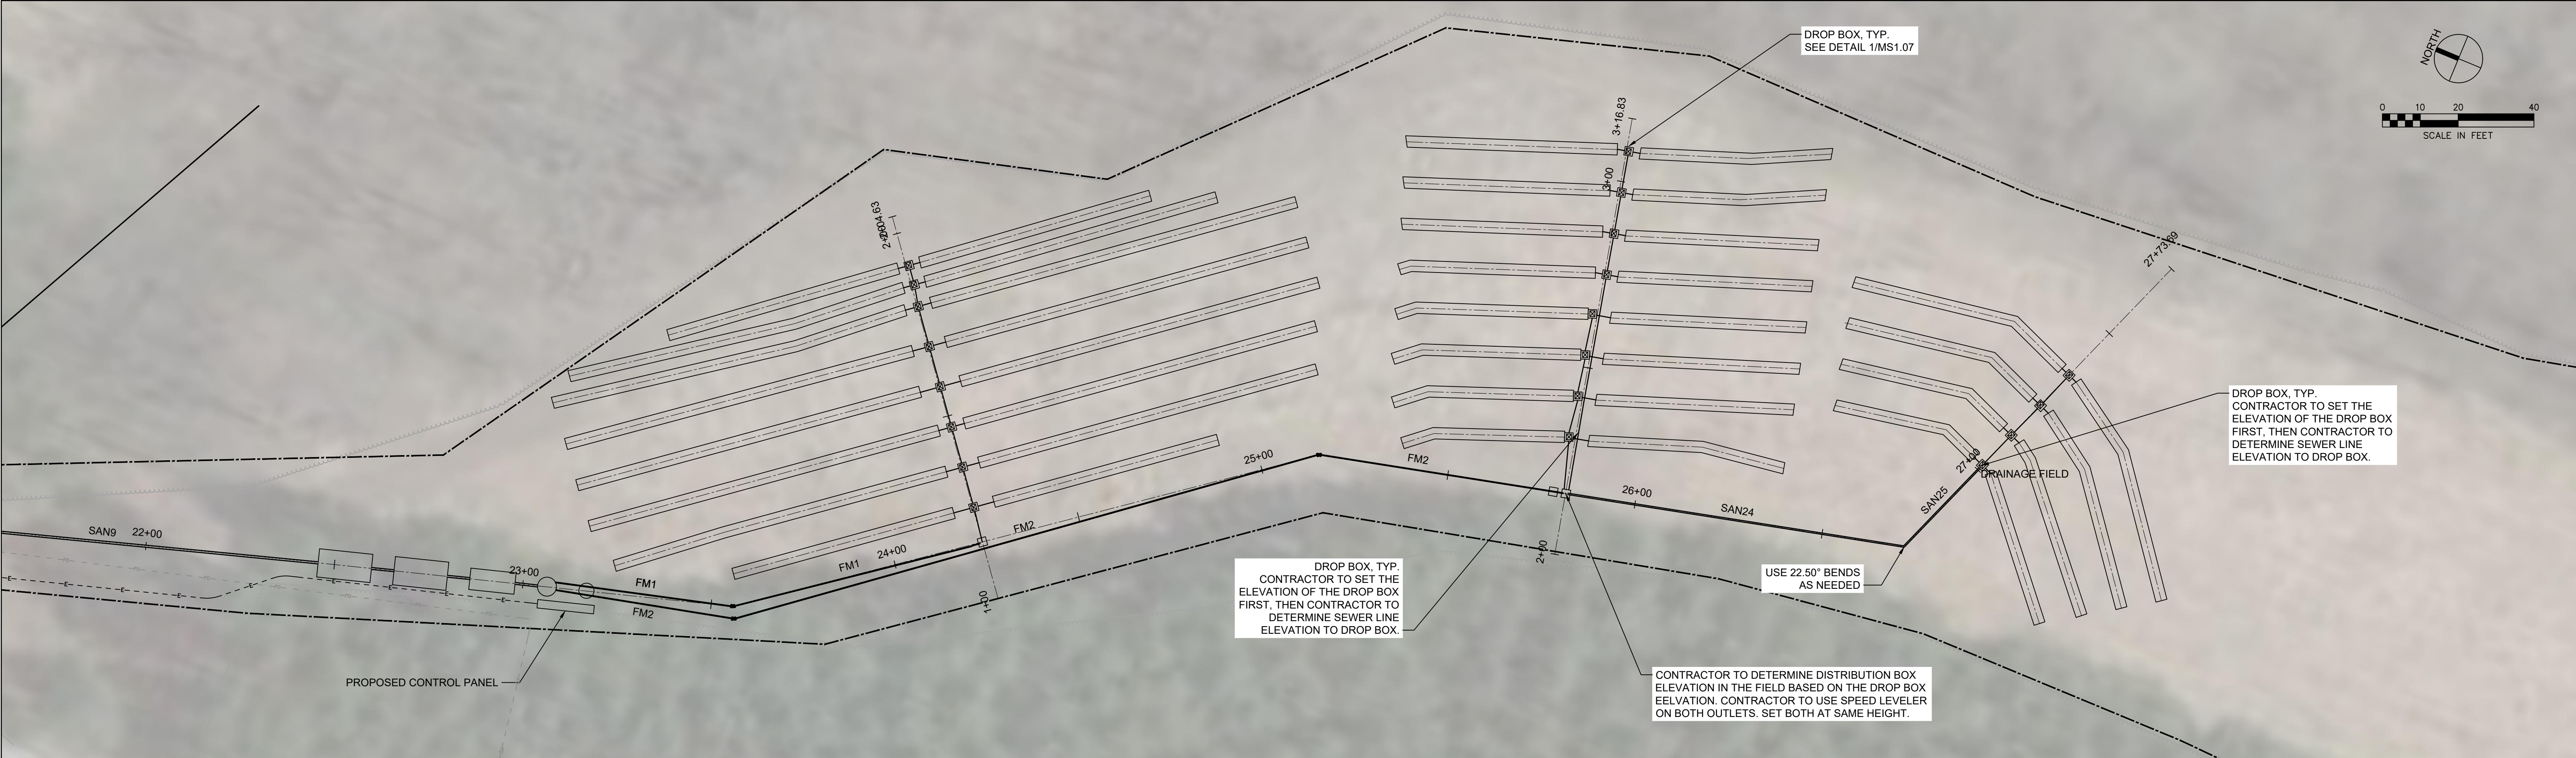


GENERAL NOTES:
1. WHERE THERE IS LESS THAN 4 FEET OF SOIL COVER OVER PIPE, CONTRACTOR TO PLACE FILL ON TOP OF EXISTING GROUND OVER TOP OF PIPE TO BRING COVER TO 4 FOOT MINIMUM. CONTRACTOR TO FEATHER SOIL DOWN FROM CENTER OF PIPE TO TREE LINE ON EACH SIDE. REFER TO F SHEETS FOR GRADING DETAILS. GRADING NOTES ON SHEET A1.01 APPLIES. AREA FROM APPROXIMATELY STATION 24+43 - 27+50 IS ANTICIPATED TO NEED FILL TO MEET MINIMUM COVER REQUIREMENT.




- GENERAL NOTES:
1. FROM STATION 32+00 - 35+00, CONTRACTOR SHALL PLACE 2 INCH X 48 INCH POLYSTYRENE CENTERED OVER PIPE (APPROXIMATELY 300 LF).
 2. WHERE THERE IS LESS THAN 4 FEET OF SOIL COVER OVER PIPE, CONTRACTOR TO PLACE FILL ON TOP OF EXISTING GROUND OVER TOP OF PIPE TO BRING COVER TO 4 FOOT MINIMUM. CONTRACTOR TO FEATHER SOIL DOWN FROM CENTER OF PIPE TO TREE LINE ON EACH SIDE. REFER TO F SHEETS FOR GRADING DETAILS. GRADING NOTES ON SHEET A1.01 APPLIES. AREA FROM APPROXIMATELY STATION 32+20 - 35+00 IS ANTICIPATED TO NEED FILL TO MEET MINIMUM COVER REQUIREMENT.
 3. CONTRACTOR TO REMOVE AND REPLACE APPROXIMATELY 25 SY OF ASPHALT PARK ROAD AND SUBBASE TO INSTALL PIPE SAN 12. MATCH EXISTING SUBBASE AND PAVEMENT SECTIONS. CONTRACTOR TO PROVIDE OWNER MINIMUM 7 BUSINESS DAYS NOTICE PRIOR TO CLOSING THE PARK ROAD FOR PIPE SAN 12 INSTALLATION. CONTRACTOR TO COORDINATE WITH OWNER ON CLOSURE OF THE ROAD AND LENGTH OF CLOSURE PRIOR TO CONSTRUCTION.

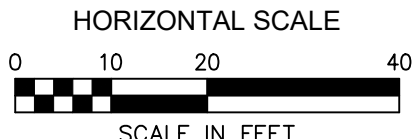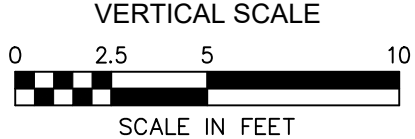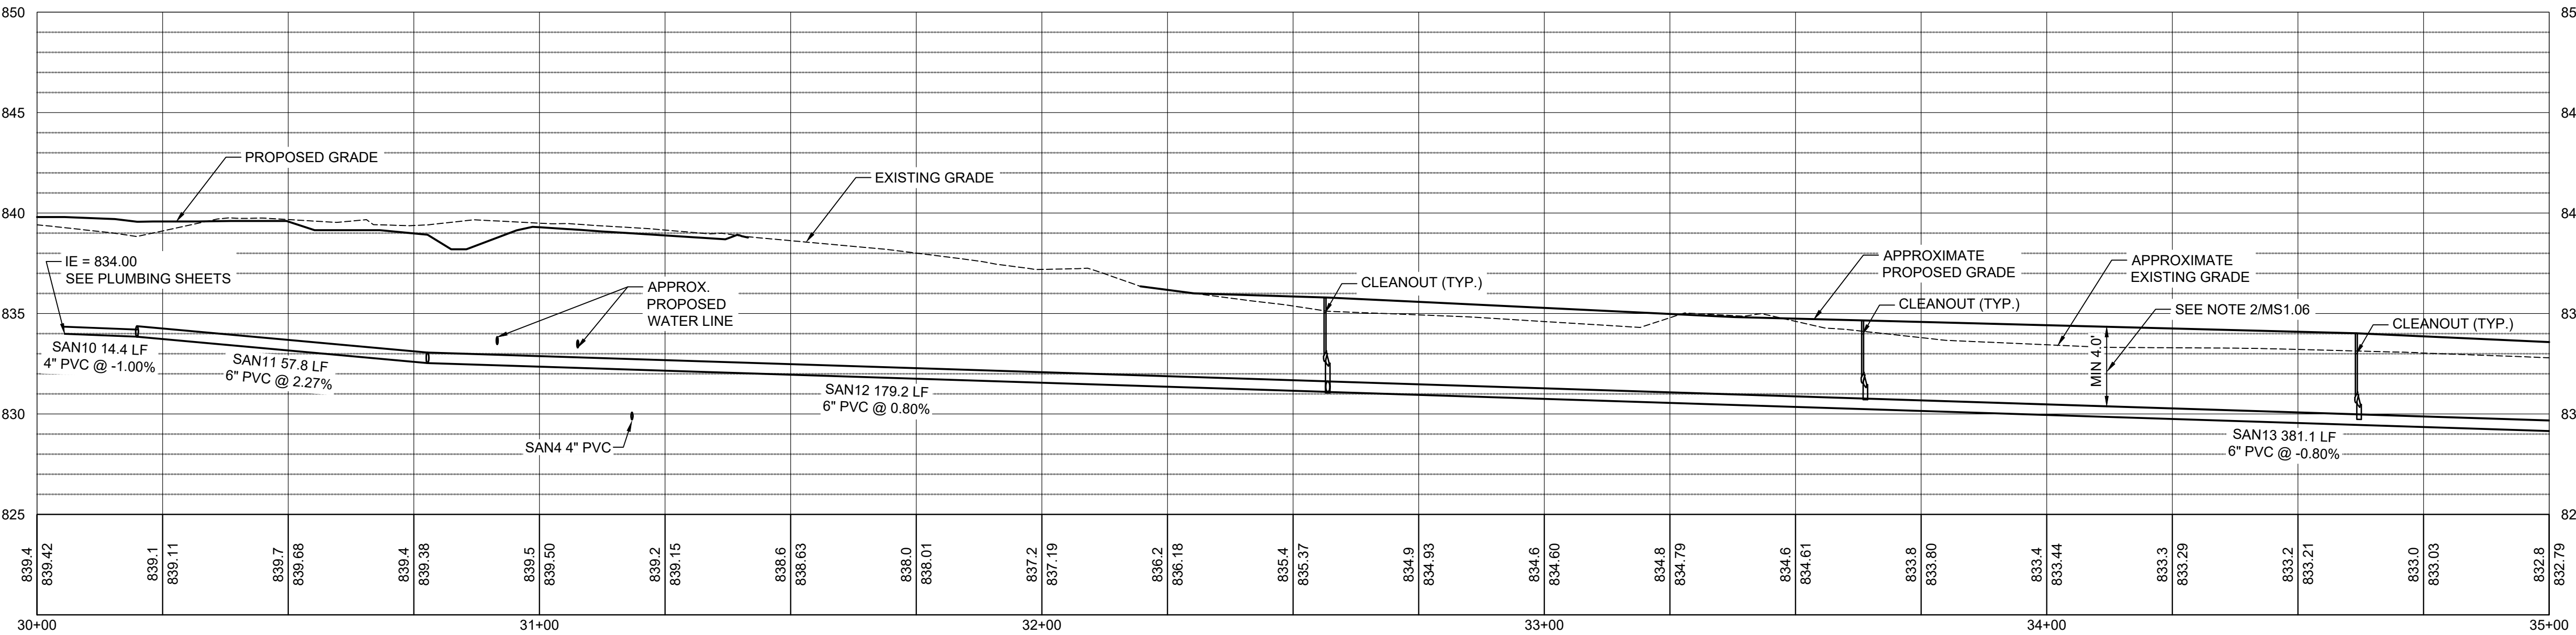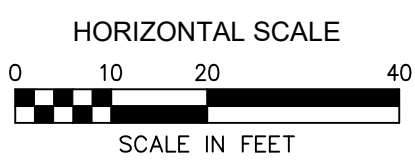

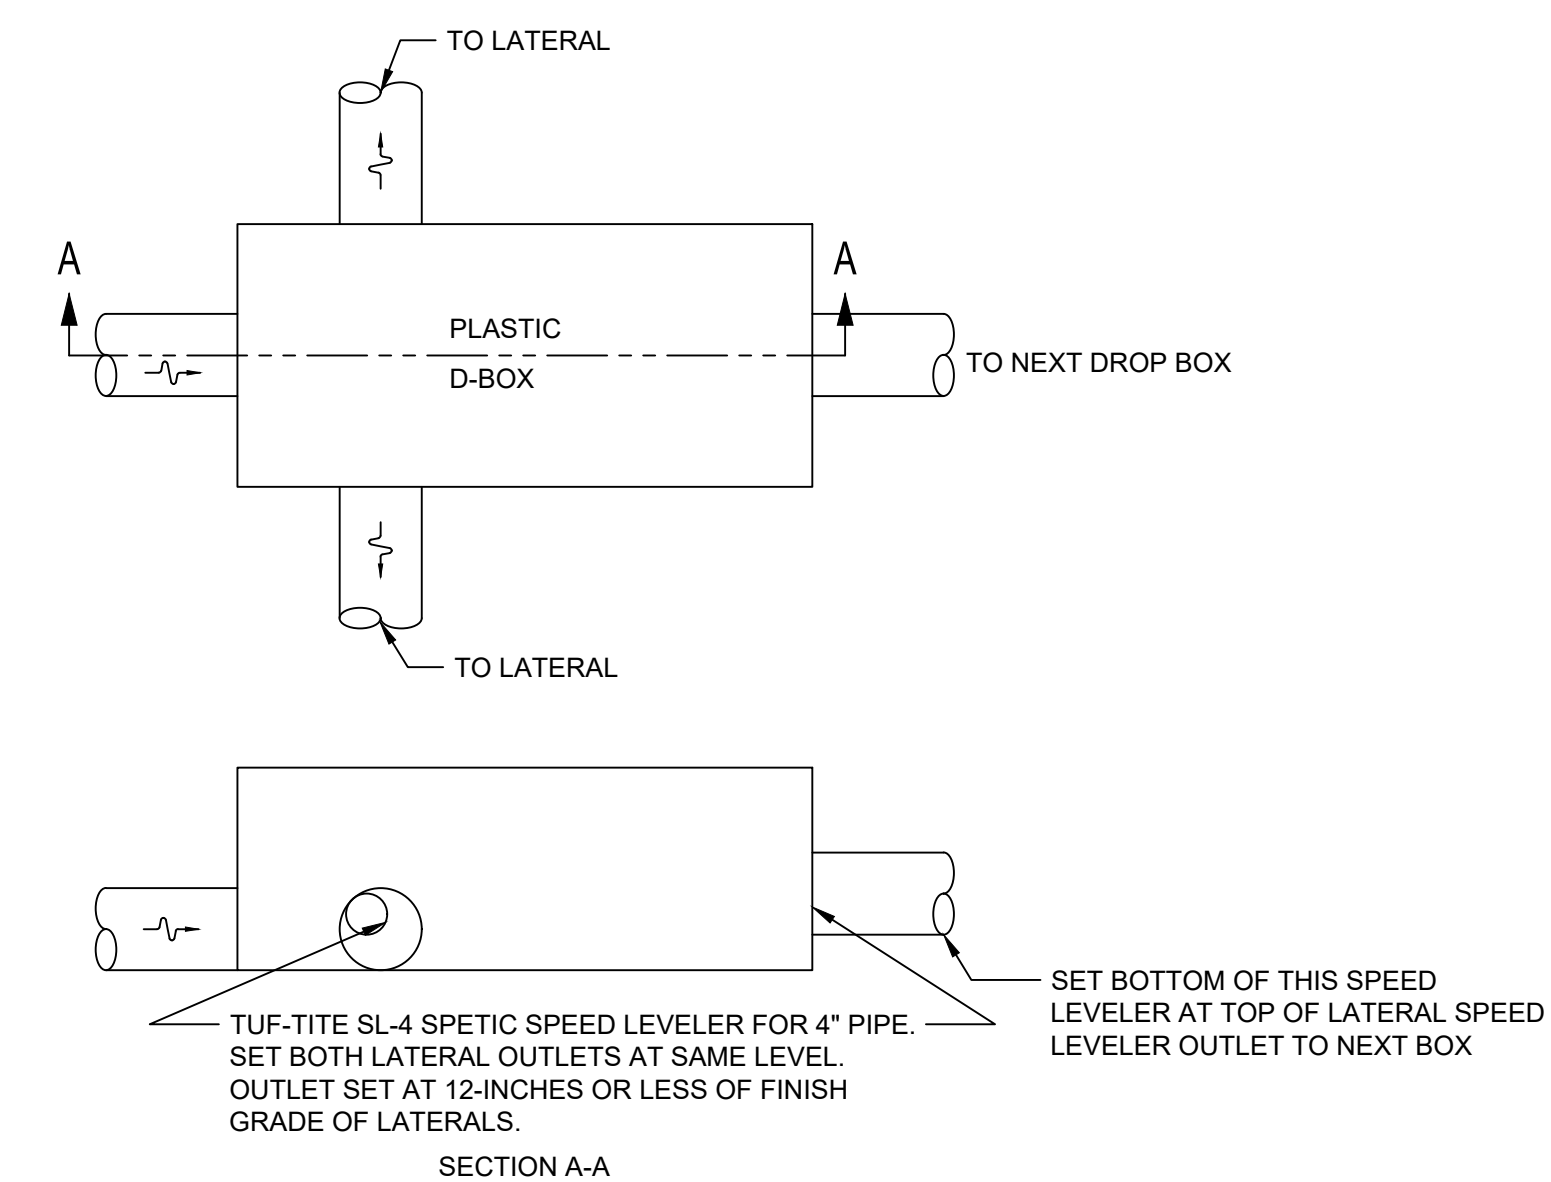


N.T.S.

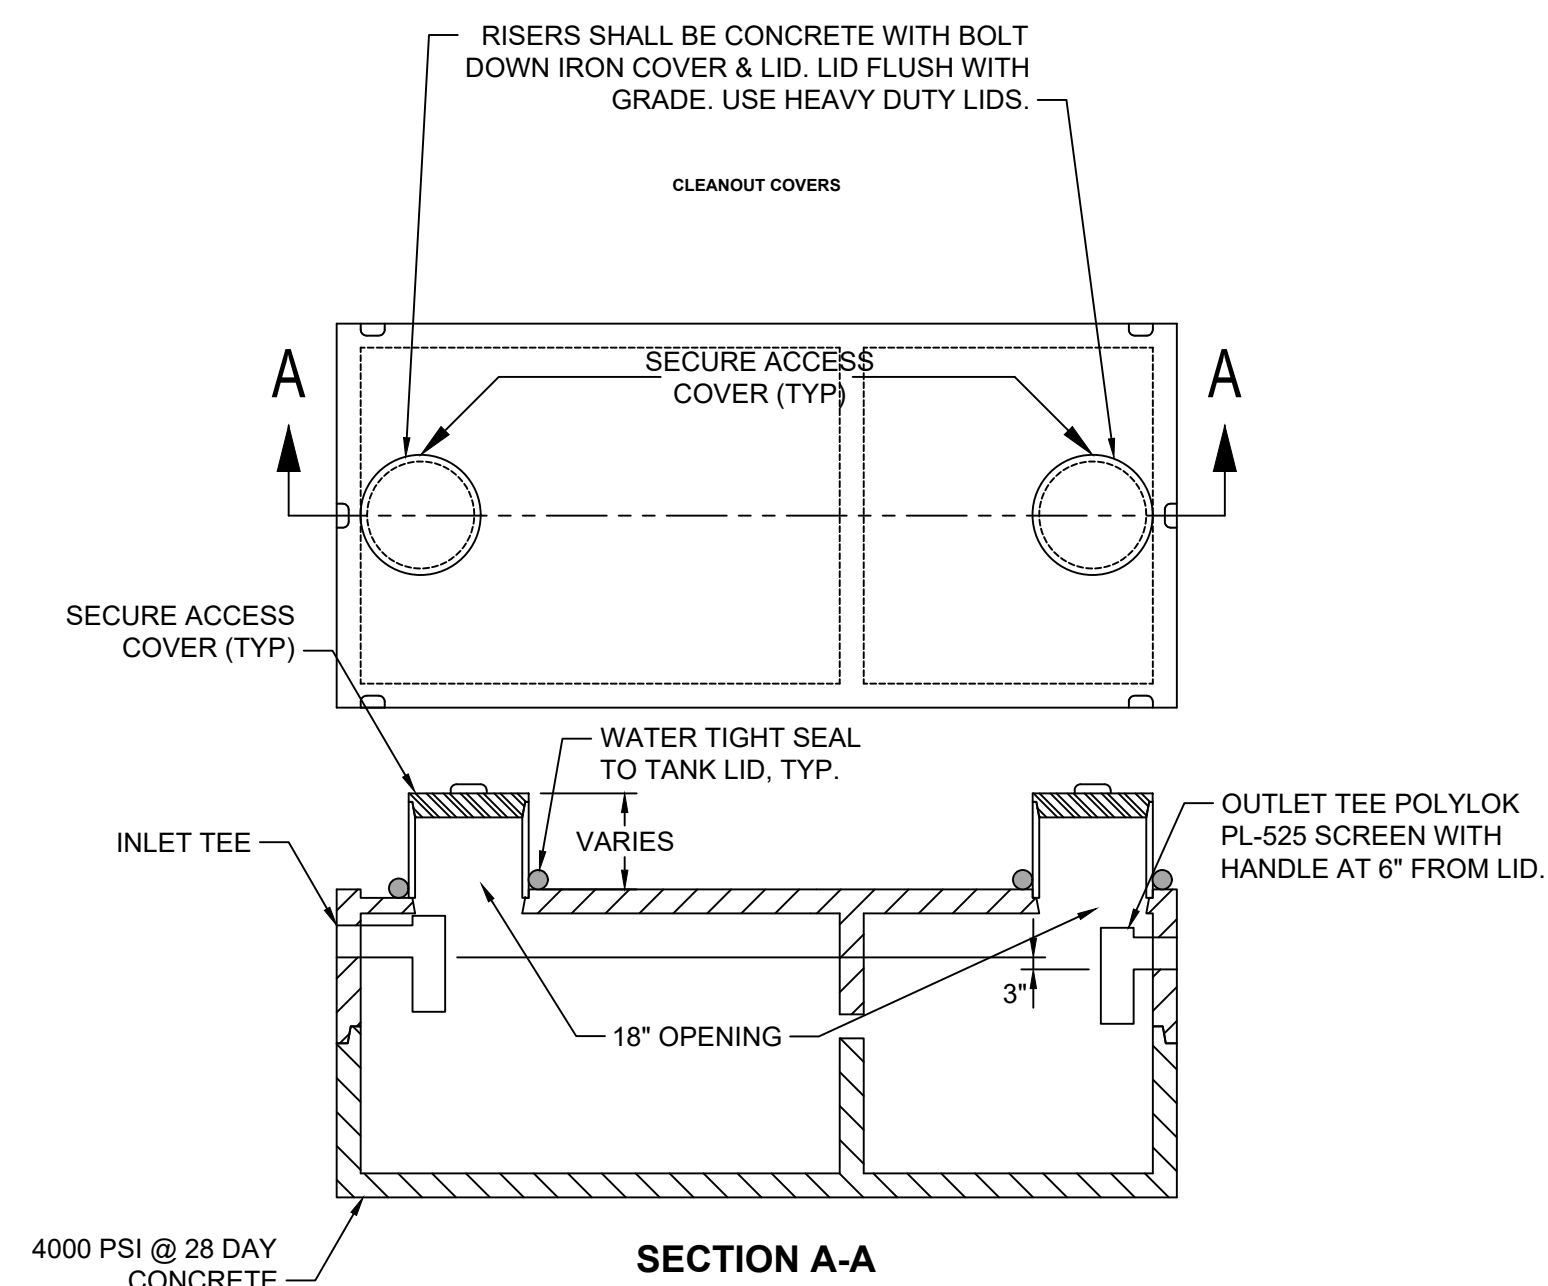


2 N.T.S

4 IN. PVC DISTRIBUTION PIPE MEETING ASTM 2729 WITH $\frac{3}{4}$ IN. DIAMETER PERFORATIONS NO MORE THAN 40 INCHES APART

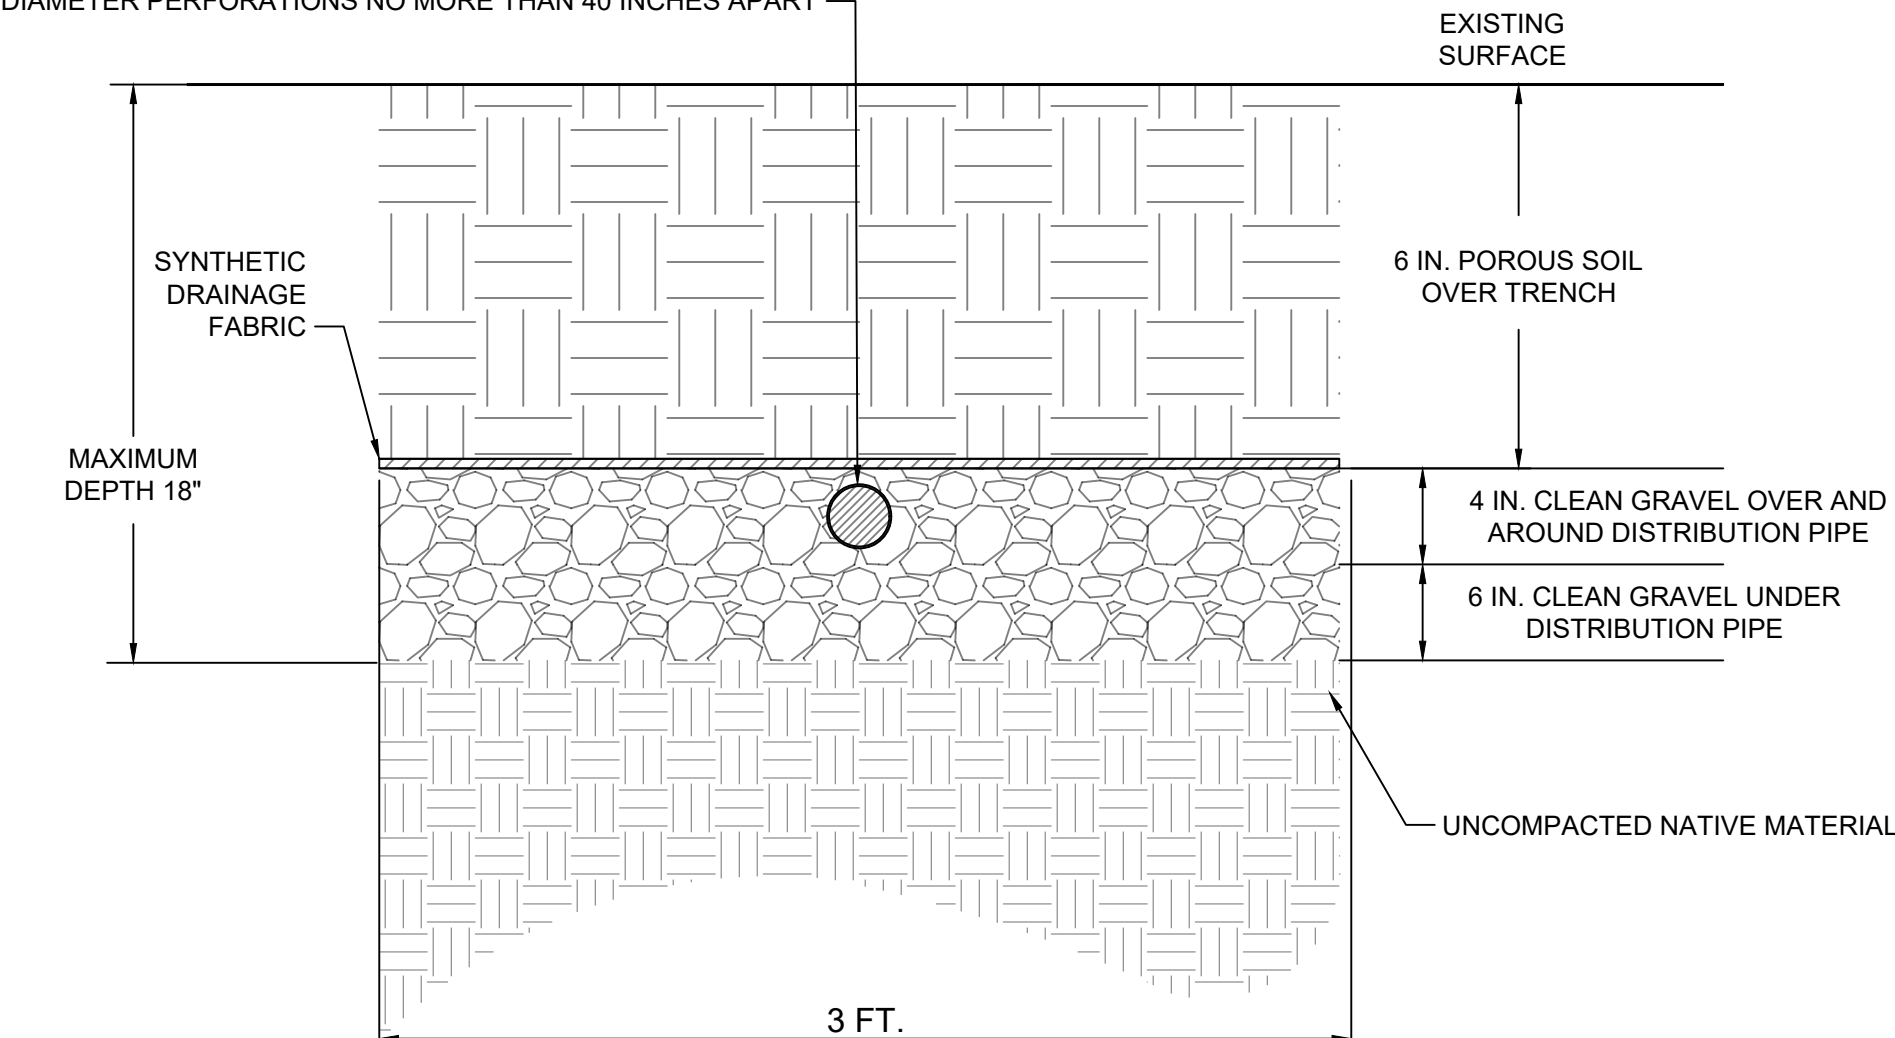




3 NOT TO SCALE

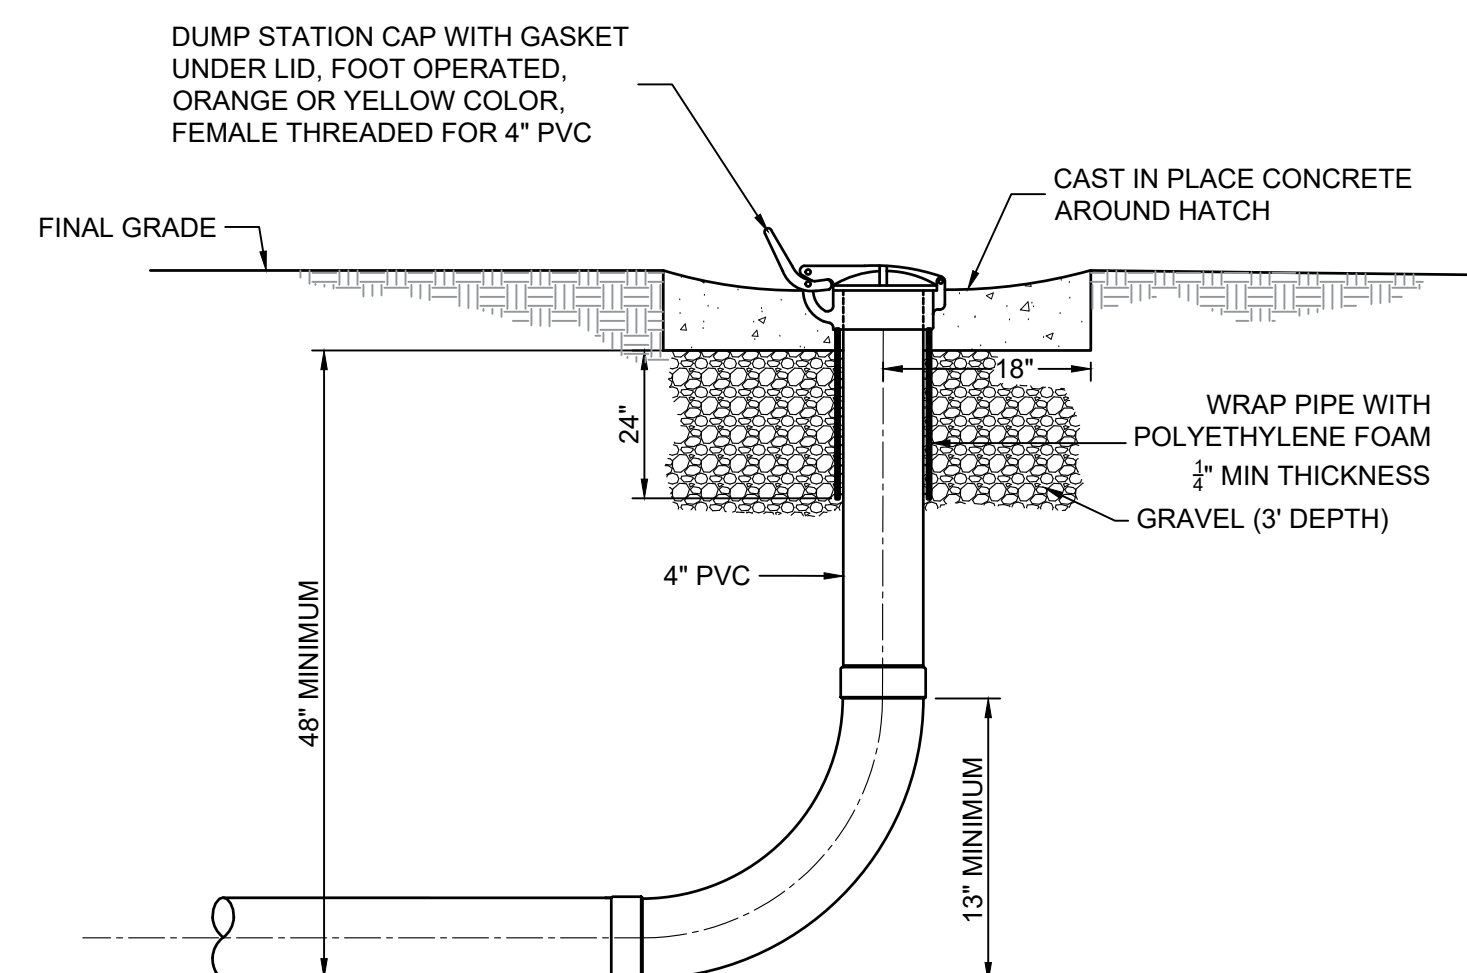

4 NOT TO SCALE



GENERAL NOTES:

1. WHERE THERE IS LESS THAN 4 FEET OF SOIL COVER OVER PIPE, CONTRACTOR TO PLACE FILL ON TOP OF EXISTING GROUND OVER TOP OF PIPE TO BRING COVER TO 4 FOOT MINIMUM. CONTRACTOR TO FEATHER SOIL DOWN FROM CENTER OF PIPE TO TREE LINE ON EACH SIDE. REFER TO F SHEETS FOR GRADING DETAILS. GRADING NOTES ON SHEET A1.01 APPLIES. AREA FROM APPROXIMATELY STATION 35+00 - 36+53 IS ANTICIPATED TO NEED FILL TO MEET MINIMUM COVER REQUIREMENT.
2. TANK #3 AND #4 SHALL BE 1,250 GALLON PLASTIC TANK AND SHALL BE ROTH. TANK #5 AND 6 COULD BE 12" OR 18" CRUSHED ROCK OR CRUSHED CONCRETE MINIMUM 12" UP ALL SIDES WITH 12" UNDER TANK. USE HEAVY DUTY SCREW DOWN LIDS PLACED FLUSH WITH FINAL GRADE.

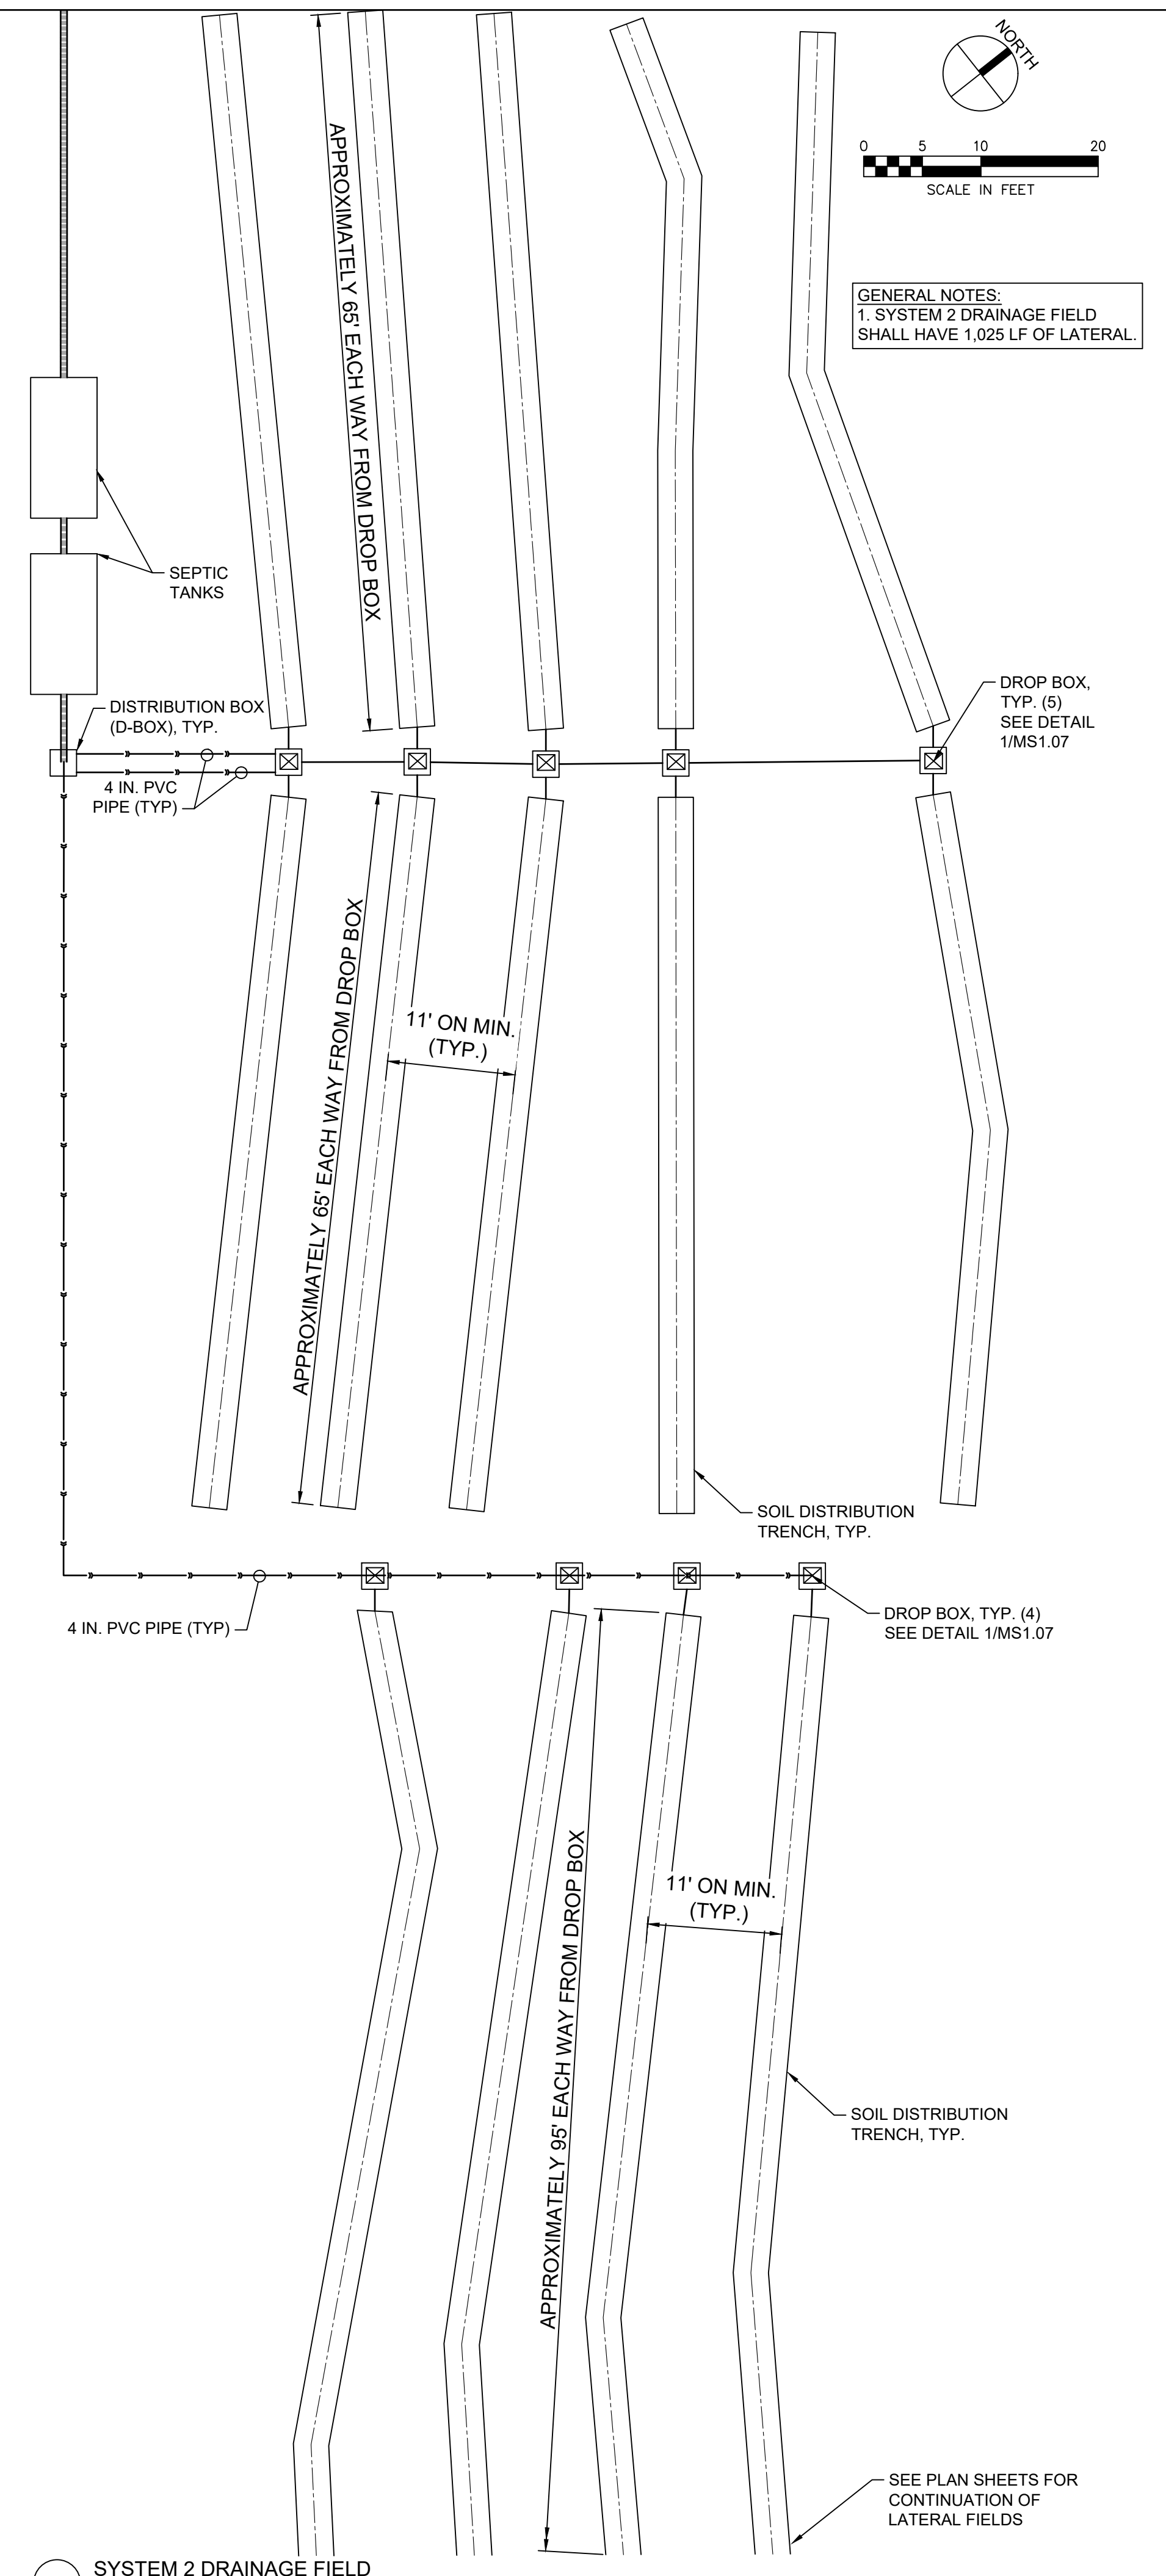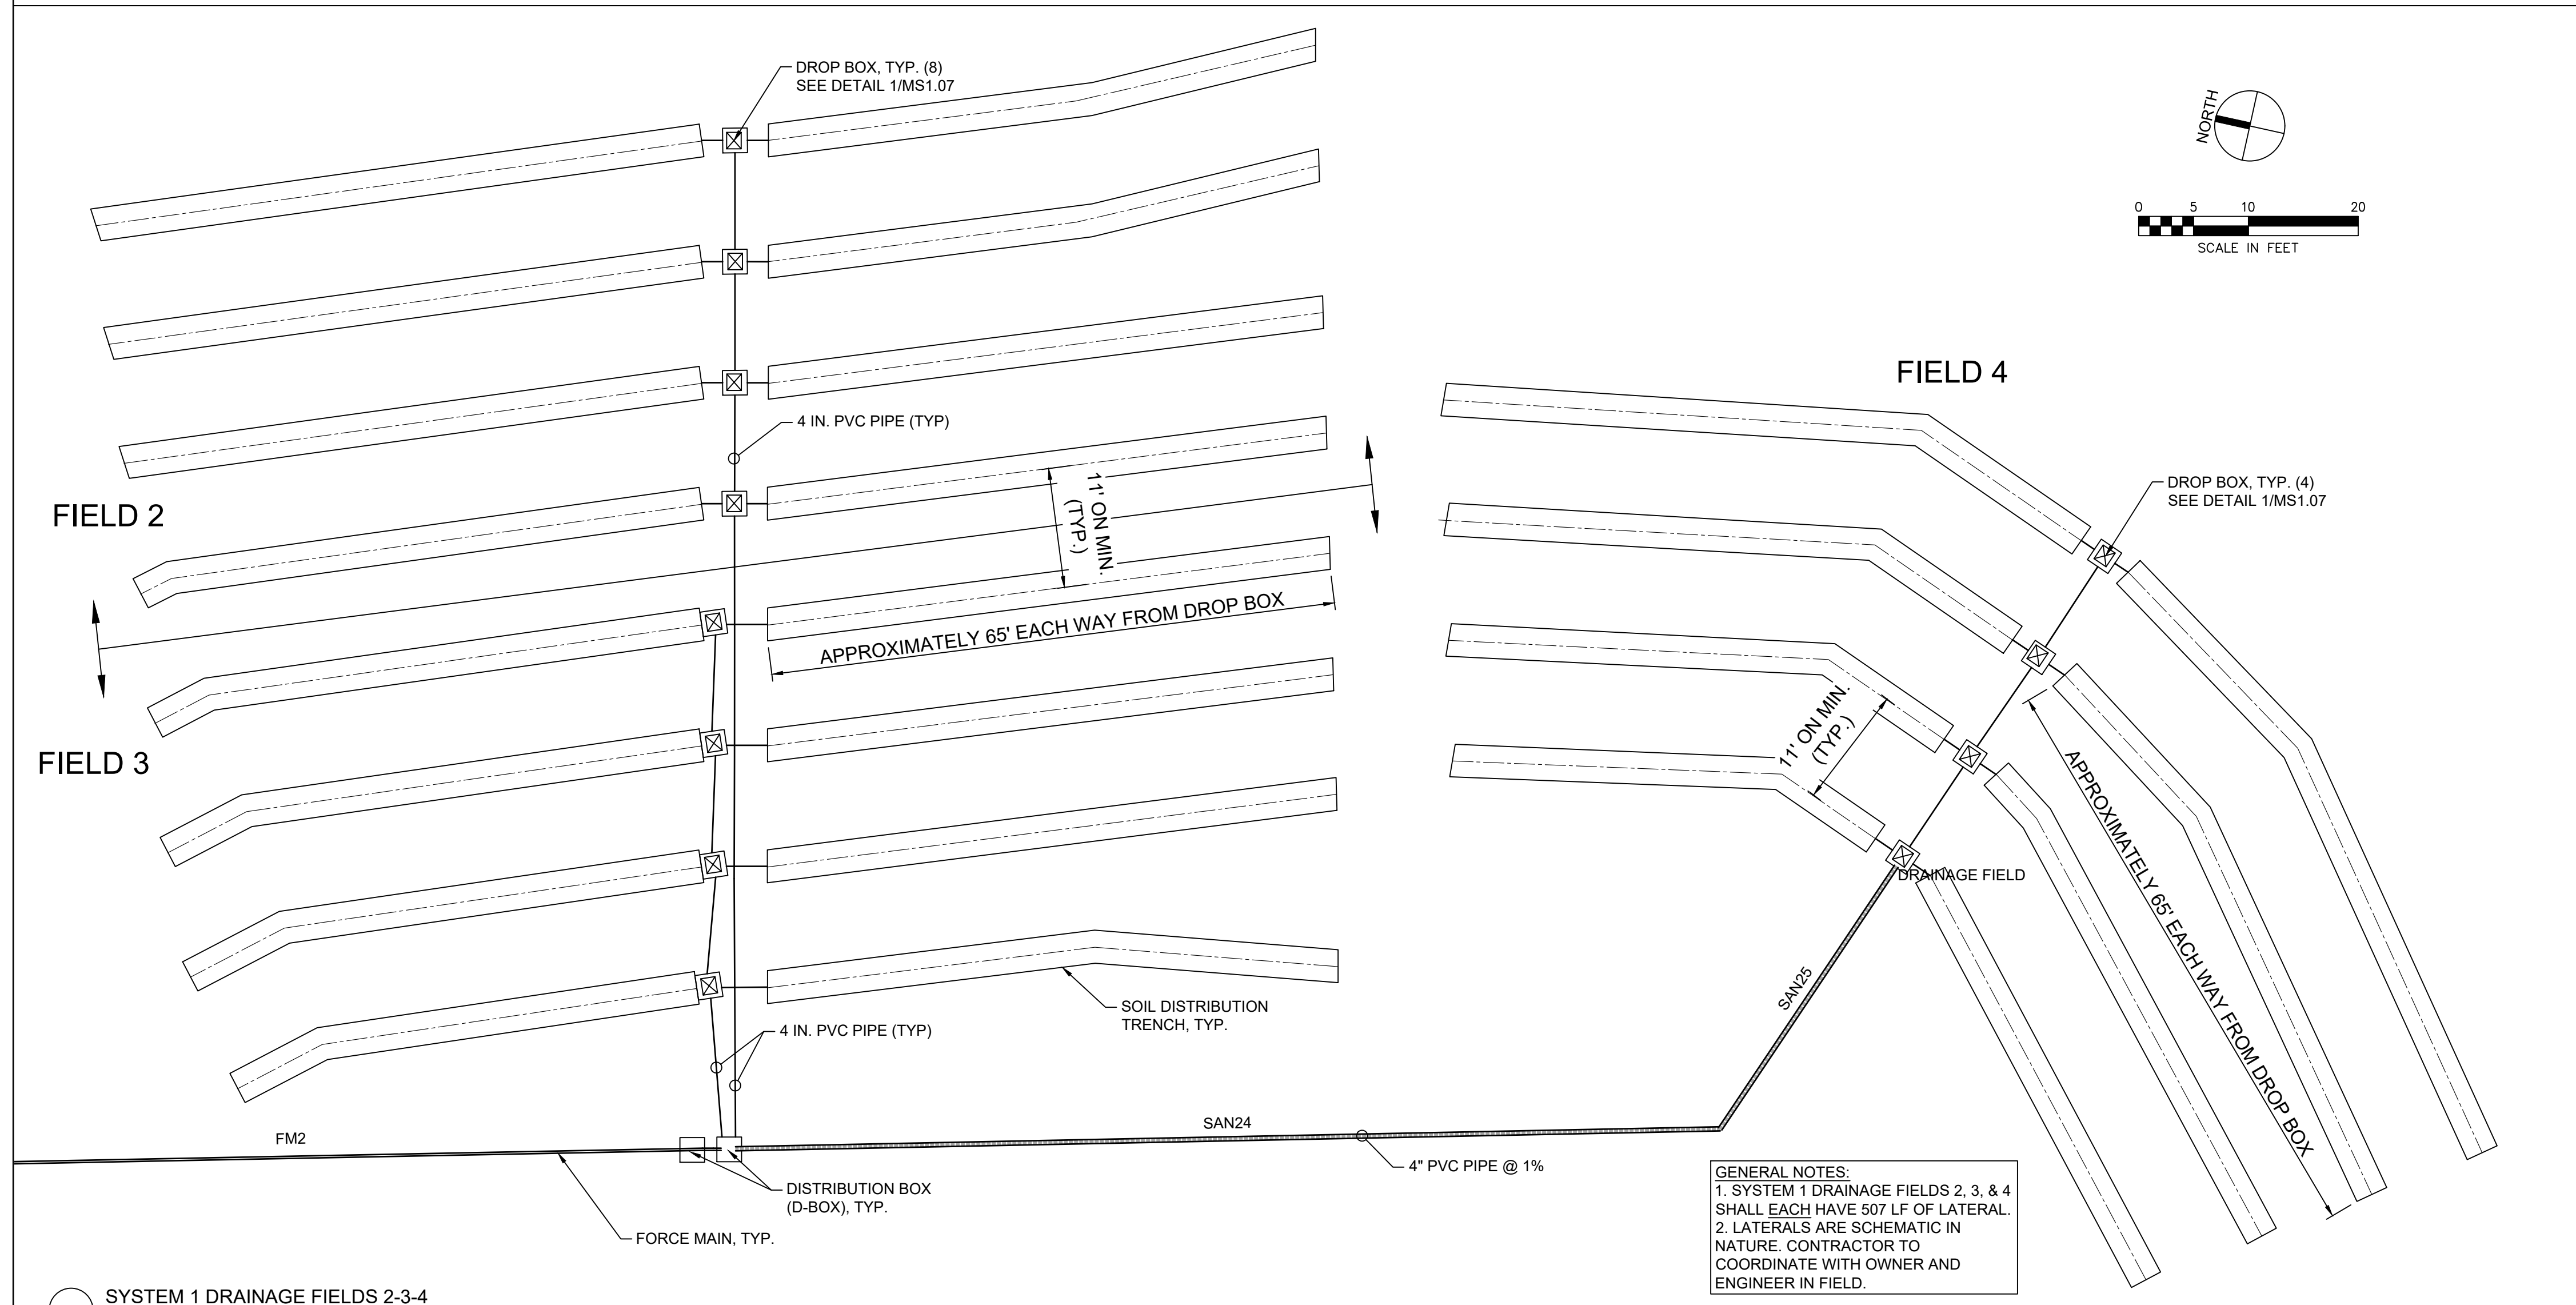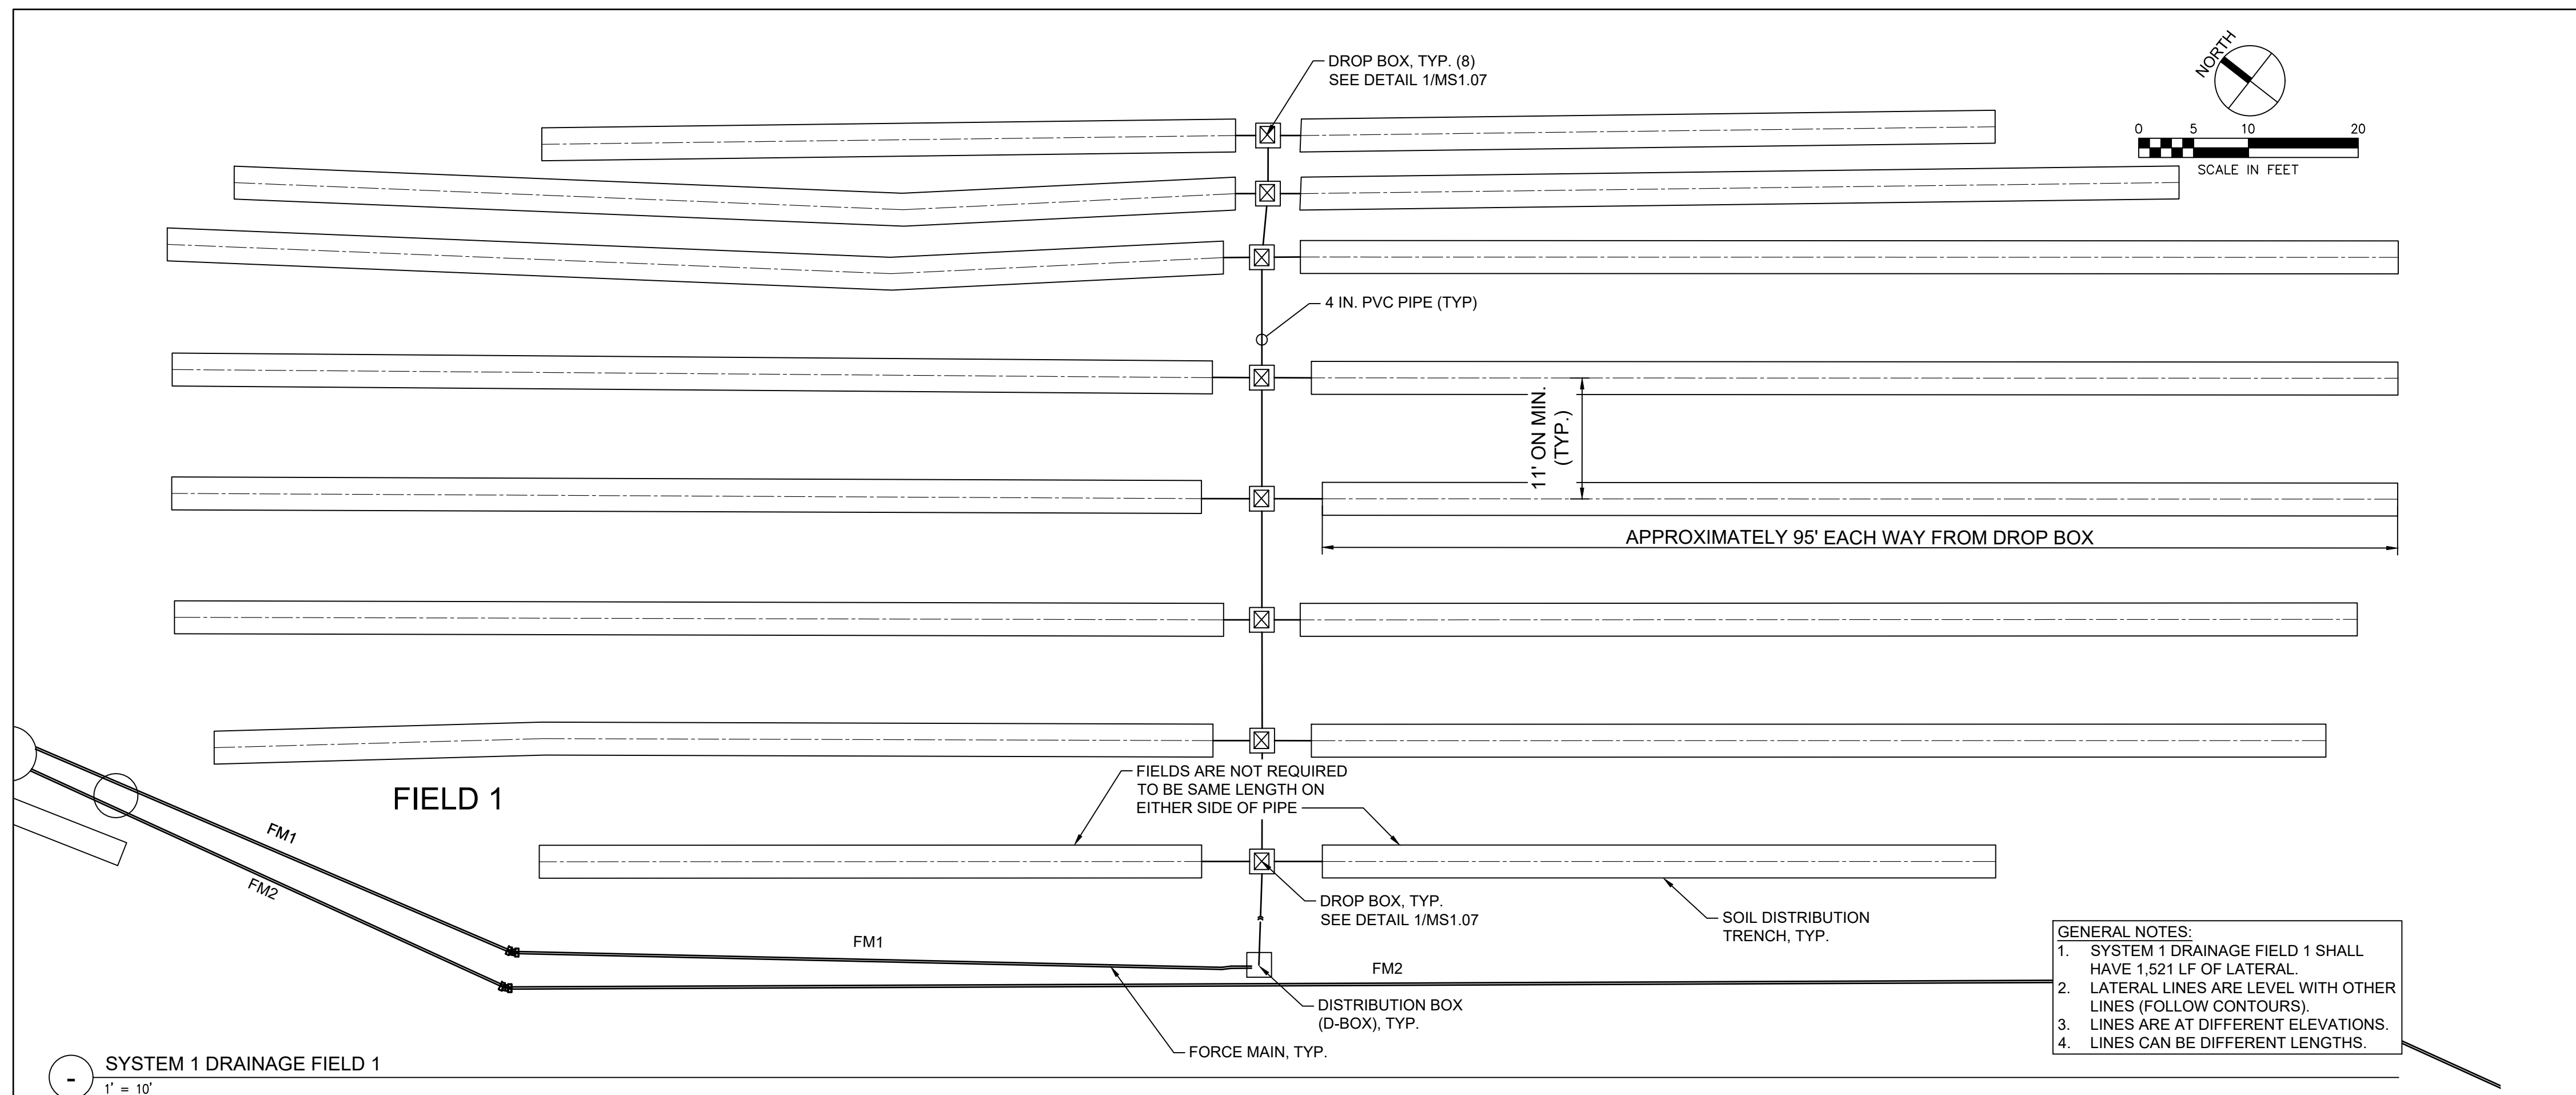

CODED NOTES: ○



- ①
- PROVIDE CONNECTION TO SITE DISTRIBUTION POWER SYSTEM.
- ②
- PROVIDE 200A CAM-LOK RECPTS FOR CONNECTION OF PORTABLE GENERATOR. COORDINATE WITH OWNER FOR ACTUAL RECEPTACLE REQUIREMENTS.
- ③
- INTERFACE EQUIPMENT FOR SENSORS TO BE FURNISHED BY OTHERS. PROVIDE CONTROL CONNECTIONS AS RECOMMENDED BY THE SUPPLIER.
- ④
- SEE WET WELL PLAN FOR FLOAT ELEVATIONS
- ⑤
- PROVIDE GROUNDING AND BONDING AT MAIN DISCONNECT PER NEC ARTICLE 250.

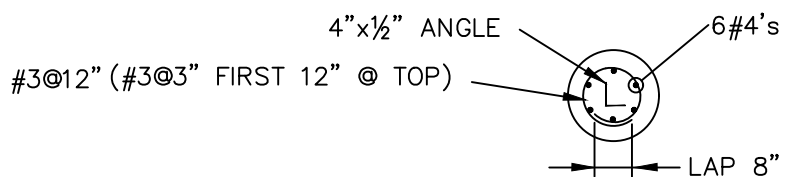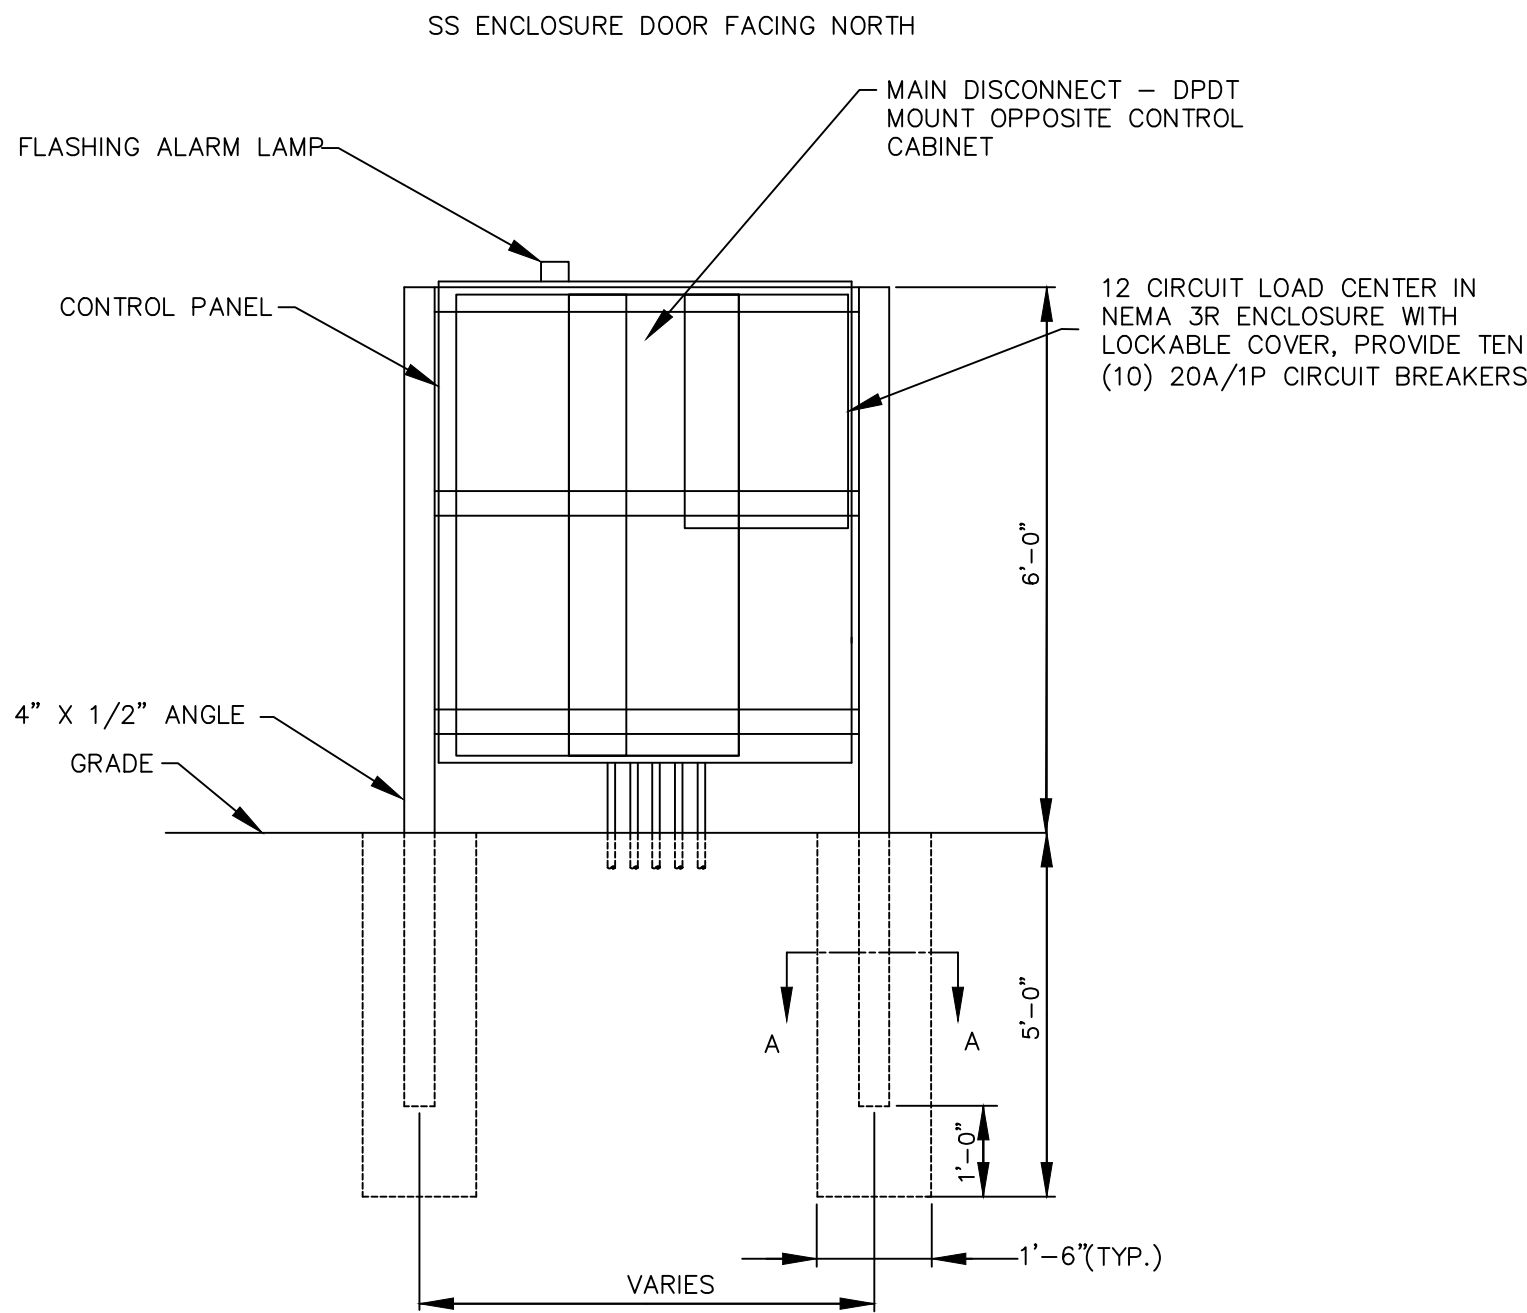

- NOTES:
1.
- COORDINATE EXACT MOUNTING CONFIGURATION, FRAME HEIGHT AND WIDTH WITH COMPONENT SHOP DRAWINGS. PROVIDE SHOP DRAWINGS FOR APPROVAL OF FINAL ARRANGEMENT BY THE ENGINEER.
2.
- FASTENING HARDWARE SHALL BE 304 STAINLESS STEEL BOLTS AND STEEL ANGLE IRON AS REQUIRED. ALL ANGLE IRON SHALL BE PRIMED, AND PAINTED WITH GRAY ZINC CHROMATE RUST-RESISTING PAINT.



CONTROL PANEL NORTH & SOUTH ELEVATIONS

SCALE: 1/8"= 1'-0"

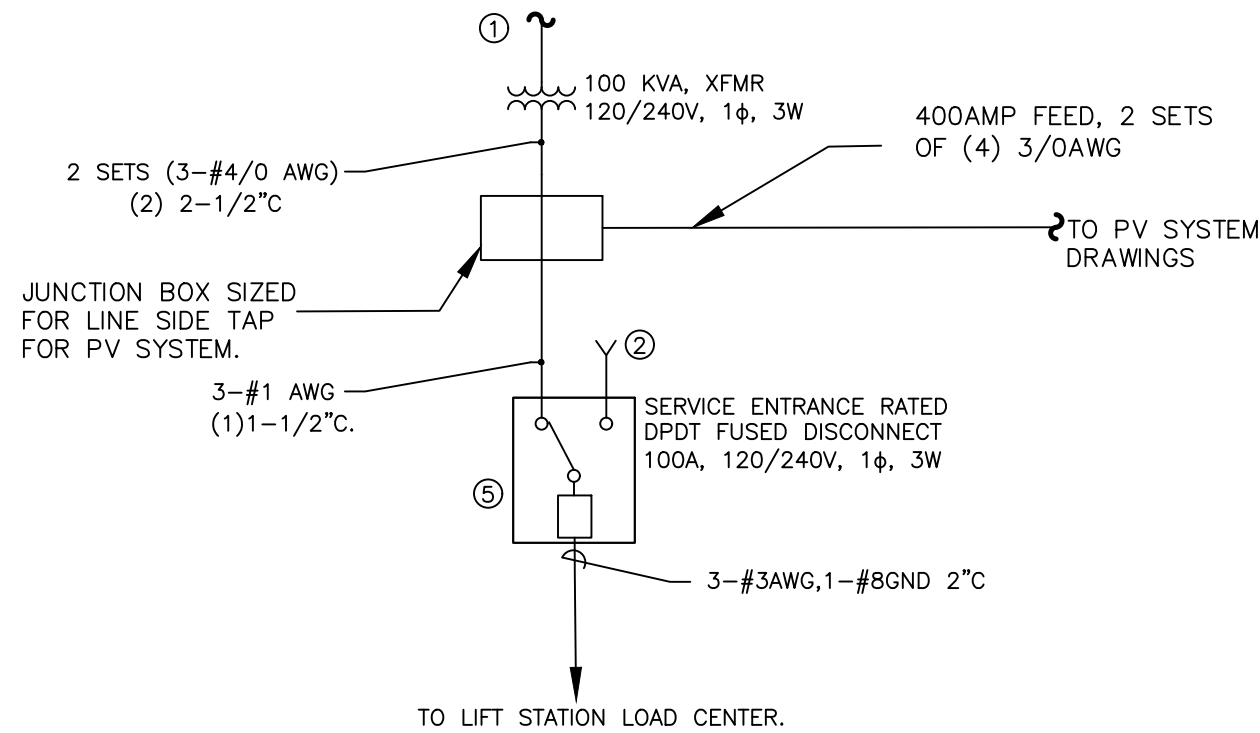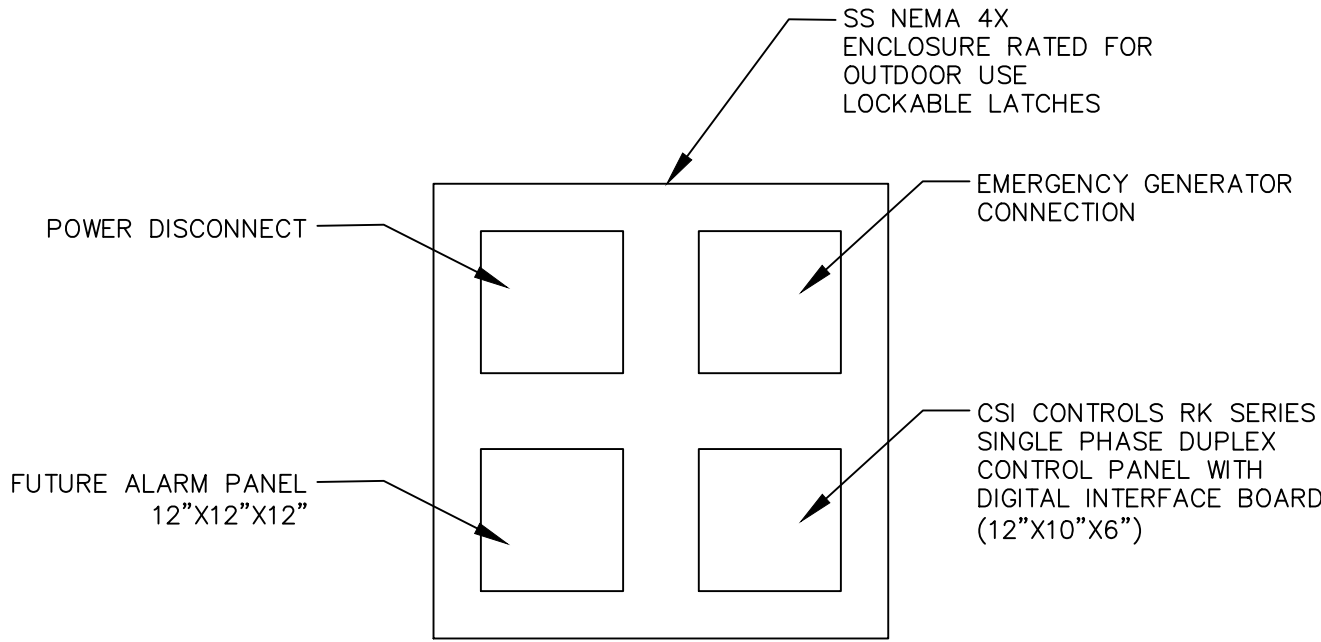

ONE LINE DIAGRAM


SCALE: NOT TO SCALE

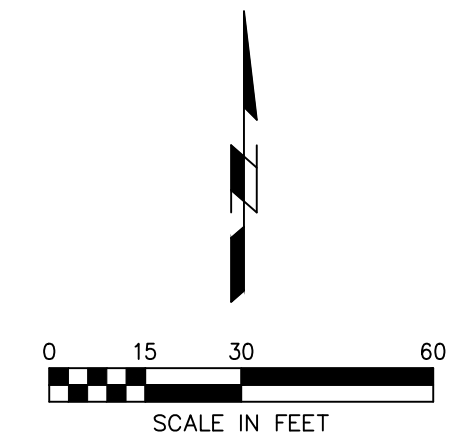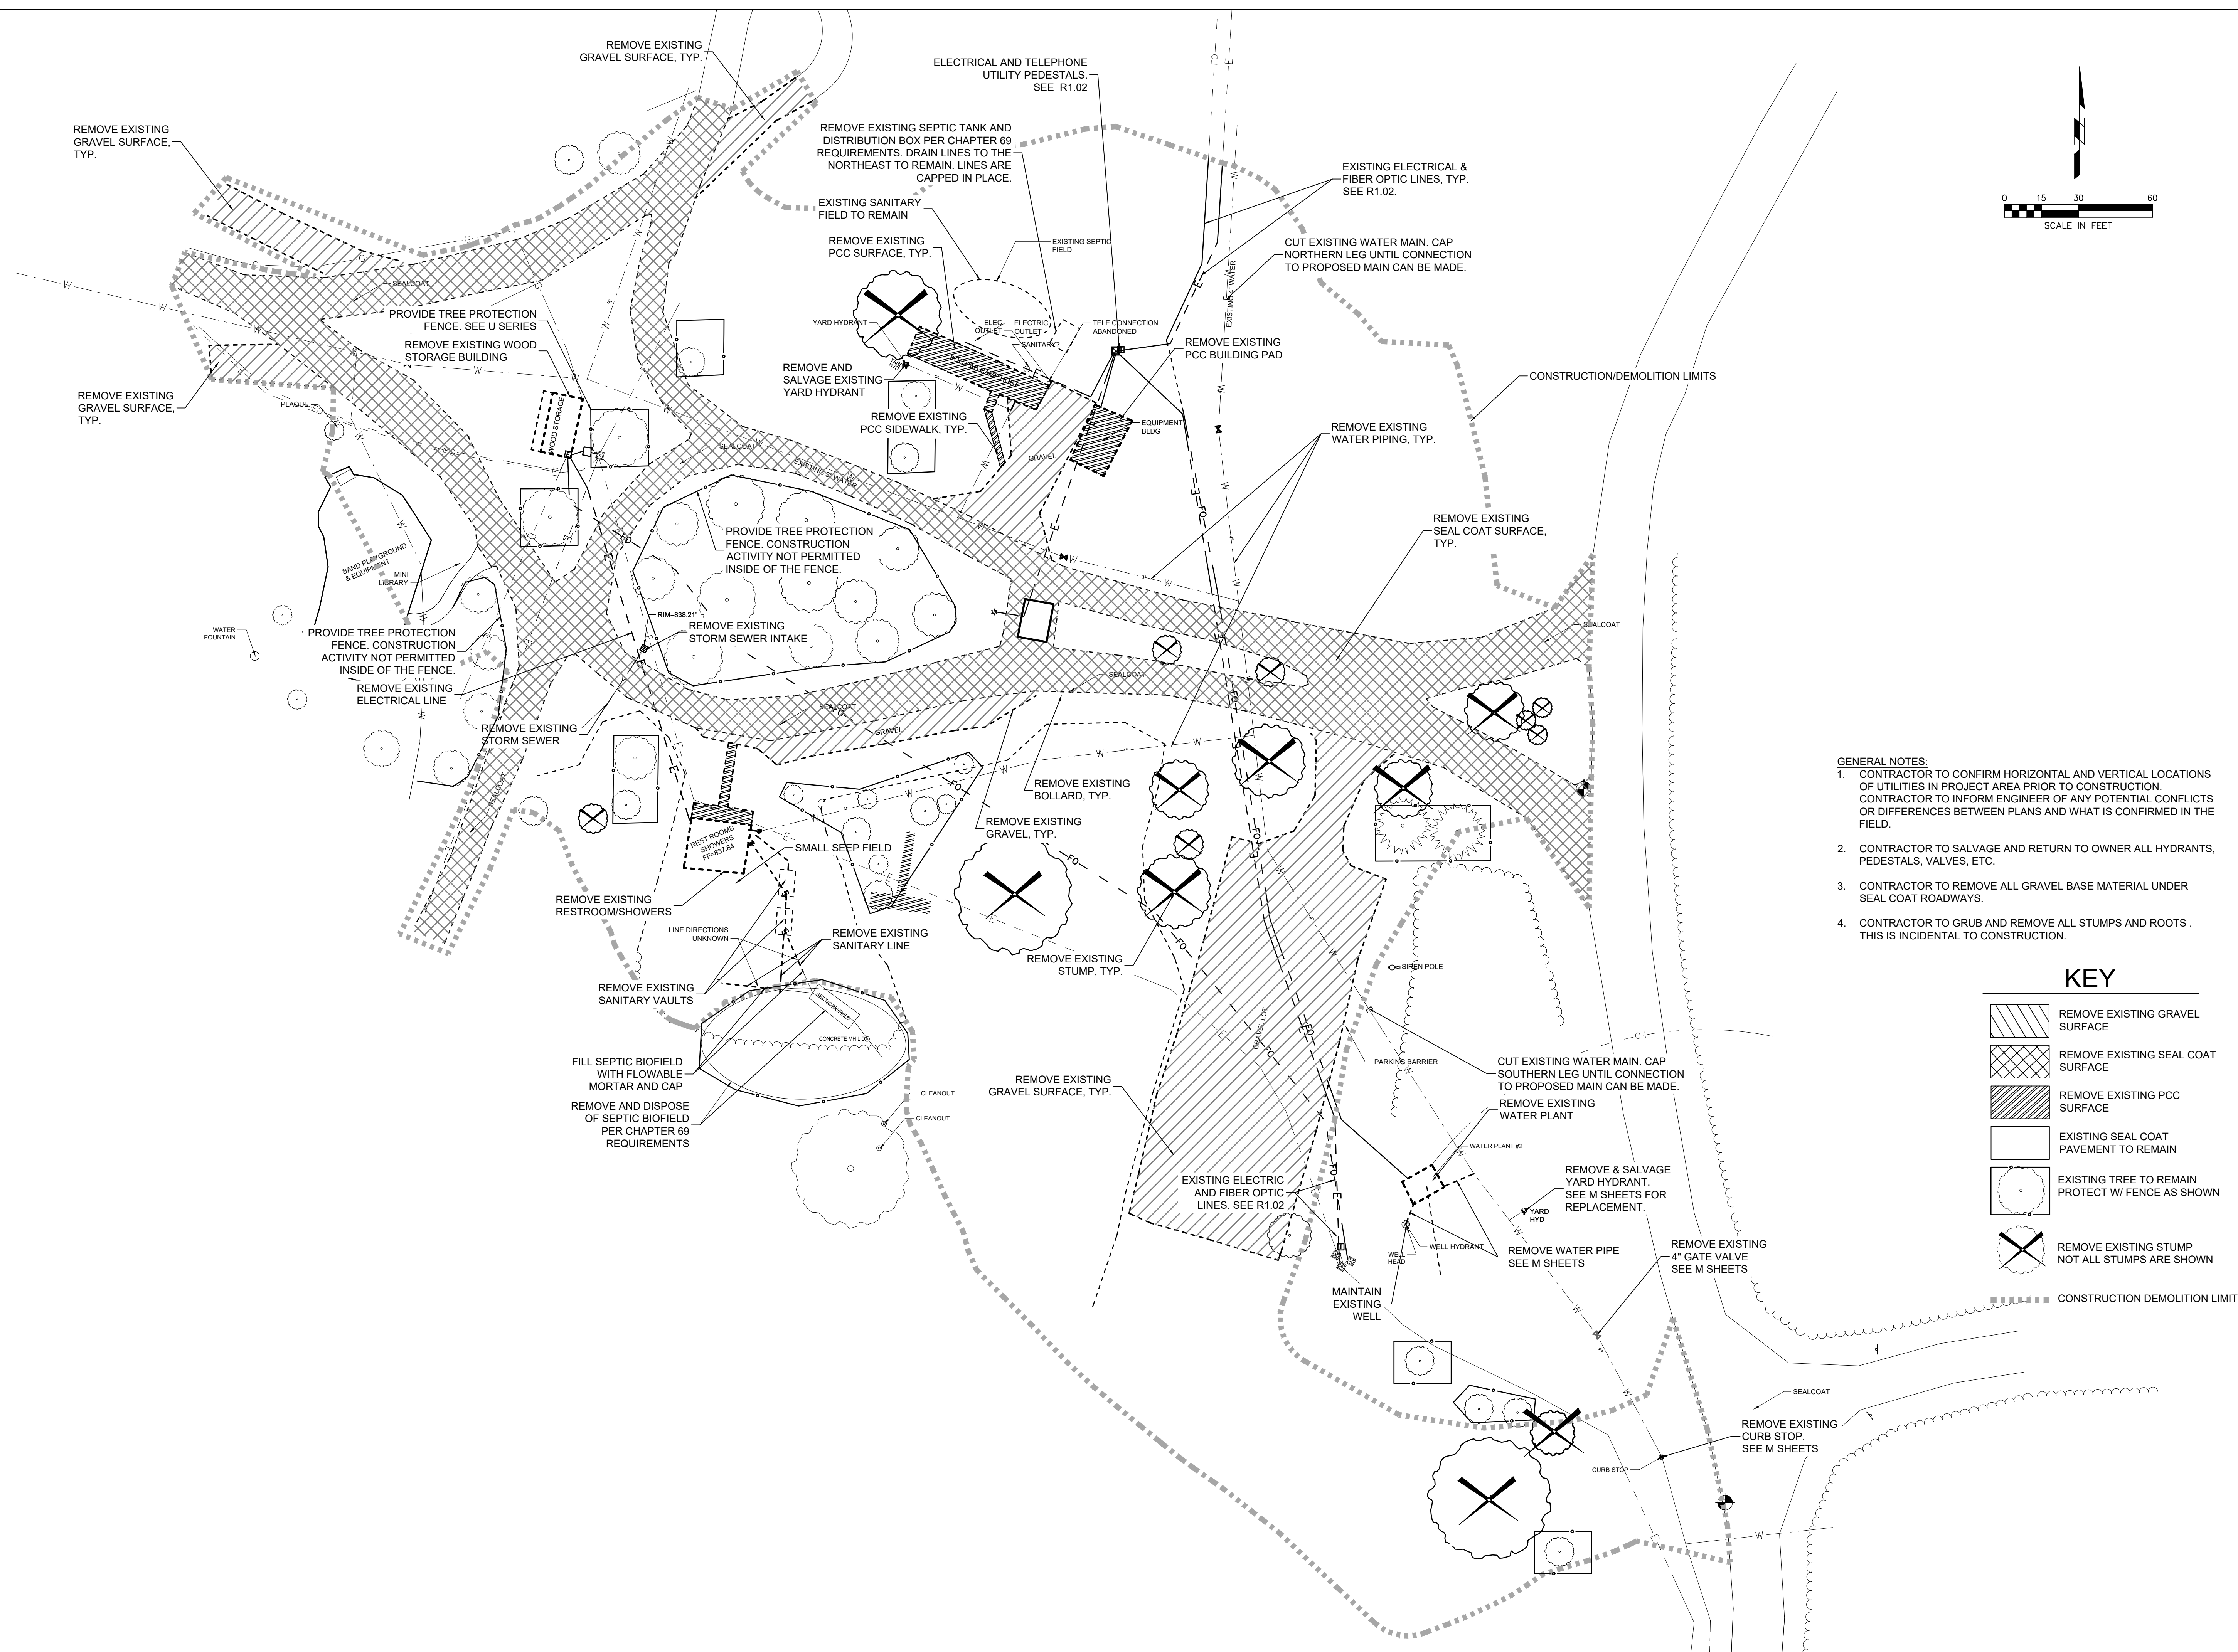



- GENERAL NOTES:**
1. CONTRACTOR TO CONFIRM HORIZONTAL AND VERTICAL LOCATIONS OF UTILITIES IN PROJECT AREA PRIOR TO CONSTRUCTION. CONTRACTOR TO INFORM ENGINEER OF ANY POTENTIAL CONFLICTS OR DIFFERENCES BETWEEN PLANS AND WHAT IS CONFIRMED IN THE FIELD.
 2. CONTRACTOR TO SALVAGE AND RETURN TO OWNER ALL HYDRANTS, PEDESTALS, VALVES, ETC.
 3. CONTRACTOR TO REMOVE ALL GRAVEL BASE MATERIAL UNDER SEAL COAT ROADWAYS.
 4. CONTRACTOR TO GRUB AND REMOVE ALL STUMPS AND ROOTS. THIS IS INCIDENTAL TO CONSTRUCTION.


KEY

	REMOVE EXISTING GRAVEL SURFACE
	REMOVE EXISTING SEAL COAT SURFACE
	REMOVE EXISTING PCC SURFACE
	EXISTING SEAL COAT PAVEMENT TO REMAIN
	EXISTING TREE TO REMAIN PROTECT W/ FENCE AS SHOWN
	REMOVE EXISTING STUMP NOT ALL STUMPS ARE SHOWN
	CONSTRUCTION DEMOLITION LIMITS

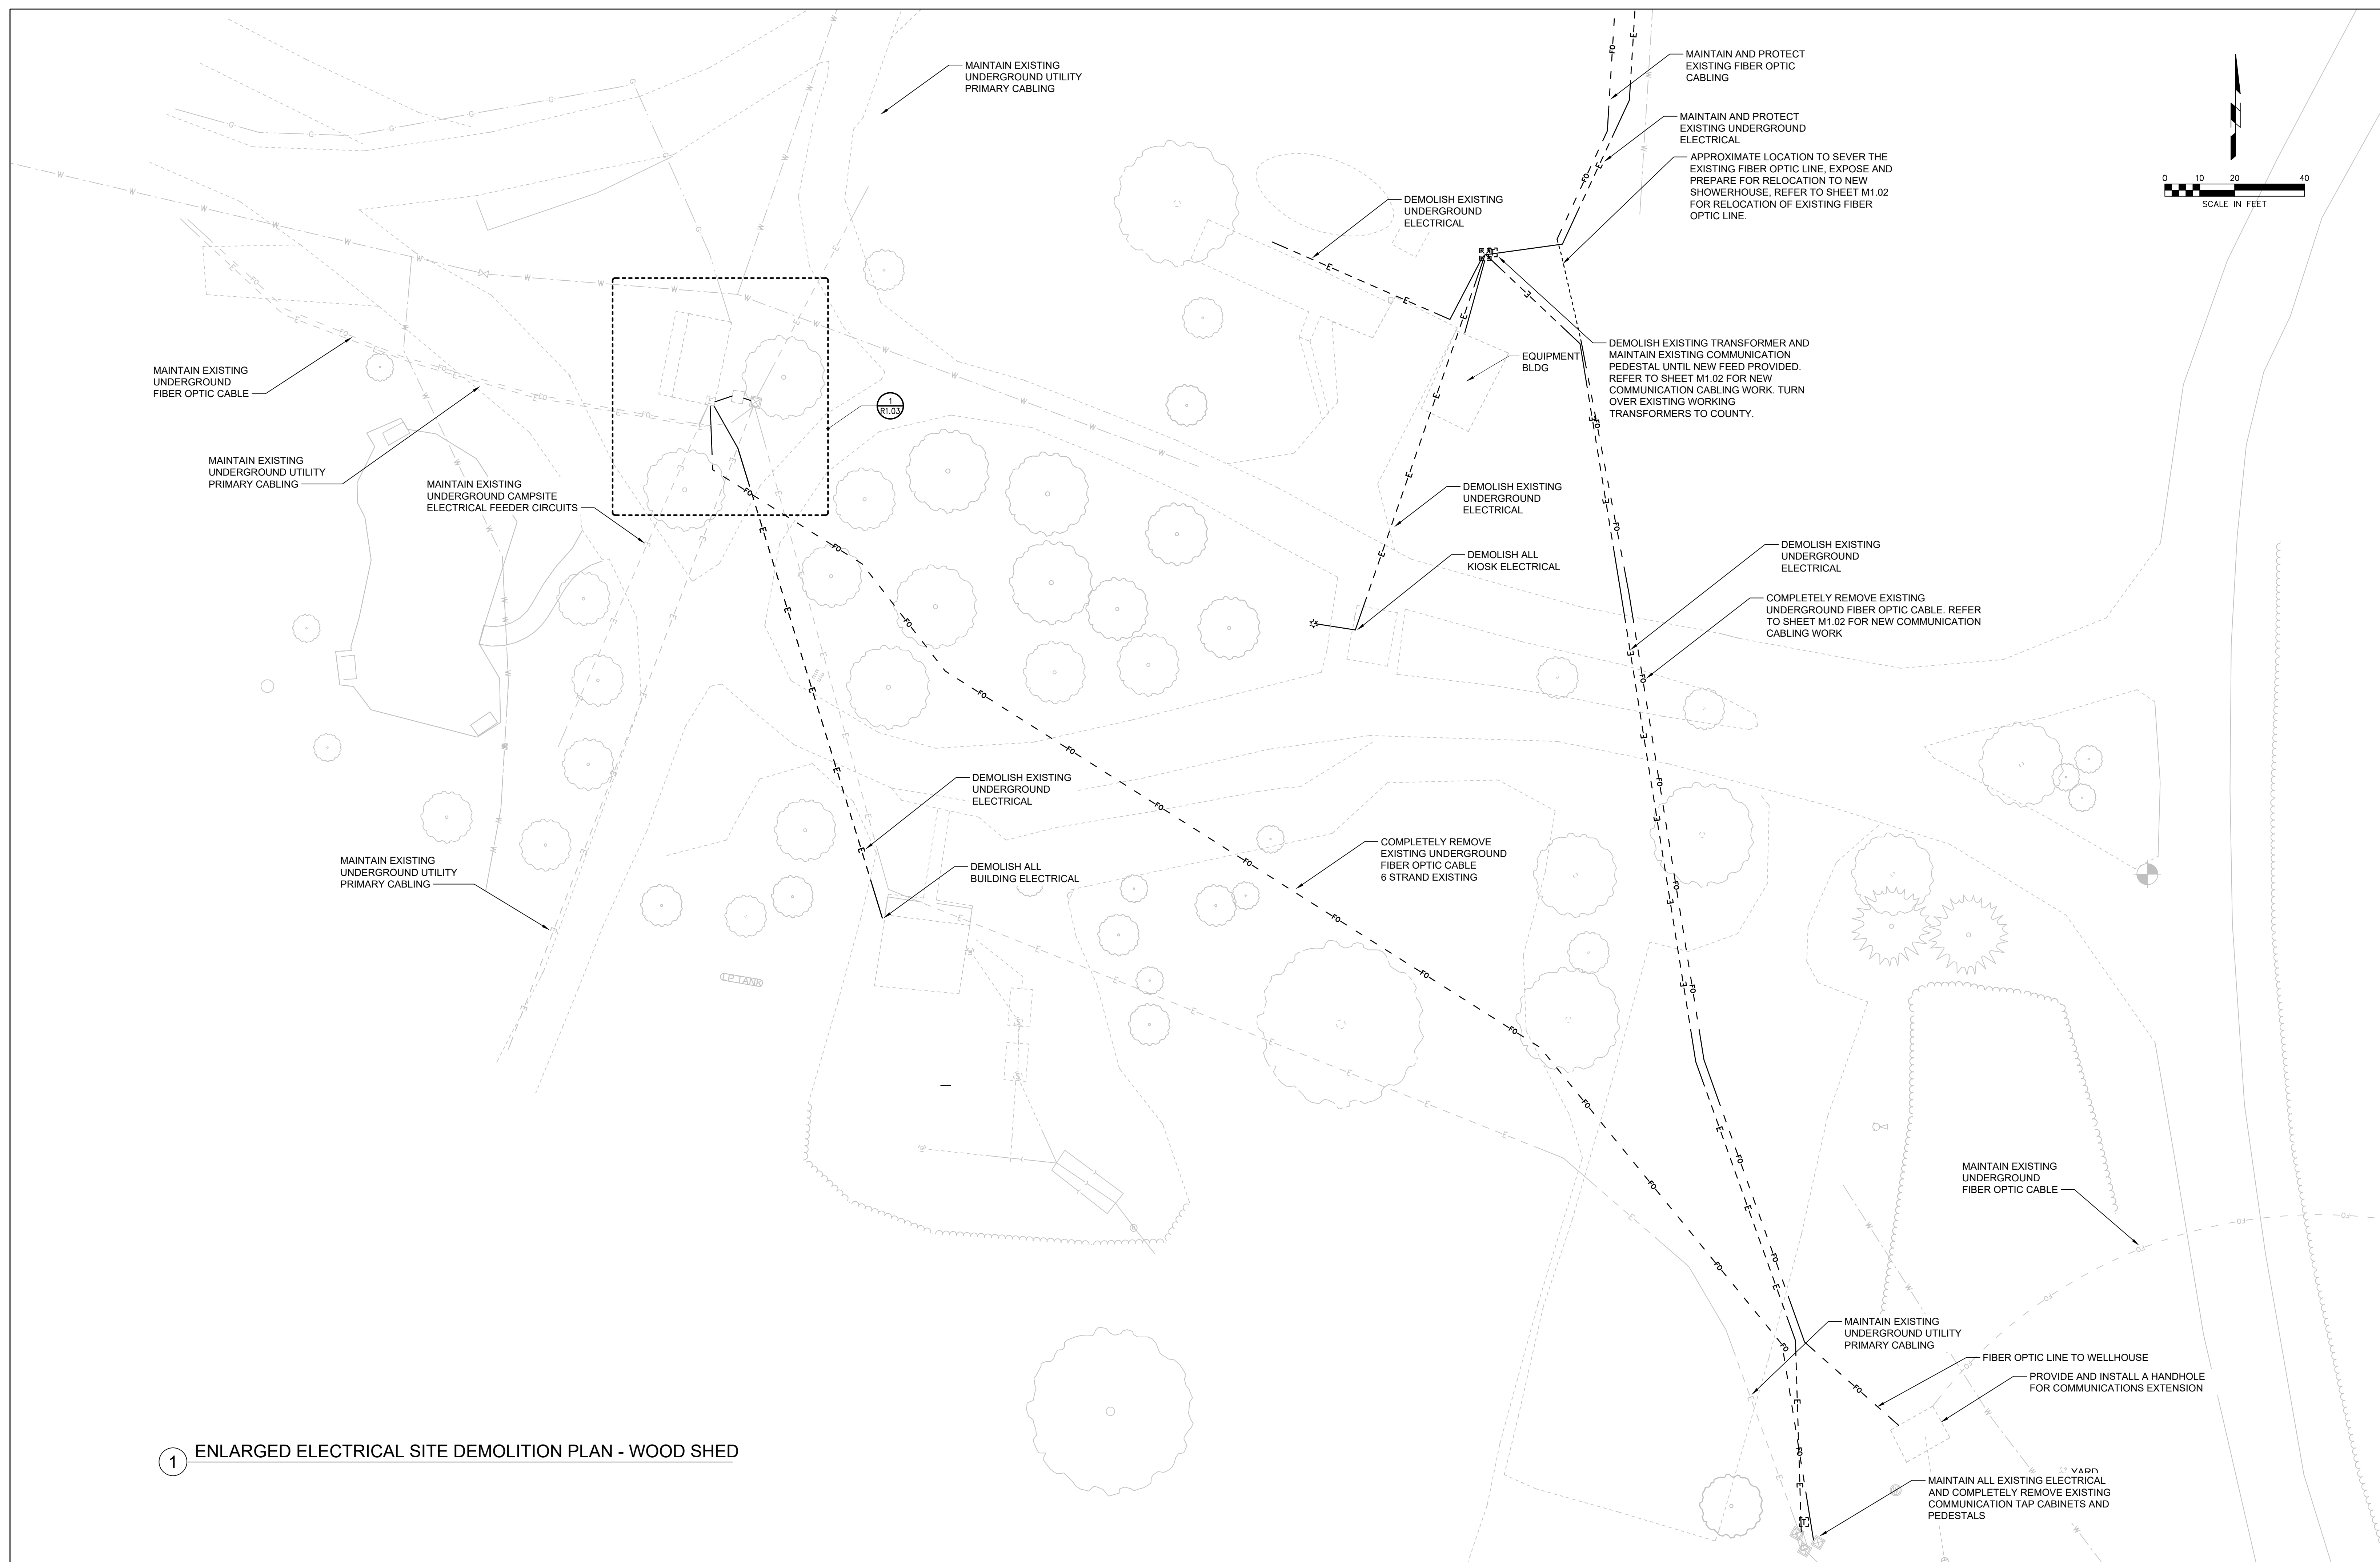

1 ENLARGED ELECTRICAL SITE DEMOLITION PLAN - WOOD SHED

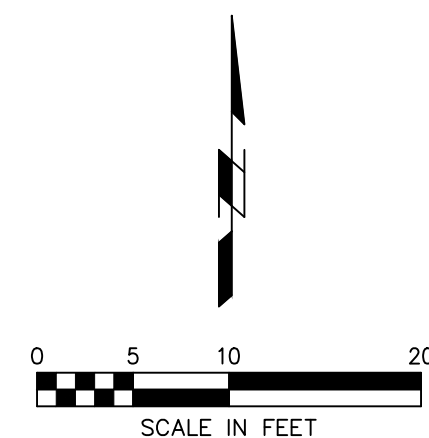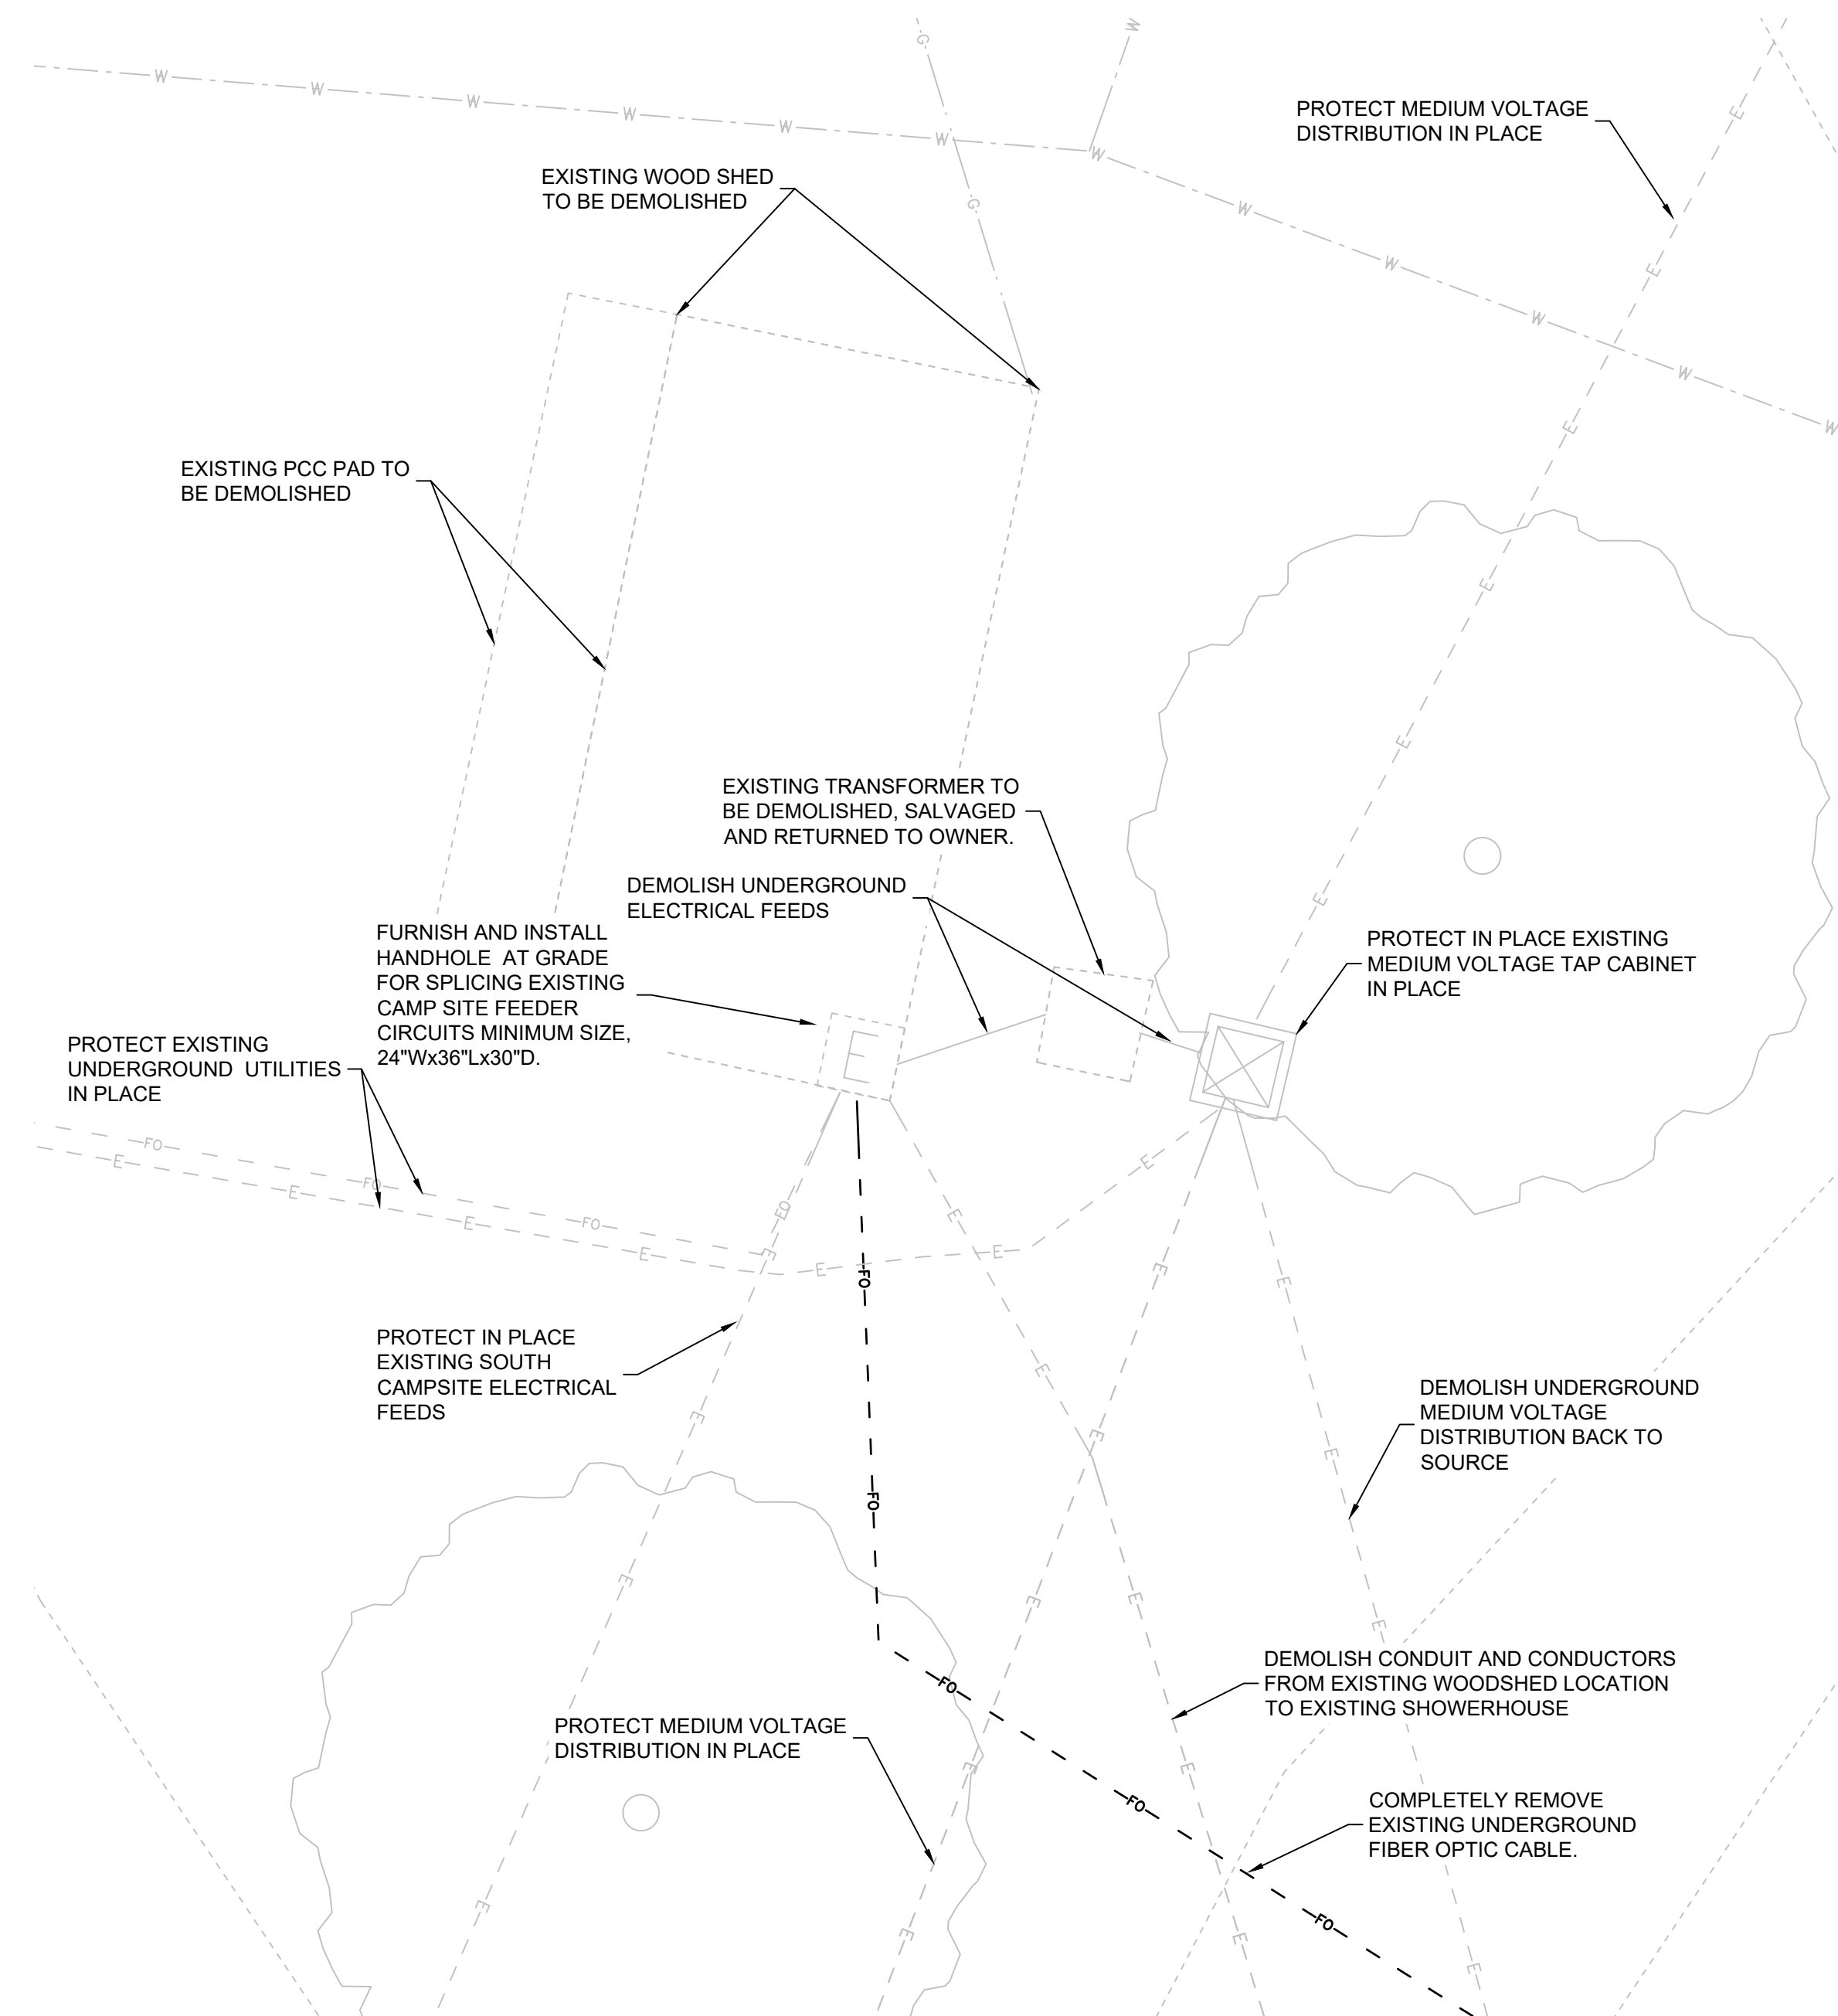

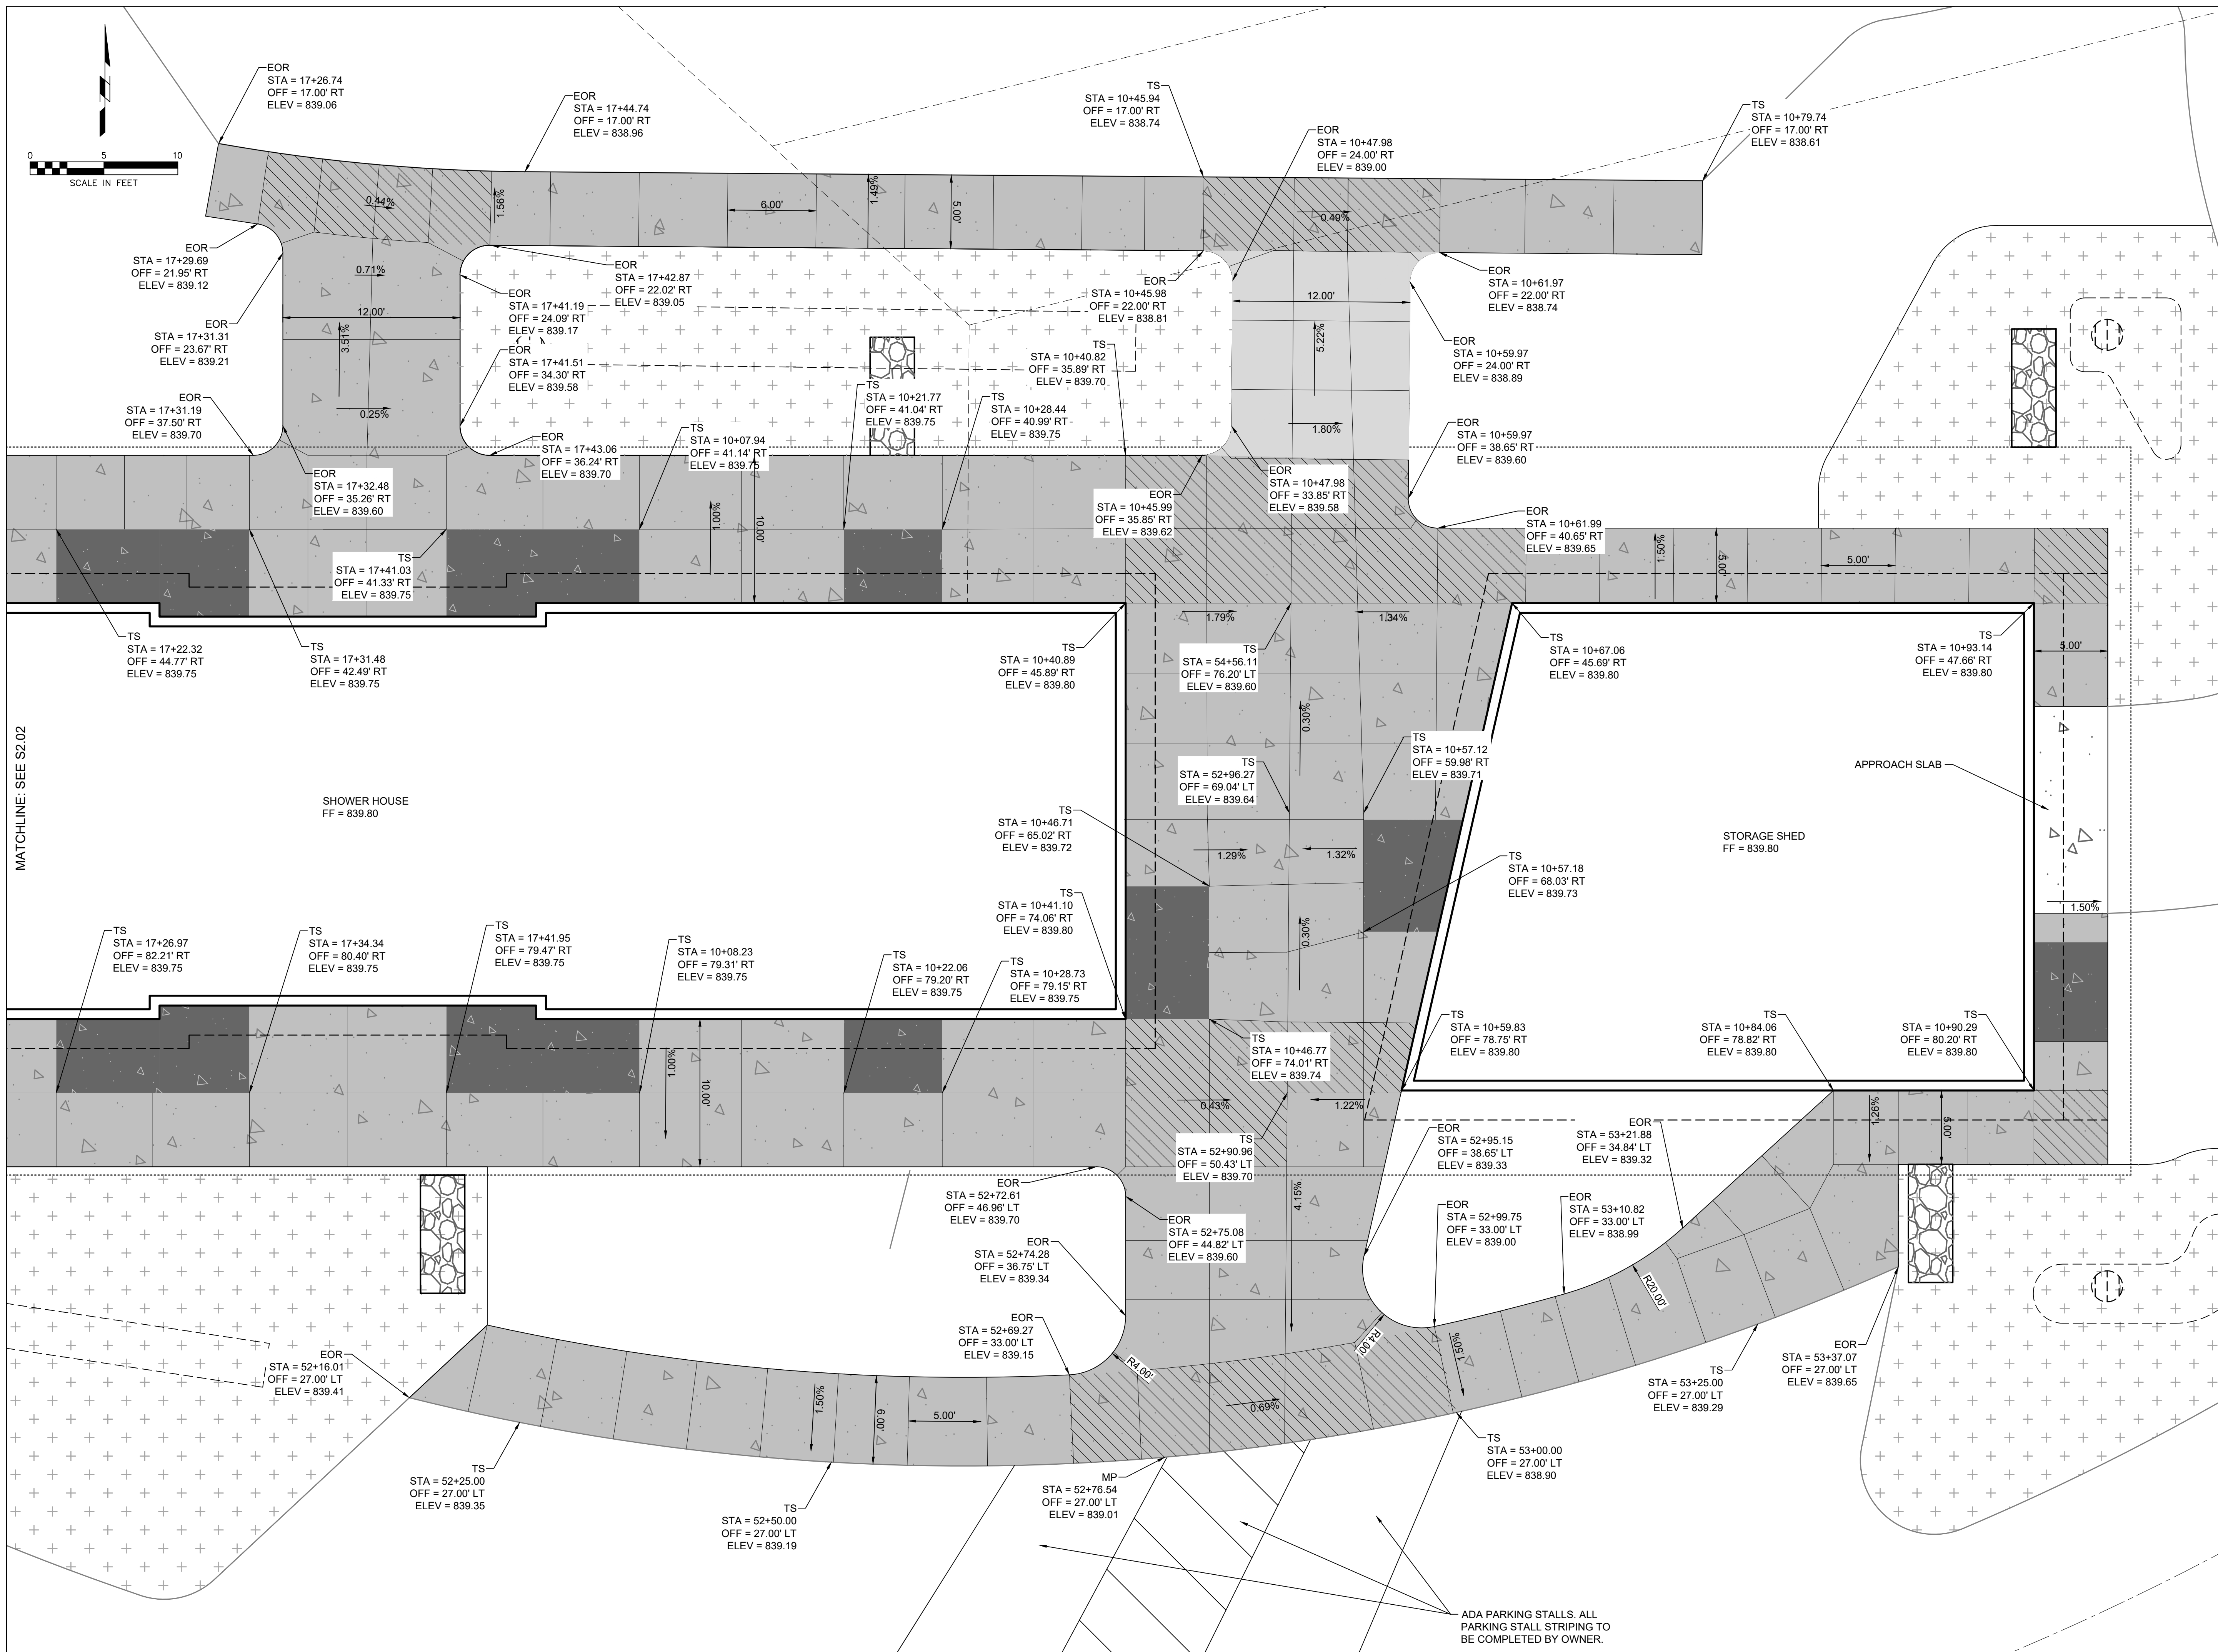

MATCHLINE: SEE S2.02

SHOWER HOUSE
FF = 839.80



STORAGE SHED
FF = 839.80

APPROACH SLAB

ADA PARKING STALLS. ALL
PARKING STALL STRIPING TO
BE COMPLETED BY OWNER.

LEGEND	
EOR	= END OF RADIUS
MP	= MIDPOINT
TS	= TOP OF SIDEWALK

- LEGEND**
- SIDEWALK (5.0% max long. slope / 2.0% max cross slope)
 - PEDESTRIAN RAMP (8.3% max long. slope / 2.0% max cross slope)
 - LANDING (2.0% max slope)
 - STRUCTURAL STOOP (SEE STRUCTURAL DETAILS)
- NOTE:**
- ALL SIDEWALK RADI ARE 2.00' UNLESS OTHERWISE SPECIFIED
 - JOINT SPACING SHOWN IS TYPICAL SPACING
 - ALL JOINTS SHALL BE C JOINTS EXCEPT THOSE ON STOOP PERIMETER.
 - STOOP JOINTS SHALL BE 3" EXPANSION JOINTS. SEE U-SHEETS FOR DETAILS.

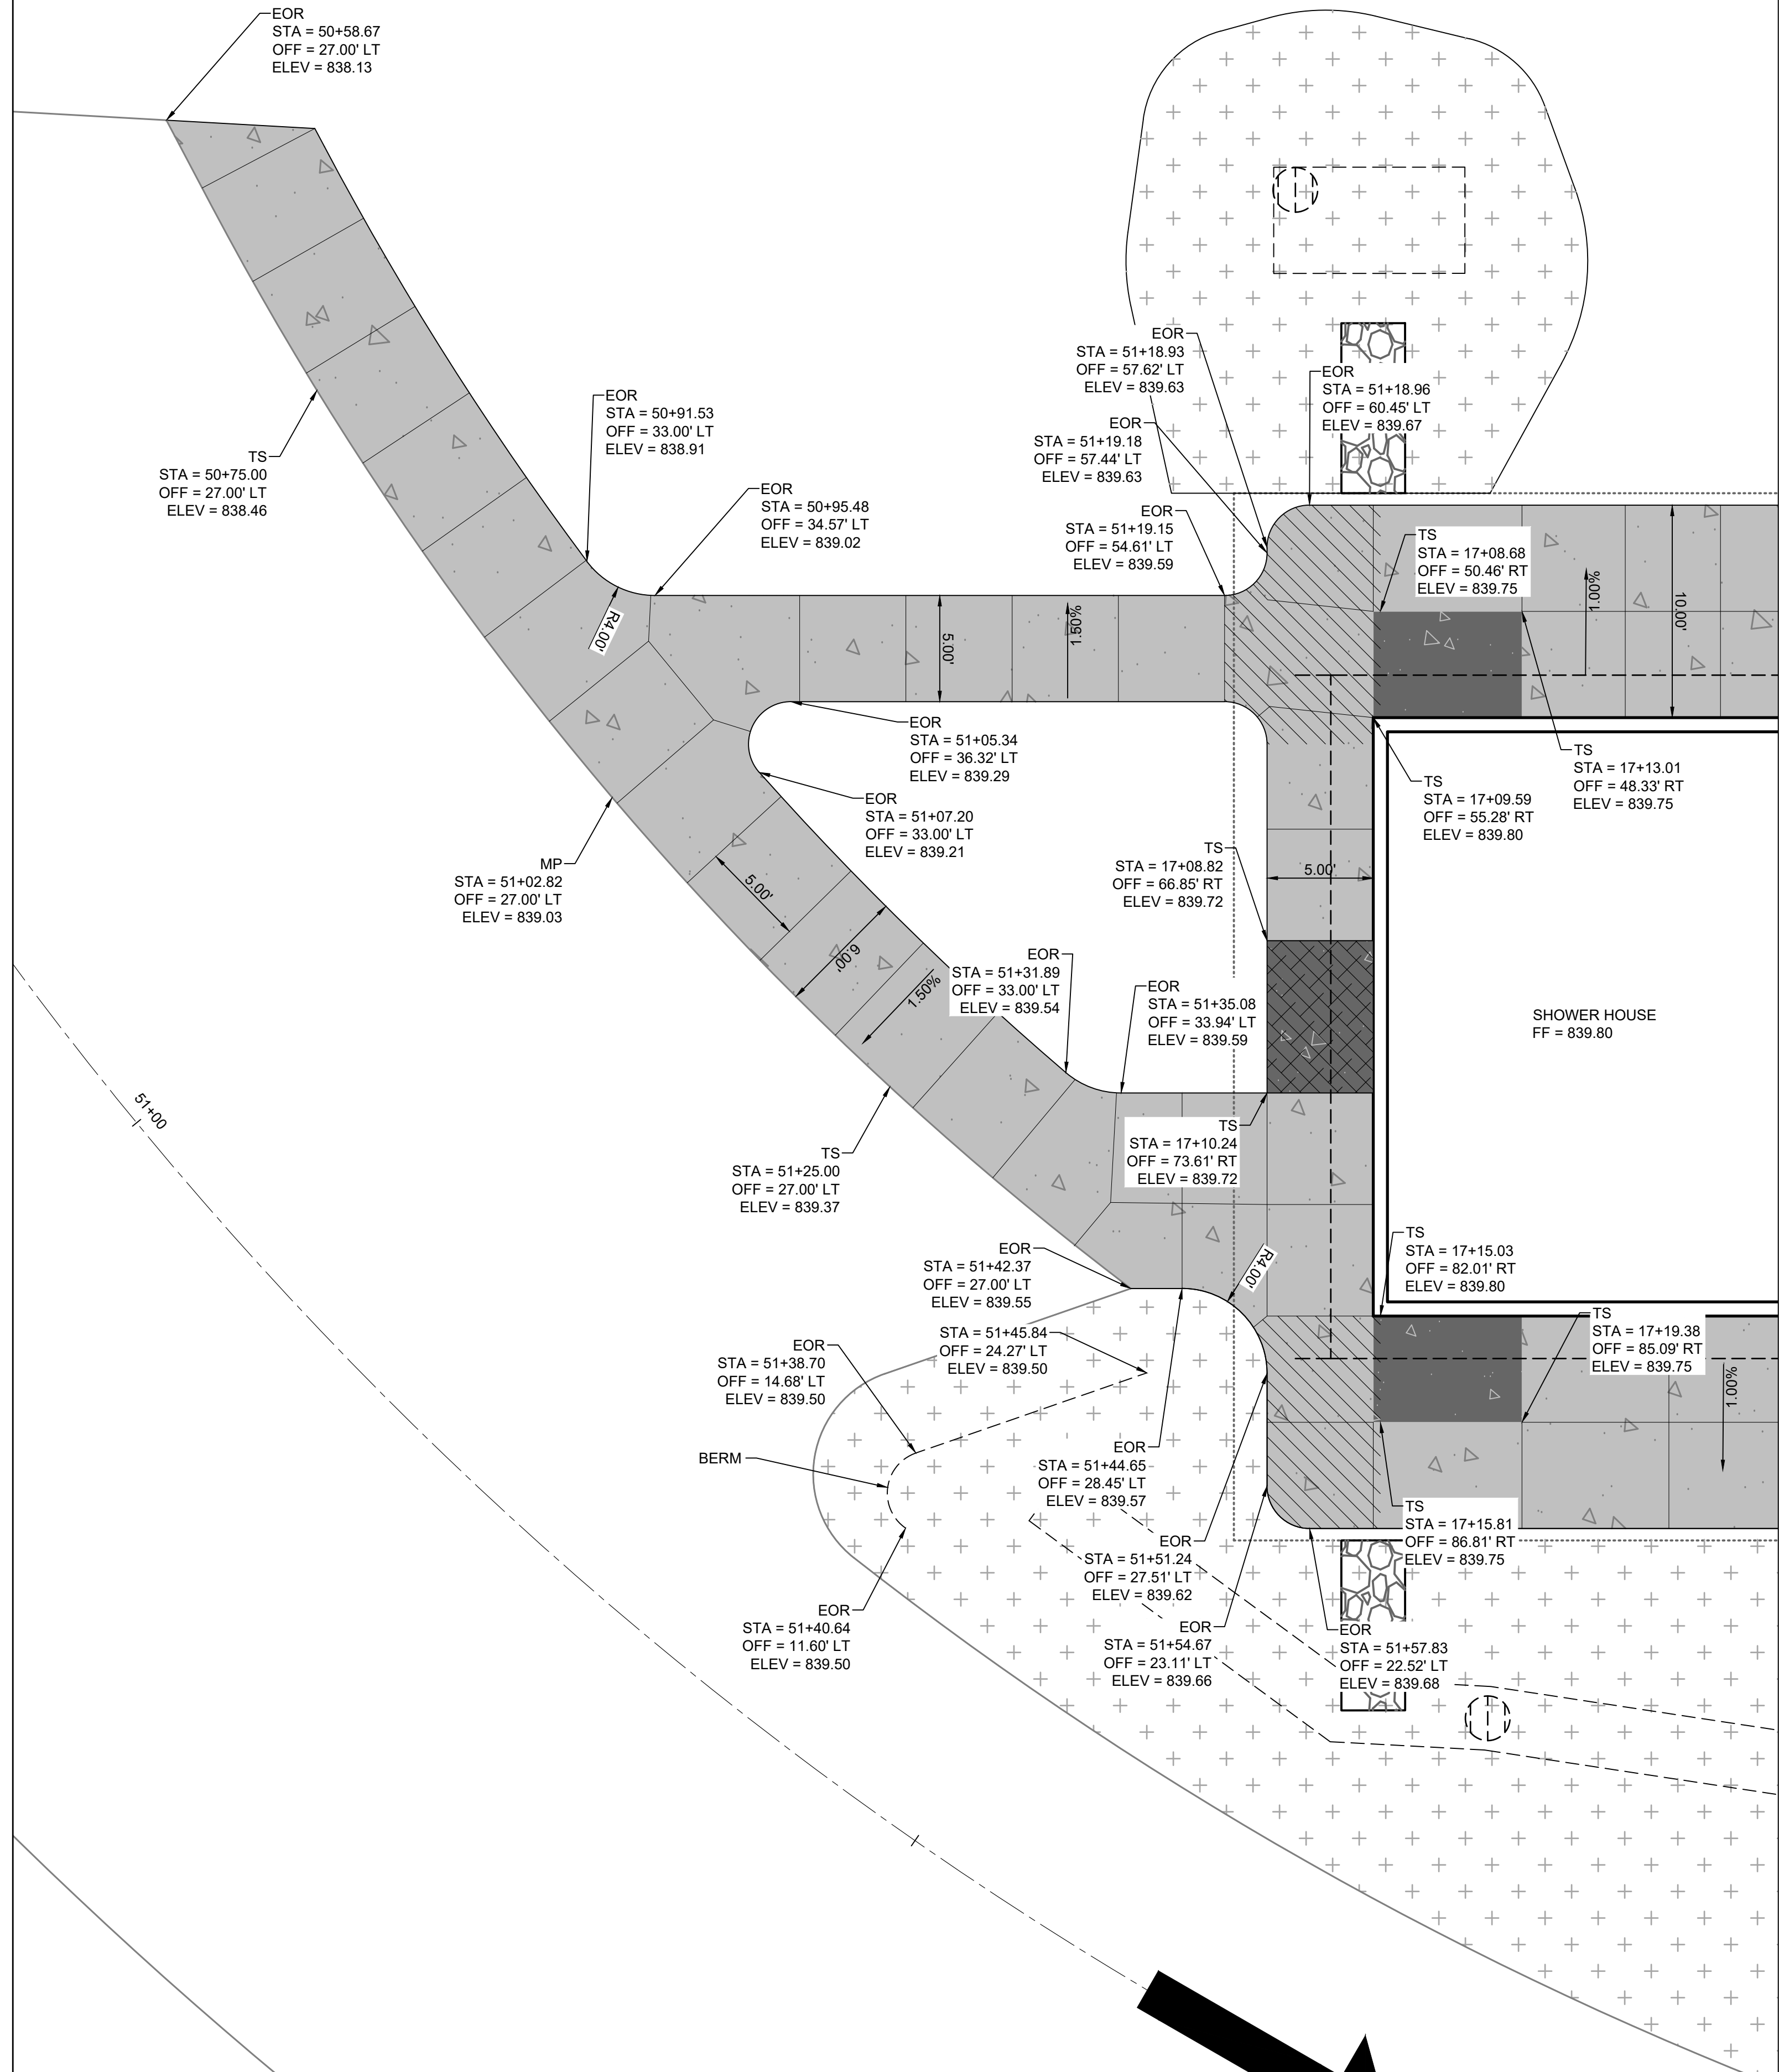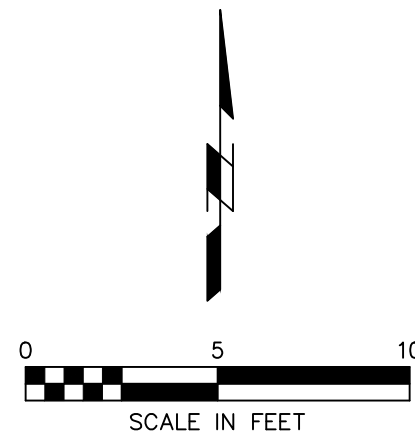


MATCHLINE: SEE S2.01


LEGEND	
EOR	= END OF RADIUS
MP	= MIDPOINT
TS	= TOP OF SIDEWALK

LEGEND	
	SIDEWALK (5.0% max long. slope) (2.0% max cross slope)
	PEDESTRIAN RAMP (8.3% max long. slope) (2.0% max cross slope)
	LANDING (2.0% max slope)
	STRUCTURAL STOOP (SEE STRUCTURAL DETAILS)

- NOTE:
1. ALL SIDEWALK RADII ARE 2.00' UNLESS OTHERWISE SPECIFIED
 2. JOINT SPACING SHOWN IS TYPICAL SPACING
 3. ALL JOINTS SHALL BE C JOINTS EXCEPT THOSE ON STOOP PERIMETER
 4. STOOP JOINTS SHALL BE $\frac{3}{4}$ " EXPANSION JOINTS. SEE U-SHEETS FOR DETAILS.

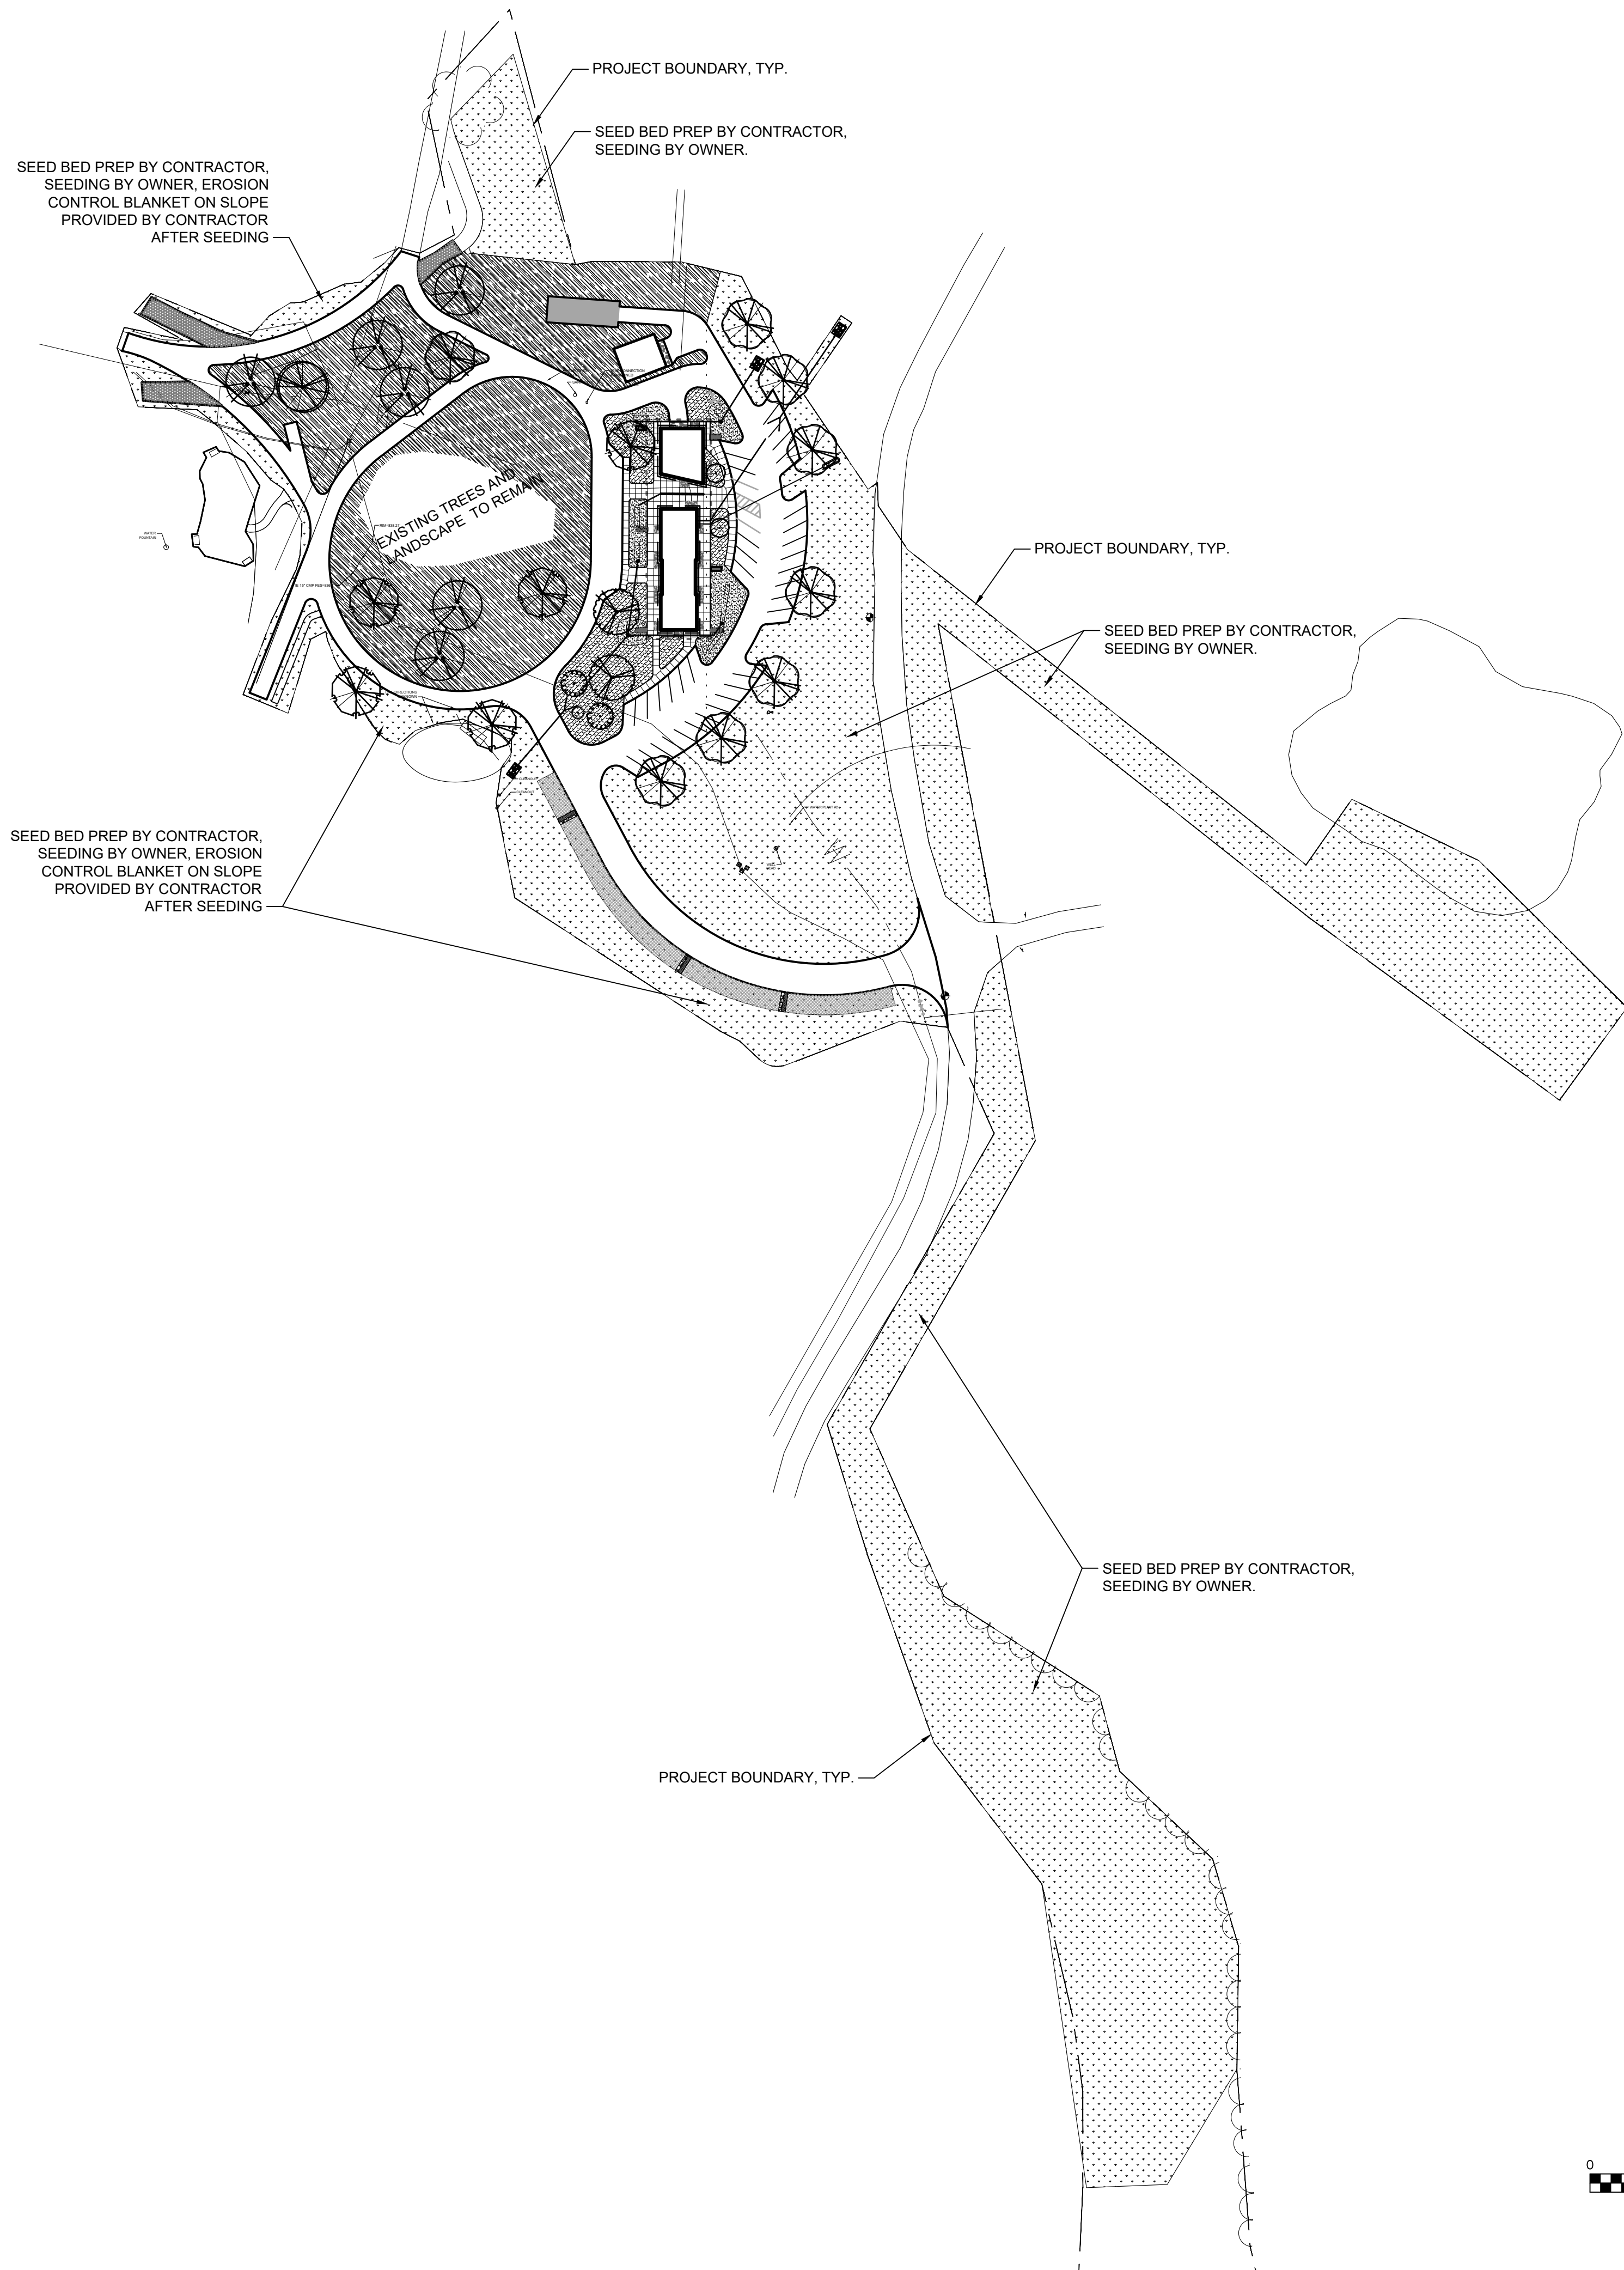


NATIVE GRASSES - OWNER PROVIDED AND SEEDED

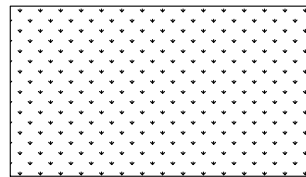


GRASSES
30% VIRGINIA WILD RYE
30% SILKY WILD RYE
20% SIDE OATS GRAMMA
10% LITTLE BLUESTEM
10% ROUGH DROPSEED


ATHLETIC TURF MIX -
OWNER APPROVAL REQUIRED
CONTRACTOR PROVIDED

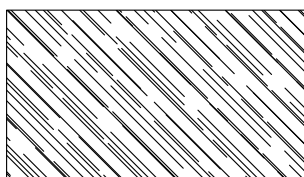

BIO-SWALE




SOD
CONTRACTOR PROVIDED



HIGH TRAFFIC AREAS SUN OR SHADE LAWN MIX
1. 40% BOREAL CREEPING RED FESCUE
2. 30% PIROUETTE II PERENNIAL RYEGRASS
3. 20% BRIDGEPORT CHEWINGS FESCUE
4. 10% BARRISTER KENTUCKY BLUEGRASS

BIO-CELL

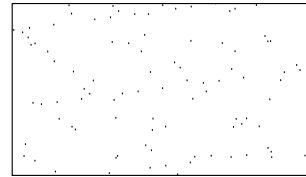



Butterfly Milkweed
Cardinal Flower
Whorled Milkweed
New England Aster
White Indigo
Pale Purple Coneflower
Culvers Root
Great Blue Lobelia
Prairie Blazingstar
Narrowleaf Mountain Mint
Sweet Black-eyed Susan
Blue Vervain
Sideoats Gramma
Columbine (native ecotype)

CONTRACTOR PROVIDED
1,934 PLANTS TOTAL. EVEN DISTRIBUTION OF SPECIES, NO SUBSTITUTIONS WITHOUT
PRIOR APPROVAL.
ALL NATIVE ECOTYPES, 1 PLANT FOR EVERY 2 SF.
SUBMIT SHOP DRAWINGS OF PLANTING PLAN - OWNER WILL PROVIDE INPUT
EVENLY INCREASE NUMBERS OF SPECIES PER EXPANDED BIOCELL SQUARE FOOTAGE.


PLANT SCHEDULE - CONTRACTOR PROVIDED AND PLANTED

TREES	QTY	BOTANICAL NAME	COMMON NAME	ROOT	SIZE	REMARKS
AME SAN	2	Amelanchier sanguinea	Roundleaf Serviceberry	B & B	2"Cal	Single leader Tree Form
CAR ILL	2	Carya illinoensis	Pecan	B & B	2.5"Cal	
CAR LAC	1	Carya laciniosa	Shellbark Hickory	B & B	2"Cal	
CER CAN	2	Cercis canadensis	Eastern Redbud	B & B	2"Cal	Single leader nursery matched
QUE ALB	8	Quercus alba	White Oak	B & B	2.5"Cal	
QUE BIC	6	Quercus bicolor	Swamp White Oak	B & B	2"Cal	
QUE RUB	5	Quercus rubra	Northern Red Oak	B & B	2"Cal	
SHRUBS	QTY	BOTANICAL NAME	COMMON NAME	ROOT	SIZE	REMARKS
VIB PRU	1	Viburnum prunifolium 'Blackhaw'	Blackhaw Viburnum	5 gal	24 - 30" Ht.	
GROUND COVERS	QTY	BOTANICAL NAME	COMMON NAME	SIZE	SPACING	
BIO X	1,649	Bio-Cell x x	Bio-Cell Mix	PLUGS	24" o.c.	
TUR BLU	3,490 sf	Turf Sod Bluegrass	Kentucky Bluegrass Sod	SF		
SOD/SEED	QTY	BOTANICAL NAME	COMMON NAME	SIZE	SPACING	
POA PRA	53,511 sf	Athletic Turf Mix	Athletic Turf Mix	SEED		
TALL GROUND COVERS	QTY	BOTANICAL NAME	COMMON NAME	SIZE	SPACING	
NAT GR	208,268 sf		Native Grasses	SEED		Owner provided/seeded

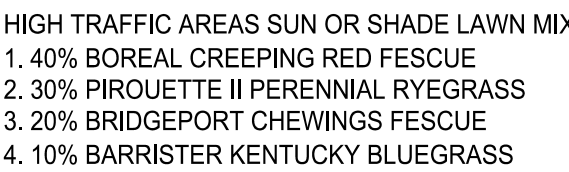


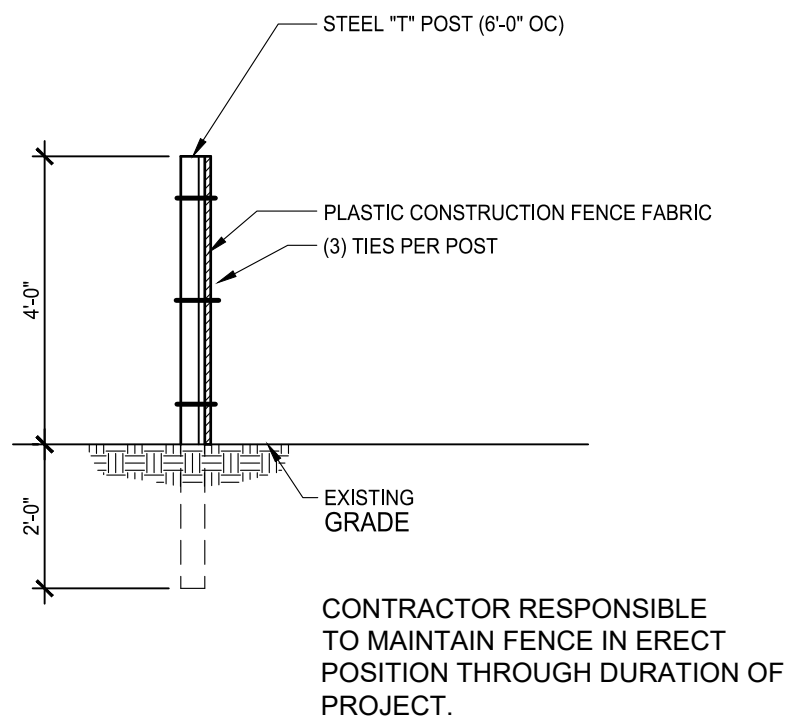

1 CONSTRUCTION FENCE DETAIL
NOT TO SCALE

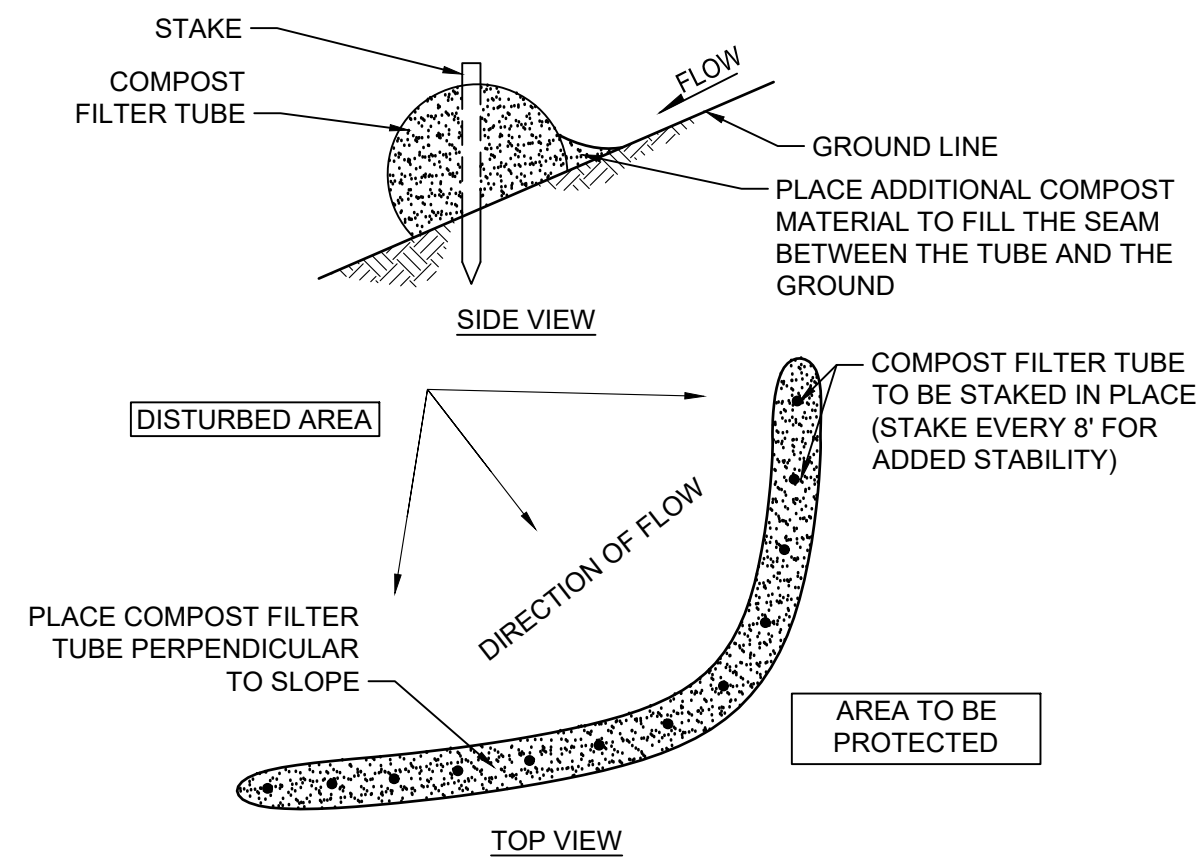


2 COMPOST FILTER SOCK DETAIL
NOT TO SCALE

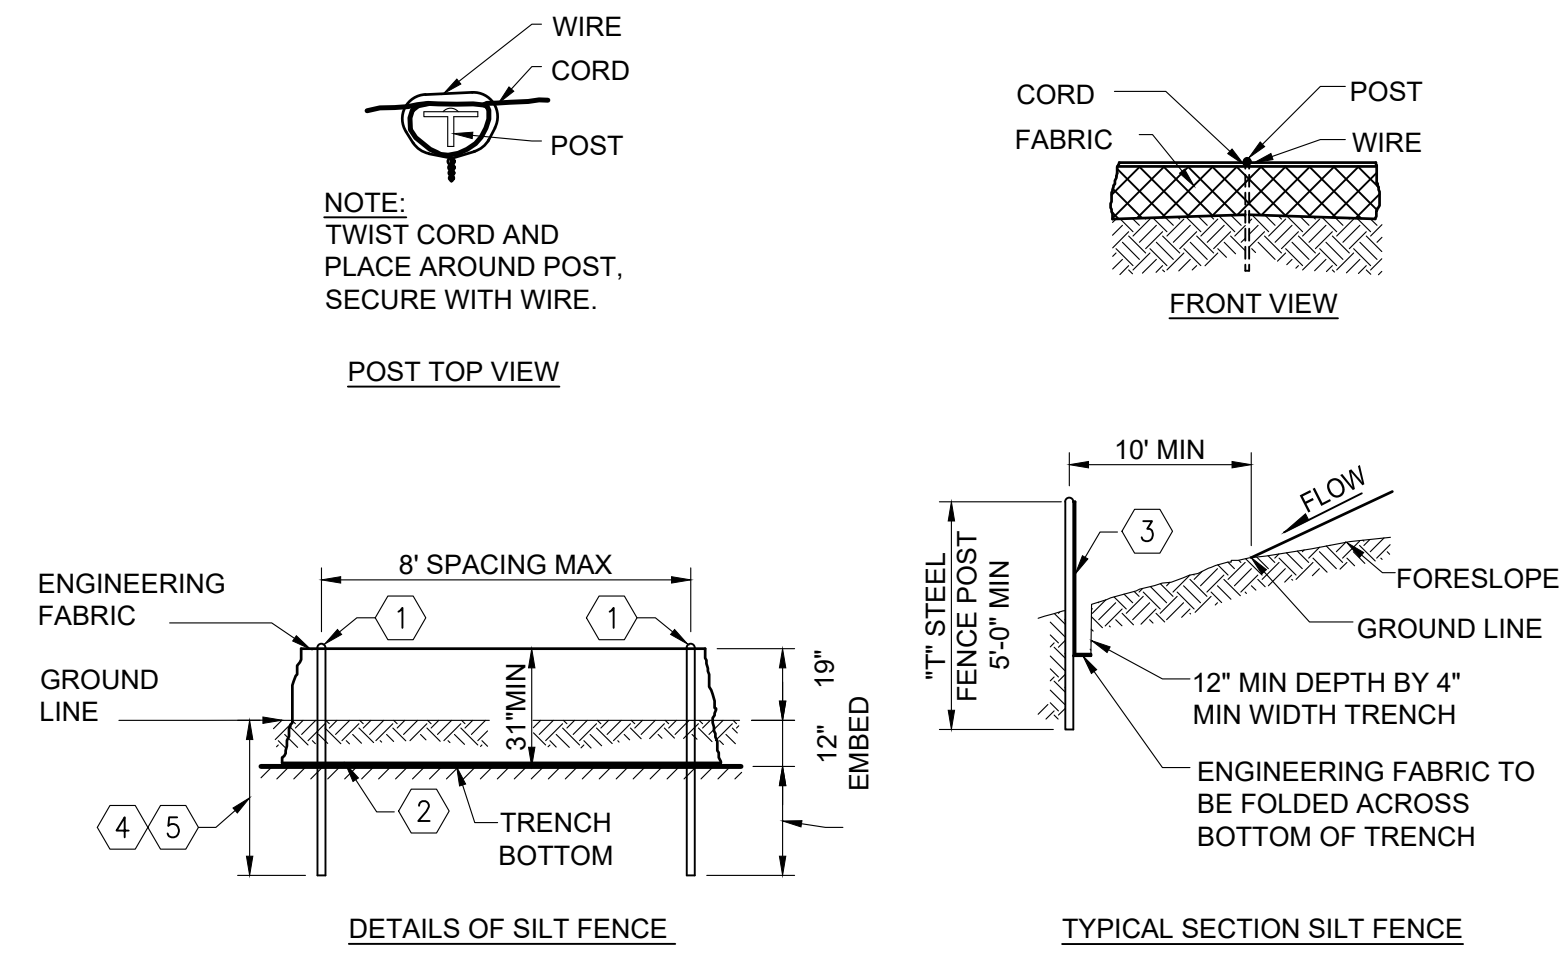


3 SILT FENCE DETAIL
NOT TO SCALE


- GENERAL NOTES:**
- 1 SECURE TOP OF ENGINEERING FABRIC TO STEEL POST.
 - 2 ENGINEERING FABRIC TO BE FOLDED ACROSS BOTTOM OF TRENCH.
 - 3 ENGINEERING FABRIC SHALL HAVE A MINIMUM 36" WIDTH.
 - 4 FOR MACHINE INSTALLATION, POSTS SHALL BE EMBEDDED 28" BELOW GROUND LINE. ALL COMPACTION SHALL BE ACCOMPLISHED BY DRIVING OVER EACH SIDE OF SILT FENCE 2-4 TIMES WITH DEVICE EXERTING 60PSI OR GREATER.
 - 5 FOR TRENCH INSTALLATION, POSTS SHALL BE EMBEDDED 28" BELOW THE TRENCH BOTTOM. ALL COMPACTION SHALL BE ACCOMPLISHED WITH A MECHANICAL OR PNEUMATIC TAMPER.

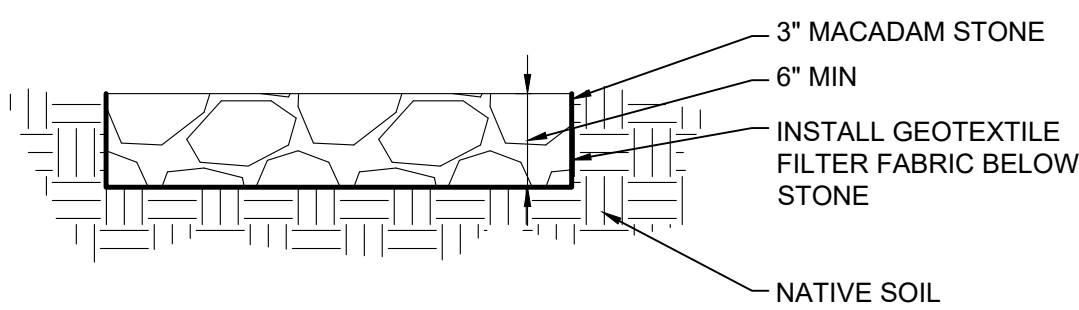


4 STABILIZED CONSTRUCTION ENTRANCE/ CONTRACTOR STAGING AND LAYDOWN AREA
NOT TO SCALE

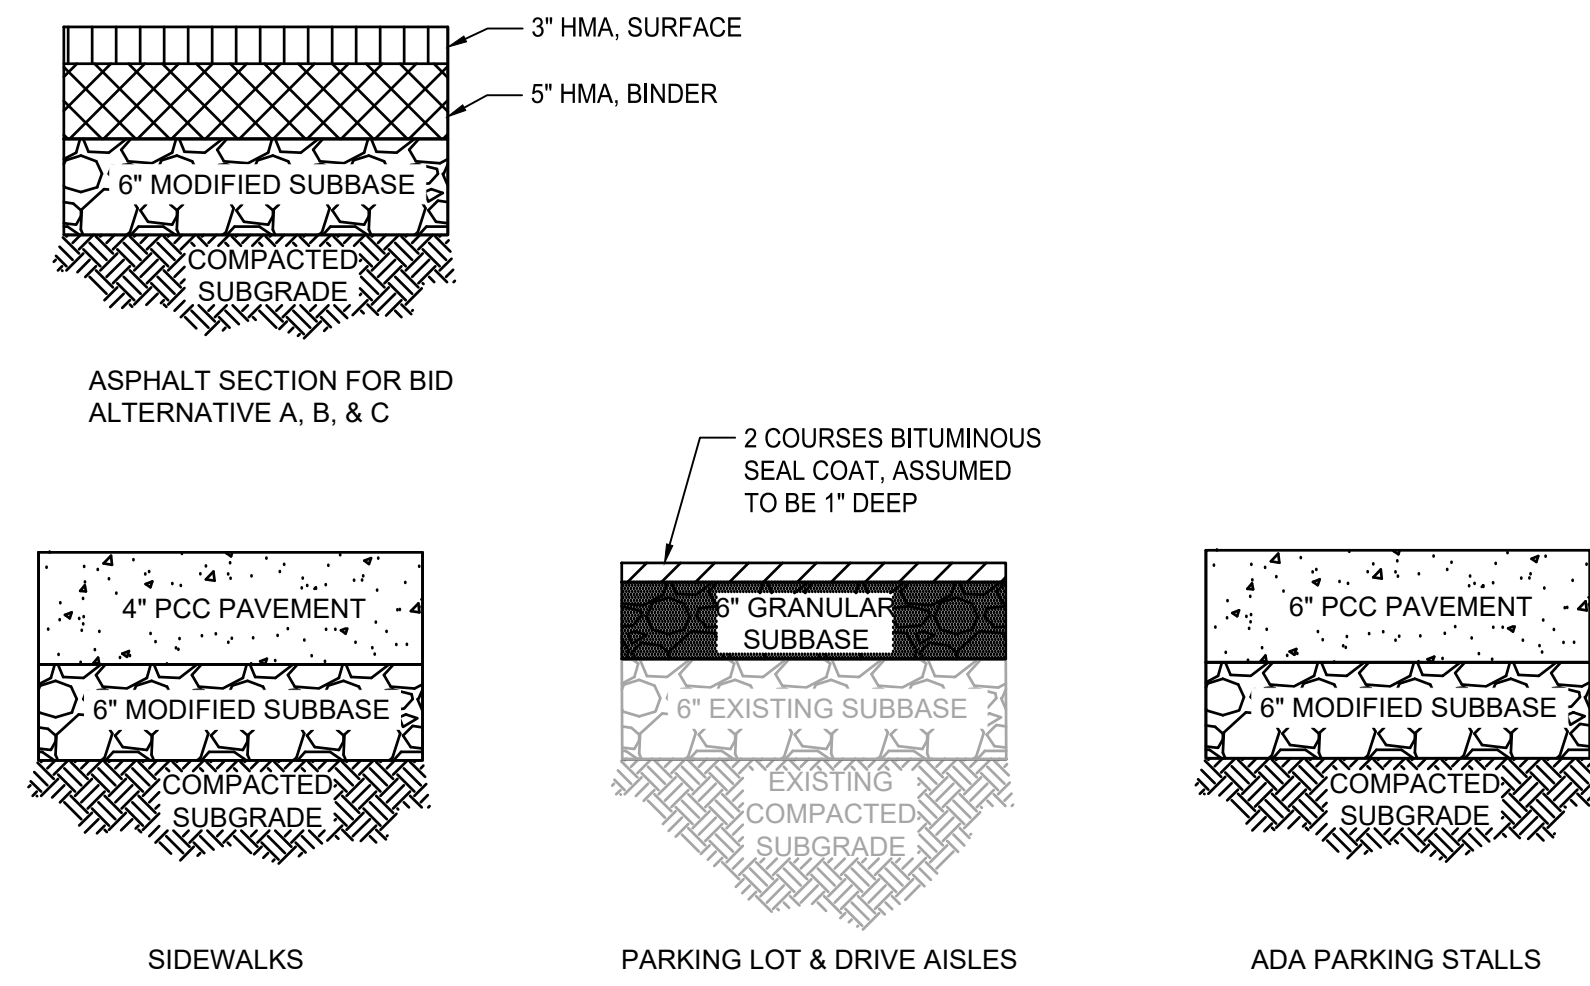

5 TYPICAL PAVEMENT SECTIONS
NO SCALE

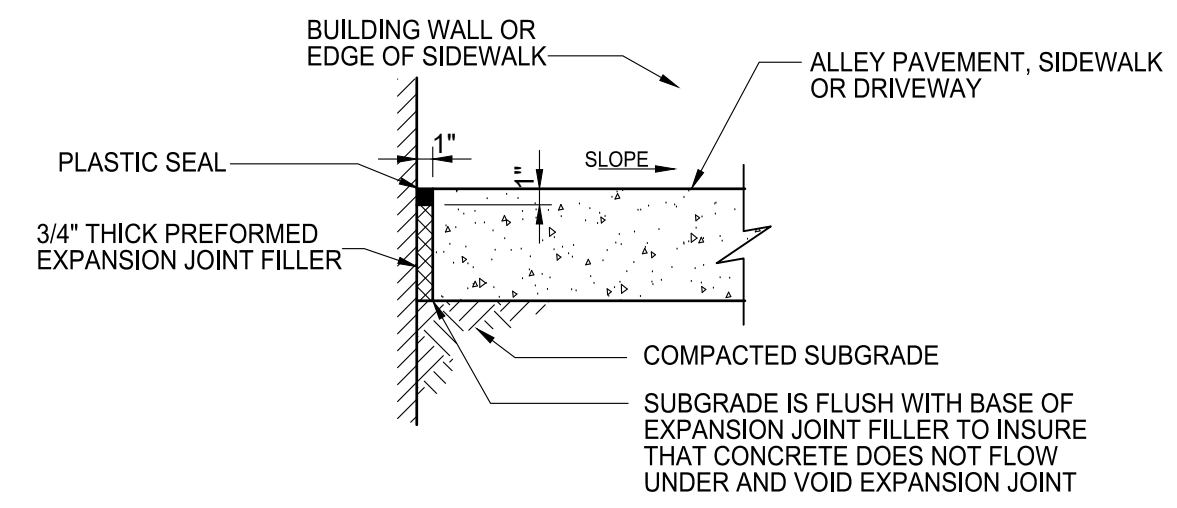


6 3/4" EXPANSION JOINT BETWEEN BUILDING AND PAVEMENT
NOT TO SCALE

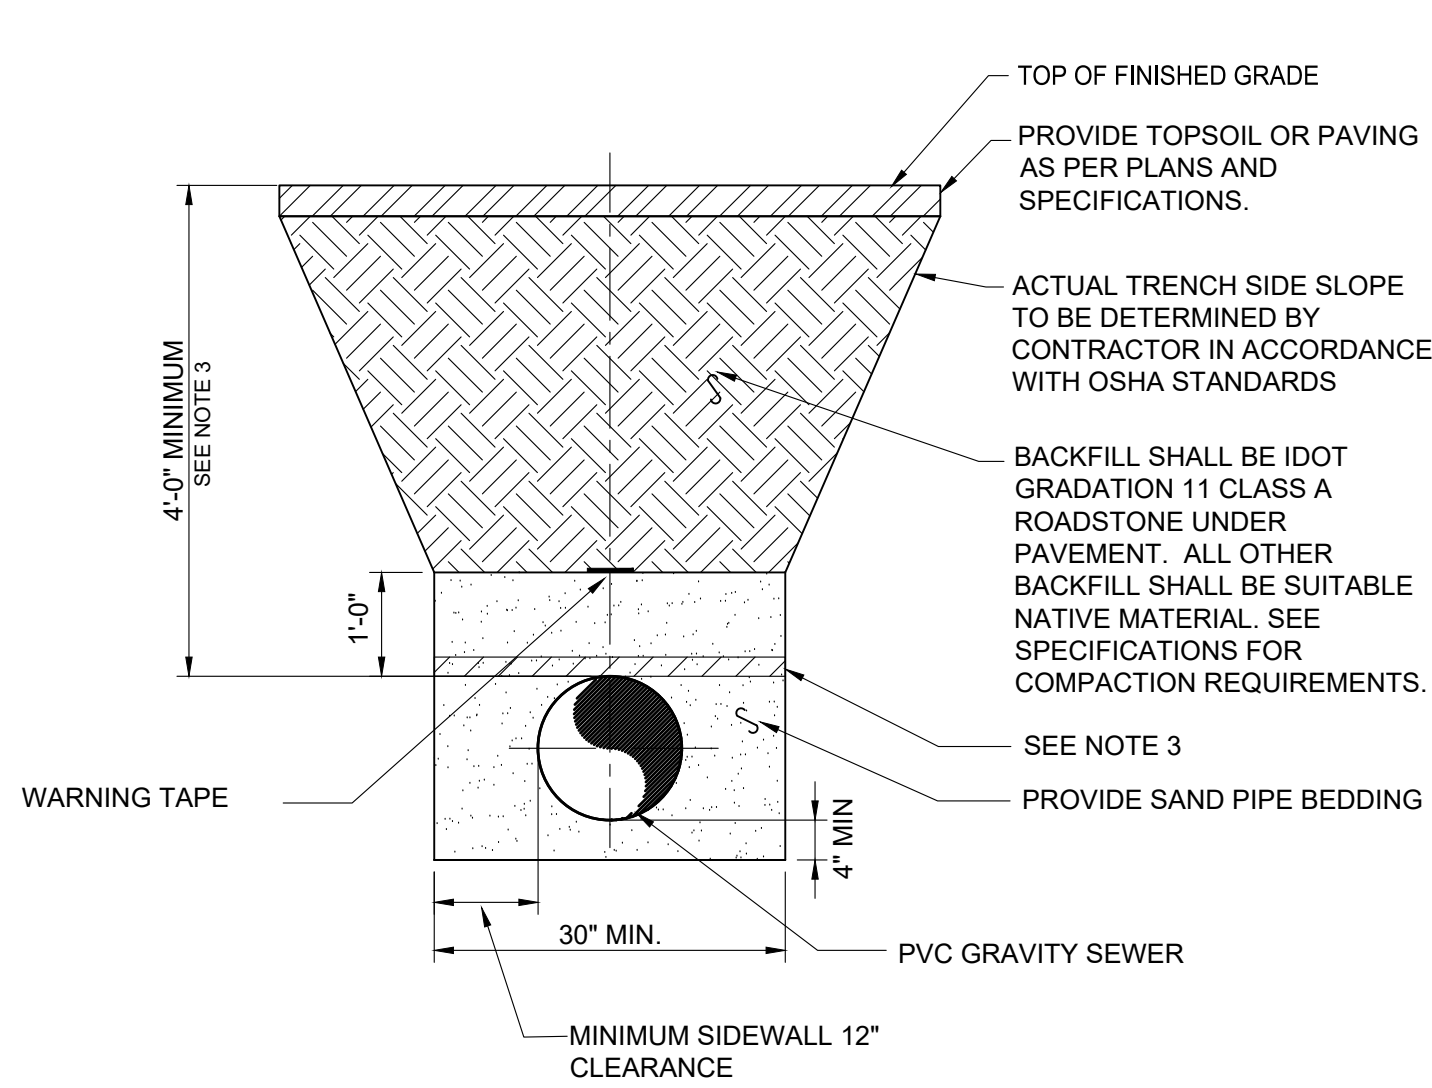


NOTE:

1. PIPING DIAMETER AS CALLED OUT ON PLANS. PIPING SHALL BE NORTH AMERICAN SPECIALTY PRODUCTS CERTA-FLO GREENLINE SDR 21 OR EQUAL.
2. GRAVITY SEWER MAINS SHALL BE SEPARATED FROM WATER MAINS BY A HORIZONTAL DISTANCE OF AT LEAST 10 FEET UNLESS:
 - 1) THE TOP OF A SEWER MAIN IS AT LEAST 18 INCHES BELOW THE BOTTOM OF THE WATER MAIN, AND,
 - 2) THE SEWER IS PLACED IN A SEPARATE TRENCH OR IN THE SAME TRENCH ON A BENCH OF UNDISTURBED EARTH AT A MINIMUM HORIZONTAL SEPARATION OF 3 FEET FROM THE WATER MAIN.
3. IF LESS THAN 48" OF COVER OVER PIPE, PLACE 2" THICK X 48" WIDE CENTERED OVER PIPE OF POLYSTYRENE.


1 TYPICAL GRAVITY SEWER PIPE EMBEDMENT AND INSTALLATION DETAIL
NOT TO SCALE

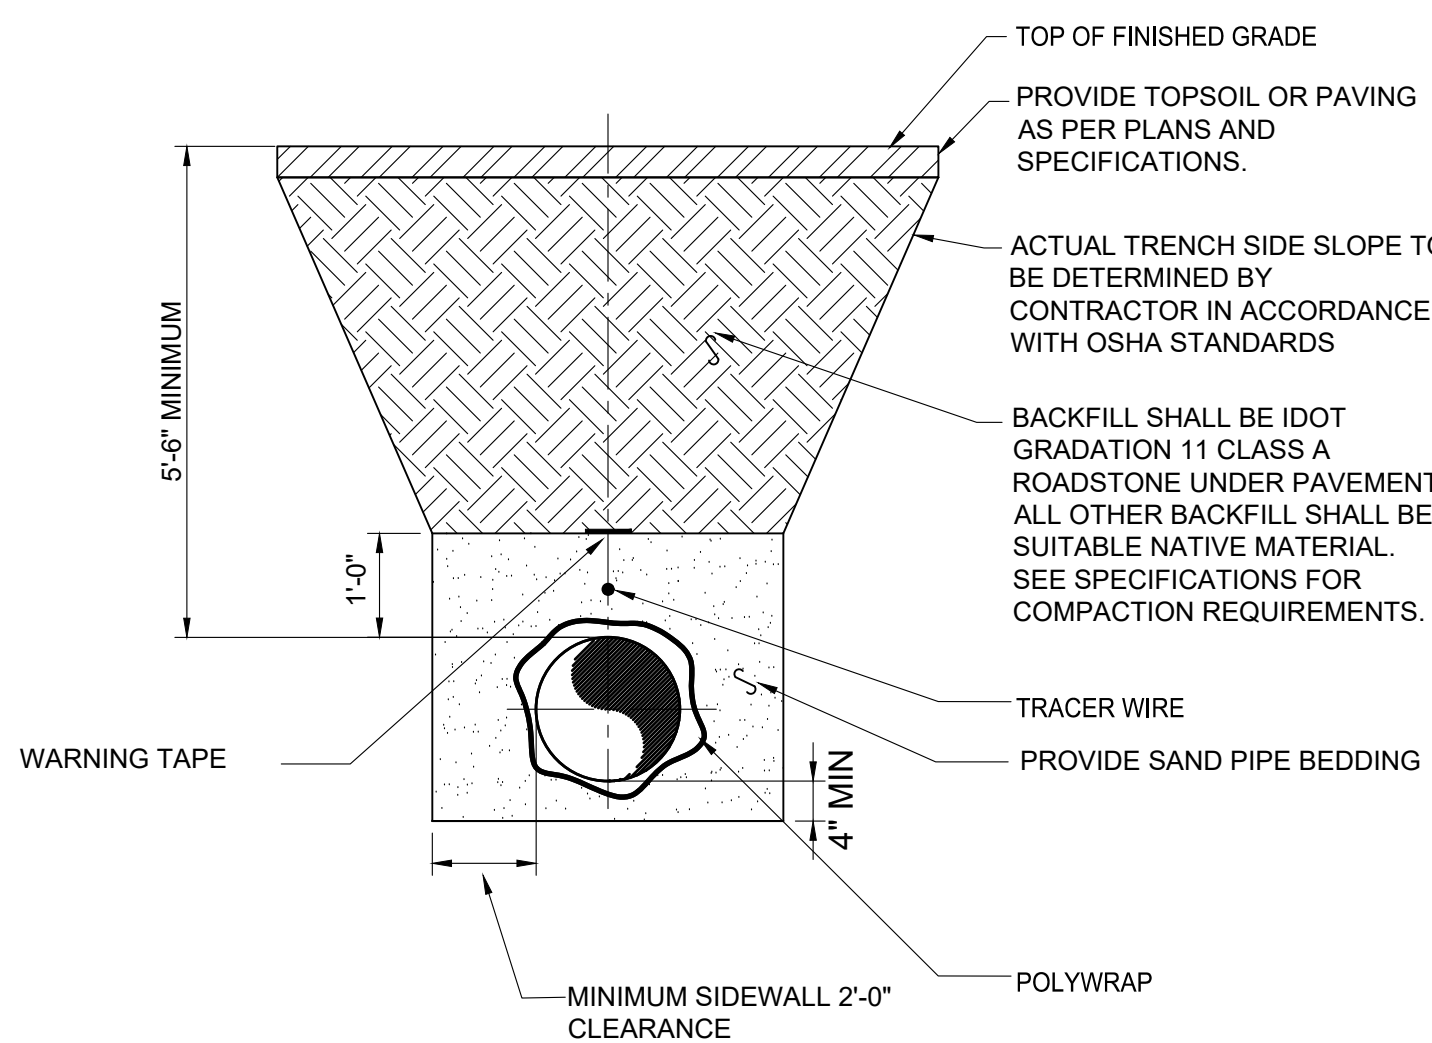


5 TYPICAL WATER PIPE EMBEDMENT AND INSTALLATION DETAIL
NOT TO SCALE

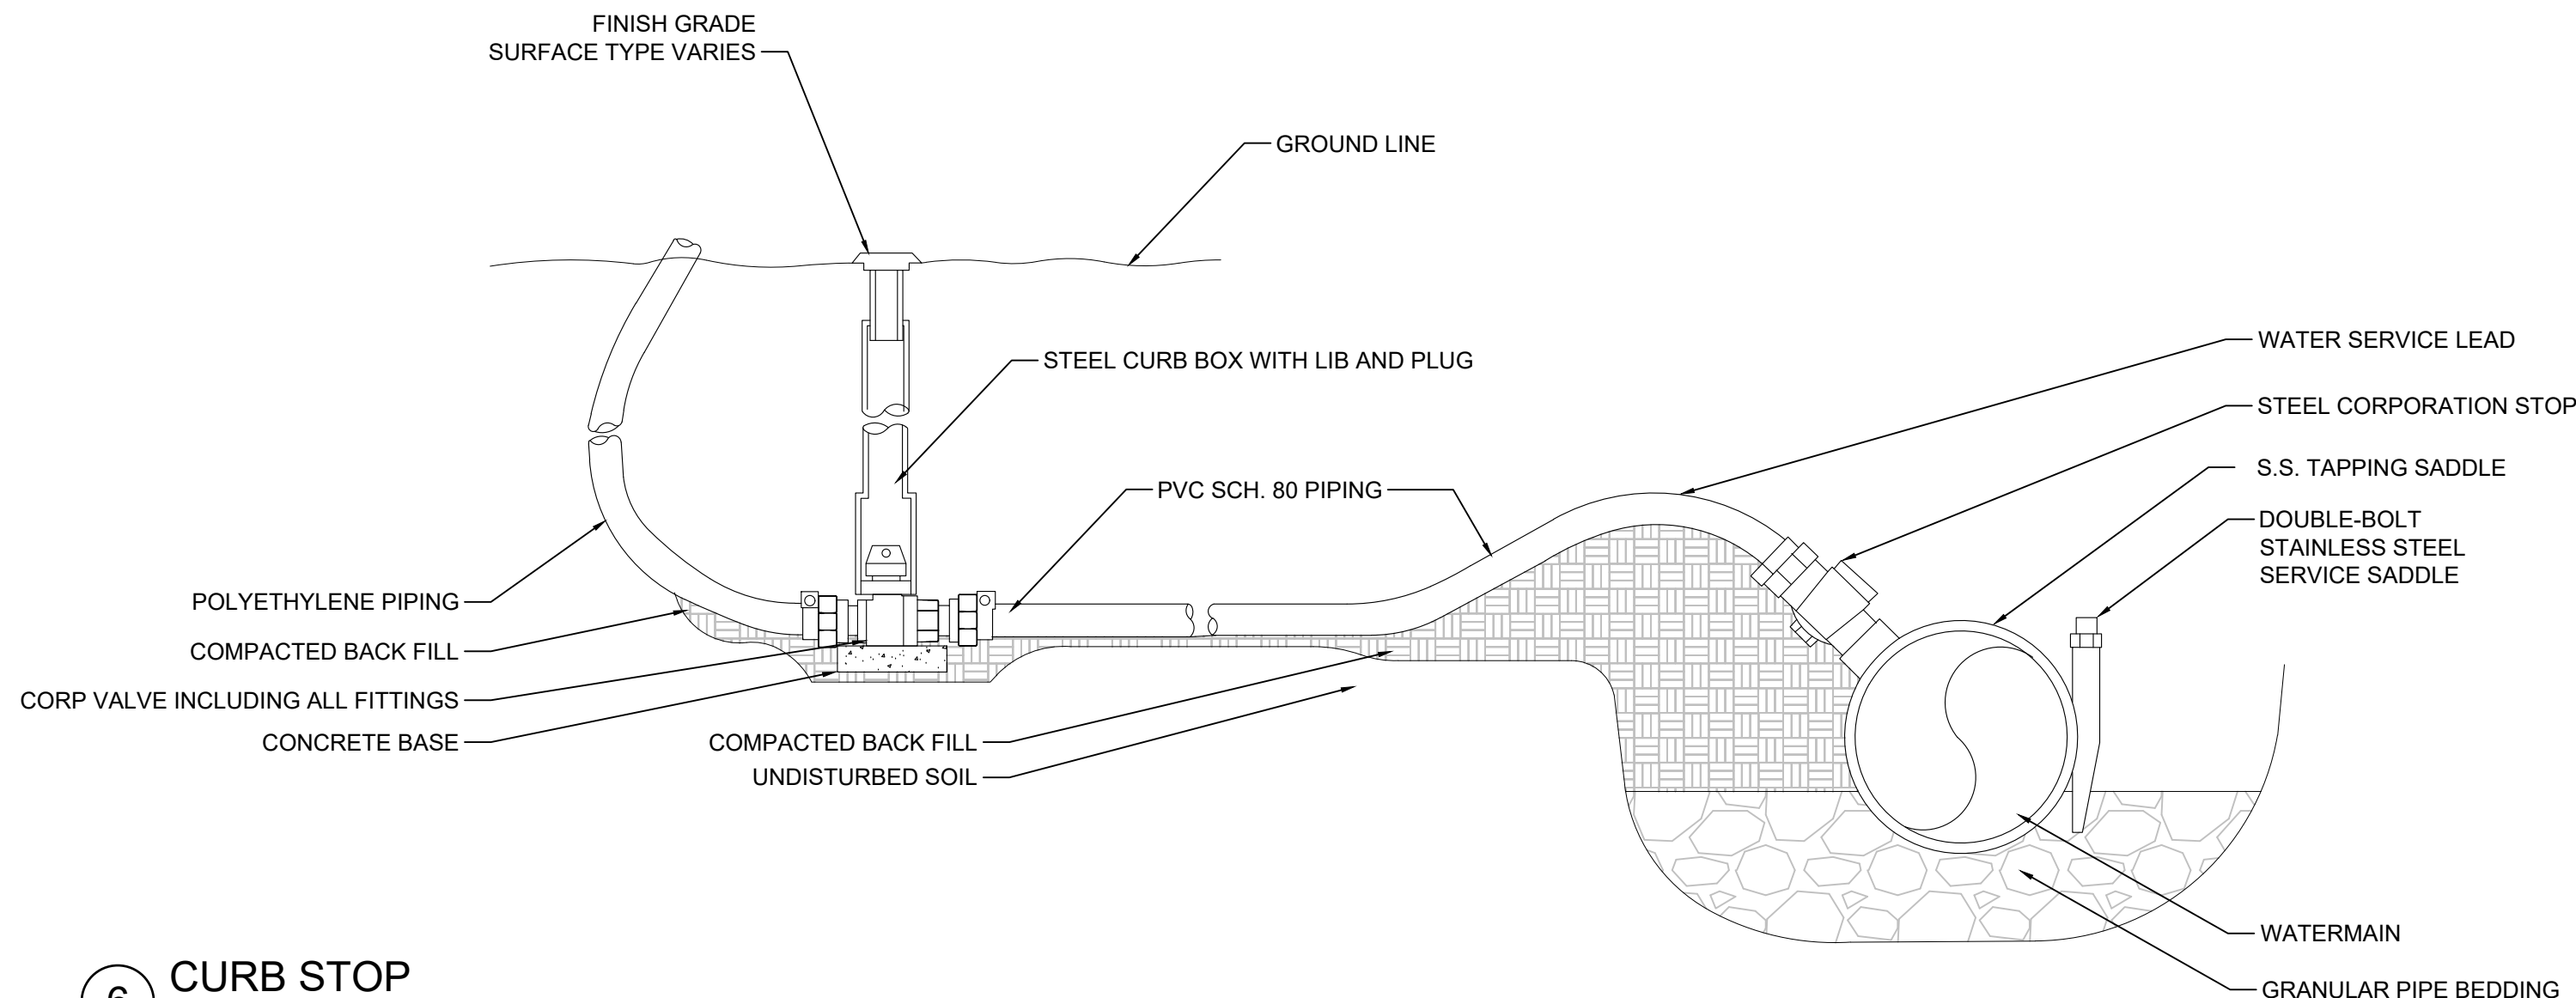



6 CURB STOP
NOT TO SCALE

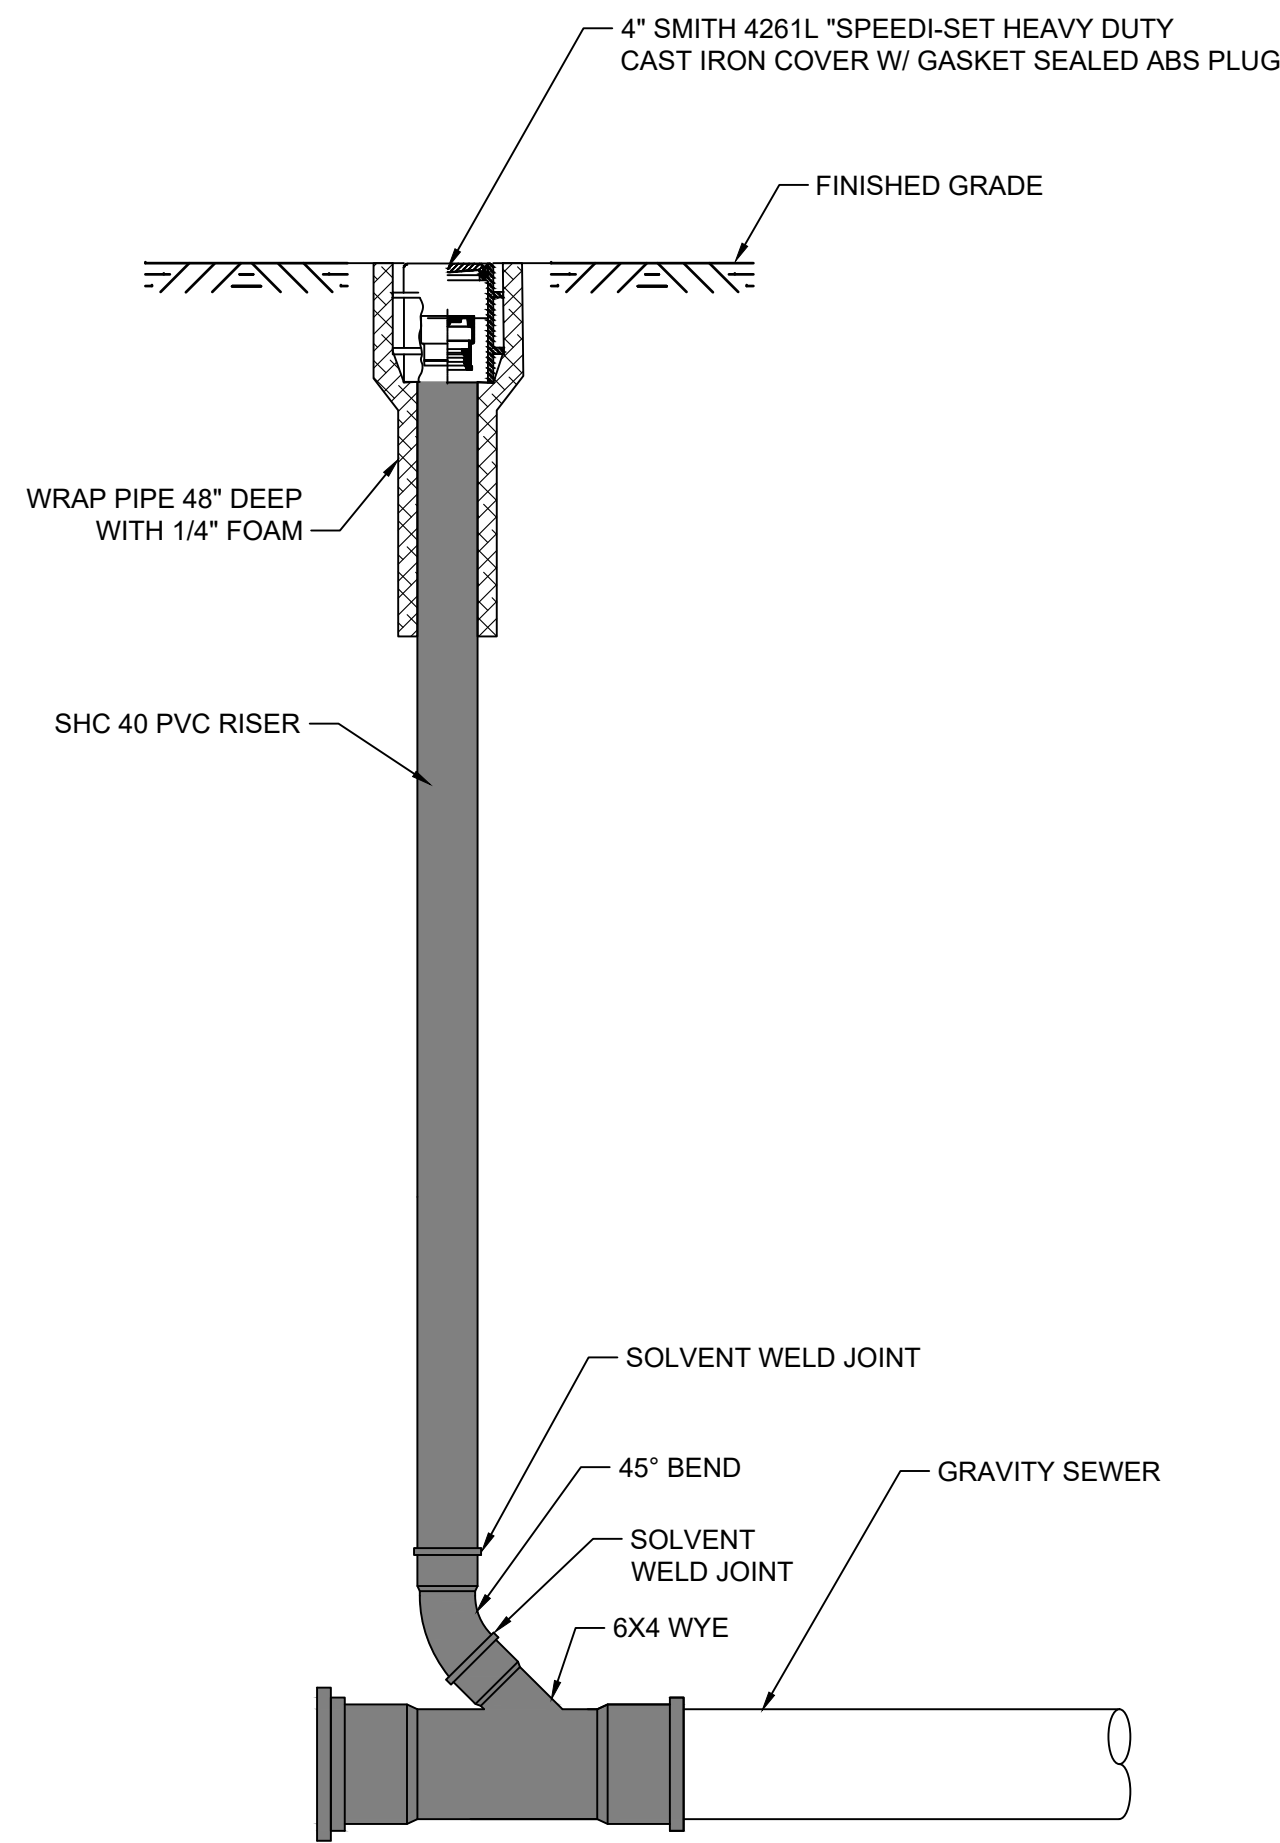


2 CLEANOUT DETAIL
NOT TO SCALE

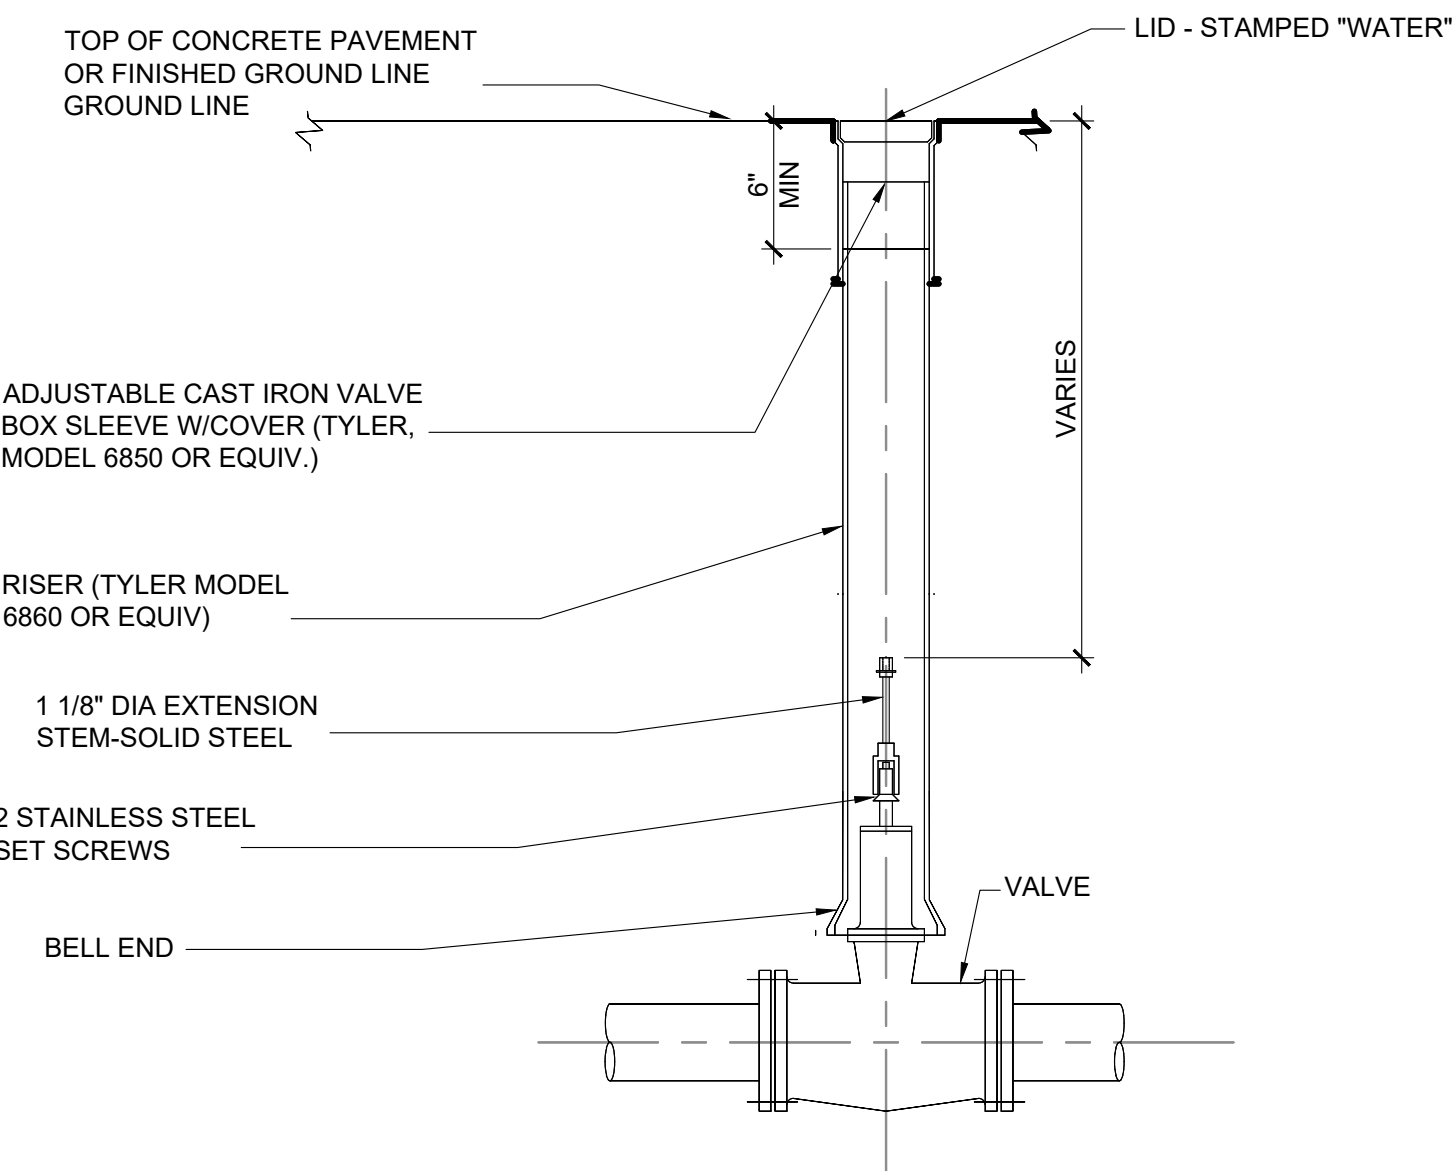

3 VALVE BOX
NOT TO SCALE

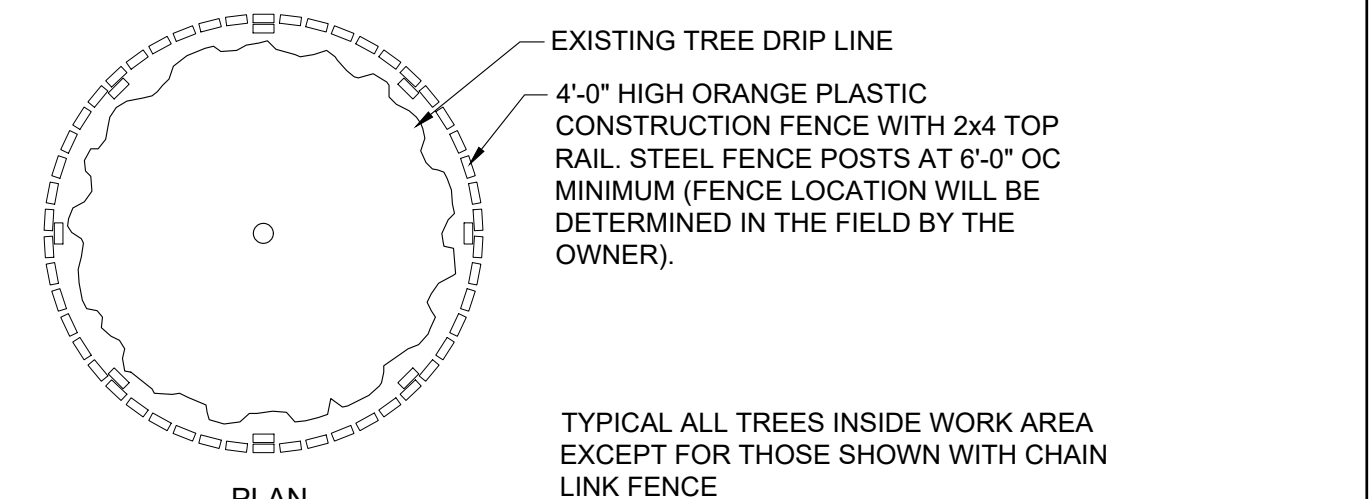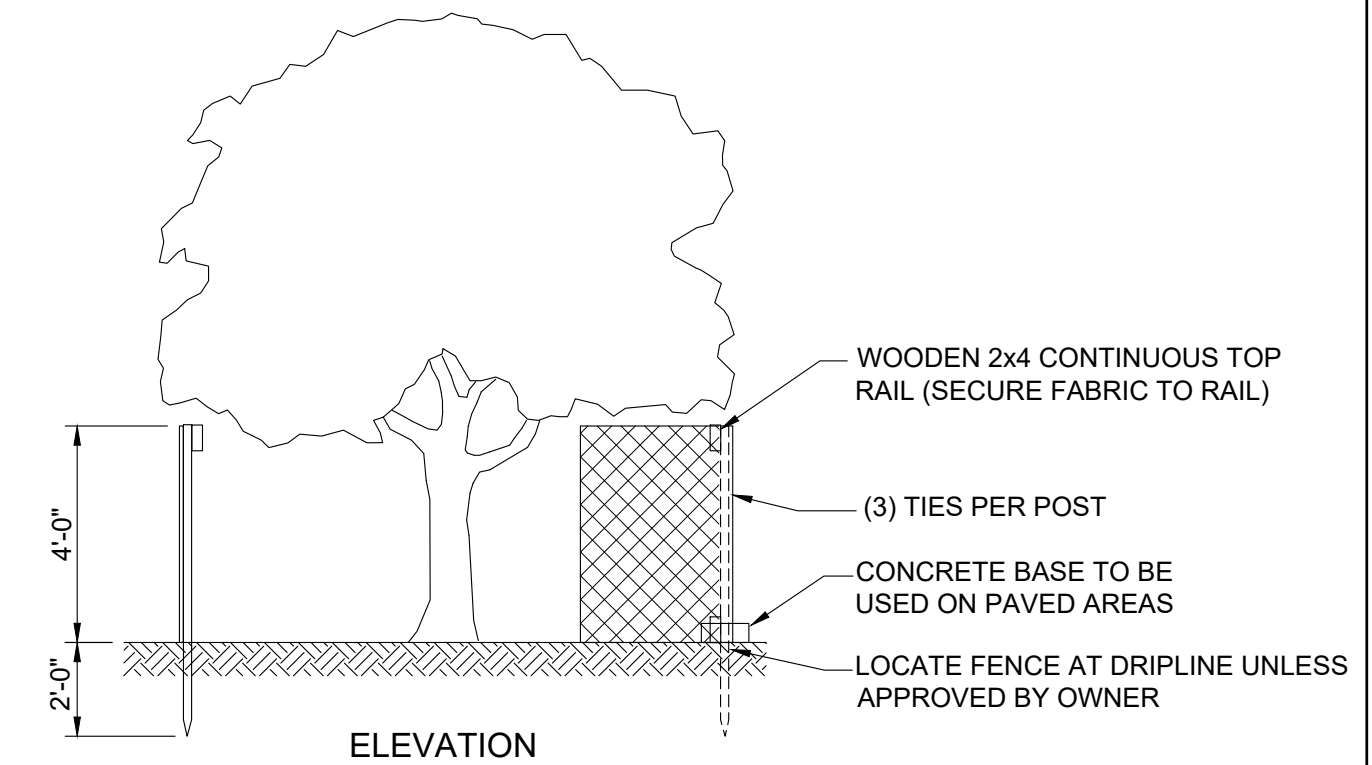

4 TREE PROTECTION FENCE LAYOUT
NOT TO SCALE

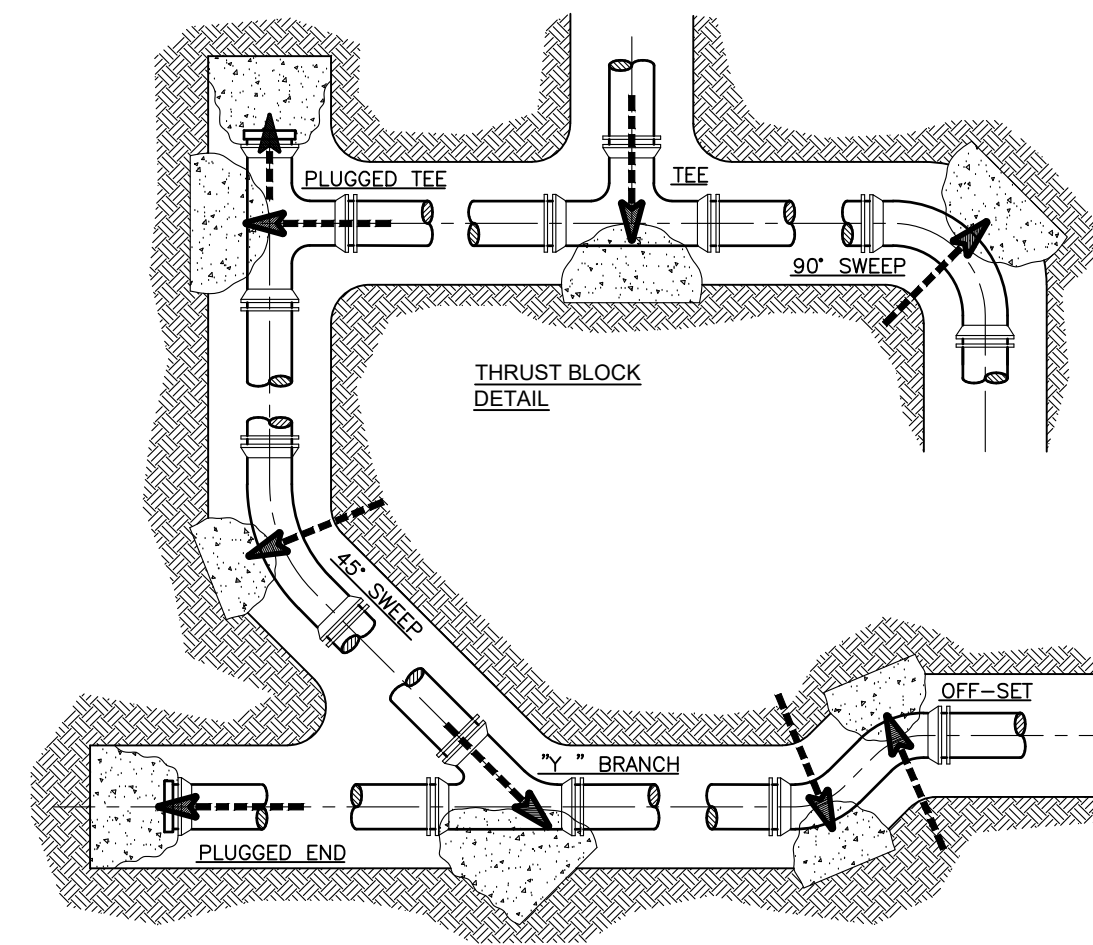


SIZE INCHES	TEE OR DEAD END	90° BEND	45° BEND	22.5° BEND	11.25° BEND
4"	1.4	1.9	1.0	1.0	1.0
6"	2.8	4.0	2.1	1.1	1.0
8"	4.8	6.8	3.7	1.9	1.0
10"	7.3	10.3	5.6	2.8	1.4
12"	10.3	14.5	7.9	4.0	2.0
16"	17.8	25.2	13.6	7.0	3.5
20"	27.5	38.9	21.0	10.7	5.4
24"	39.2	55.5	30.0	15.3	7.7
30"	60.3	85.3	46.2	23.5	11.8
36"	86.4	122.2	66.1	33.7	16.9
42"	116.6	165.0	89.3	45.5	22.9
48"	152.0	215.0	116.3	59.3	29.8
54"	192.1	271.6	147.0	74.9	37.6


THE ABOVE AREAS ARE BASED UPON A SOIL BEARING CAPACITY OF 2000 PSF OF UNDISTURBED SOIL. IF ACTUAL SOIL BEARING STRENGTH IS LESS THAN 2000 PSF, THE THRUST BEARING AREA SHALL BE INCREASED BASED ON THE ACTUAL SOIL BEARING STRENGTH.

7 THRUST BLOCK BEARING AREA (in sq ft)
NOT TO SCALE


02510-F-01

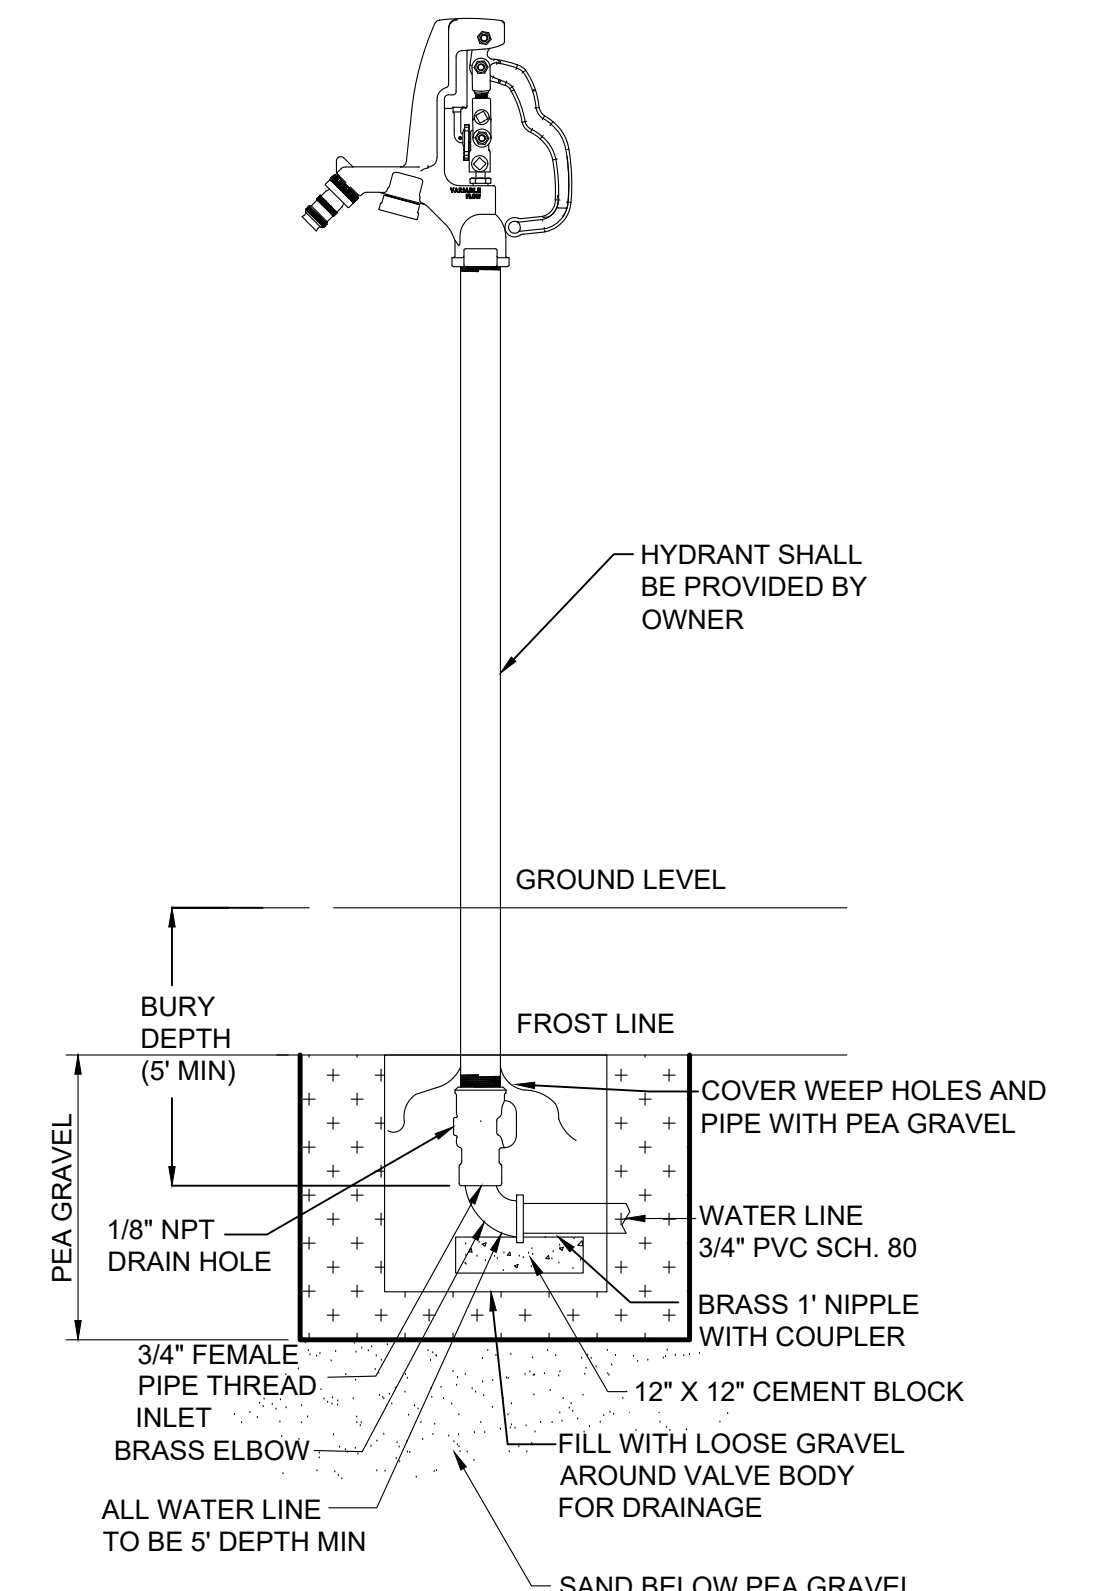

8 YARD HYDRANT DETAIL
NOT TO SCALE

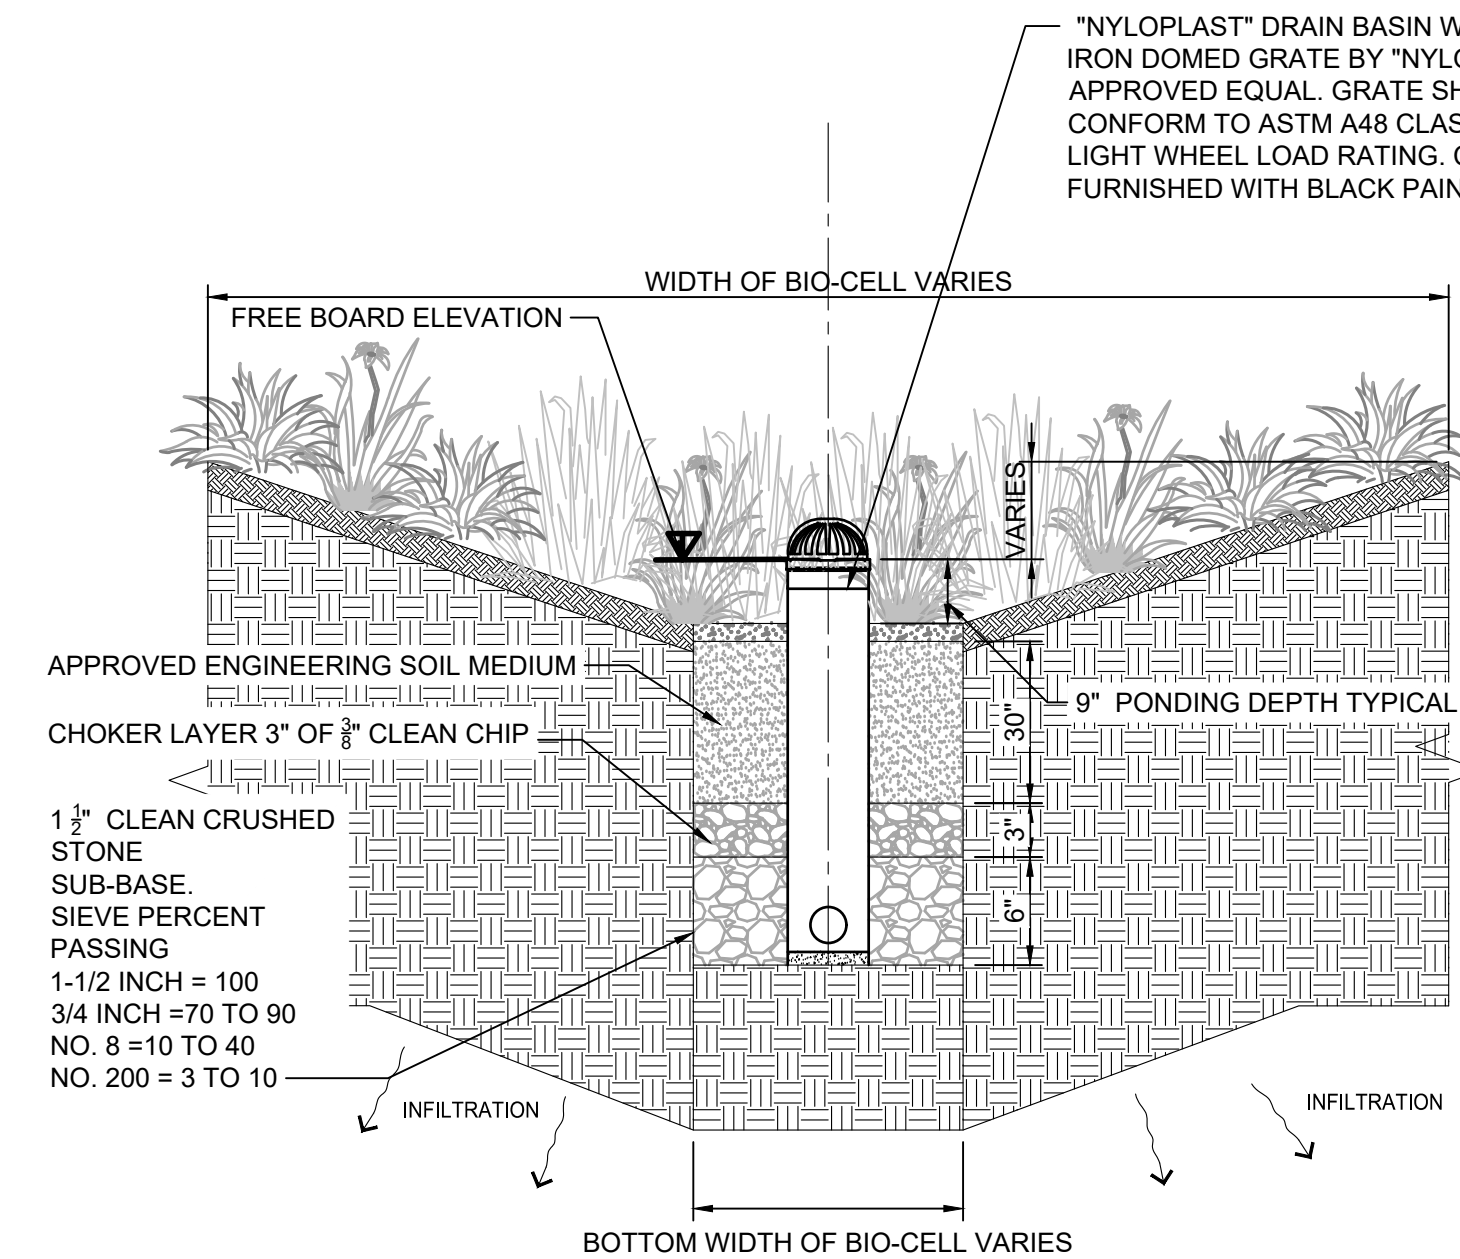

1 BIO-RETENTION CELL
NOT TO SCALE

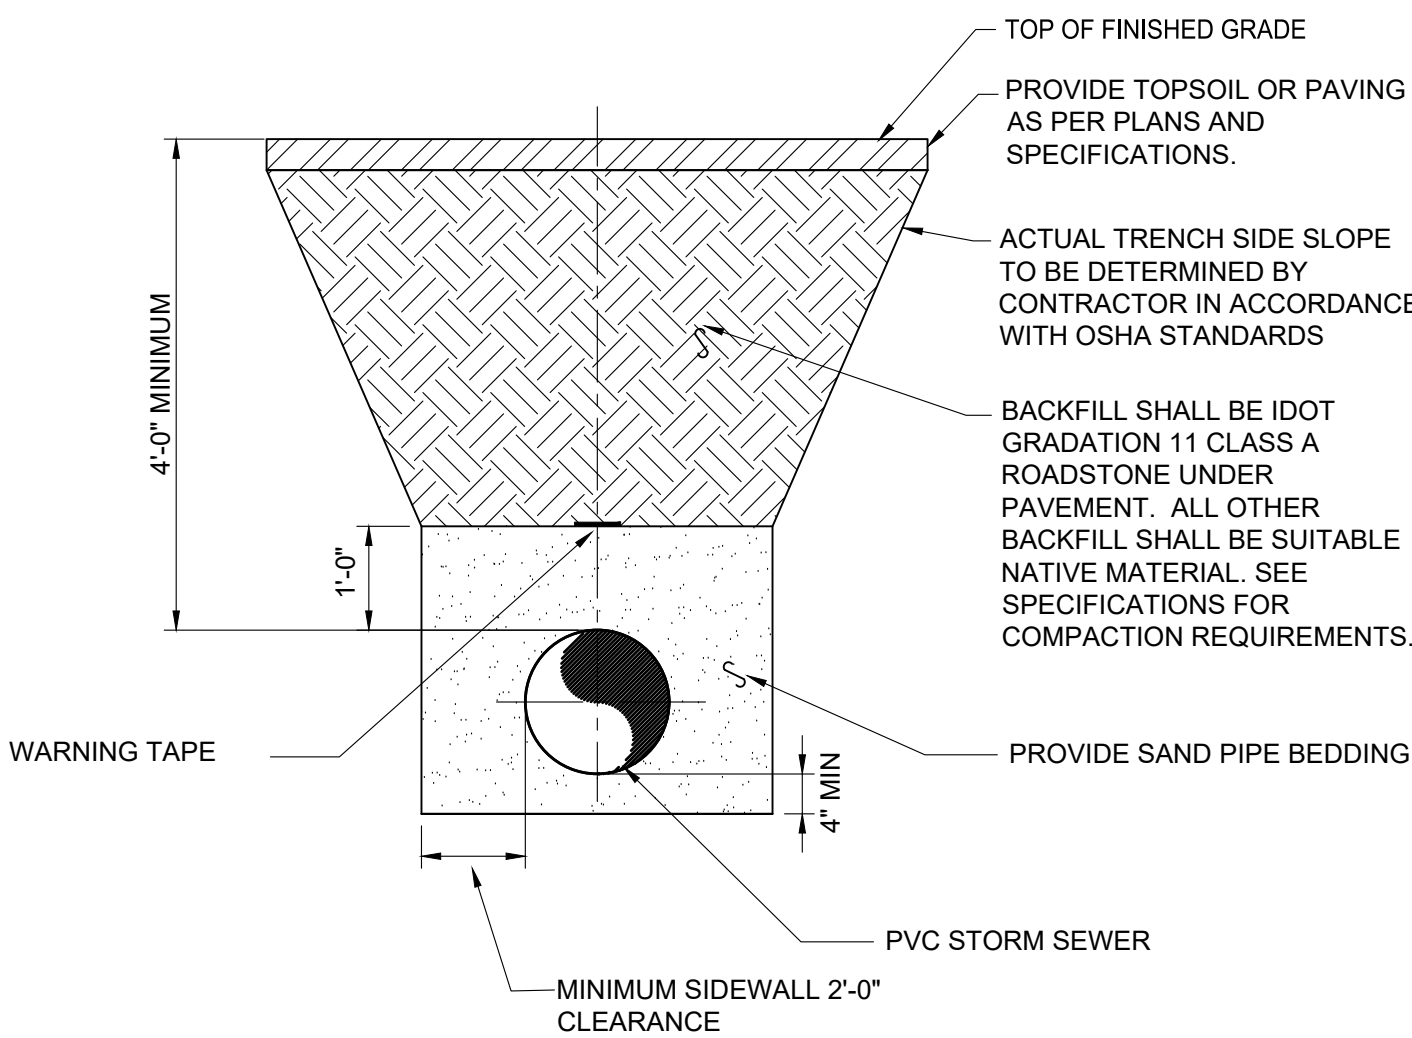


NOTE:

1. PIPING DIAMETER AS CALLED OUT ON PLANS. PIPING SHALL BE NORTH AMERICAN SPECIALTY PRODUCTS CERTA-FLO GREENLINE SDR 21 OR EQUAL.
2. GRAVITY SEWER MAINS SHALL BE SEPARATED FROM WATER MAINS BY A HORIZONTAL DISTANCE OF AT LEAST 10 FEET UNLESS:
 - 1) THE TOP OF A STORM MAIN IS AT LEAST 18 INCHES BELOW THE BOTTOM OF THE WATER MAIN, AND,
 - 2) THE SEWER IS PLACED IN A SEPARATE TRENCH OR IN THE SAME TRENCH ON A BENCH OF UNDISTURBED EARTH AT A MINIMUM HORIZONTAL SEPARATION OF 3 FEET FROM THE WATER MAIN.


4 TYPICAL GRAVITY STORM PIPE EMBEDMENT AND INSTALLATION DETAIL
NOT TO SCALE

COMPOST MEDIUM NOTES:


1. THE BIORETENTION FACILITY MAY NOT BE CONSTRUCTED UNTIL ALL CONTRIBUTING DRAINAGE AREA HAS BEEN STABILIZED.
2. COMPOST MEDIUM SHALL BE WELL MIXED ON SITE AND SHALL CONSIST OF:
 - A. 60% CONSTRUCTION SAND
 - B. 30% ORGANIC COMPOST
 - C. 10% QUALITY TOPSOIL W/ LESS THAN 5% MAX. CLAY CONTENT
3. ALL COSTS FOR MATERIALS, DELIVERY TO SITE, AND REQUIRED TEST ANALYSIS TO BE PAID FOR BY THE CONTRACTOR.
4. ENGINEERED COMPOST MEDIUM SHALL BE FREE OF STONES, STUMPS, ROOTS OR OTHER SIMILAR OBJECTS LARGER THAN TWO INCHES. NO OTHER MATERIALS OR SUBSTANCES SHALL BE MIXED OR DUMPED WITHIN THE BIORETENTION AREA THAT MAY BE HARMFUL TO PLANT GROWTH, OR PROVE A HINDRANCE TO THE PLANTING OR MAINTENANCE OPERATIONS. THE PLANTING SHALL BE FREE OF NOXIOUS WEEDS.
5. FINAL ENGINEERED COMPOST MEDIUM SHOULD MEET THE FOLLOWING CRITERIA:
 - A. pH RANGE: 5.2-7.0
 - B. ORGANIC MATTER 5-10%
 - C. SOLUBLE SALTS NOT TO EXCEED 500 PPM
6. WHEN BACKFILLING THE BIOSWALE CELL, PLACE COMPOST MEDIUM LIFTS IN 12" OR GREATER. DO NOT USE HEAVY EQUIPMENT WITHIN THE CELL. LIGHTWEIGHT EQUIPMENT SHALL BE USED AROUND THE PERIMETER OF THE BASIN TO SUPPLY SOILS AND SANDS.

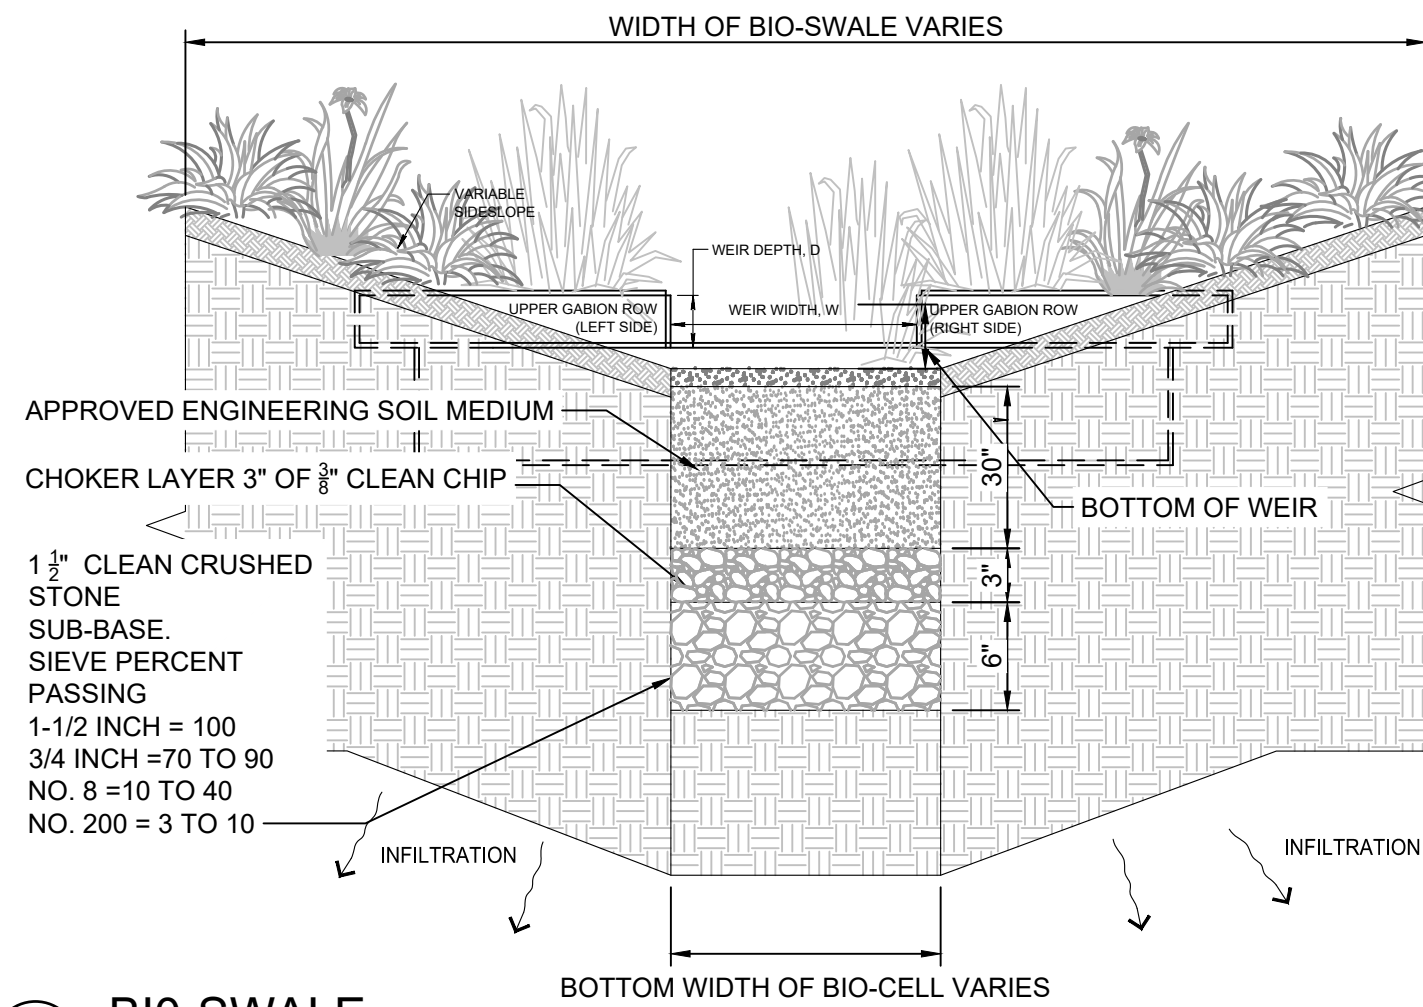



2 BIO-SWALE
NOT TO SCALE

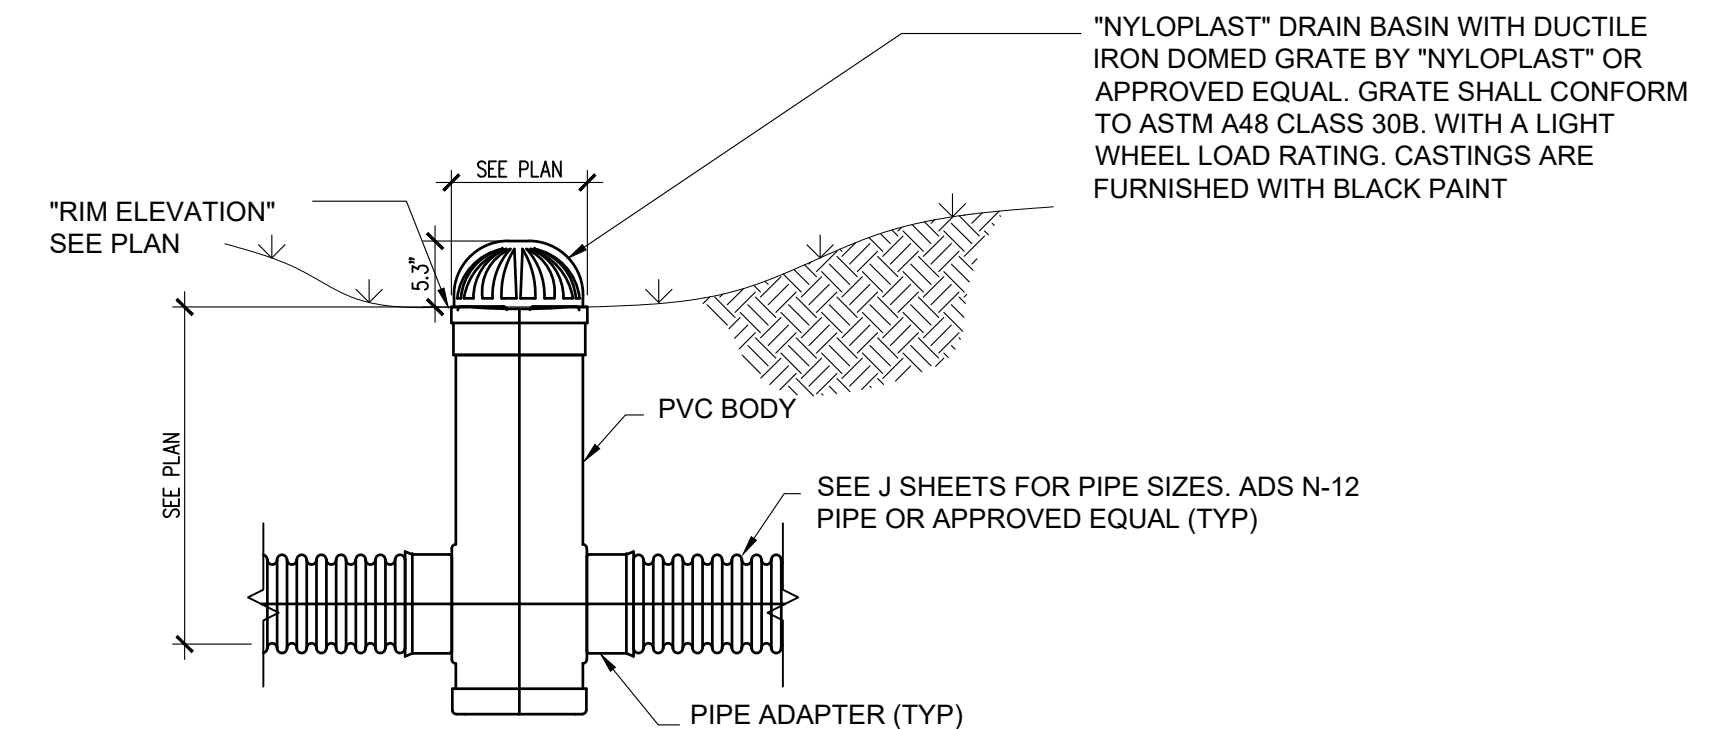

3 NYLOPLAST DRAIN BASIN
NOT TO SCALE

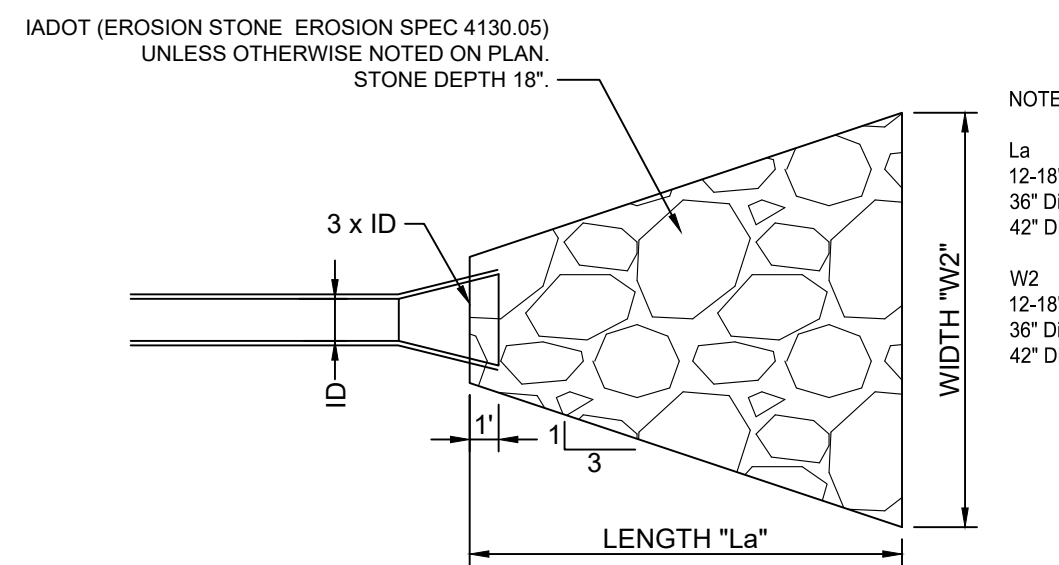


5 RIP RAP AT FLARED END SECTION
NOT TO SCALE

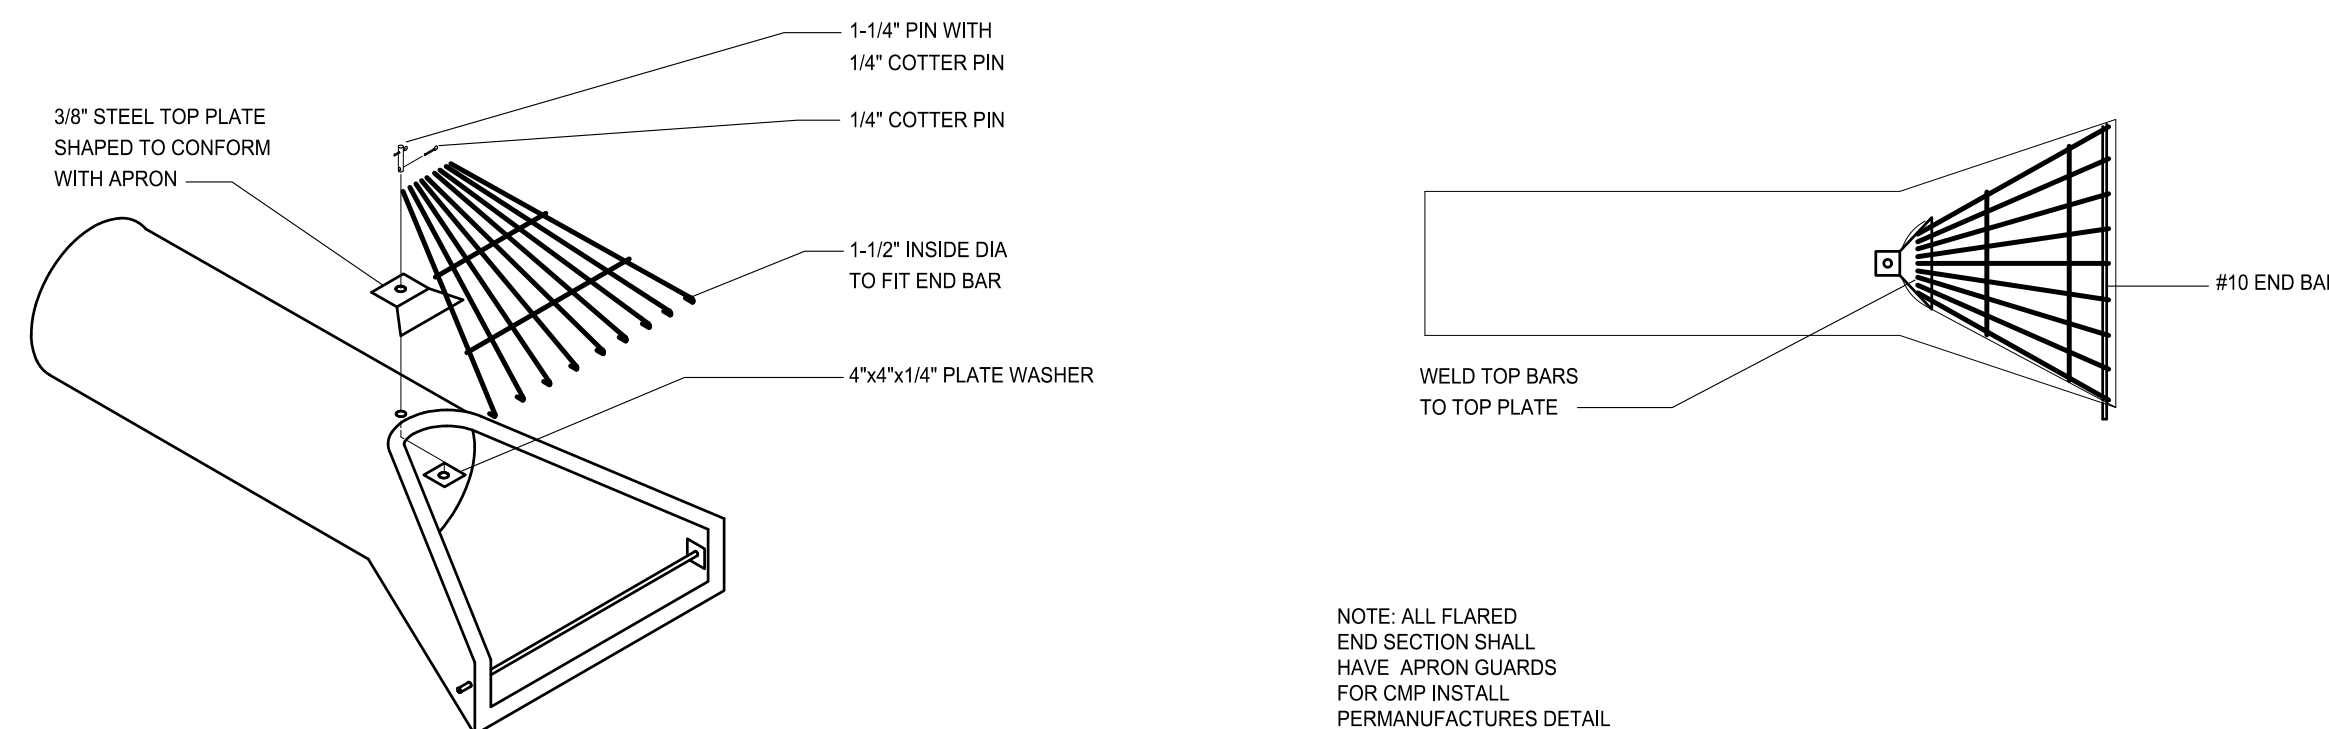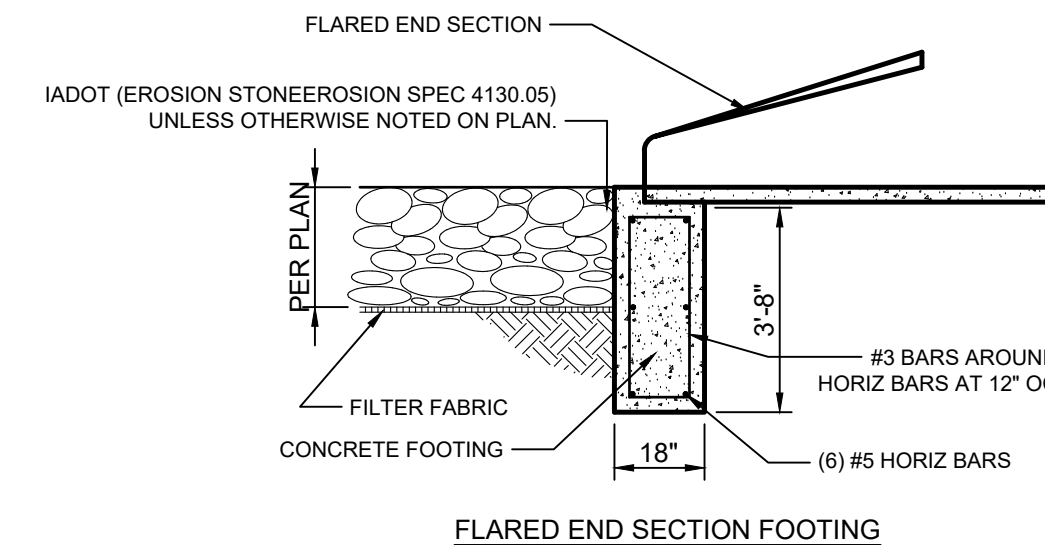


NOTE: ALL FLARED END SECTION SHALL HAVE APRON GUARDS FOR CMP INSTALL. PERMANUFACTURES DETAIL.


6 FLARED END SECTION APRON GAURD
NOT TO SCALE

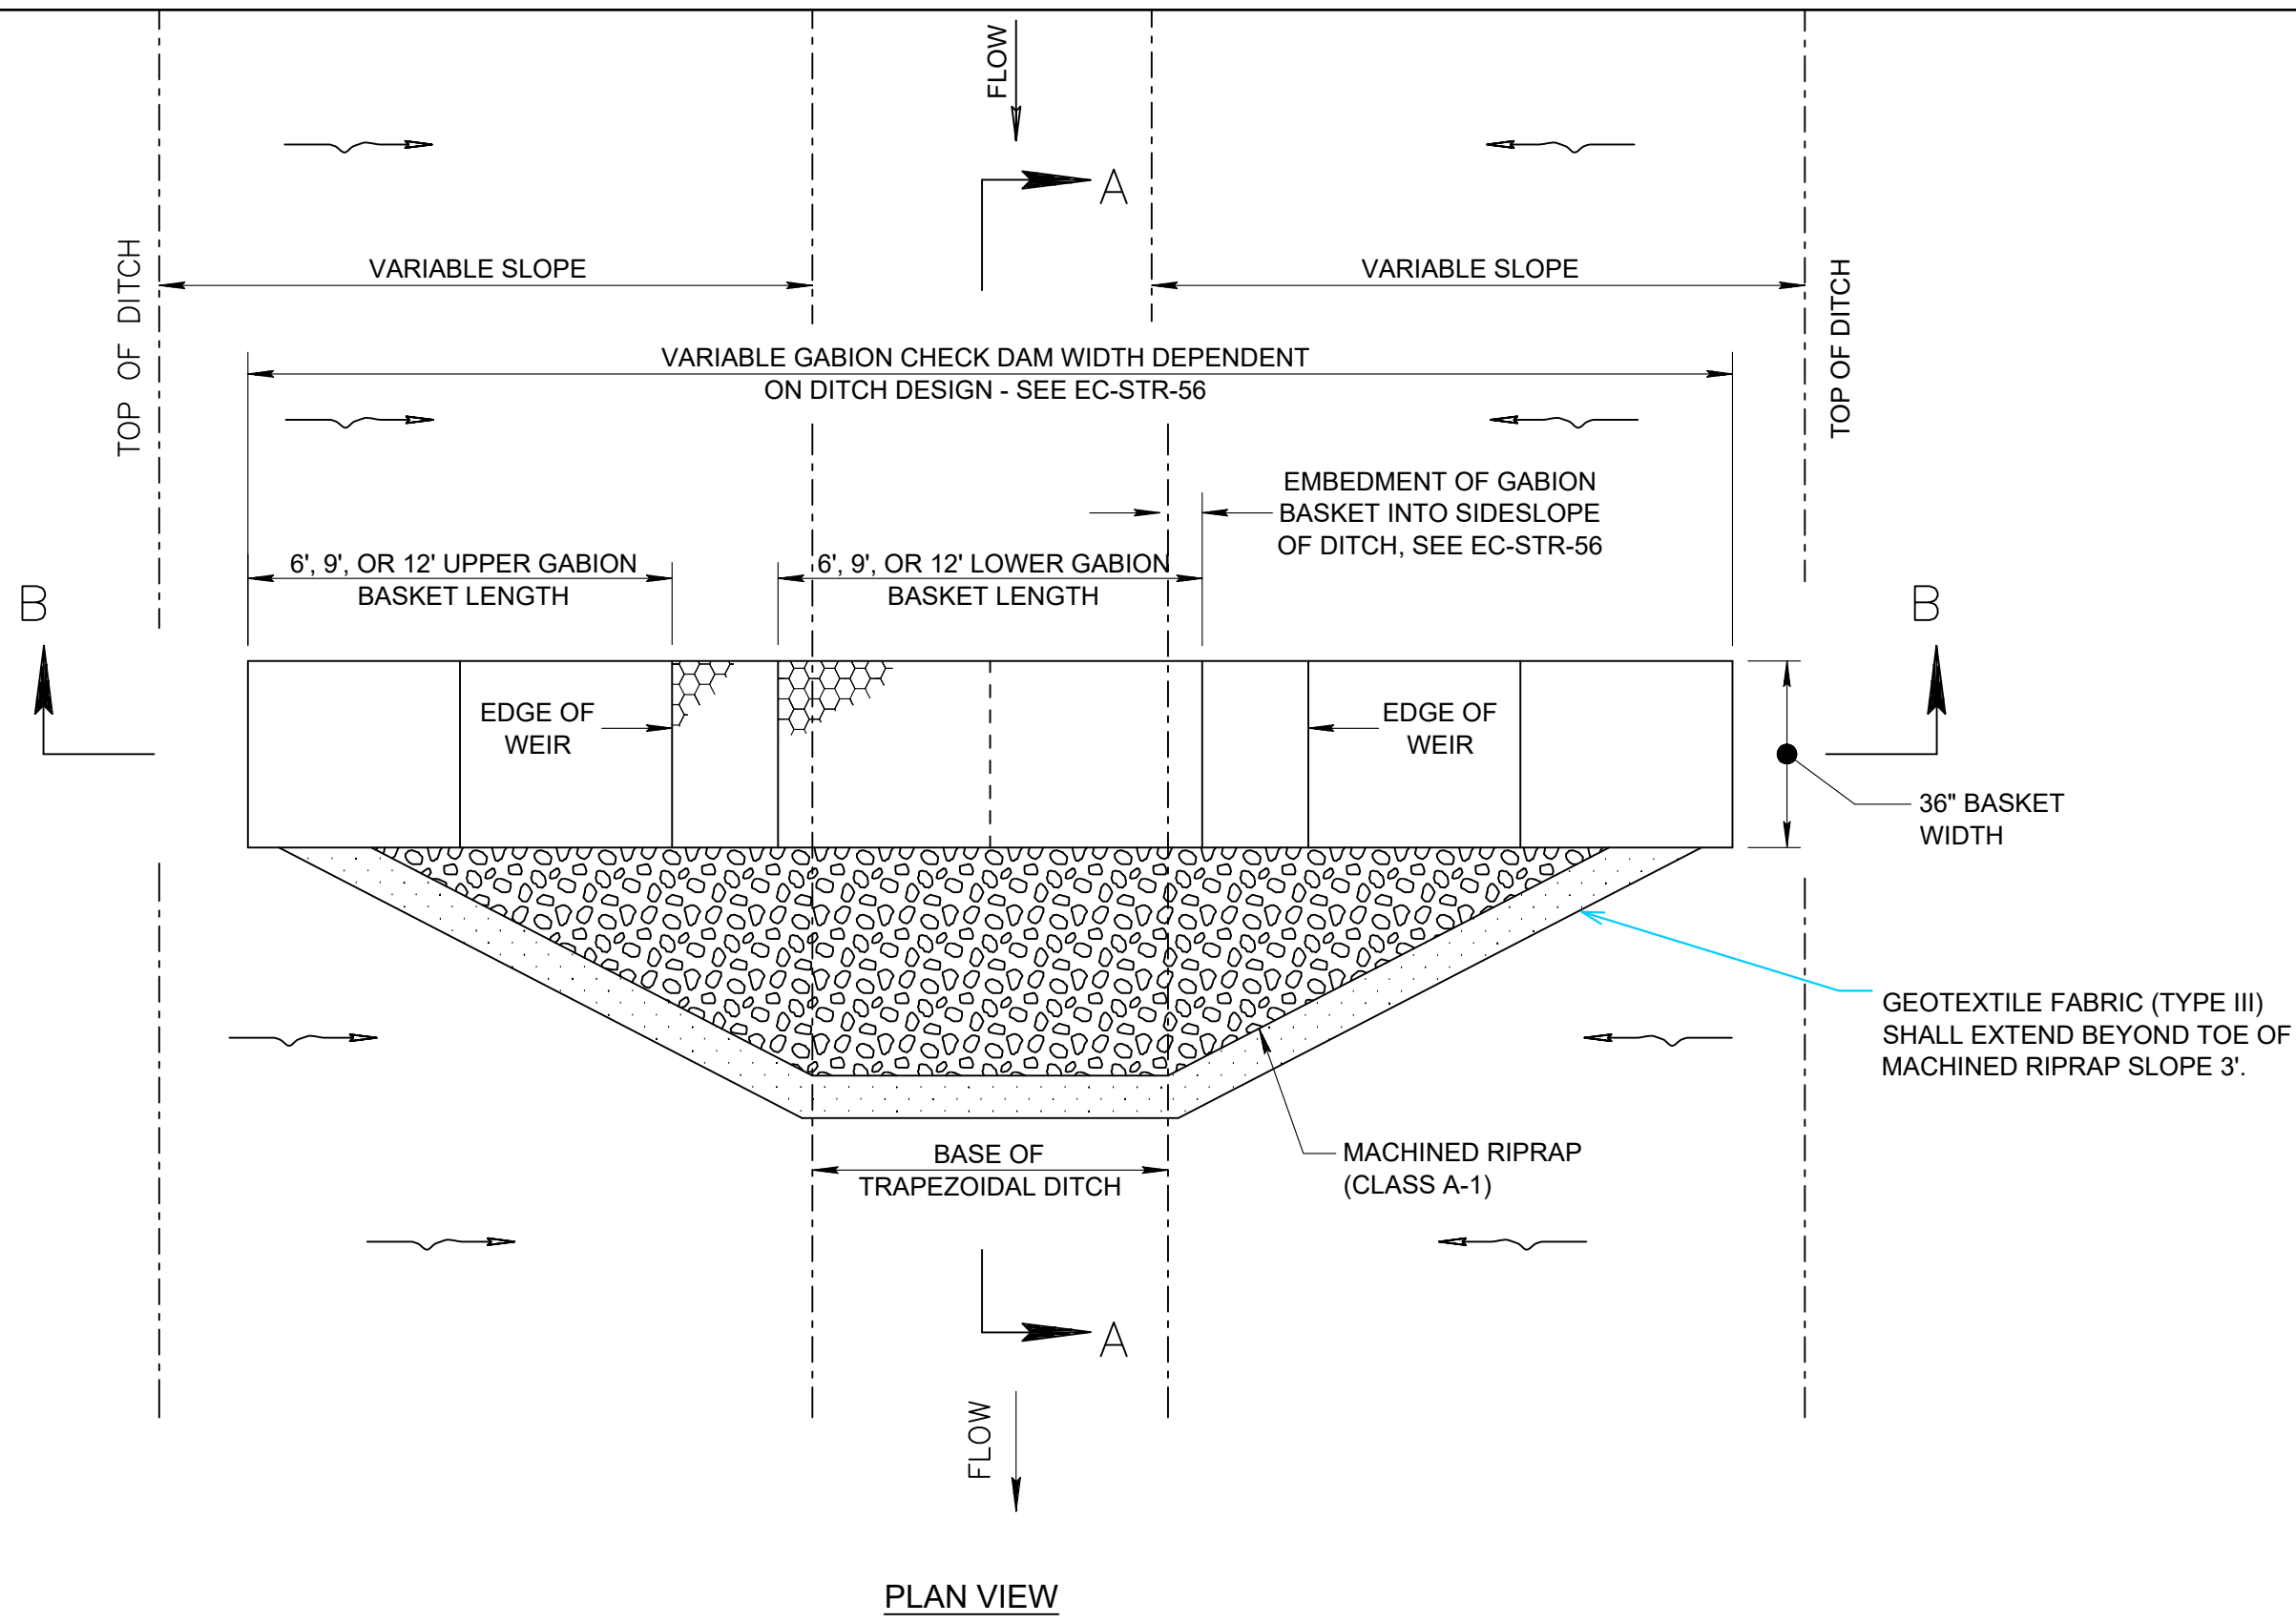

1 CHECKDAM DETAIL PLAN
NOT TO SCALE

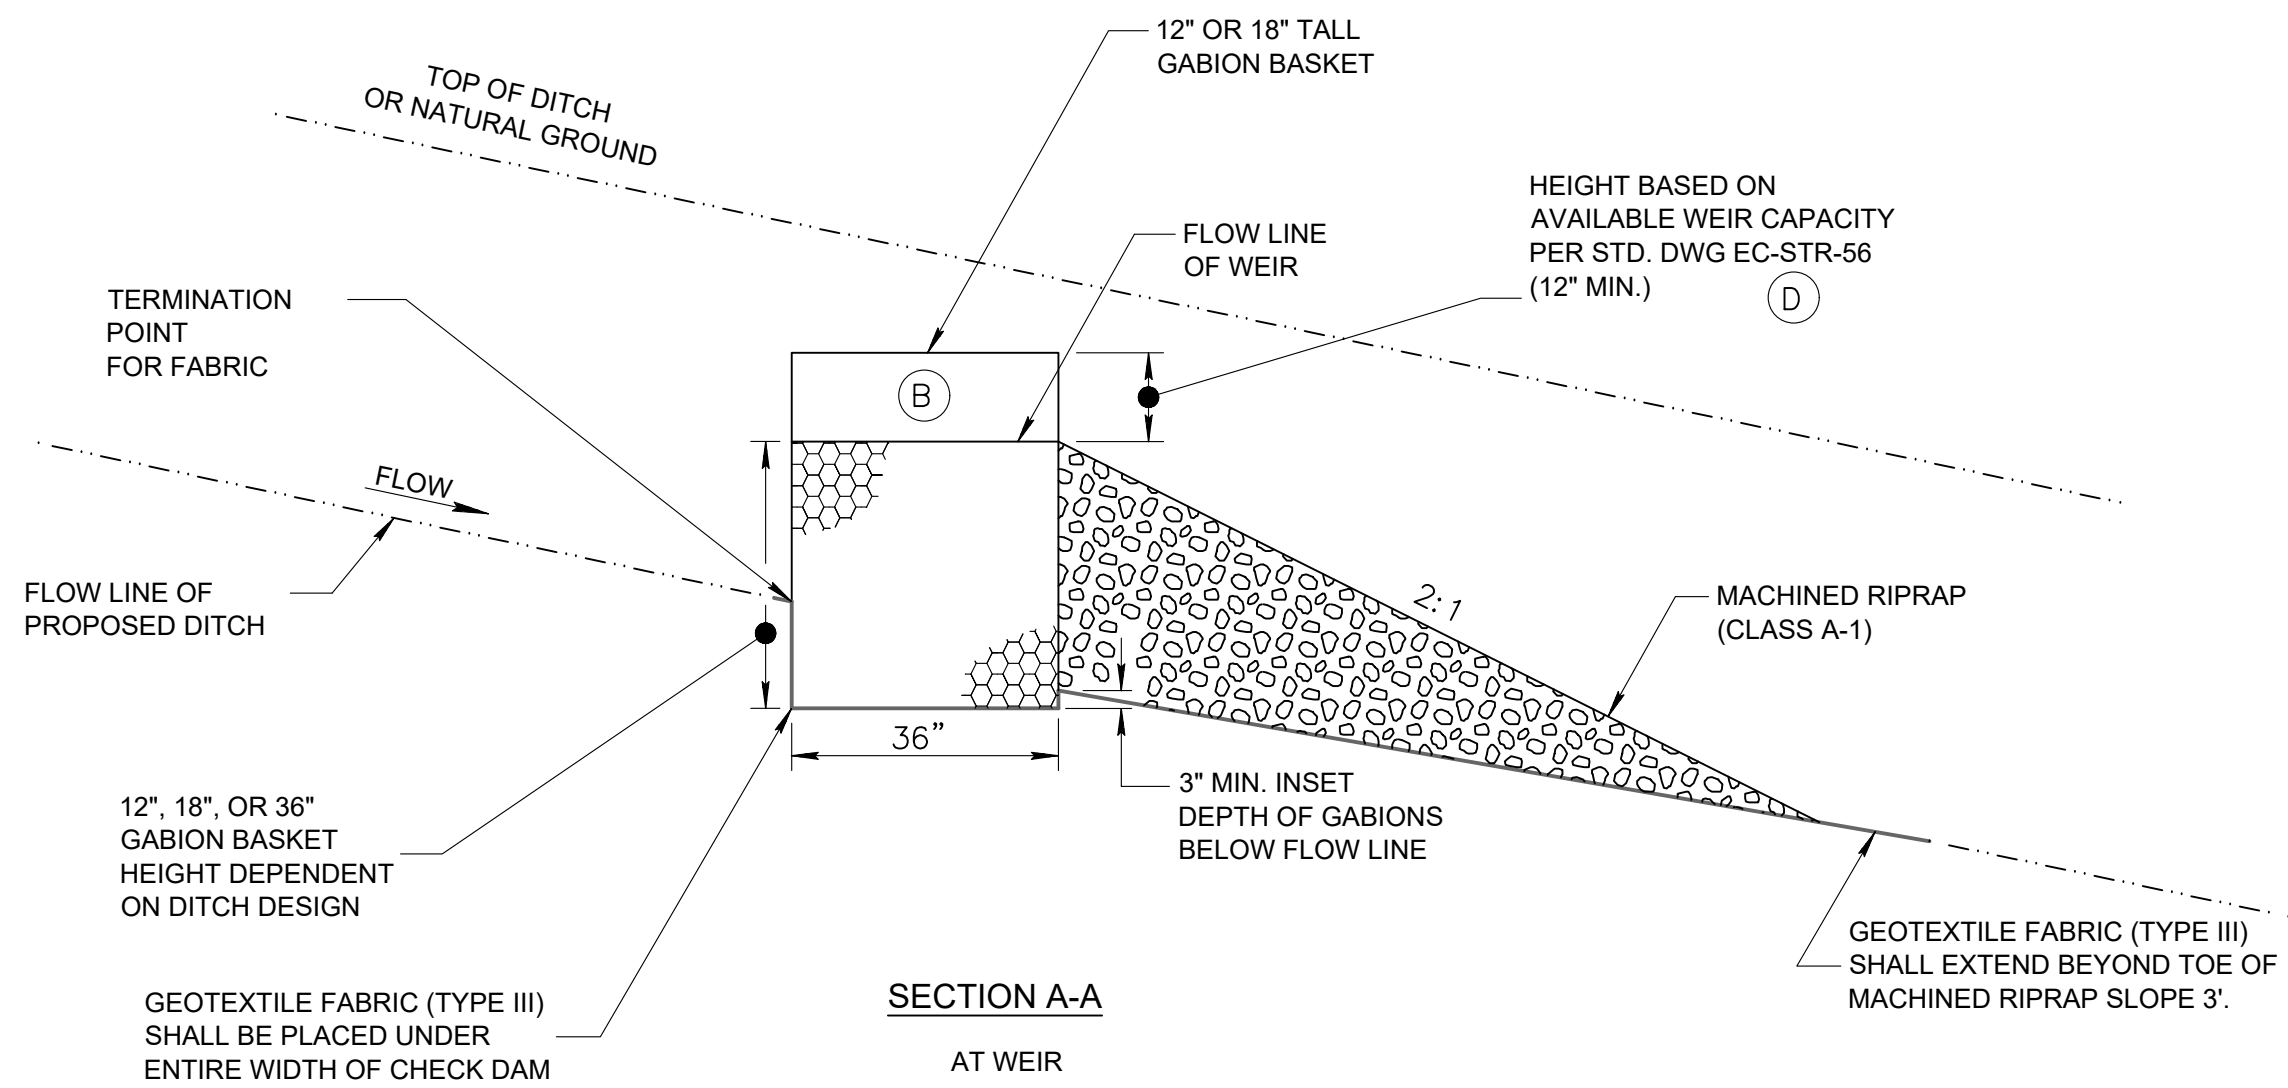

2 CHECK DAM SECTION A-A
NOT TO SCALE

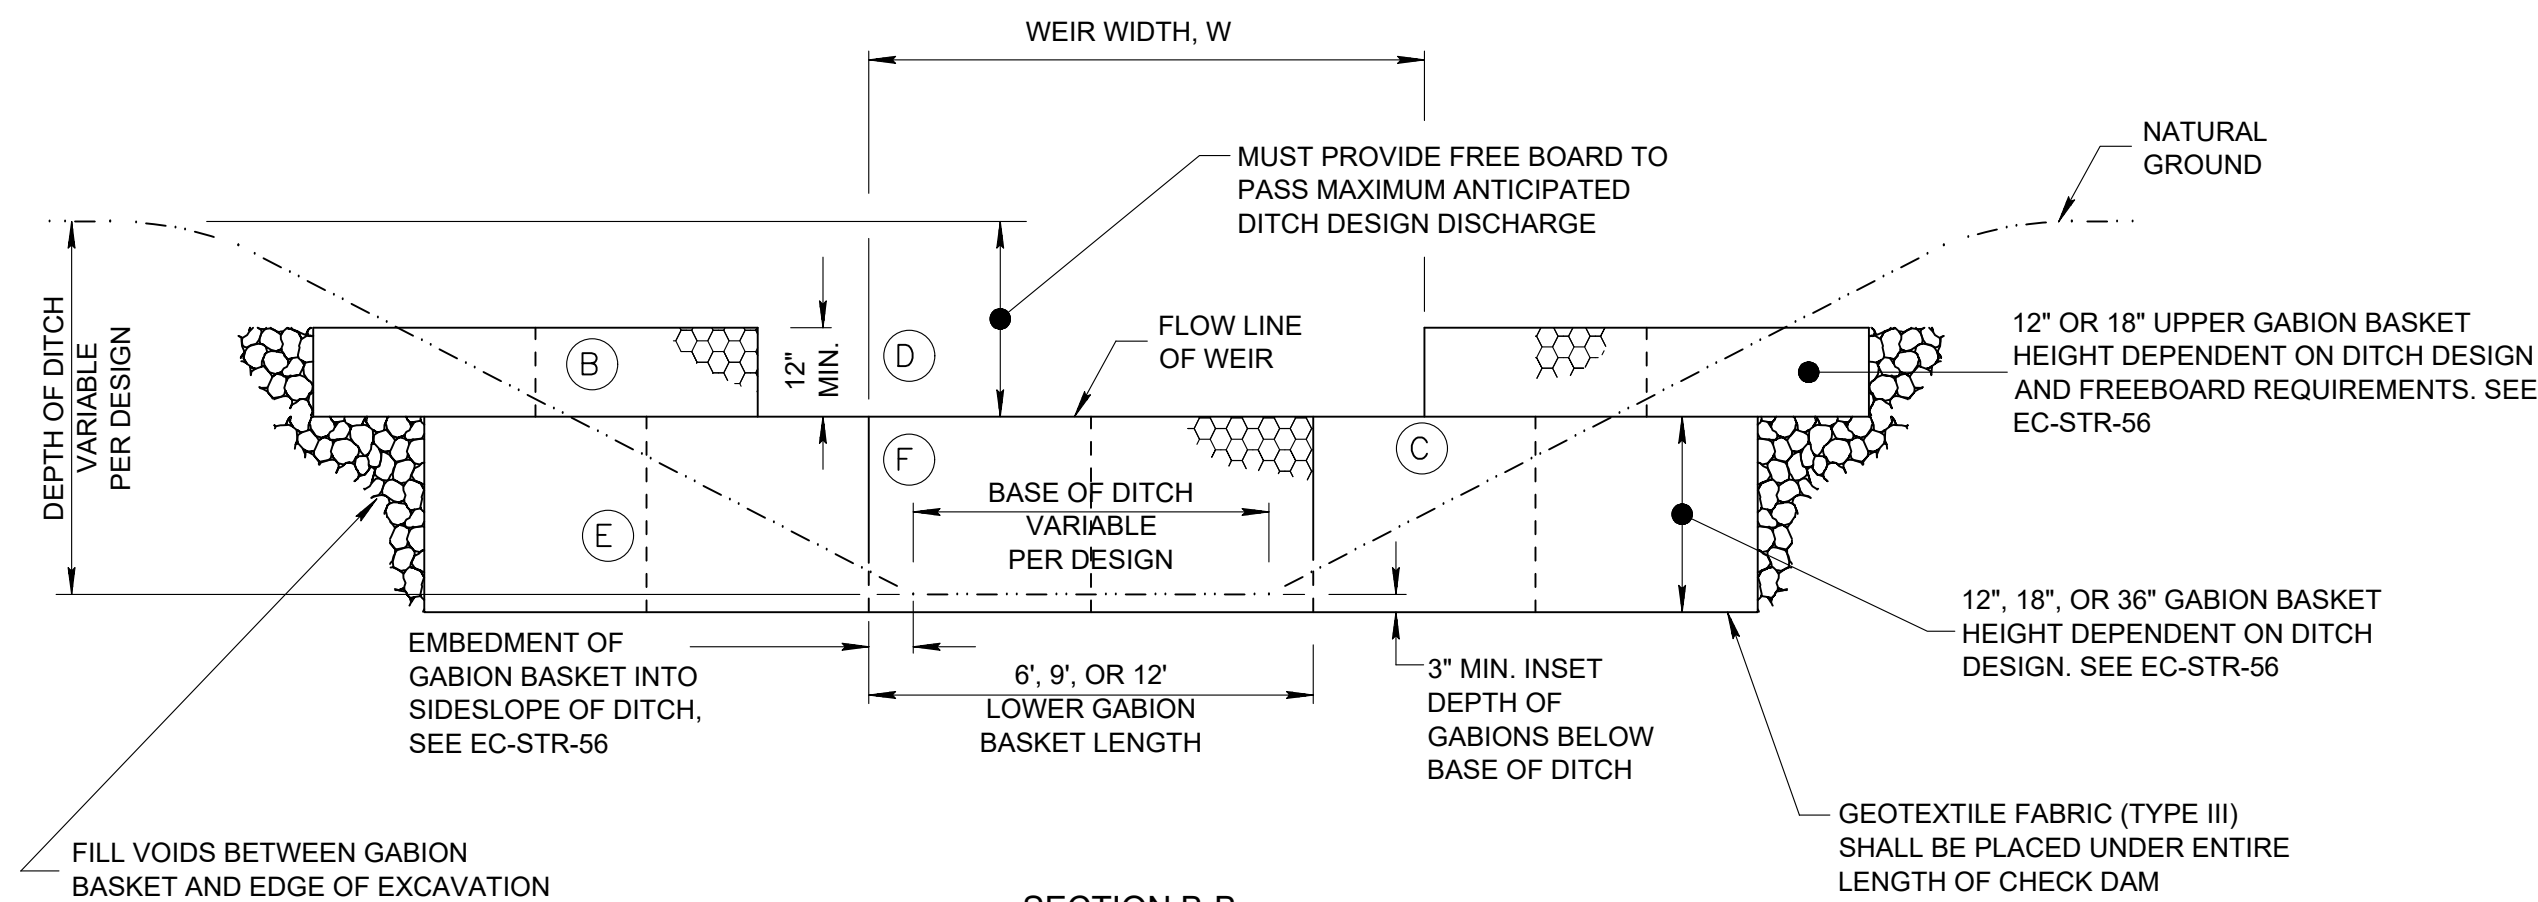

3 CHECK DAM SECTION B-B
NOT TO SCALE

GABION CHECK DAM GENERAL NOTES

(A) GABION CHECK DAMS ARE USED FOR VELOCITY REDUCTION AND EROSION PREVENTION IN AREAS WHERE CONCENTRATED FLOWS EXIST. GABION CHECK DAMS ARE NOT TO BE USED FOR SEDIMENT CONTROL AND SHOULD NOT BE CONSIDERED A SEDIMENT TRAPPING DEVICE. GABION CHECK DAMS SHALL NOT BE USED IN STREAMS OR OTHER NATURAL WATER RESOURCES.

(B) HEIGHT OF UPPER GABION SHALL BE OF EQUAL OR LESSER HEIGHT THAN LOWER GABION AND SHALL NOT EXCEED 18".

(C) VERTICAL JOINTS OF GABION BASKETS SHALL BE STAGGERED.

(D) SIZE WEIR TO CONTAIN THE 2-YEAR, 24-HOUR STORM. CONTAIN DESIGN DISCHARGE WITHIN WEIR STRUCTURE WHERE

POSSIBLE. FOR SITES WHICH DRAIN TO HIGH-QUALITY OR SEDIMENT-IMPAIRED STREAMS, THE WEIR SHALL BE SIZED TO CONTAIN THE 5-YEAR, 24-HOUR STORM.

(E) DIAPHRAGMS SEPARATE INDIVIDUAL GABION CELLS.

(F) BASKET-TO-BASKET CONNECTIONS SHALL BE AS DIRECTED ON STD. DWG. EC-STR-57 & EC-STR-58.

A GABIONS SHALL BE APPLIED AS CHECK DAMS WHERE ALLOWABLE MAXIMUM SHEAR FORCES AND VELOCITIES FOR LOOSE RIP RAP ARE EXCEEDED.

B GABION CHECK DAMS SHALL NOT BE USED IN STREAMS.

C GABION CHECK DAMS ARE TO BE USED, PRIMARILY AS AN EROSION CONTROL MEASURE FOR VELOCITY REDUCTION. THE 2-YEAR PEAK FLOW RATE MUST BE LESS THAN OR EQUAL TO THE WEIR FLOW SHOWN FOR THE SELECTED GABION CHECK DAM CONFIGURATION. AT SITES WHICH DRAIN TO HIGH-QUALITY OR SEDIMENT-IMPAIRED STREAMS, THE 5-YEAR PEAK FLOW RATE MUST BE LESS THAN OR EQUAL TO THE WEIR FLOW SHOWN ON THE TABLE.

D GABION CHECK DAMS SHALL REMAIN IN PLACE AS PERMANENT CHECK DAMS, AS SHOWN IN THE PLANS OR AS DIRECTED BY THE ENGINEER.

E THE CENTER OF THE GABION CHECK DAM MUST BE AT LEAST ONE (1) FOOT LOWER THAN THE OUTER EDGES. THIS WILL ELIMINATE THE BASKET-SOIL FAILURE POINT WHERE THE GABION CHECK DAM AND NATURAL GROUND MERGE.

F WIRE MESH GABION ALTERNATES:

1. WELDED MESH - WELDED WIRE MESH WITH A UNIFORM SQUARE OR RECTANGULAR PATTERN AND RESISTANCE WELD AT EACH INTERSECTION. THE WELDED WIRE CONNECTIONS SHALL CONFORM WITH THE REQUIREMENTS OF ASTM A185, INCLUDING WIRE SMALLER THAN W1.2 (0.124 IN.), EXCEPT THAT THE WELDED CONNECTIONS SHALL HAVE A MINIMUM AVERAGE SHEAR STRENGTH OF 70% AND A MINIMUM SHEAR STRENGTH OF 60% OF THE MINIMUM ULTIMATE TENSILE STRENGTH OF THE WIRE. WIRE SHALL BE GALVANIZED AFTER THE FORMING OF THE WELDED MESH.

G WIRE FOR FABRICATION AND ASSEMBLY SHALL BE HOT-DIPPED GALVANIZED. THE WIRE SHALL HAVE A MINIMUM TENSILE STRENGTH OF 60,000 PSI. GALVANIZED STEEL WIRE SHALL CONFORM TO ASTM A641, CLASS 3, SOFT TEMPER.

H TYPE 1, TYPE 2 AND TYPE 3 FASTENERS MUST PROVIDE A MINIMUM STRENGTH OF 1,400 POUNDS PER LINEAR FOOT FOR GABION BASKETS. ALL FASTENERS SHALL MEET ALL OF THE COATING REQUIREMENTS OF THE GABION MANUFACTURER IN ADDITION TO ANY REQUIREMENTS SPECIFIED IN THESE GENERAL NOTES.

I TYPE 4 SPIRAL BINDERS ARE FOR WELDED-MESH GABION BASKETS ONLY AND SHALL BE FORMED FROM WIRE MEETING THE SAME QUALITY AND COATING THICKNESS REQUIREMENTS AS SPECIFIED FOR THE GABION BASKETS.

J FOUNDATION PREPARATION - SURFACE IRREGULARITIES, LOOSE MATERIAL, VEGETATION, AND ALL FOREIGN MATTER SHALL BE REMOVED FROM FOUNDATIONS.

K ASSEMBLY - ROTATE THE GABION PANELS INTO POSITION AND JOIN THE VERTICAL EDGES WITH FASTENERS FOR GABION ASSEMBLY. WHERE LACING WIRE IS USED, WRAP THE WIRE WITH ALTERNATING SINGLE AND DOUBLE HALF-HITCHES AT INTERVALS BETWEEN FOUR (4) TO FIVE (5) INCHES. WHERE RING TYPE ALTERNATE FASTENERS ARE USED FOR BASKET ASSEMBLY, INSTALL THE FASTENERS AT A MAXIMUM SPACING OF 6 INCHES. USE THE SAME FASTENING PROCEDURES TO INSTALL INTERIOR DIAPHRAGMS WHERE THEY ARE REQUIRED. INTERIOR DIAPHRAGMS WILL BE REQUIRED WHEN ANY INSIDE DIMENSION OF A GABION BASKET EXCEEDS 3 FEET.

L PLACEMENT - PLACE THE EMPTY GABIONS ON THE FOUNDATION AND INTERCONNECT THE ADJACENT GABIONS ALONG THE TOP, BOTTOM, AND VERTICAL EDGES USING LACING WIRE. WRAP THE WIRE WITH ALTERNATING SINGLE AND DOUBLE HALF-HITCHES AT INTERVALS BETWEEN FOUR (4) TO SIX (6) INCHES. SPIRAL FASTENERS ARE COMMONLY USED FOR THE ASSEMBLY AND INTERCONNECTION OF WELDED MESH GABIONS. SPIRALS ARE SCREWED DOWN AT THE CONNECTING EDGES, THEN EACH END OF THE SPIRAL IS SECURELY TIED DOWN TO PREVENT UNRAVELING. LACING MAY BE USED AS NEEDED TO SUPPLEMENT THE INTERCONNECTION OF WELDED MESH GABIONS, AND THE CLOSING OF LIDS. FOR GABION LACING DETAILS, SEE EC-STR-57.

M UNLESS OTHERWISE SPECIFIED ON THE PLANS, THE VERTICAL JOINTS BETWEEN GABION BASKET UNITS OF ADJACENT LAYERS OR TIERS, ALONG THE LENGTH OF THE CHECK DAM, SHALL BE STAGGERED BY A MINIMUM OF ONE CELL.

N FILLING OPERATION

1. FOR REINFORCEMENT, INTERNAL CONNECTING WIRES SHALL BE PLACED IN EACH UNRESTRAINED GABION CELL 18 INCHES OR GREATER IN HEIGHT, INCLUDING GABION CELLS LEFT TEMPORARILY UNRESTRAINED. TWO INTERNAL CONNECTING WIRES SHALL BE PLACED (TWO ACROSS THE WIDTH AND TWO ACROSS THE LENGTH) CONCURRENTLY WITH ROCK PLACEMENT, AT THE SPECIFIED DEPTH INTERVAL.

2. IN WELDED MESH GABIONS, OPTIONAL CORNER STIFFENERS MAY BE USED IN LIEU OF INTERNAL CONNECTING WIRE REINFORCEMENT. WHEN USED, DIAGONAL STIFFENERS SHALL BE PLACED ACROSS THE CORNERS OF THE GABIONS AT 12 INCHES FROM CORNERS AS DETAILED ON STANDARD DRAWING EC-STR-58. LACING WIRE OR PREFORMED HOOKING WIRE STIFFENERS MAY BE USED.

3. THE GABIONS SHALL BE CAREFULLY FILLED WITH ROCK, BY HAND METHODS, ENSURING ALIGNMENT, AVOIDING BULGES, AND PROVIDING A COMPACT MASS THAT MINIMIZES VOIDS. THE CELLS IN ANY ROW SHALL BE FILLED IN STAGES SO THAT THE DEPTH OF ROCK PLACED IN ANY ONE CELL DOES NOT EXCEED THE DEPTH OF ROCK IN ANY ADJOINING CELL BY MORE THAN 3 INCHES. ALONG THE EXPOSED FACES, THE OUTER LAYER OF STONE SHALL BE CAREFULLY PLACED AND ARRANGED BY HAND TO ENSURE A NEAT, COMPACT PLACEMENT WITH A UNIFORM APPEARANCE.

4. THE LAST LAYER OF ROCK SHALL BE UNIFORMLY LEVELED TO THE TOP EDGES OF THE GABIONS. LIDS SHALL BE STRETCHED TIGHT OVER THE ROCK FILLING USING ONLY APPROVED LID CLOSING TOOLS AS NECESSARY. THE USE OF CROWBARS OR OTHER SINGLE POINT LEVERAGE BARS FOR LID CLOSING IS PROHIBITED, AS THEY MAY DAMAGE THE BASKETS. THE LID SHALL BE STRETCHED UNTIL IT MEETS THE PERIMETER EDGES OF THE FRONT AND END PANELS. THE GABION LID SHALL THEN BE SECURED TO THE SIDES, ENDS, AND DIAPHRAGMS WITH SPIRAL BINDERS, INTERLOCKING WIRE, OVERLAPPING RING FASTENERS, OR LACING WIRE WRAPPED WITH ALTERNATING SINGLE AND DOUBLE HALF-HITCHES IN THE MESH OPENINGS.

O CARE SHOULD BE TAKEN WHEN PLACING ROCK IN GABIONS TO INSURE THAT THE GABION BASKETS WILL NOT BE DAMAGED OR BROKEN.

P ROCK OR STONE SIZE FOR USE IN GABION BASKETS SHALL BE BETWEEN 4 AND 8 INCHES WITH A D OF 6 INCHES (MINIMUM) AND SHALL CONSIST OF LIMESTONE OUTCROPPING OR LIMESTONE QUARRY STONE. THE SPECIFIC GRAVITY OF INDIVIDUAL STONES SHALL BE A MINIMUM OF 2.6. STONES SHALL BE OF A QUALITY THAT WILL NOT DISINTEGRATE WITH EXPOSURE TO WATER OR WEATHERING.


Q GEOTEXTILE FABRIC (TYPE III) SHALL MEET REQUIREMENTS OF THE STANDARD SPECIFICATIONS FOR GEOTEXTILES AASHTO DESIGNATION M-288, EROSION CONTROL.

R GABION CHECK DAMS SHALL BE PAID FOR UNDER THE FOLLOWING ITEM NUMBERS:

PAYMENT SHALL INCLUDE ALL MATERIALS, EQUIPMENT, EXCAVATION, AND LABOR NECESSARY FOR CONSTRUCTION AND MAINTENANCE OF THE GABION CHECK DAMS.

S SEDIMENT SHALL BE REMOVED FROM BEHIND THE GABION CHECK DAMS WHEN IT HAS ACCUMULATED TO ONE-HALF THE ORIGINAL HEIGHT OF THE DAM


EXAMPLE BELOW SHOWS 3-CELLED, 9 FOOT LONG GABION BASKET WITH ATTACHED 6 FOOT LONG GABION. ACTUAL GABION LENGTHS WILL VARY, BUT SHALL BE MULTIPLES (1,2,3, OR 4) OF THE 3 FOOT BASKET WIDTH.

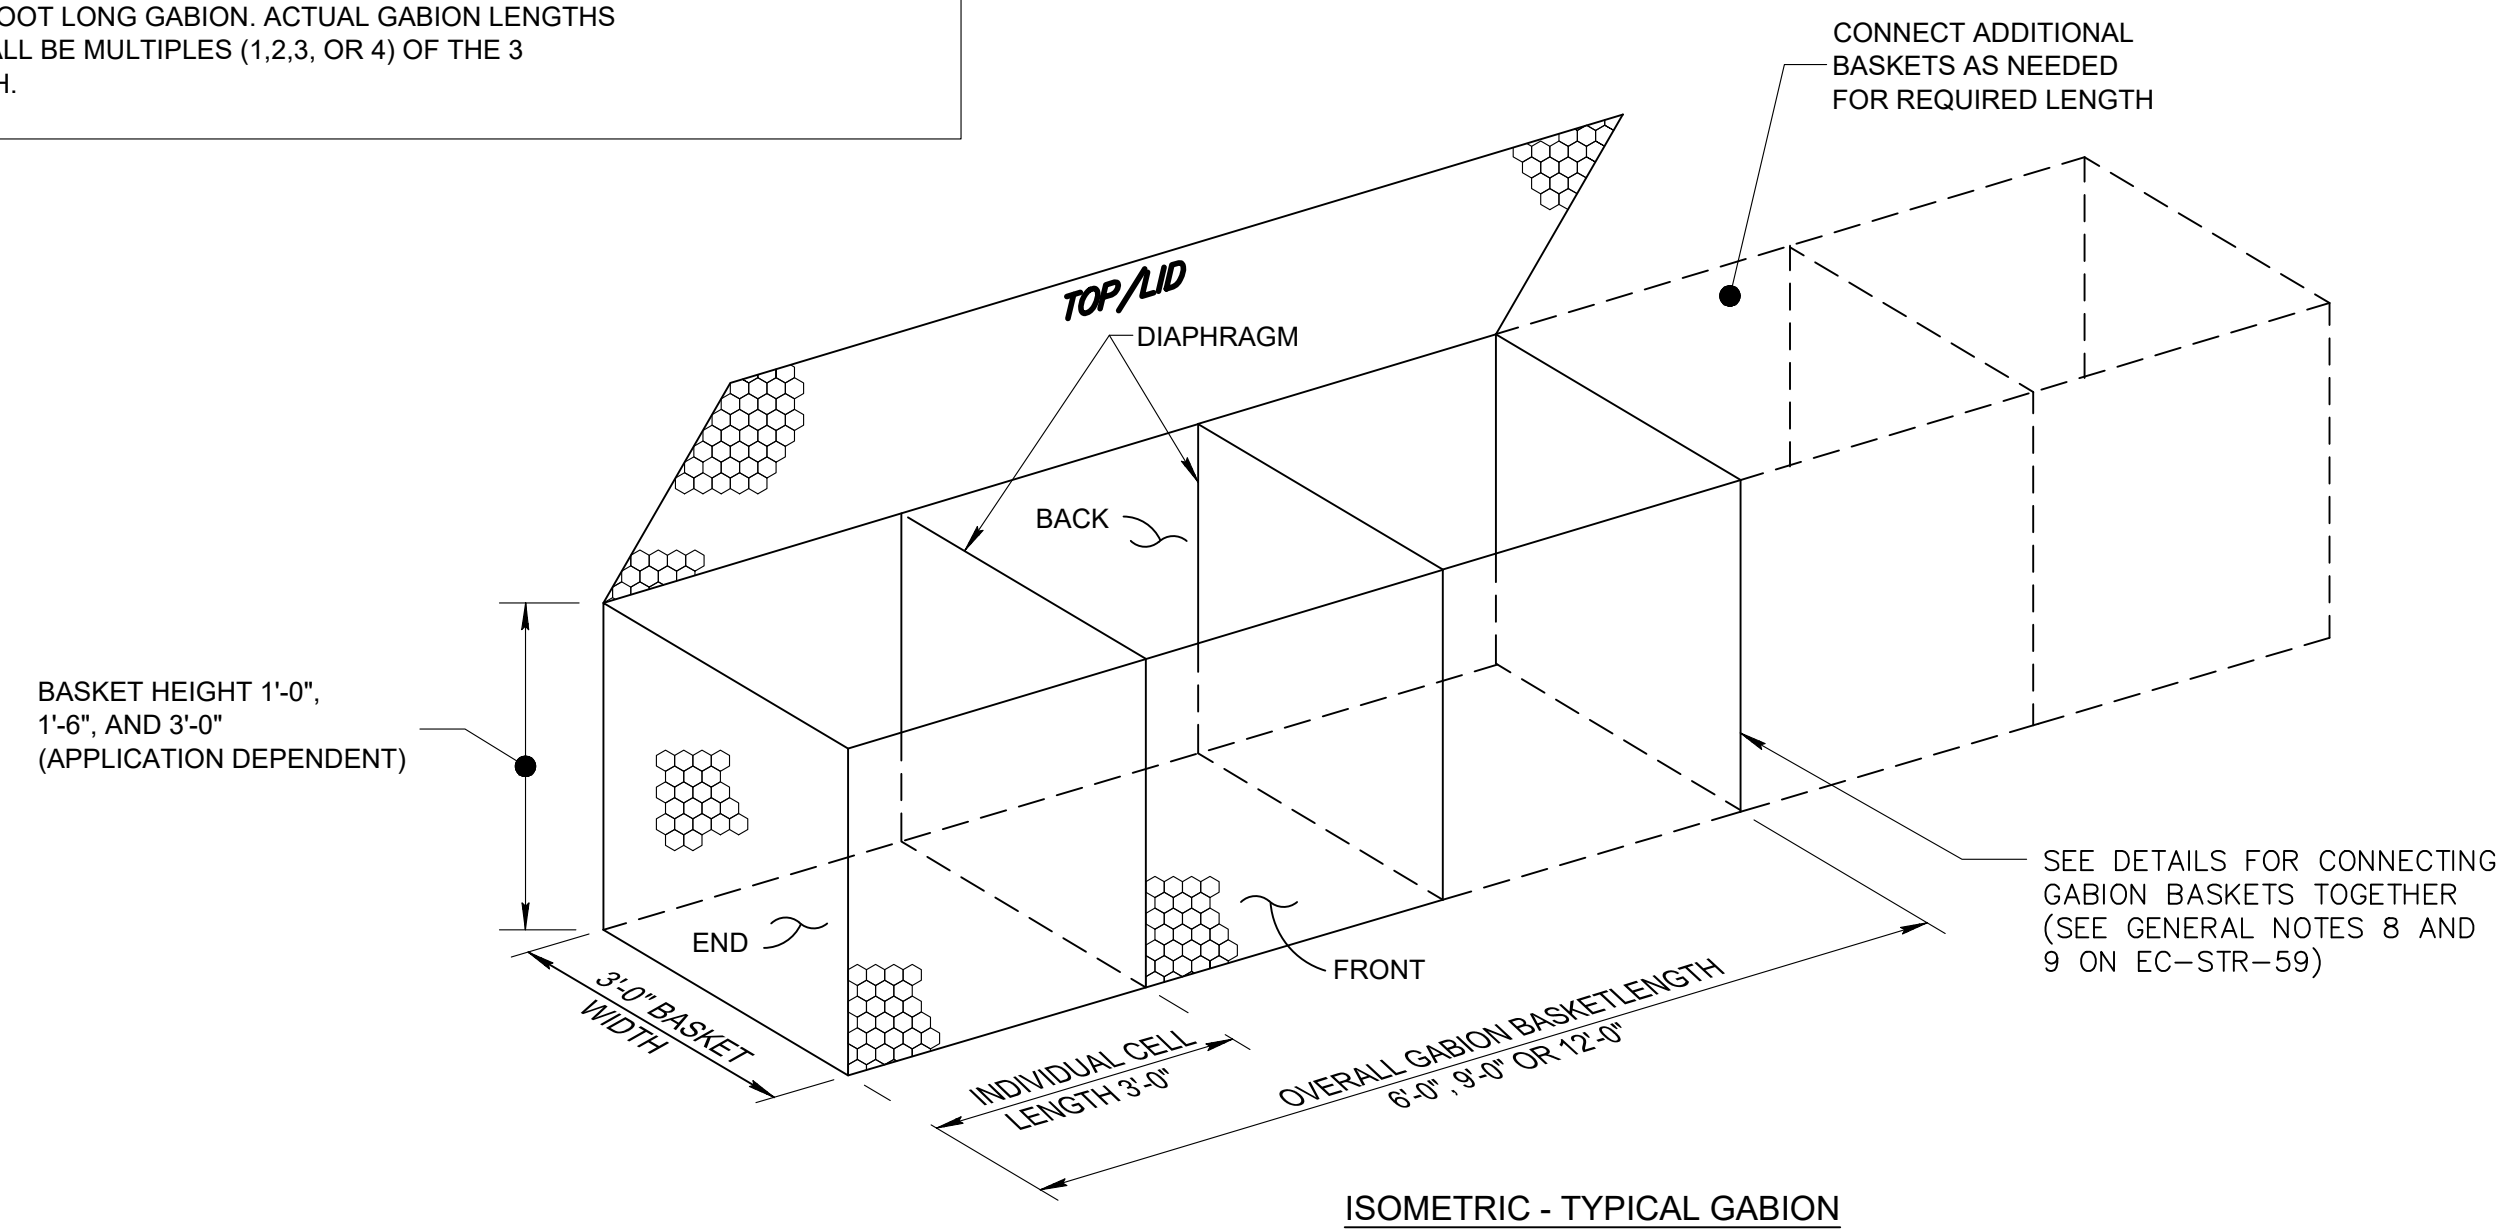

6

NOT TO SCALE

9 GAGE DIAGONAL STIFFENER
HOOKED AT INTERSECTION OF
WELDED WIRES.

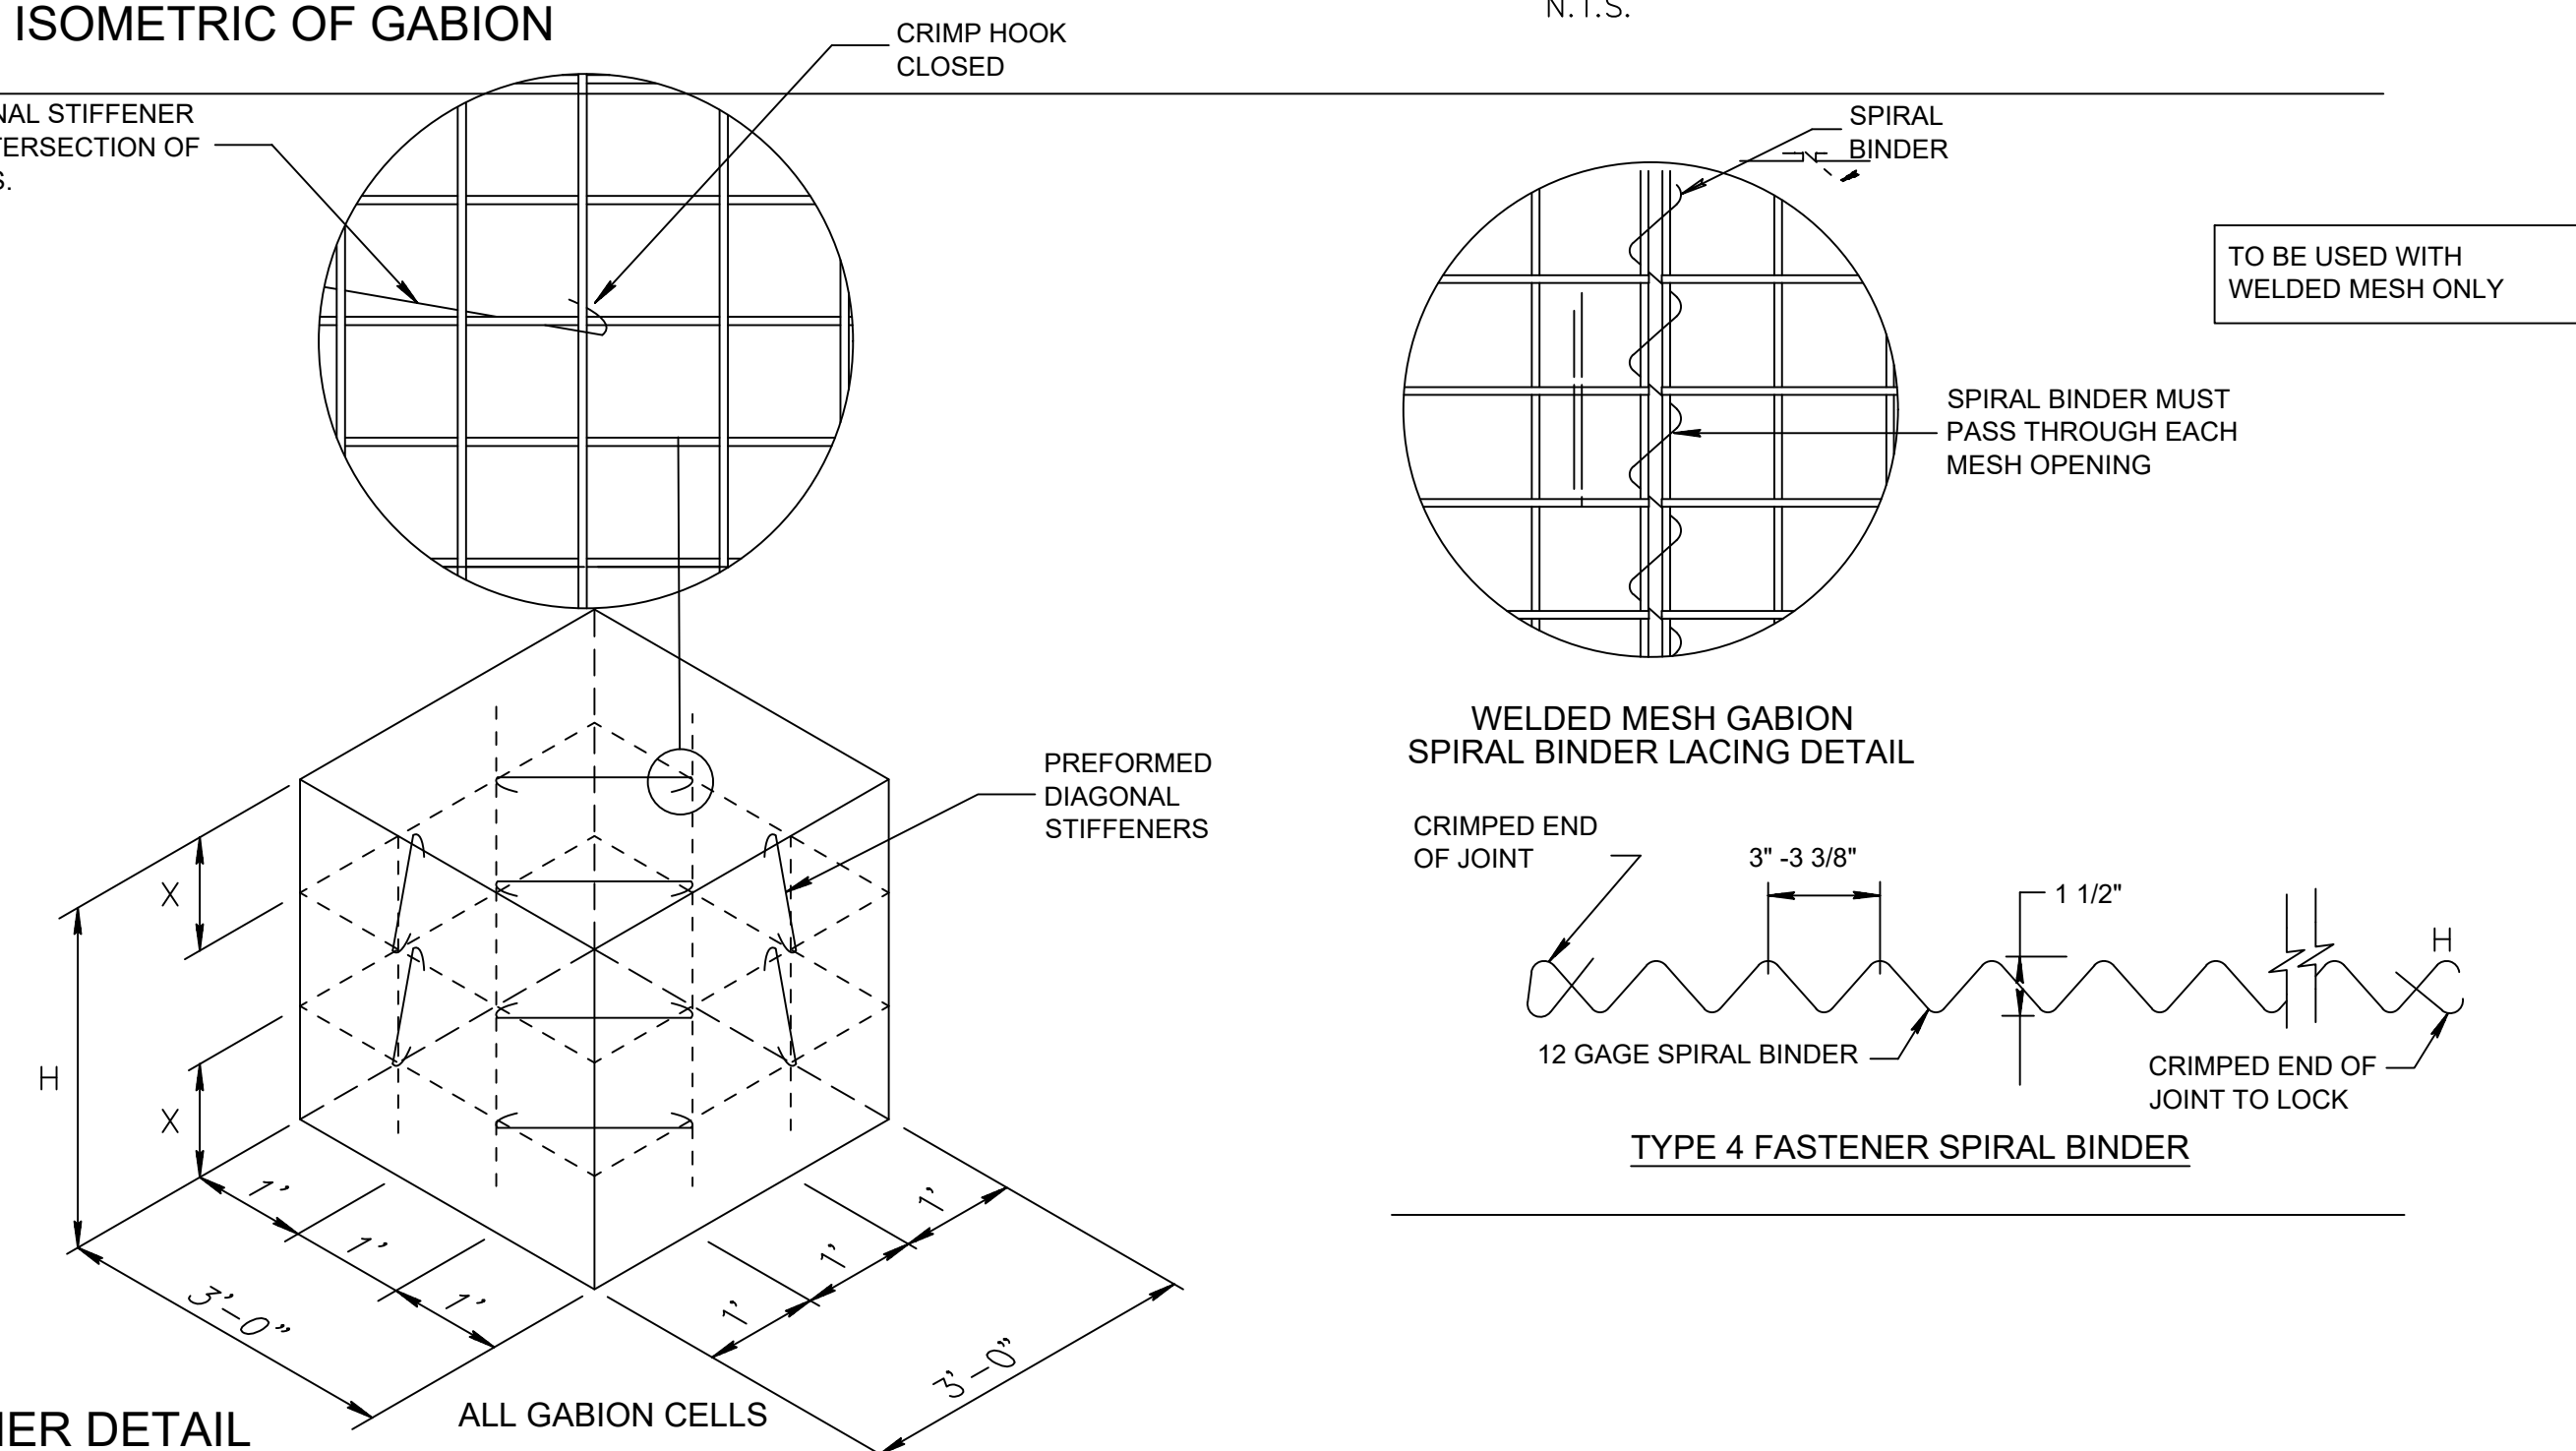


(

NOT TO SCALE


CELL HEIGHT H (FT)	DIAGONAL STIFFENER SPACING, X
3'-0"	1/3H & 2/3H
1'-6"	1/2H
1'-0"	NONE

OPTIONAL DIAGONAL CORNER STIFFENERS FOR WELDED WIRE GABION BASKETS

N.T.S.

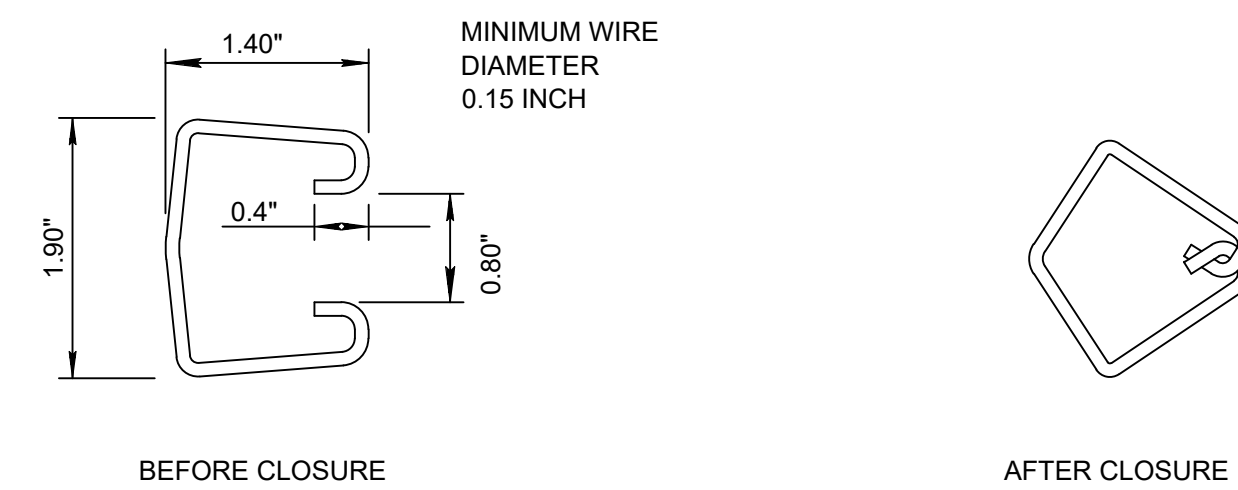

TYPE 1 FASTENER INTERLOCKING WIRE

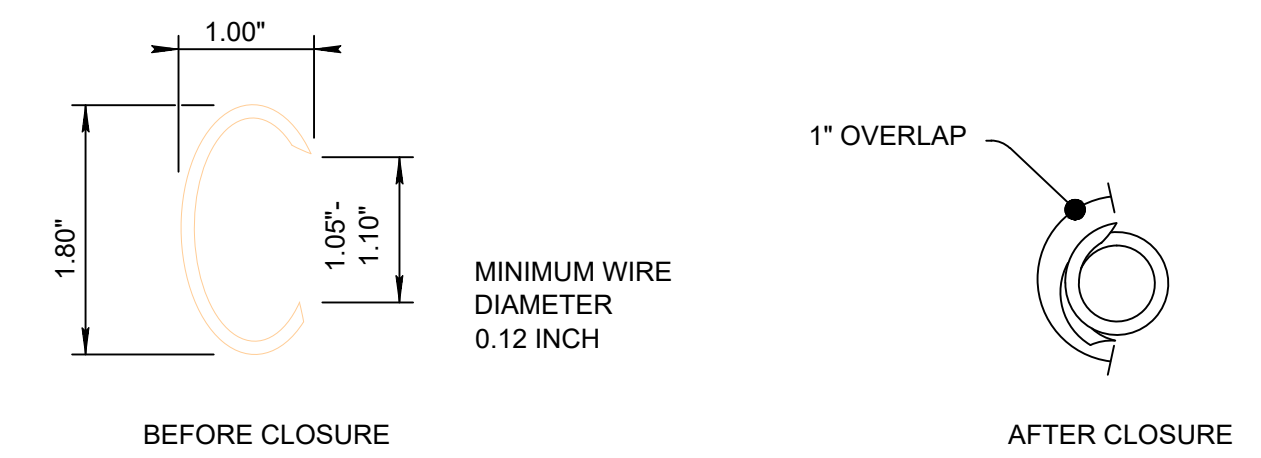


TYPE 2 FASTENER OVERLAPPING RING

NOTE: DIMENSIONS SHOWN ARE NOMINAL

INSTALL TYPE 1 OR TYPE 2 FASTENERS AT EACH MESH OPENING ALONG GABION BASKET EDGE.

(

NOT TO SCALE

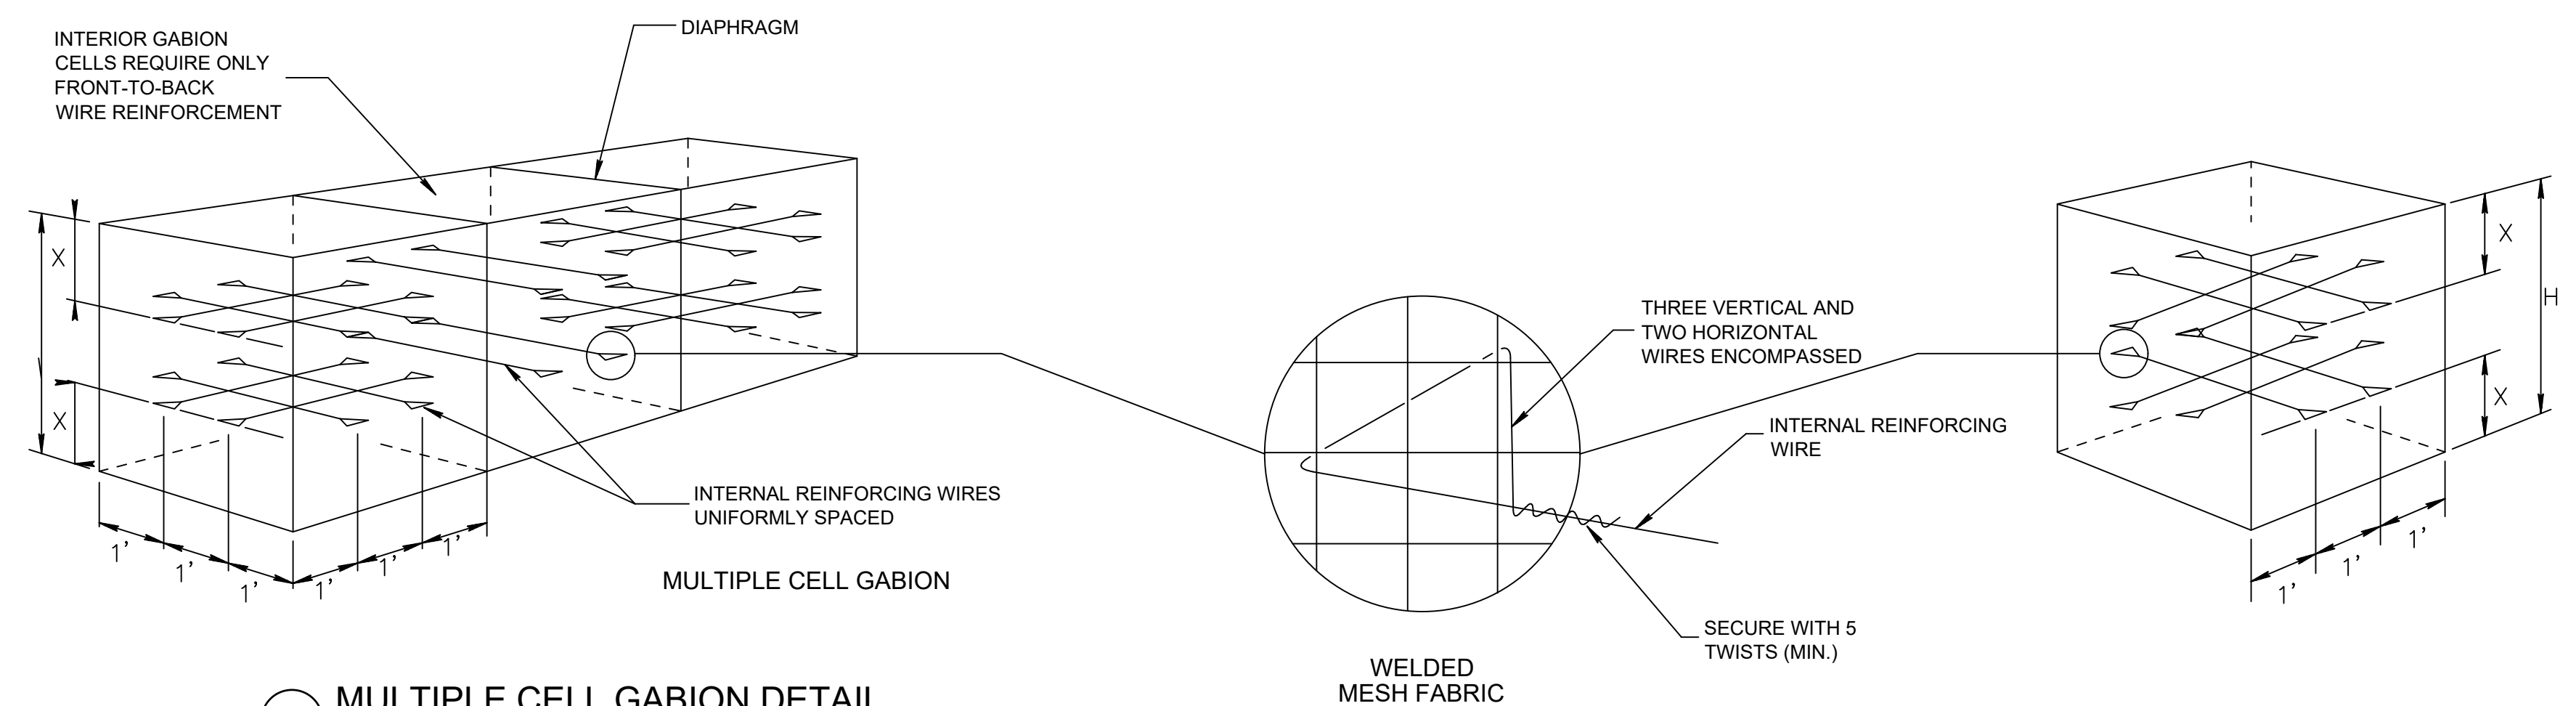

(

NOT TO SCALE

GABION CHECK DAM COMPONENT PROPERTIES *				
TYPE OF WIRE	MESH SIZE (INCHES)	U.S WIRE (GAGE)	GALVANIZED ZINC COATING (OZ/S.F.)	TOTAL DIAMETER CORE WIRE (INCHES)
WELDED WIRE MESH	3.00 X 3.00	12	0.8	0.105
SELVEDGE	—	10	0.8	0.130
LACING WIRE	—	13.5	0.8	0.087
INTERNAL REINFORCING WIRE	—	13.5	0.8	0.087
SPIRAL BINDER	—	12	0.8	0.105

* ALL COMPONENTS SHALL BE HOT-DIPPED GALVANIZED STEEL (SEE NOTE 6B REGARDING WELDED MESH GABIONS).

SINGLE CELL GABION	
CELL HEIGHT H (FT)	TIE WIRE SPACING, X
3'-0"	1/3H & 2/3H
1'-6"	1/2H
1'-0"	NONE

PLACEMENT OF INTERNAL CONNECTING WIRE REINFORCEMENT

N.T.S.

STRUCTURAL GENERAL NOTES

1.

ELEVATIONS GIVEN ON THE PLANS ARE TO TOP (UNLESS NOTED OTHERWISE) OF BEAMS, WALLS, ETC. WITH RESPECT TO THE REFERENCE ELEVATION OF THE FINISHED FLOOR. ELEVATIONS FOR LINTELS ARE TO THE BOTTOM OF LINTELS.
2.

GOVERNING BUILDING CODE: 2021 INTERNATIONAL BUILDING CODE (IBC).
3.

CONTRACTOR TO VERIFY ALL FIELD CONDITIONS AND DIMENSIONS PRIOR TO FABRICATION OR INSTALLATION OF ITEMS.
4.

STRUCTURAL DRAWINGS SHALL BE USED IN CONJUNCTION WITH THE ARCHITECTURAL, MECHANICAL, ELECTRICAL, SHOP DRAWINGS, AND SPECIFICATIONS.
5.

THE COMPLETED LATERAL-FORCE RESISTING SYSTEMS AND DIAPHRAGMS ARE REQUIRED FOR THE STRUCTURE TO RESIST LATERAL LOADS AND PROVIDE STABILITY UNDER GRAVITY LOADS. DURING THE CONSTRUCTION PROCESS, THE CONTRACTOR SHALL PROVIDE ALL REQUIRED BRACING DURING CONSTRUCTION TO MAINTAIN THE STABILITY AND SAFETY OF ALL STRUCTURAL ELEMENTS UNTIL THE LATERAL-LOAD RESISTING OR STABILITY-PROVIDING SYSTEM IS COMPLETELY INSTALLED AND THE STRUCTURE IS COMPLETELY TIED TOGETHER.
6.

UNLESS OTHERWISE NOTED, DETAILS SHOWN ON ANY DRAWING ARE TO BE CONSIDERED TYPICAL FOR ALL SIMILAR CONDITIONS.
7.

GOVERNING DESIGN CODE IS THE INTERNATIONAL BUILDING CODE 2021 EDITION.

7.1.

RISK CATEGORY: II

7.2.

LIVE LOADS

7.2.1.

ROOF LIVE LOAD: 20 PSF

7.3.

DEAD LOADS

7.3.1.

SHOWER HOUSE TYPICAL ROOF DEAD LOAD: 20 PSF TOP CHORD, 20 PSF BOTTOM CHORD + STRUCTURE WT.+SPECIFIC EQUIP. LOADS

7.3.1

WOOD SHED TYPICAL ROOF DEAD LOAD: 10 PSF

7.4.

SEISMIC LOAD

7.4.1.

RISK CATEGORY: II

7.4.2.

IMPORTANCE FACTOR: 1.00

7.4.3.

SITE CLASS: "D"

7.4.4.

MAPPED SPECTRAL RESPONSE COEFFICIENTS: S_s=0.072 S₁=0.058

7.4.5.

SEISMIC DESIGN CATEGORY: "B"

7.4.6.

SPECTRAL RESPONSE COEFFICIENTS: S_{ds} = 0.077 S_{d1} = 0.093

7.4.7.

ANALYSIS PROCEDURE USED (SHOWER HOUSE): EQUIVALENT LATERAL FORCE PROCEDURE

7.4.8.

ANALYSIS PROCEDURE USED (WOOD SHED): DETERMINED BY BUILDING MANUFACTURER

7.4.9.

SEISMIC RESPONSE COEFFICIENT (SHOWER HOUSE): C_s = 0.026

7.4.10.

SEISMIC RESPONSE COEFFICIENT C_s (WOOD SHED): DETERMINED BY BUILDING MANUFACTURER

7.4.11.

BASIC SEISMIC FORCE-RESISTING SYSTEM (SHOWER HOUSE): ORDINARY PRECAST SHEAR WALLS

7.4.12.

BASIC SEISMIC FORCE-RESISTING SYSTEM (WOOD SHED): DETERMINED BY BUILDING MANUFACTURER

7.4.13.

RESPONSE MODIFICATION FACTOR (SHOWER HOUSE): R = 3.0

7.4.14.

RESPONSE MODIFICATION FACTOR, R (WOOD SHED): DETERMINED BY BUILDING MANUFACTURER

7.5.

WIND PRESSURE ON BUILDING

7.5.1.

BASIC WIND SPEED (3-SECOND GUST): 115 MPH

7.5.2.

RISK CATEGORY: II

7.5.3.

EXPOSURE CLASSIFICATION: B

7.5.4.

INTERNAL PRESSURE COEFFICIENT: ± 0.18

7.6.

SOIL NET ALLOWABLE BEARING CAPACITY: 1500 PSF

7.7.

ROOF SNOW LOADS

7.7.1.

GROUND SNOW LOAD: P_g = 25 PSF

7.7.2.

FLAT-ROOF SNOW LOAD (SHOWER HOUSE): P_f = 20 PSF

7.7.3.

FLAT-ROOF SNOW LOAD (WOOD SHED): P_f = 21 PSF

7.7.4.

SNOW EXPOSURE FACTOR, C_e = 1.0

7.7.5.

SNOW LOAD IMPORTANCE FACTOR, I = 1.0

7.7.6.

THERMAL FACTOR (SHOWER HOUSE): C_t = 1.1

7.7.7.

THERMAL FACTOR (WOOD SHED): C_t = 1.2

7.8.

WOOD SHED: REFER TO SPECIFICATION SECTION 13 3400 ENGINEERED POST FRAME STRUCTURES.

8.

CONCRETE

8.1.

CONCRETE SHALL BE 4,500 PSI, STRENGTH ATTAINABLE AFTER 28 DAYS (ASTM C39). SLAB-ON-GRADE CONCRETE SHALL BE 4,000 PSI AT 28 DAYS. SLUMP OF CONCRETE SHALL BE TESTED ON SITE AT TIME OF DELIVERY AND SHALL NOT EXCEED 4". ALL FORMED SURFACES SHALL BE DAMPENED; PLACE CONCRETE IN SUCCESSIVE LIFTS NOT TO EXCEED 48" IN HEIGHT IN WALLS. WHILE PLACING,VIBRATE MIXTURE AND TAMP FORMS TO ENSURE CONSOLIDATION OF MATERIAL IN FORMWORK. SEE SPECIFICATIONS FOR ADDITIONAL MATERIAL AND CURE REQUIREMENTS.

8.2.

CONCRETE FINISH

8.2.1.

SLAB-ON-GRADE: WHERE CONCRETE DENSIFIER IS CALLED OUT ON ARCHITECTURAL DRAWINGS, FINISH CONCRETE SURFACE USING BROOM FINISH. APPLY CONCRETE DENSIFIER/HARDENER TO SURFACE OF FRESH CONCRETE PER MANUFACTURER REQUIREMENTS. DO NOT OVER APPLY PRODUCT. DO NOT ALLOW MATERIAL TO PUDDLE ON THE SURFACE. APPROVED PRODUCT: LIQUI-HARD ULTRA BY W.R. MEADOWS.

8.2.2.

FOR REMAINING SURFACES, REFER TO SPECIFICATIONS.

8.3.

REINFORCING: MILD STEEL REINFORCING MINIMUM YIELD STRENGTH 60 KSI. EPOXY COATED WHERE INDICATED.

8.4.

REINFORCEMENT PROTECTION:

8.4.1.

CONCRETE PLACED AGAINST EARTH: 3"

8.4.2.

CONCRETE PLACED IN FORMS BUT EXPOSED TO WEATHER OR EARTH:

8.4.2.1.

BARS #5 AND SMALLER: 2"

8.4.2.2.

BARS LARGER THAN #5: 2"

8.4.2.3.

STRUCTURAL SLABS (TOP AND BOTTOM): 2"

8.5.

NO SPLICES OF REINFORCEMENT PERMITTED EXCEPT AS DETAILED OR AUTHORIZED BY ENGINEER. MAKE BARS CONTINUOUS AROUND CORNERS. WHERE PERMITTED PROVIDE SPLICES BY CONTACT LAP. WHERE CLASSES ARE NOT CALLED OUT ON DRAWINGS USE CLASS "B" TENSION SPLICE.

8.6.

DETAIL BARS IN ACCORDANCE WITH "ACI DETAILING MANUAL", PUBLICATION SP-66, AND "BUILDING CODE REQUIREMENTS FOR REINFORCED CONCRETE", ACI 318.

8.7.

ROUGHEN ALL CONSTRUCTION JOINTS TO AN AMPLITUDE OF AT LEAST 1/4".

9.

METALS

9.1.

STRUCTURAL STEEL: MINIMUM YIELD STRENGTH 50 KSI FOR WIDE FLANGES, 35 KSI FOR PIPE, 50 KSI FOR TUBES, AND 36 KSI ALL ELSE UNLESS NOTED OTHERWISE. REFER TO THE SPECIFICATIONS FOR REQUIREMENTS.

9.2.

USE STANDARD FRAMED BEAM CONNECTIONS FOR WIDE FLANGE AND CHANNEL CONNECTIONS AND SINGLE PLATE SHEAR CONNECTIONS FOR PIPE AND HSS CONNECTIONS MEETING REQUIREMENTS OF AISC "STEEL CONSTRUCTION MANUAL", 15TH EDITION, WITH 3/4" MINIMUM DIAMETER A325 BOLTS (OR WELDED EQUIVALENT) UNLESS OTHERWISE NOTED. MINIMUM OF TWO (2) ROWS OF BOLTS PER CONNECTION. SIZE CONNECTION FOR 3/4 OF TOTAL UNIFORM LOAD CAPACITY OF THE BEAMS.

9.3.

USE E70XX ELECTRODES FOR ALL SHOP AND FIELD WELDS. PROVIDE WELD SIZE IN ACCORDANCE WITH THE AISC SPECIFICATIONS, BUT NOT LESS THAN 3/16" FILLET, CONTINUOUS UNLESS OTHERWISE NOTED.

9.4.

WELDERS: SHOW CURRENT EVIDENCE OF PASSING THE APPROPRIATE A.W.S. CERTIFICATION TESTS.

9.5.

THERE SHALL BE NO FIELD CUTTING OF STRUCTURAL STEEL MEMBERS FOR THE WORK OF OTHER TRADES WITHOUT PRIOR APPROVAL OF THE ENGINEER.

9.6.

ALL STRUCTURAL STEEL SHALL BE PRIME PAINTED. SEE ARCHITECTURAL FOR FINISH SCHEDULE.

9.7.

ALL EXTERIOR AND INTERIOR EXPOSED STRUCTURAL STEEL SHALL RECEIVE THE FOLLOWING COATING SYSTEM:

1.

TNEMEC SERIES N69 H.B. EPOXOLINE II (TWO COATS AT 3 MILS.)

2.

TNEMEC SERIES 1075U ENDURA-SHIELD II (ONE COAT AT 3 MILS.)

10.

FOUNDATIONS

10.1.

THE GENERAL CONTRACTOR SHALL BE REQUIRED TO READ AND FOLLOW ALL RECOMMENDATIONS IN THE SOILS INVESTIGATION REPORT THAT WAS CONDUCTED BY TEAM SERVICES (SUBMITTED ON JANUARY 27, 2015). TEAM SERVICES' PROJECT NUMBER 1-3658.

10.2.

FOUNDATIONS DESIGNED FOR ASSUMED BEARING CAPACITY LISTED ABOVE. SEE SPECIFICATION FOR STRUCTURAL EXCAVATION, BACKFILL, AND SOIL COMPACTION REQUIREMENTS.

10.3.

CONTRACTOR SHALL VERIFY IN-SITU SOIL BEARING CAPACITY AND SHALL NOTIFY ENGINEER OF ANY UNUSUAL SOIL CONDITIONS THAT ARE IN VARIANCE WITH THE ASSUMED BEARING PRESSURE.

11.

SEALANTS

11.1.

FLOOR SEALANTS AND CONSTRUCTION JOINT SEALANTS: REFER TO ARCHITECTURAL DRAWINGS AND SPECIFICATIONS.

12.

MASONRY

12.1.

MASONRY MATERIALS AND CONSTRUCTION SHALL COMPLY WITH THE REQUIREMENTS OF "SPECIFICATION FOR MASONRY STRUCTURES AND RELATED COMMENTARIES" (TMS 602) PUBLISHED BY THE MASONRY SOCIETY, EXCEPT WHERE REQUIREMENTS ARE EXCEEDED BY THESE CONTRACT DOCUMENTS. REFER TO THE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.

12.2.

MORTAR AND GROUT

12.2.1.

PORTLAND CEMENT, ASTM C150, TYPE I, WITHOUT AIR ENTRAINMENT, OF NATURAL COLOR.

12.2.2.

USE TYPE III HIGH-EARLY-STRENGTH AS REQUIRED FOR LAYING MASONRY IN COLD WEATHER.

12.2.3.

MASONRY CEMENT, ASTM C91, NON-STAINING, EXCEPT WITH 12% MAXIMUM AIR CONTENT BY VOLUME.

12.2.4.

HYDRATED LIME, ASTM C207, TYPE S.

12.2.5.

AGGREGATES, ASTM C144, EXCEPT FOR JOINTS LESS THAN 1/4-INCH USE AGGREGATE GRADED WITH 100% PASSING THE NO. 16 SIEVE.

12.2.6.

MORTAR FOR CONCRETE MASONRY UNITS SHALL BE NATURAL LIGHT GREY, TYPE S CEMENT-LIME MORTAR CONFORMING TO THE PROPORTION SPECIFICATION OF ASTM C270.

12.2.7.

GROUT FOR CONCRETE MASONRY UNIT BOND BEAMS, GROUTED VOIDS/CORES, OR LINTELS:

12.2.7.1.

COMPLY WITH ASTM C476. PROPORTIONS ESTABLISHED BY 28-DAY COMPRESSIVE STRENGTH TESTS IN ACCORDANCE WITH TEST METHOD C1019 THAT OBTAIN THE SPECIFIED COMPRESSIVE STRENGTH. THE MINIMUM 28-DAY COMPRESSIVE STRENGTH OF GROUT SHALL BE NOT LESS THAN 2500 PSI AND F'M (NET AREA COMPRESSIVE STRENGTH OF MASONRY).

12.2.7.2.

USE GROUT OF TYPE INDICATED OR, IF NOT OTHERWISE INDICATED, OF TYPE (FINE OR COARSE) THAT WILL COMPLY WITH TABLE 1.16.1 IN ACI 530.1/ASCE 6/TMS 602 FOR DIMENSIONS OF GROUT SPACES AND POUR HEIGHT.

12.2.7.3.

PROVIDE GROUT WITH A SLUMP OF 8 TO 10 INCHES AS MEASURED ACCORDING TO ASTM C 143/C 143M.

12.3.

CONCRETE MASONRY UNITS

12.3.1.

DEVELOP 2000 PSI ULTIMATE COMPRESSIVE STRENGTH (F'M) IN 28 DAYS.

12.3.2.

CONCRETE MASONRY UNITS SHALL BE MODULAR, NOMINAL SIZED TWO CORE UNITS, WITH WIDTH AND FACE FINISH, PLAIN OR SPLIT FACE BLOCK AS INDICATED IN DRAWINGS (MEETING ASTM C140). UNITS EXPOSED TO THE EXTERIOR SHALL HAVE A WATER REPELLING ADMIXTURE INCORPORATED DURING MANUFACTURE. ALL COURSING SHALL BE LAID IN RUNNING BOND PATTERN.

12.3.3.

CONCRETE BLOCK SHALL BE MANUFACTURER'S STANDARD UNITS WITH NOMINAL FACE DIMENSIONS OF 16" LONG X 8" HIGH (15-5/8" X 7-5/8" ACTUAL), UNLESS OTHERWISE INDICATED. PROVIDE SPECIAL SHAPES FOR LINTELS, CORNERS, JAMBS, SASH, CONTROL JOINTS, HEADERS, BONDING, AND OTHER SPECIAL CONDITIONS.

12.3.4.

PROVIDE BULLNOSE BLOCK FOR EXPOSED OUTSIDE CORNERS AT INTERIOR WALLS.

12.4.

MASONRY JOINT REINFORCEMENT

12.4.1.

GENERAL

12.4.1.1.

ASTM A 951

12.4.1.2.

INTERIOR WALLS: HOT-DIP GALVANIZED, CARBON STEEL

12.4.1.3.

WIRE SIZE FOR SIDE RODS: W1.7 OR 0.148 INCH DIAMETER

12.4.1.4.

WIRE SIZE FOR CROSS RODS: W1.7 OR 0.148-INCH DIAMETER.

12.4.1.5.

PROVIDE IN LENGTHS OF NOT LESS THAN 10 FEET (3 M), WITH PREFABRICATED CORNER AND TEE UNITS.

12.4.1.6.

MASONRY JOINT REINFORCEMENT FOR SINGLE-WYTHE MASONRY: EITHER LADDER OR TRUSS TYPE WITH SINGLE PAIR OF SIDE RODS.

12.5.

MASONRY REINFORCEMENT

12.5.1.

REINFORCE INTERIOR 8" AND 6" MASONRY WALLS WITH HORIZONTAL JOINT REINFORCEMENT AT 16" O.C. UNLESS DETAILED OTHERWISE OR AUTHORIZED BY ENGINEER.

12.5.2.

REINFORCE ALL MASONRY WALLS WITH VERTICAL BARS AS SHOWN ON THE DRAWINGS. REINFORCING BARS: DEFORMED BARS, MINIMUM YIELD STRENGTH 60 KSI, CENTER REINFORCING IN WALLS.

12.5.3.

SPLICES NOT PERMITTED IN REINFORCING BARS EXCEPT AS DETAILED OR AUTHORIZED BY ENGINEER. WHERE PERMITTED, SPLICES MADE BY CONTACT LAPS, A MINIMUM OF 60 BAR DIAMETERS.

12.5.4.

FILL VOIDS AND BLOCK CELLS SOLIDLY WITH GROUT FULL HEIGHT AND 12" EACH SIDE OF BEAM REACTIONS OR OTHER CONCENTRATED LOADS IF NOT OTHERWISE REINFORCED

12.5.5.

UNLESS NOTED OTHERWISE, PROVIDE:

12.5.5.1.

(1) #5 BAR VERTICALLY IN GROUTED CELLS IMMEDIATELY ADJACENT TO ENDS OF WALLS, VERTICAL CONTROL JOINTS, WALL INTERSECTIONS, WALL CORNERS AND EACH SIDE OF WALL OPENINGS.

12.5.6.

ALL MASONRY WALLS SHALL HAVE VERTICAL CONTROL JOINTS AT A MAXIMUM SPACING OF 25 FEET. COORDINATE CONTROL JOINTS WITH LOCATIONS INDICATED ON ARCHITECTURAL DRAWINGS.

12.6.

INSTALLATION

12.6.1.

JOINTS TO BE FINISHED CONCAVE.

12.6.2.

LAY HOLLOW CONCRETE MASONRY UNITS WITH FULL MORTAR COVERAGE ON HORIZONTAL AND VERTICAL FACE SHELLS. FULL MORTAR BED JOINT AT BASE OF WALLS, ON TOP OF FOUNDATIONS WALLS AND FOOTINGS, AND IN ALL COURSES ON PIERS, COLUMNS AND PILASTERS, AND WHERE ADJACENT TO CELLS OR CAVITIES TO BE REINFORCED OR FILLED WITH CONCRETE OR GROUT.

12.6.3.

DOWELS IN FOOTINGS SHALL BE PLACED TO ALIGN WITH CORES CONTAINING REINFORING STEEL. COORDINATE PLACEMENT BEFORE CONSTRUCTION OF FOOTING BEGINS.

12.6.4.

THE CONCRETE MASONRY WALLS WERE DESIGNED TO SPAN VERTICALLY AND BE BRACED BY THE ROOF AND FLOOR FRAMING ELEMENTS OF THE STRUCTURE. DURING CONSTRUCTION THE MASONRY CONTRACTOR SHALL PROVIDE LATERAL BRACING UNTIL THE ROOF STRUCTURE IS INSTALLED AS RECOMMENDED BY TMS 402 AND THE LATEST REVISION OF "STANDARD PRACTICE FOR BRACING MASONRY WALLS UNDER CONSTRUCTION", PREPARED BY THE COUNCIL FOR MASONRY WALL BRACING.

13.

WOOD

13.1.

FOR WOOD SHED, REFER TO SPECIFICATION SECTION 13 3400 ENGINEERED POST FRAME STRUCTURES FOR DESIGN AND CONSTRUCTION REQUIREMENTS.

13.2.

FOR WOOD TRUSSES, REFER TO SPECIFICATION SECTION 06 1753 SHOP-FABRICATED WOOD TRUSSES FOR DESIGN AND CONSTRUCTION REQUIREMENTS.

13.3.

ALL METAL TO WOOD OR WOOD TO WOOD CONNECTIONS SHALL BE STANDARD OR AS DETAILED ON THE DRAWINGS. ALL GALVANIZED BOLTS AND LAG SCREW HEADS IN CONTACT WITH WOOD SHALL HAVE PLATES OR WASHERS AS DETAILED OR SPECIFIED. THE MINIMUM SIZE WASHER EQUALS 2" DIAMETER.

13.4.

ALL FRAMING ANCHORS, HURRICANE TIES, AND HANGERS INDICATED ON THE DRAWINGS ARE GALVANIZED "SIMPSON COMPANY" OR EQUAL, UNLESS OTHERWISE DETAILED, ALL BEAMS AND JOISTS SHALL RECEIVE HANGERS WITH A NORMAL LOAD CAPACITY EQUAL TO THE SHEAR CAPACITY OF THE SUPPORTED MEMBER. HANGERS LOCATED IN CONTACT WITH TREATED WOOD OR WET CONDITIONS SHALL BE Z-MAX OR STAINLESS STEEL.

13.5.

LAG SCREWS SHALL BE PRE-DRILLED WITH LEAD HOLES AS FOLLOWS:

13.5.1.

THE LEAD HOLE FOR THE SHANK SHALL HAVE THE SAME DIAMETER AS THE SHANK, AND THE SAME DEPTH AS THE LENGTH OF THE UNTREADED SHANK.

13.5.2.

THE LEAD HOLE FOR THE THREADED PORTION SHALL HAVE A DIAMETER EQUAL TO 60% TO 70% OF THE SHANK DIAMETER AND A LENGTH EQUAL TO AT LEAST THE LENGTH OF THE THREADED PORTION.

13.6.

WOOD SCREWS SHALL BE PRE-DRILLED WITH LEAD HOLES. THE PART OF THE HOLE RECEIVING THE SHANK SHALL BE ABOUT 7/8X THE DIAMETER OF THE SHANK AND THAT FOR THE THREADED PORTION SHALL BE ABOUT 7/8X THE DIAMETER OF THE SCREW AT THE ROOT OF THE THREAD.

13.7.

MINIMUM NAILING SHALL BE ACCORDING TO NAILING PATTERN AS INDICATED ON THE DRAWINGS.

13.8.

PREFABRICATED OPEN WEB TRUSSES SHALL BE CASCADE LUMBER OR APPROVED EQUAL. TRUSSES SHALL BE DESIGNED BY THE MANUFACTURER FOR THE SPANS AND CONDITIONS SHOWN ON THE PLANS AND SHALL BE FURNISHED AND INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S PUBLISHED SPECIFICATIONS. ALL NECESSARY BRIDGING, BLOCKING, PRE-NOTCHED PLATES, ETC., SHALL BE DETAILED AND FURNISHED BY THE MANUFACTURER. SUBMIT SHOP DRAWINGS AND DESIGN CALCULATIONS (COMPLETE WITH STRESS DIAGRAMS) TO THE ARCHITECT AND STRUCTURAL ENGINEER FOR REVIEW PRIOR TO FABRICATION. DESIGN SUBMITTALS SHALL BEAR THE STAMP AND SIGNATURE OF A REGISTERED PROFESSIONAL ENGINEER IN THE STATE OF IOWA. PERMANENT AND TEMPORARY BRIDGING SHALL BE INSTALLED IN CONFORMANCE WITH MANUFACTURER'S SPECIFICATIONS.

13.9.

BUILDING INTERIOR AND EXTERIOR WALLS ARE NOT Laterally SELF-SUPPORTING. PREFABRICATED OPEN WEB TRUSSES, BRIDGING, BLOCKING, AND CONNECTIONS SHALL BE DESIGNED TO BRACE WALLS FOR CODE PRESCRIBED LOADS AND LOADS INDICATED.

14.

PRECAST CONCRETE

14.1.

PRECAST MANUFACTURER SHALL VERIFY WEIGHT OF PRECAST WITH ENGINEER PRIOR TO CONSTRUCTION.

14.2.

PRECAST ELEMENTS SHALL BE DESIGNED BY THE PRECAST MANUFACTURER ACCORDING TO THE APPLICABLE BUILDING CODE FOR GRAVITY AND LATERAL LOADS, INCLUDING BUILDING LOADS LISTED IN THESE NOTES AS WELL AS ANY OTHER ADDITIONAL LOADS INDICATED ON THE PLANS. SEE SPECIFICATIONS FOR DESIGN REQUIREMENTS.

14.3.

ALL EMBED PLATES AND CONNECTIONS SHALL BE STAINLESS STEEL. CONTROL HEAT DURING WELDING OF STAINLESS STEEL TO PREVENT CRACKING OF SURROUNDING CONCRETE. PRECAST CONNECTIONS AND LIFTING INSERTS SHALL BE CONCEALED OR RECESSED AND PATCHED.

14.4.

VERIFY OPENINGS THROUGH FLOORS AND WALLS WITH ARCHITECTURAL, MECHANICAL, ELECTRICAL, AND PROCESS REQUIREMENTS. CHANGES IN SIZE, LOCATION, OR NUMBER OF OPENINGS SHALL NOT BE PERMITTED WITHOUT WRITTEN APPROVAL BY THE ENGINEER.

15.

POST-INSTALLED ANCHORS

15.1.

ADHESIVE ANCHOR SYSTEMS USED IN CONCRETE AND MASONRY SHALL CONSIST OF ASTM A193 B7 RODS WITH HEAVY HEX NUTS AND WASHERS. ADHESIVE SHALL BE A TWO COMPONENT STRUCTURAL ADHESIVE INJECTED IN A DUAL CARTRIDGE DISPENSING SYSTEM THAT PROPERLY MIXES THE COMPONENTS AT THE POINT OF APPLICATION. ANCHORS SHALL BE HOT DIP GALVANIZED UNLESS NOTED OTHERWISE. ADHESIVE ANCHORING SYSTEM LISTED AS BASIS OF DESIGN ARE THE SIZE AND QUANTITY SHOWN IN THE DRAWINGS. ACCEPTABLE ALTERNATE ANCHORS SHALL MATCH THE SIZE, QUANTITY, AND CONFIGURATION WITH THE SAME CAPACITY OF THE BASIS OF DESIGN ANCHORS. PROVIDE ALTERNATE ANCHOR PRODUCT DATA TO THE STRUCTURAL ENGINEER FOR REVIEW AND APPROVAL.

15.2.

THE FOLLOWING SUMMARIZES THE ADHESIVE ANCHORS ALLOWED ON THE PROJECT:

15.2.1.

ANCHORING INTO CRACKED AND UNCRACKED CONCRETE: BASIS OF DESIGN - HILTI HIT-HY 200

15.2.2.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.3.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.4.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.5.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.6.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.7.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.8.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.9.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.10.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.11.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.12.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.13.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.14.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.15.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.16.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.17.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.18.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.19.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.20.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.21.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.22.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.23.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.24.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.25.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.26.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.27.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.28.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.29.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.30.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.31.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.32.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.33.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.34.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.35.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.36.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.37.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.38.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.39.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.40.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.41.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.42.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.43.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.44.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.45.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.46.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.47.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.48.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.49.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.50.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.51.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.52.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.53.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.54.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.55.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.56.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.57.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.58.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.59.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.60.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.61.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.62.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.63.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.64.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.65.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.66.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.67.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.68.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.69.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.70.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.71.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.72.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.73.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.74.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.75.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.76.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.77.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.78.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.79.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.80.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.81.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.82.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.83.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.84.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.85.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.86.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.87.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.88.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.89.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.90.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.91.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.92.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.93.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.94.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.95.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.96.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.97.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.98.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.99.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.100.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.101.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.102.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.103.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.104.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.105.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.106.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.107.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.108.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.109.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.110.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.111.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.112.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.113.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.114.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.115.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.116.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.117.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.118.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.119.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.120.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.121.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.122.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.123.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.124.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 270

15.2.125.

ANCHORING INTO HOLLOW AND GROUTED CMU: BASIS OF DESIGN - HILTI HIT-HY 2

SOILS	SERVICE	EXTENT	AGENT
1. VERIFY MATERIALS BELOW SHALLOW FOUNDATIONS ARE ADEQUATE TO ACHIEVE THE DESIGN	FIELD INSPECTION	PERIODIC	PE/GE/EIT
2. VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL	FIELD INSPECTION	PERIODIC	PE/GE/EIT
3. PERFORM SIEVE TESTS (ASTM D422 & D1140) AND MODIFIED PROCTOR TESTS (ASTM D1557) OF EACH SOURCE OF FILL MATERIAL	FIELD INSPECTION	PERIODIC	PE/GE/EIT
4. VERIFY USE OF PROPER MATERIALS, DENSITIES, AND LIFT THICKNESSES DURING PLACEMENT AND COMPACTION OF COMPACTED FILL. TEST DENSITY OF EACH LIFT OR FILL BY NUCLEAR METHODS (ASTM D2922)	FIELD INSPECTION	CONTINUOUS	PE/GE/EIT
5. PRIOR TO PLACEMENT OF COMPACTED FILL, OBSERVE SUBGRADE AND VERIFY THAT THE SITE HAS BEEN PREPARED PROPERLY	FIELD INSPECTION	PERIODIC	PE/GE/EIT


CONCRETE CONSTRUCTION	SERVICE	EXTENT	AGENT
1. INSPECT SIZE, SPACING, COVER, POSITIONING AND GRADE OF REINFORCING STEEL AND PRESTRESSING STEEL. VERIFY THAT REINFORCING BARS ARE FREE OF FORM OIL OR OTHER DELETERIOUS MATERIALS. INSPECT BAR LAPS AND MECHANICAL SPLICES. VERIFY THAT BARS ARE ADEQUATELY TIED AND SUPPORTED OF CHAIRS OR BOLSTERS.	FIELD INSPECTION	PERIODIC	ACI-CCI, ICC-RCSI
2. REINFORCING STEEL WELDING	FIELD INSPECTION		
A. VERIFICATION OF WELDABILITY OF STEEL OTHER THAN ASTM A706		PERIODIC	
B. INSPECT SINGLE PASS FILLET WELDS < 5/16"		PERIODIC	
C. ALL OTHER WELDS	CONTINUOUS		
3. INSPECT SIZE, POSITIONING, AND EMBEDMENT OF ANCHOR RODS. INSPECT CONCRETE PLACEMENTS AND CONSOLIDATION AROUND ANCHORS	FIELD INSPECTION	PERIODIC	
4. INSPECTION OF ANCHORS AND REINFORCING STEEL POST-INSTALLED IN HARDENED CONCRETE. PER RESEARCH REPORTS INCLUDING VERIFICATION OF ANCHOR TYPE, ANCHOR DIMENSIONS, HOLE DIMENSIONS, HOLE CLEANING PROCEDURES, ANCHOR SPACING, EDGE DISTANCES, CONCRETE MINIMUM THICKNESS, ANCHOR EMBEDMENT, AND TIGHTENING TORQUE.	FIELD INSPECTION	CONTINUOUS FOR HORIZONTAL OR UPWARDLY INCLINED ORIENTATIONS TO RESIST SUSTAINED TENSION LOADS. PERIODIC FOR ALL OTHER ACHORS	ACI-CCI, ICC-RCSI
5. REVIEW CONCRETE BATCH TICKETS AND VERIFY COMPLIANCE WITH APPROVED MIX DESIGN. VERIFY THAT WATER ADDED AT THE SITE DOES NOT EXCEED THAT ALLOWED BY THE MIX DESIGN	FIELD INSPECTION	PERIODIC	ACI-CCI, ICC-RCSI
6. TEST CONCRETE COMPRESSION STRENGTH (ASTM C31 & C39), SLUMP (ASTM C143), AIR-CONTENT (ASTM C231 OR C173) AND TEMPERATURE (ASTM C1064)	FIELD INSPECTION	CONTINUOUS	ACI-CFTT, ACI-STT
7. INSPECT PLACEMENT OF CONCRETE AND SHOTCRETE. VERIFY THAT CONCRETE CONVEYANCE AND DEPOSITING AVOIDS SEGREGATION OR CONTAMINATION. VERIFY THAT CONCRETE IS PROPERLY CONSOLIDATED.	FIELD INSPECTION	CONTINUOUS	ACI-CCI, ICC-RCSI
8. INSPECTION OF MAINTENANCE OF SPECIFIED CURING TEMPERATURE AND TECHNIQUES	FIELD INSPECTION	PERIODIC	ACI-CCI, ICC-RCSI
9. INSPECTION OF FORMWORK FOR SHAPE, LINES, LOCATION, AND DIMENSIONS	FIELD INSPECTION	PERIODIC	ACI-CCI, ICC-RCSI
10. CERTIFY IN-SITU CONCRETE STRENGTH, PRIOR TO STRESSING OF TENDONS IN POST-TENSIONED CONCRETE AND PRIOR TO REMOVAL OF SHORES AND FORMS FROM BEAMS AND STRUCTURAL SLAB.	FIELD TESTING AND REVIEW OF LABORATORY REPORTS	PERIODIC	
11. PERFORM FLOOR FLATNESS AND/OR LEVELNESS TESTING (ASTM E1155) FOR ALL SLAB-ON-GRADE AND ELEVATED SLAB PER SPECIFICATION.	FIELD INSPECTION	PERIODIC AT ALL BOLTED CONNECTIONS	ACI-CCI, ICC-RCSI

PRECAST CONCRETE CONSTRUCTION	SERVICE	EXTENT	AGENT
1. REVIEW PLANT OPERATIONS AND QUALITY CONTROL PROCEDURES	PCI CERTIFIED PLANT REQUIRED BY SPECIFICATION	PERIODIC	
2. ERECTION OF PRECAST CONCRETE MEMBERS			
A. INSPECT IN ACCORDANCE WITH CONSTRUCTION DOCUMENTS	FIELD INSPECTION	PERIODIC	
B. PERFORM INSPECTION OF WELDING AND BOLTING IN ACCORDANCE WITH STEEL CONSTRUCTION	FIELD INSPECTION	PERIODIC	
3. VERIFICATION OF IN-SITU CONCRETE STRENGTH, PRIOR TO STRESSING OF TENDONS IN POST TENSIONED CONCRETE AND PRIOR TO REMOVAL OF SHORES AND FORMS FROM BEAMS AND STRUCTURAL SLABS.	REVIEW FIELD TESTING AND LABORATORY REPORTS	PERIODIC	

STEEL CONSTRUCTION	SERVICE	EXTENT	AGENT
1. FABRICATOR CERTIFICATION	AISC CERTIFIED FABRICATOR REQUIRED BY SPECIFICATION		
2. MATERIAL VERIFICATION. REVIEW CERTIFIED MILL TEST REPORTS AND IDENTIFICATION MARKINGS ON WIDE-FLANGE SHAPES, HIGH STRENGTH BOLTS, NUTS, AND WELDING ELECTRODES	FIELD INSPECTION	PERIODIC	
3. EMBEDMENTS: VERIFY DIAMETER, GRADE, TYPE, LENGTH, AND EMBEDMENT. SEE CONCRETE CONSTRUCTION FOR ANCHORS	FIELD INSPECTION	PERIODIC	
4. VERIFY MEMBER LOCATIONS, BRACES, STIFFENERS, AND APPLICATION OF JOINT DETAILS AT EACH CONNECTION COMPLY WITH CONSTRUCTION DOCUMENTS	FIELD INSPECTION	PERIODIC	
5. STRUCTURAL STEEL WELDING:			
A. INSPECTION TASKS PRIOR TO WELDING (OBSERVE OR PERFORM FOR EACH WELDED JOINT OR MEMBER, THE QA TASKS LISTED IN AISC 360, TABLE N5.4-1)	FIELD INSPECTION	PERIODIC AT ALL WELDED JOINTS	
B. INSPECTION TASKS DURING WELDING (OBSERVE OR PERFORM FOR EACH WELDED JOINT OR MEMBER, THE QA TASKS LISTED IN AISC 360, TABLE N5.4-2)	FIELD INSPECTION	PERIODIC AT ALL WELDED JOINTS	
C. INSPECTION TASKS AFTER WELDING (OBSERVE OR PERFORM FOR EACH WELDED JOINT OR MEMBER, THE QA TASKS LISTED IN AISC 360, TABLE N5.4-3)	FIELD INSPECTION	PERIODIC AT ALL WELDED JOINTS	
D. NON-DESTRUCTIVE TESTING (NDT) OF WELDED JOINTS:			
1) COMPLETE PENETRATION WELDS WHEN REQUIRED BY ASIC 360, N5.5b	FIELD ULTRASONIC TESTING - 100%	PERIODIC	
2) WELDED JOINTS SUBJECT TO FATIGUE WHEN REQUIRED BY AISC 360, APPENDIX 3, TABLE A-3.2	FIELD RADIOGRAPHIC OR ULTRASONIC TESTING	PERIODIC	
3) FABRICATOR'S NDT REPORTS WHEN FABRICATOR PERFORMS NDT	VERIFY REPORTS	EACH SUBMITTAL	
6. STRUCTURAL STEEL BOLTING:			
A. INSPECTION TASKS PRIOR TO BOLTING (OBSERVE OR PERFORM TASKS FOR EACH BOLTED CONNECTION, IN ACCORDANCE WITH QA TASKS LISTED IN AISC 360, TABLE N5.6-1)	FIELD INSPECTION	PERIODIC AT ALL BOLTED CONNECTIONS	
B. INSPECTION TASKS DURING BOLTING (OBSERVE THE QA TASKS LISTED IN AISC 360, TABLE N5.6-2)	FIELD INSPECTION	PERIODIC AT ALL BOLTED CONNECTIONS	
1) PRE-TENSIONED AND SLIP-CRITICAL JOINTS			
a. TURN-OF-NUT WITH MATCHING MARKINGS		CONTINUOUS	
b. DIRECT TENSION INDICATOR		CONTINUOUS	
c. TWIST-OFF TYPE TENSION CONTROL BOLT		CONTINUOUS	
d. TURN-OF-NUT WITHOUT MATCHING MARKINGS		CONTINUOUS	
e. CALIBRATED WRENCH		CONTINUOUS	
2) SNUG-TIGHT JOINTS		PERIODIC	
C. INSPECTION TASKS AFTER BOLTING (PERFORM TASKS FOR EACH BOLTED CONNECTION IN ACCORDANCE WITH QA TASKS LISTED IN AISC 360, TABLE N5.6-3	FIELD INSPECTION	PERIODIC AT ALL BOLTED CONNECTIONS	
7. INSPECTION OF STEEL ELEMENTS OF COMPOSITE CONSTRUCTION PRIOR TO CONCRETE PLACEMENT. INSPECT SIZE, NUMBER, POSITIONING, AND WELDING OF SHEAR CONNECTORS. INSPECT STUDS FOR FULL 360 DEGREE FLASH. PING TEST ALL SHEAR CONNECTORS WITH A 3 LB HAMMER. BEND TEST ALL QUESTIONABLE STUDS TO 15 DEGREES	FIELD INSPECTION AND TESTING	PERIODIC	
8. MATERIAL VERIFICATION OF COLD-FORMED STEEL DECK: IDENTIFICATION MARKINGS	FIELD INSPECTION	PERIODIC	
9. CONNECTION OF COLD-FORMED STEEL DECK TO SUPPORTING STRUCTURE. INSPECT WELDING AND SIDE-LAP FASTENING OF METAL ROOF AND FLOOR DECK IS IN CONFORMANCE WITH APPROVED SUBMITTAL.	FIELD INSPECTION	PERIODIC	
10. COLD-FORMED STEEL TRUSSES SPANNING 60 FEET OR GREATER: VERIFY TEMPORARY AND PERMANENT RESTRAINT/BRACING ARE INSTALLED IN ACCORDANCE WITH THE APPROVED TRUSS SUBMITTAL PACKAGE	FIELD INSPECTION	PERIODIC	
11. OPEN WEB STEEL JOIST: INSPECT INSTALLATION, FIELD WELDING, FIELD BOLTING, AND BRIDGING OF JOIST IS IN CONFORMANCE WITH APPROVED SUBMITTAL	FIELD INSPECTION	PERIODIC	

MASONRY CONSTRUCTION	SERVICE	EXTENT	AGENT
LEVEL B QUALITY ASSURANCE			
1. Verify compliance with approved submittals	Field Inspection	Periodic	
2. Verification of f'm prior to construction	Unit Strength Method	Periodic	
3. Verification of Slump Flow and Visual Stability Index (VSI) of self-consolidating grout as delivered to the project	Field Testing	Continuous	ICC-SMSI
4. Verify proportions of site-mixed mortar, grout and prestressing grout for bonded tendons	Field Inspection	Periodic	ICC-SMSI
5. Verify grade, type, and size of reinforcement and anchor bolts, and prestressing tendons and anchorages	Field Inspection	Periodic	ICC-SMSI
6. Verify construction of mortar joints	Field Inspection	Periodic	ICC-SMSI
7. Verify placement of reinforcement, connectors, and prestressing tendons and anchorages	Field Inspection	Periodic	ICC-SMSI
8. Verify grout space prior to grouting	Field Inspection	Periodic	ICC-SMSI
9. Verify placement of grout and prestressing grout for bonded tendons	Field Inspection	Continuous	ICC-SMSI
10. Verify size and location of structural masonry elements	Field Inspection	Periodic	ICC-SMSI
11. Verify type, size, and location of anchors, including details of anchorage of masonry to structural members, frames, or other construction.	Field Inspection	Periodic	ICC-SMSI
12. Verify welding of reinforcement	Field Inspection	Continuous	ICC-SMSI
13. Verify preparation, construction, and protection of masonry during cold weather (temperature below 40°F) or hot weather (temperature above 90°F)	Field Inspection	Periodic	ICC-SMSI
14. Verify application and measurement of prestressing force	Field Inspection	Continuous	ICC-SMSI


STATEMENT OF SPECIAL INSPECTIONS	
This Statement of Special Inspections is submitted as a condition for permit issuance in accordance with the Special Inspection and Structural Testing requirements of the Building Code. It includes a schedule of Special Inspection services applicable to the structural components of this project. If applicable, it includes Requirements for Seismic Resistance and/or Requirements for Wind Resistance. This Statement of Special Inspections Encompasses the following disciplines:	
<div><div>[X] Structural</div><div>[] Architectural</div><div>[] Mechanical / Electrical / Plumbing</div><div>[] Other</div></div>	
The Special Inspection Coordinator shall keep records of all inspections and shall furnish inspection reports to the Building Official and the Registered Design Professional in Responsible Charge. Discovered discrepancies shall be brought to the immediate attention of the Contractor for correction. If such discrepancies are not corrected, the discrepancies shall be brought to the attention of the Building Official and the Registered Design Professional in Responsible Charge. The Special Inspection program does not relieve the Contractor of his or her responsibilities.	
Interim reports shall be submitted to the Building Official and the Registered Design Professional in Responsible Charge. A Final Report of Special Inspections documenting completion of all required Special Inspections, testing and corrections of any discrepancies noted in the inspections shall be submitted prior to issuance of a Certificate of Use and Occupancy. Job site safety and means and methods of construction are solely the responsibility of the Contractor.	
QUALIFICATIONS OF INSPECTORS AND TESTING TECHNICIANS	
The qualifications of all personnel performing Special Inspection and testing activities are subject to the approval of the Building Official. The credentials of all inspectors and testing technicians shall be provided if requested.	
Key for Minimum Qualifications of Inspection Agents:	
When the Registered Design Professional in Responsible Charge deems it appropriate that the individual performing a stipulated test or inspection have a specific certification or license as indicated below, such designations shall appear below the Agent on the Schedule.	
PE/SE	Structural Engineer - A licensed SE or PE specializing in the design of building structure
PE/GE	Geotechnical Engineer - A licensed PE specializing in soil mechanics and foundations
EIT	Engineer-In-Training - A graduate engineer who has passed the Fundaments of Engineering examination
American Concrete Institute (ACI) Certification	
ACI-CFTT	Concrete Field Testing Technician - Grade 1
ACI-CCI	Concrete Construction Inspector
ACI-LTT	Laboratory Testing Technician - Grade 1 & 2
ACI-STT	Strength Testing Technician
American Welding Society (AWS) Certification	
AWS-CWI	Certified Welding Inspector
AWS/AISC-SSI	Certified Structural Steel Inspector
American Society of Non-Destructive Testing (ASNT) Inspection	
ASNT	Non-Destructive Testing Technician - Level II or III
International Code Council (ICC) Certification	
ICC-SMSI	Structural Masonry Special Inspector
ICC-SFSI	Spray-Applied Fireproofing Special Inspector
ICC-RCSI	Reinforced Concrete Special Inspector
ICC-SWSI	Structural Steel and Welding Special Inspector
ICC-PCSI	Prestressed Concrete Special Inspector
National Institute of Certification in Engineering Technologies (NICET)	
NICET-CT	Concrete Technician - Levels I, II, III, & IV
NICET-ST	Soils Technician - Levels I, II, III & IV
NICET-GET	Geotechnical Engineering Technician - Level I, II, III & IV
Exterior Design Institute (EDI) Certification	
EDI-EIFS	EIFS Third Party Inspector
QUALITY ASSURANCE PLAN	
Quality Assurance for Seismic Resistance:	
1. Seismic Design Category:	B
2. Statement of Special Inspections for Seismic Resistance required (Y/N):	N
3. Description of Seismic-Force Resisting System subject to Special Inspection and testing for Seismic Resistance:	NA
4. Description of Designated Seismic Systems subject to Special Inspections and testing for Seismic Resistance:	NA
5. Description of additional Seismic Systems and components requiring Special Inspections and testing:	NA
6. Each Contractor responsible for the construction and fabrication of a system or component described above must submit a Statement of Responsibility.	
Quality Assurance Plan for Wind Requirements:	
1. Nominal Design Wind Speed, Vasd =	90
2. Wind Exposure Category:	C
3. Statement for Special Inspection for Wind Resistance Required (Y/N):	N
4. Description of main Wind Force-Resisting System subject to Special Inspection for Wind Resistance:	NA
5. Description of Wind Force-Resisting components subject to Special Inspection of Wind Resistance:	NA
6. Each Contractor responsible for the construction or fabrication of a system or component described above must submit a Statement of Responsibility.	
CONTRACTOR'S RESPONSIBILITY REGARDING INSPECTIONS	
1. The Contractor is responsible for scheduling a pre-construction meeting (scheduled at least 5 business days before start of construction). Meeting should include all responsible parties (A/E, S/E's, Field Inspector). Meeting is for entire project, not phase of work.	
2. Pre-construction meeting is to be conducted by the contractor with meeting minutes to be taken and distributed to all members attending. Meeting minutes to include a sign-in sheet for all parties.	
3. The contractor is responsible for scheduling inspections and tests. Sufficient notice and lead time must be allowed for the inspection and testing to be performed without impeding construction operations.	
4. The contractor must cooperate with the inspections and testing agencies. Safe access must be provided to all inspection and test to be performed. This may require the contractor to provide scaffolding, ladders or lifts.	
5. When deficiencies are identified, the contractor must take corrective actions to comply with the contract documents or remedy the deficiencies as directed by the registered design professional.	
6. The special inspection and quality assurance program does not relieve the contractor of his or her responsibility to perform quality control.	
7. The contractor is responsible for testing services that are required for material submittals and that not part of the special inspections program (e.g. aggregate tests, concrete mix designs, testing of controlled fill, materials, etc.).	




REACTION TABLE		SHEAR TABLE FOR WIND SHEAR TRANSFERRED TO PRECAST WALLS FROM ROOF
R1	16.0 KIPS	
R2	13.0 KIPS	
V1	0.80 KIPS/FT	
V2	0.88 KIPS/FT	
V3	0.40 KIPS/FT	
V4	0.32 KIPS/FT	
V5	0.16 KIPS/FT	
V6	0.16 KIPS/FT	

ROOF PLAN NOTES:


1. FUTURE CHLORINE RETENTION PIPES SHOWN ON PLUMBING DRAWINGS SHALL BE SUPPORTED BY CMU WALLS AND NOT BY ROOF STRUCTURE.
2. REFER TO ELECTRICAL DRAWINGS AND SPECIFICATIONS FOR REQUIREMENTS FOR PHOTOVOLTAIC PANELS ON SHOWER HOUSE ROOF

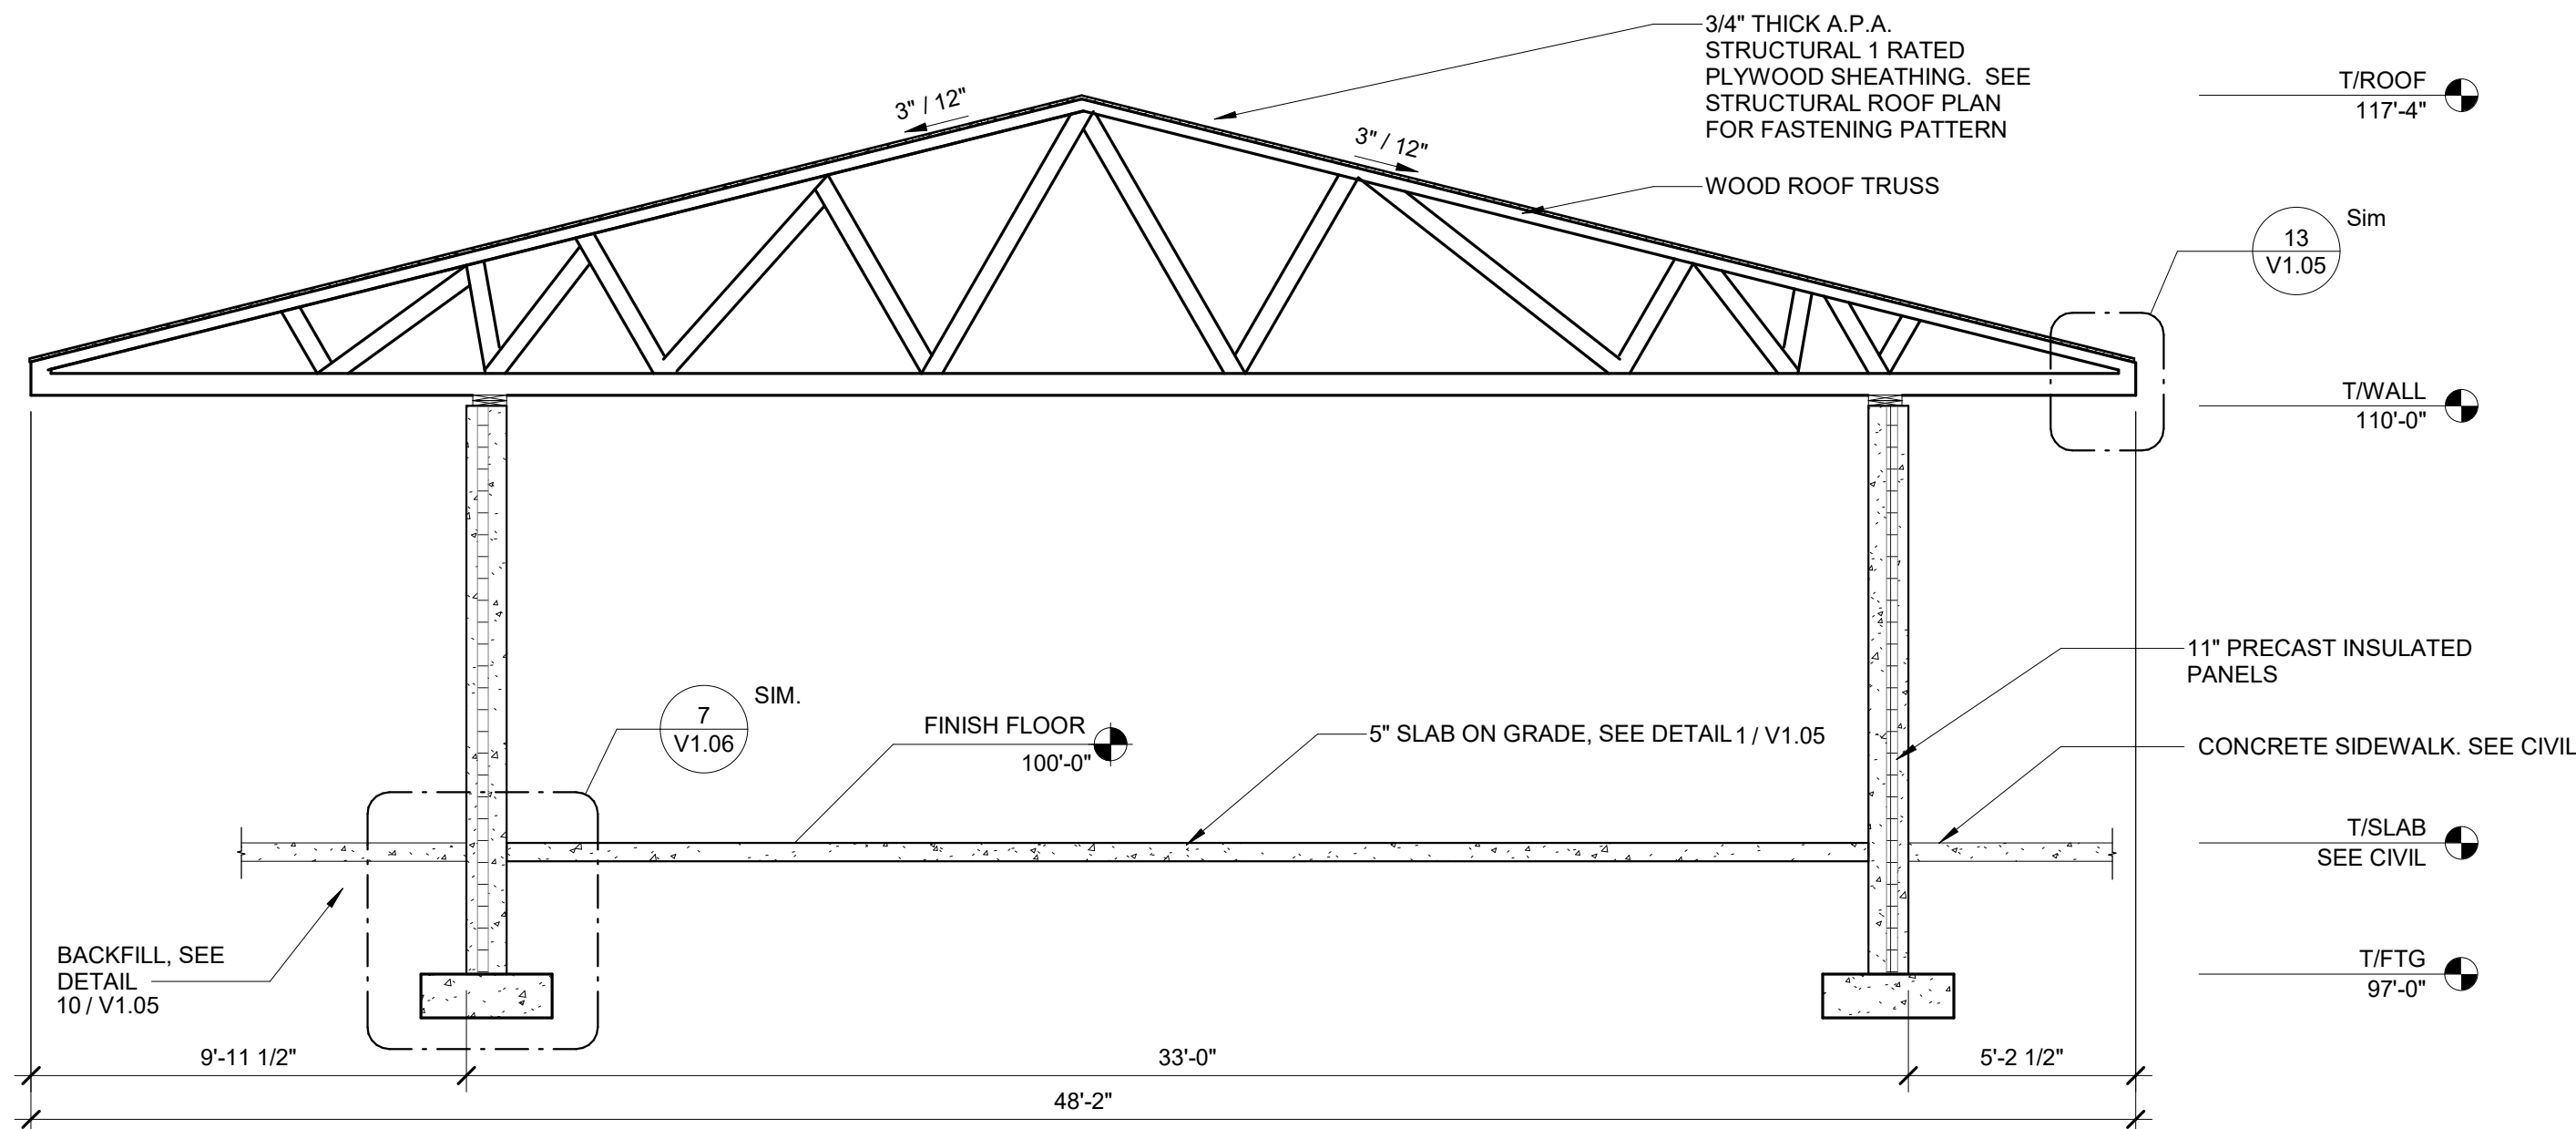


1 BUILDING SECTION THROUGH STORAGE ROOM
1/4" = 1'-0"

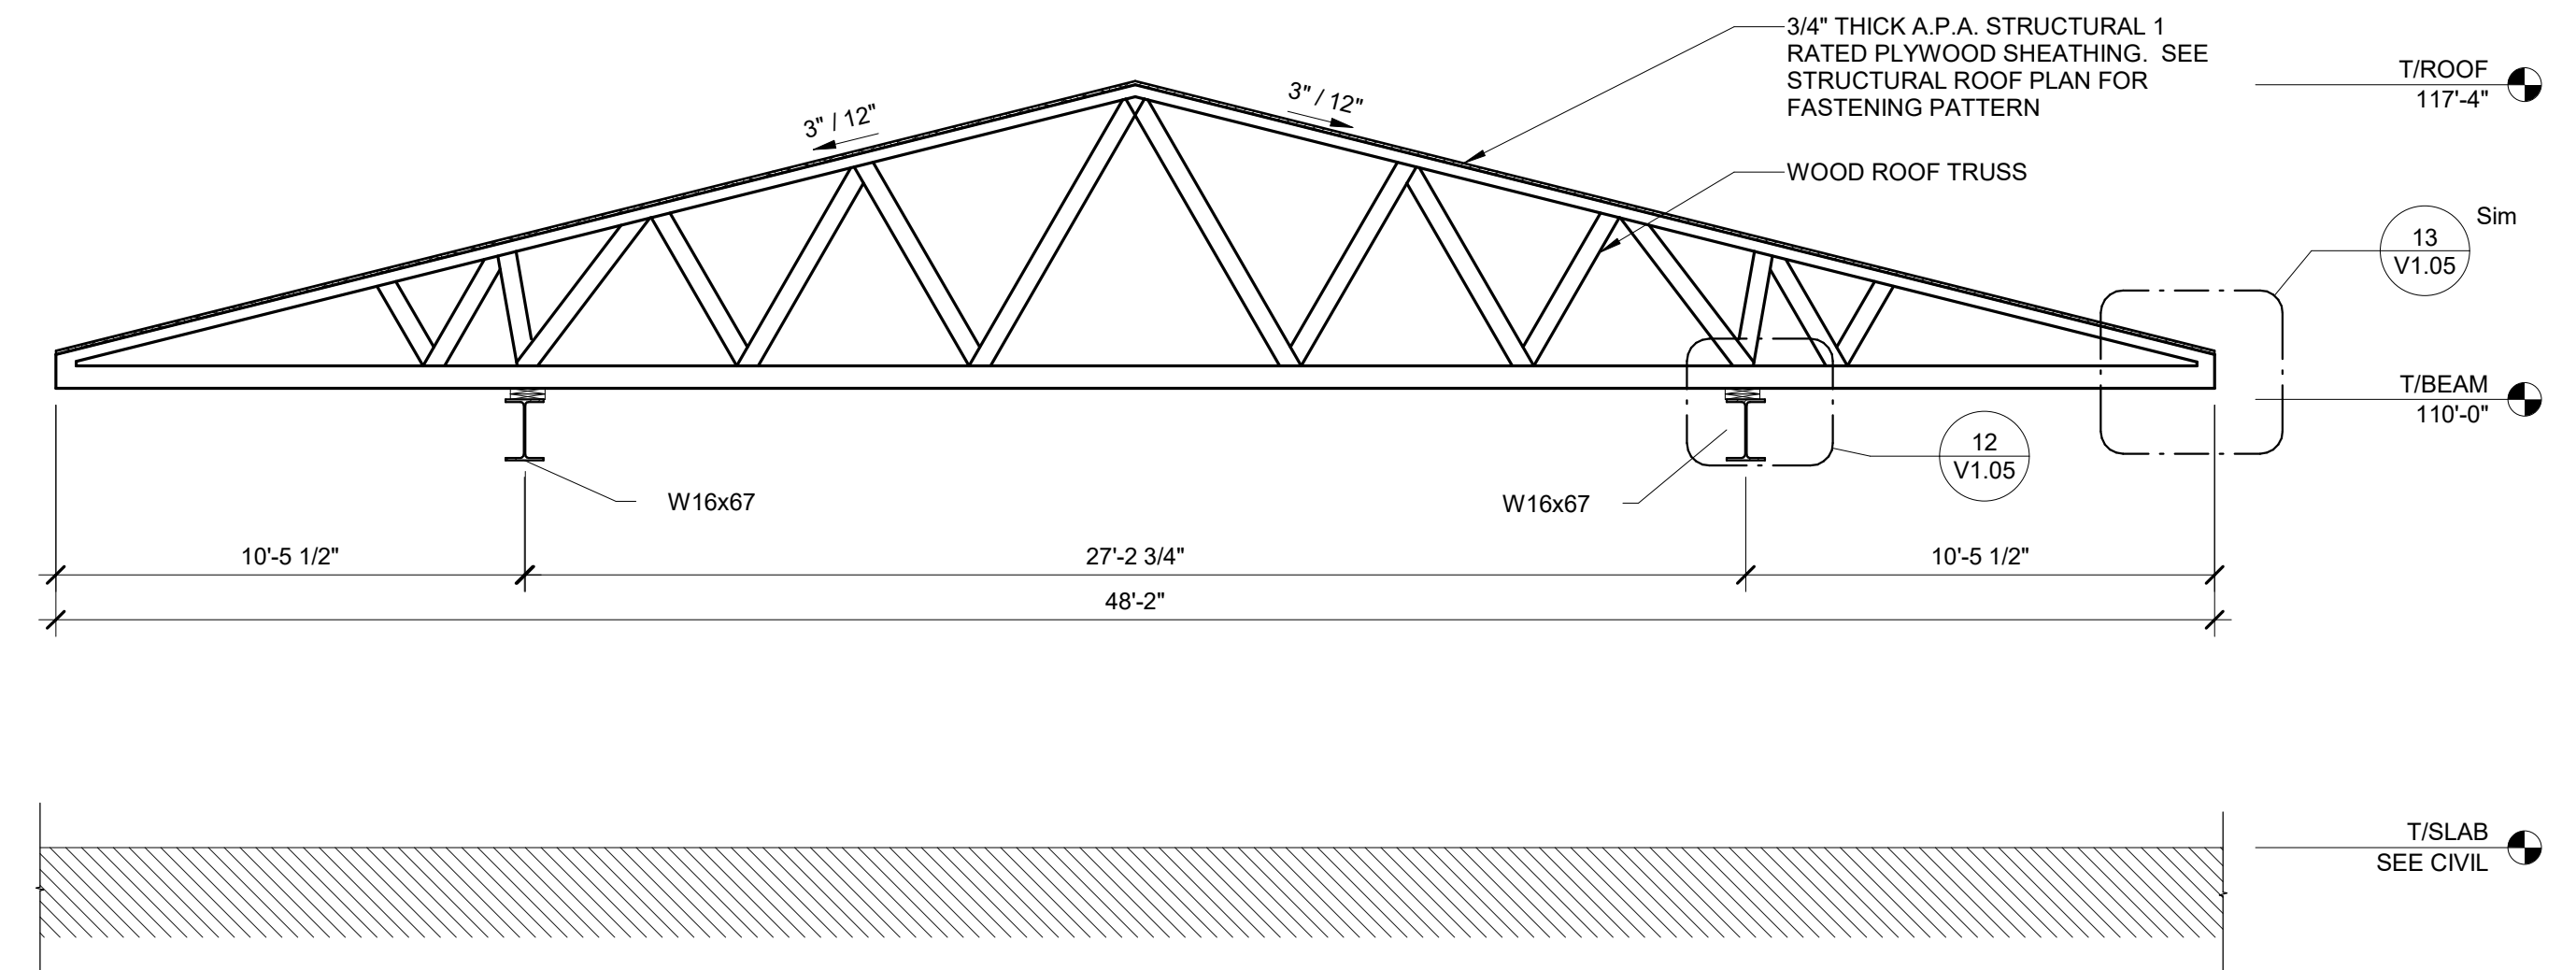


















2 BUILDING SECTION THROUGH BREEZEWAY
1/4" = 1'-0"

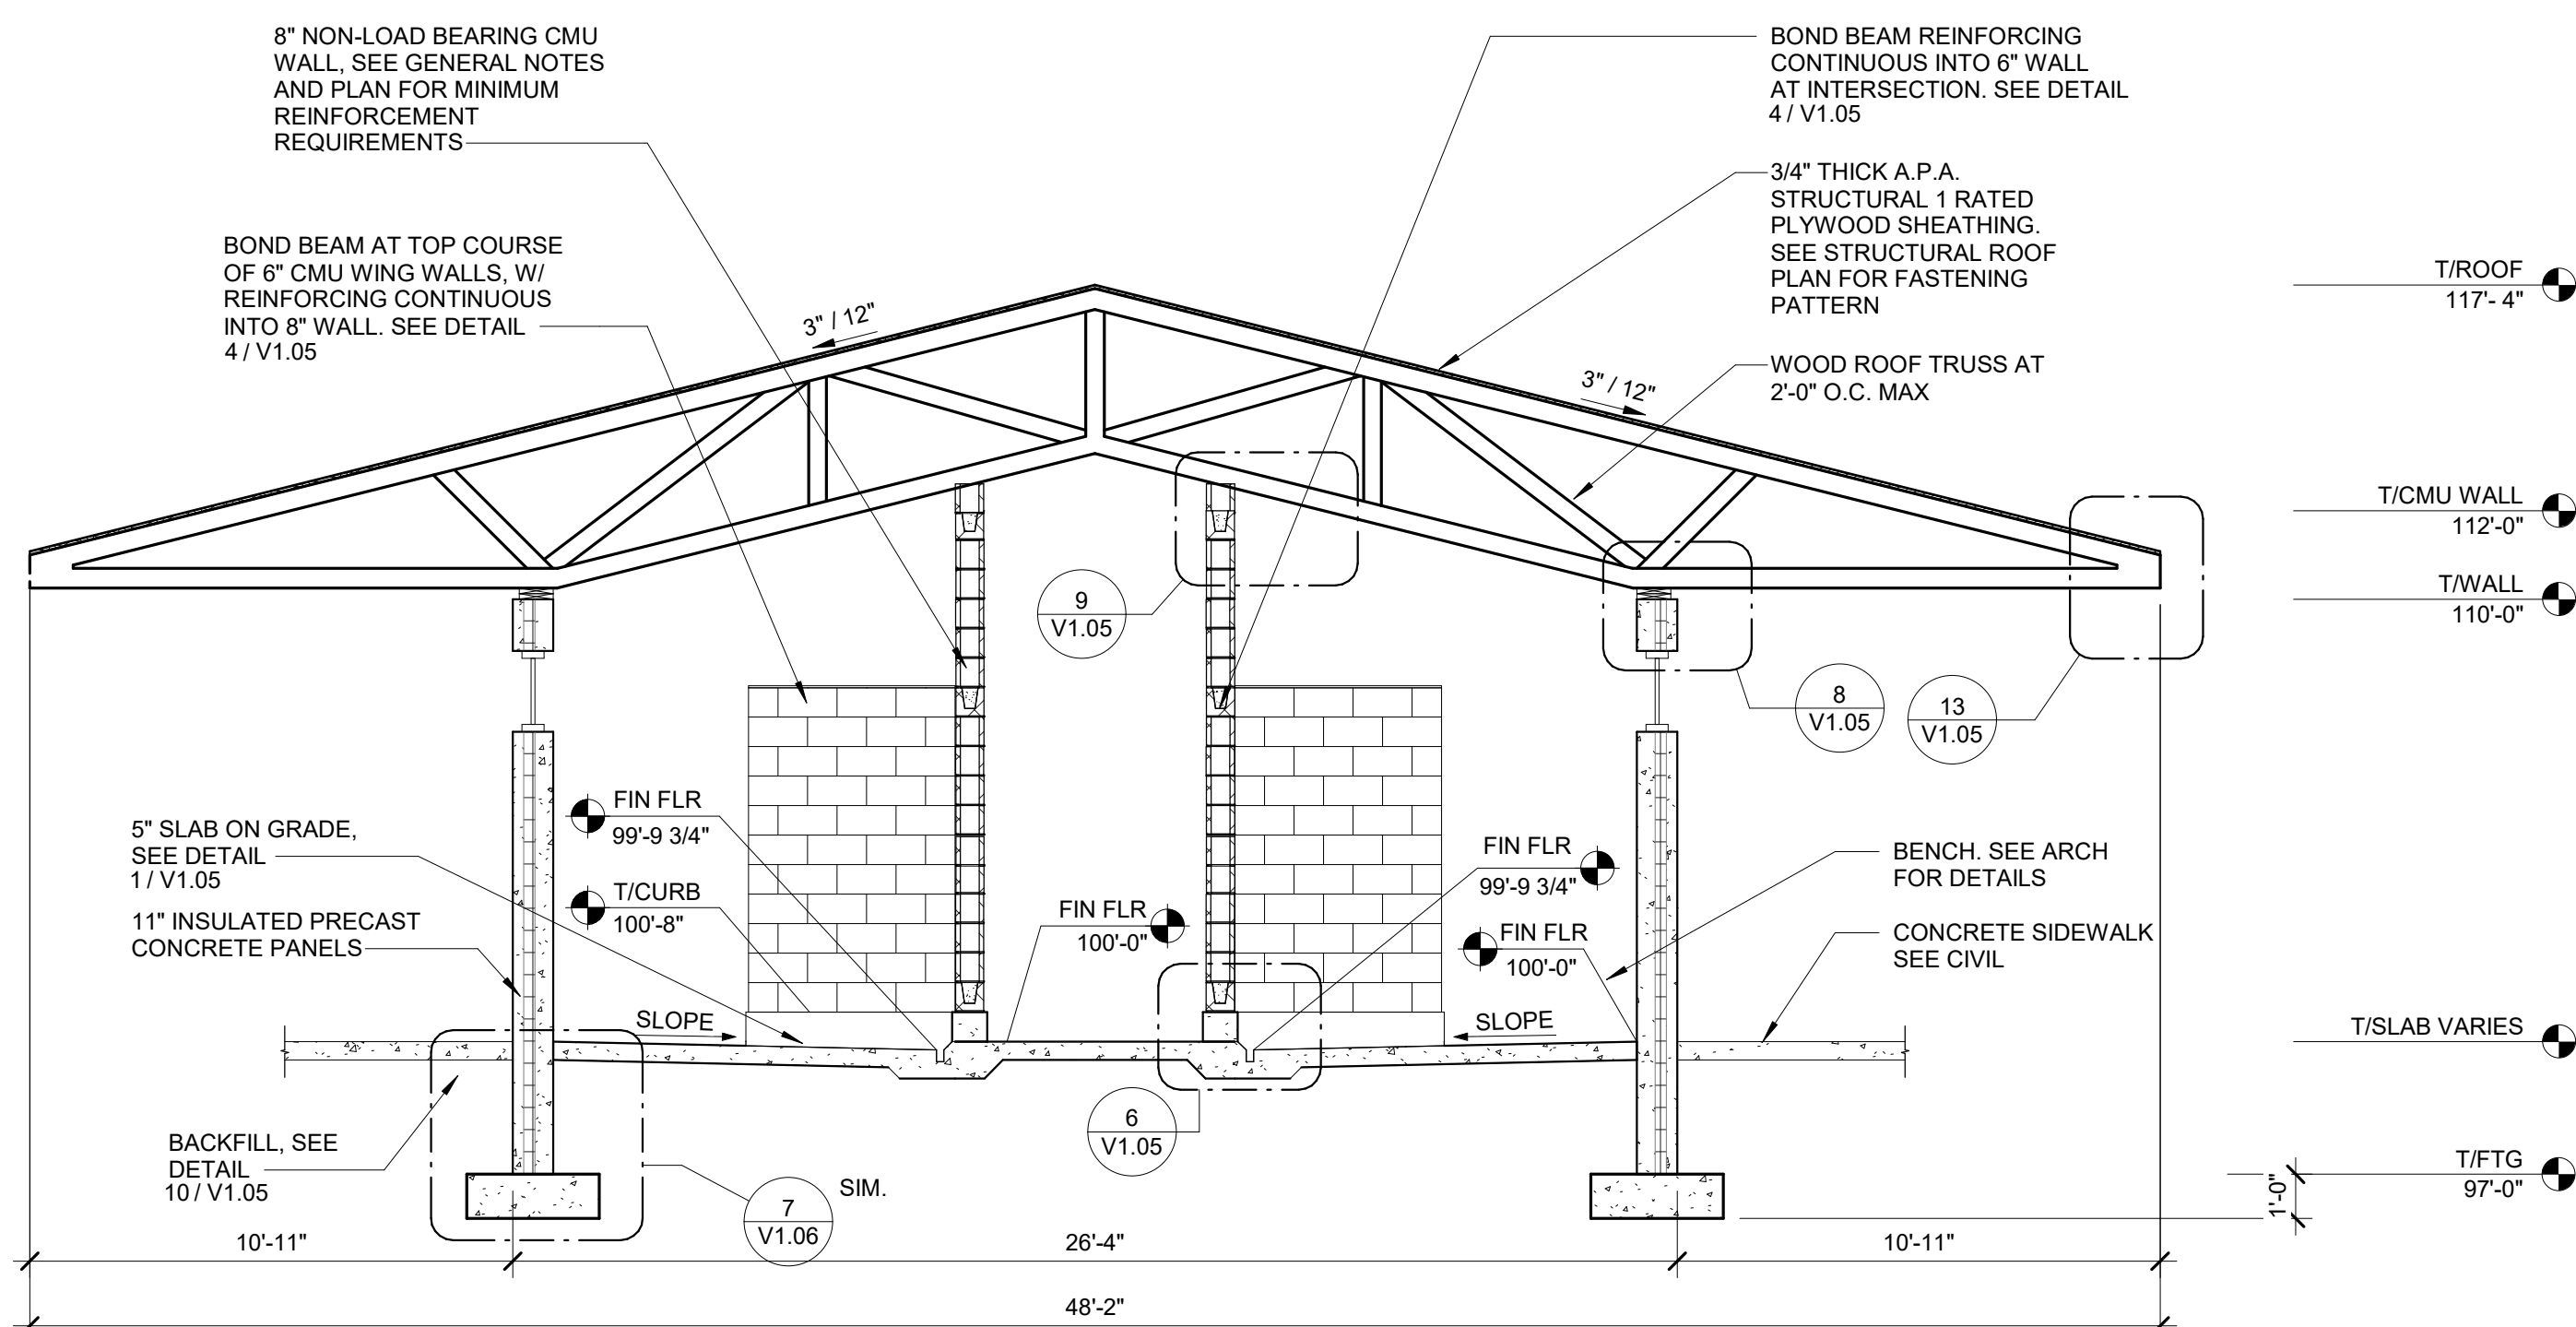

3 SHOWER HOUSE BUILDING SECTION
1/4" = 1'-0"








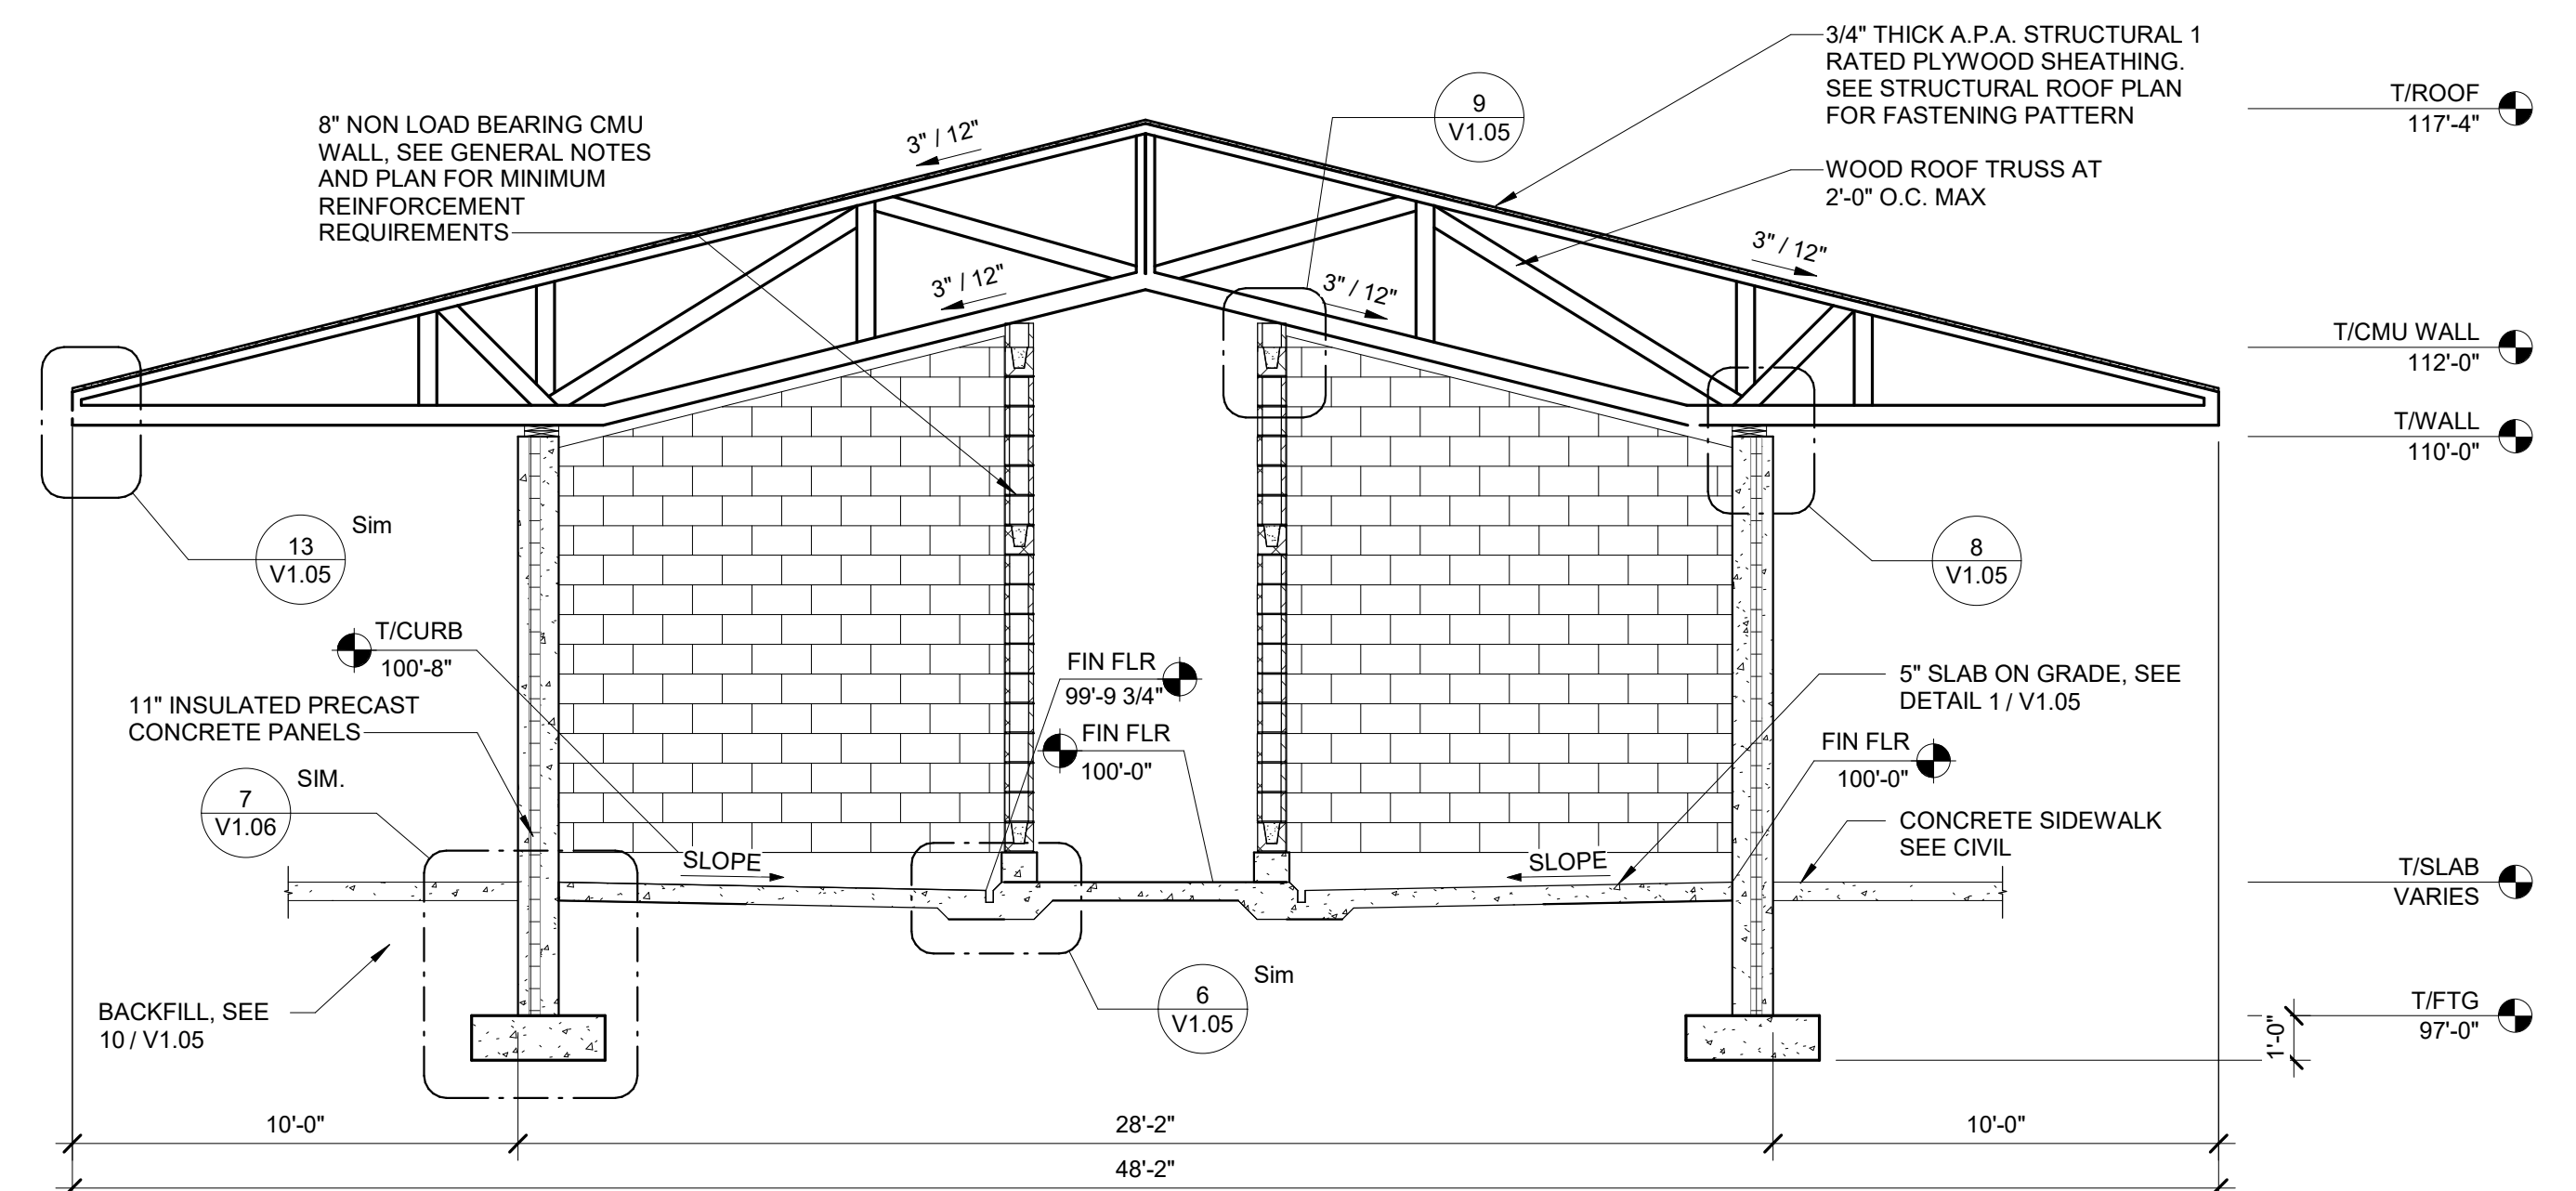



4 BUILDING SECTION THROUGH SHOWER AREA
1/4" = 1'-0"

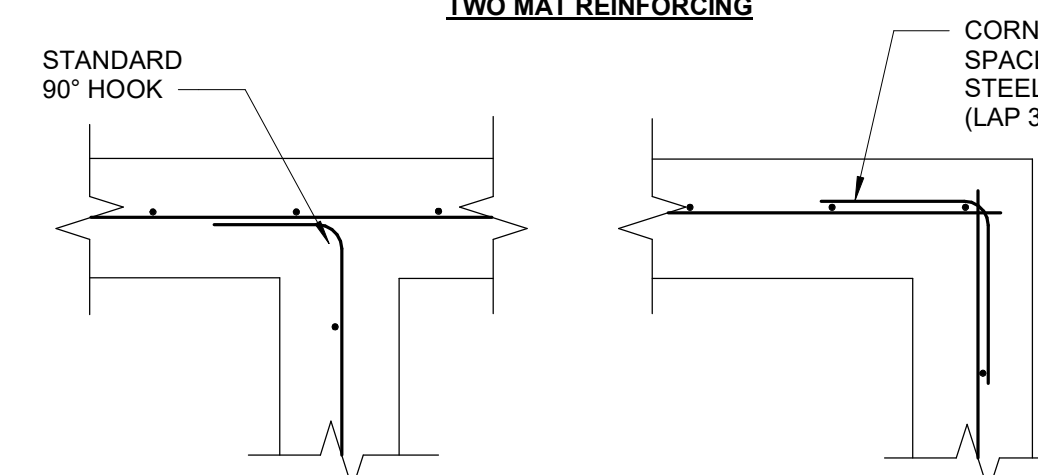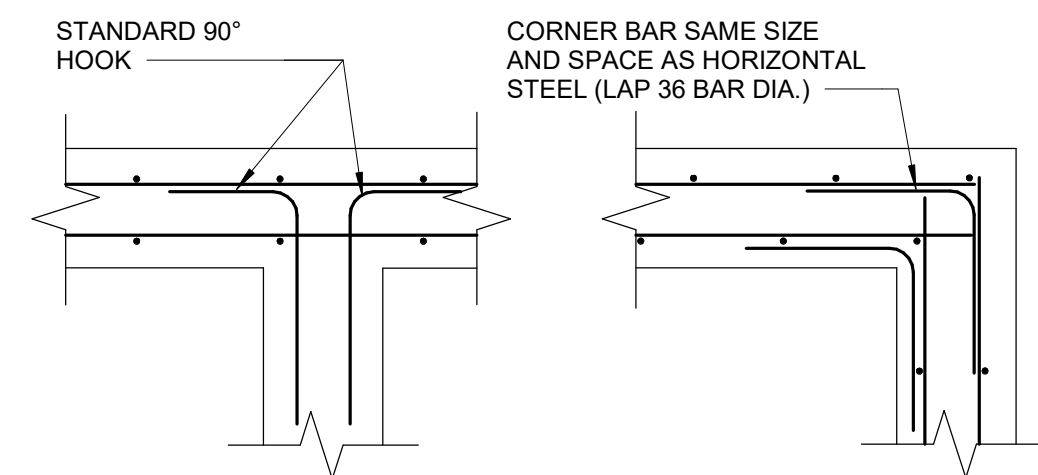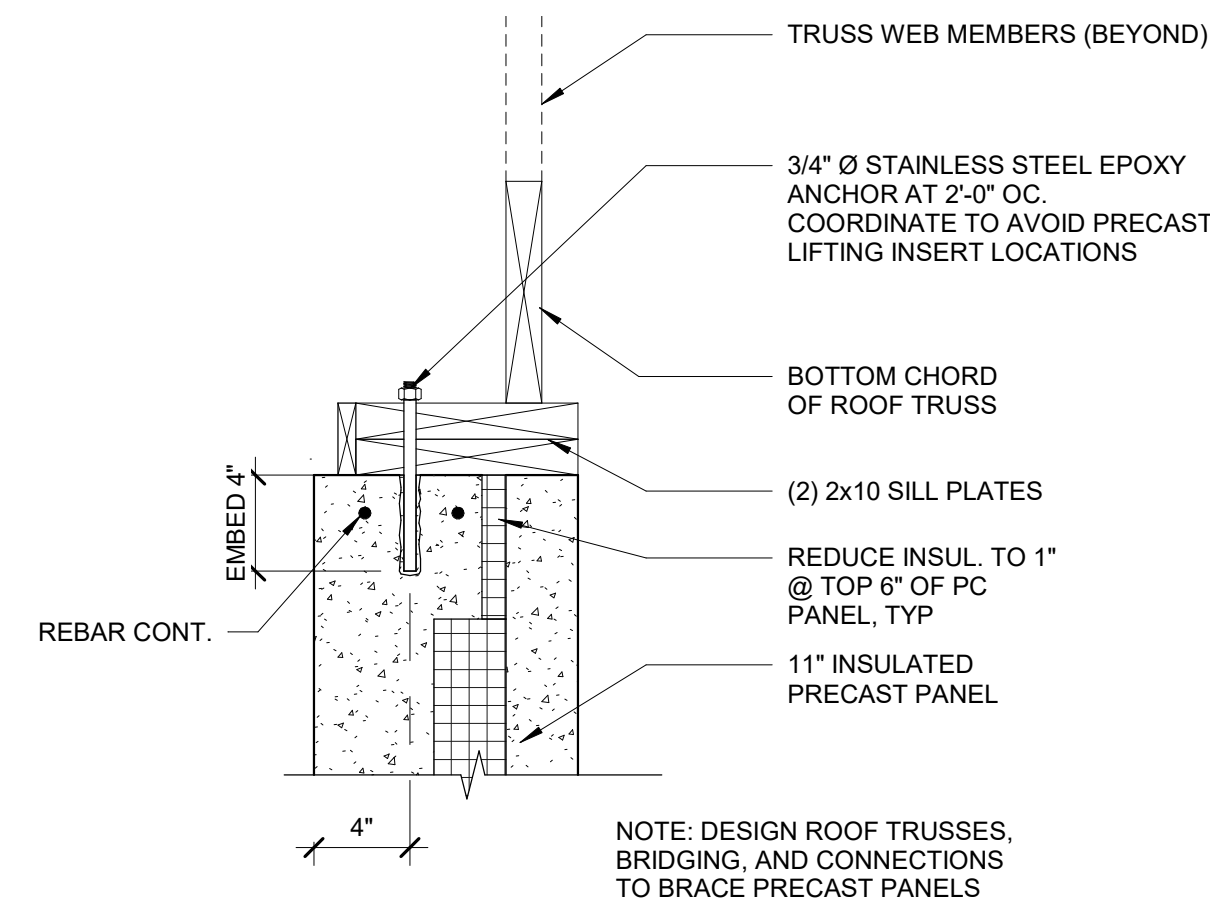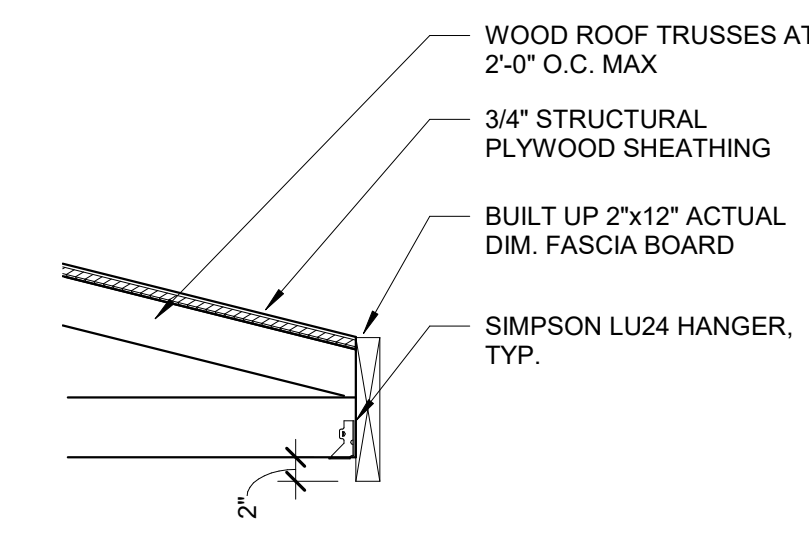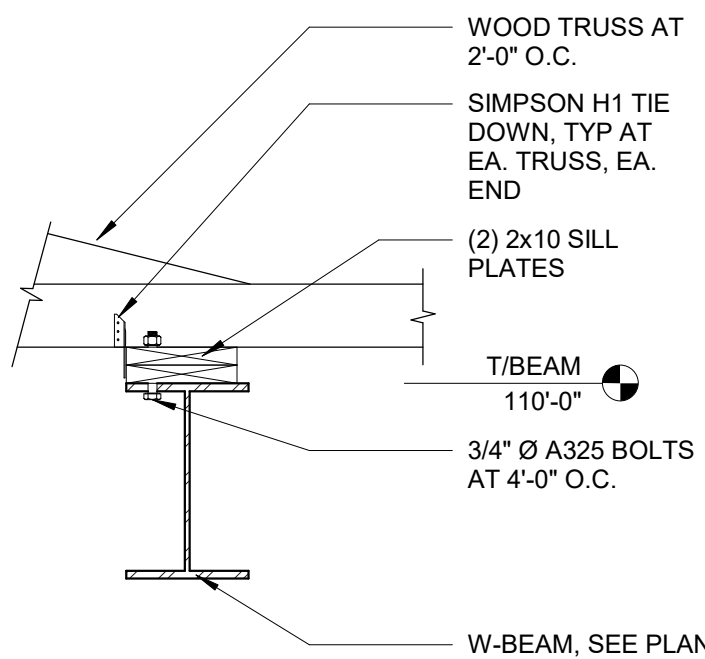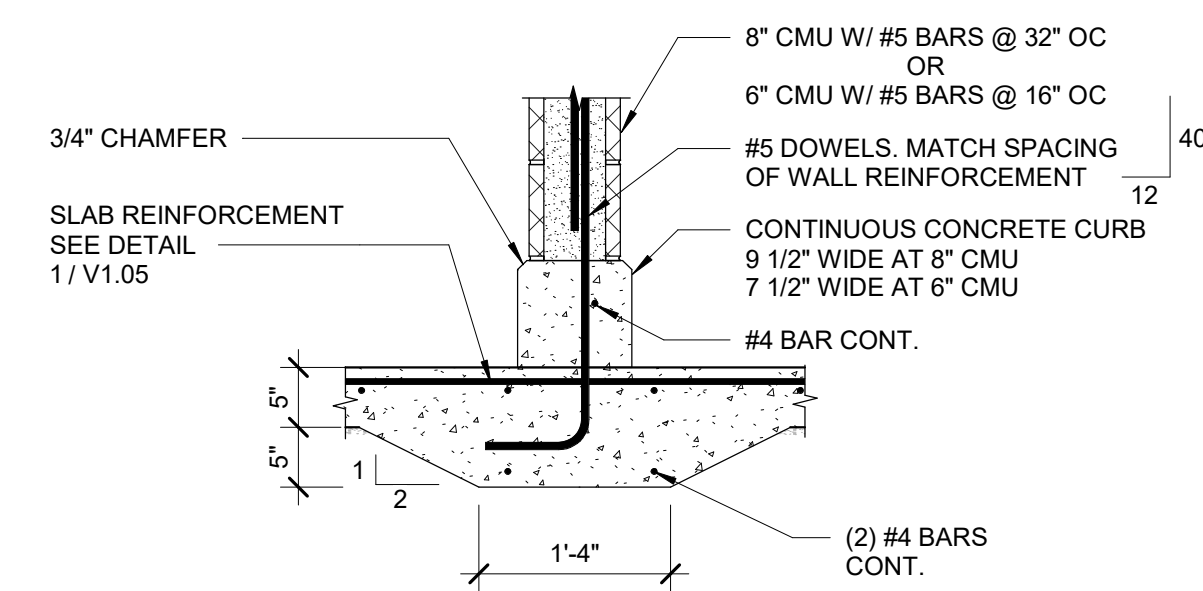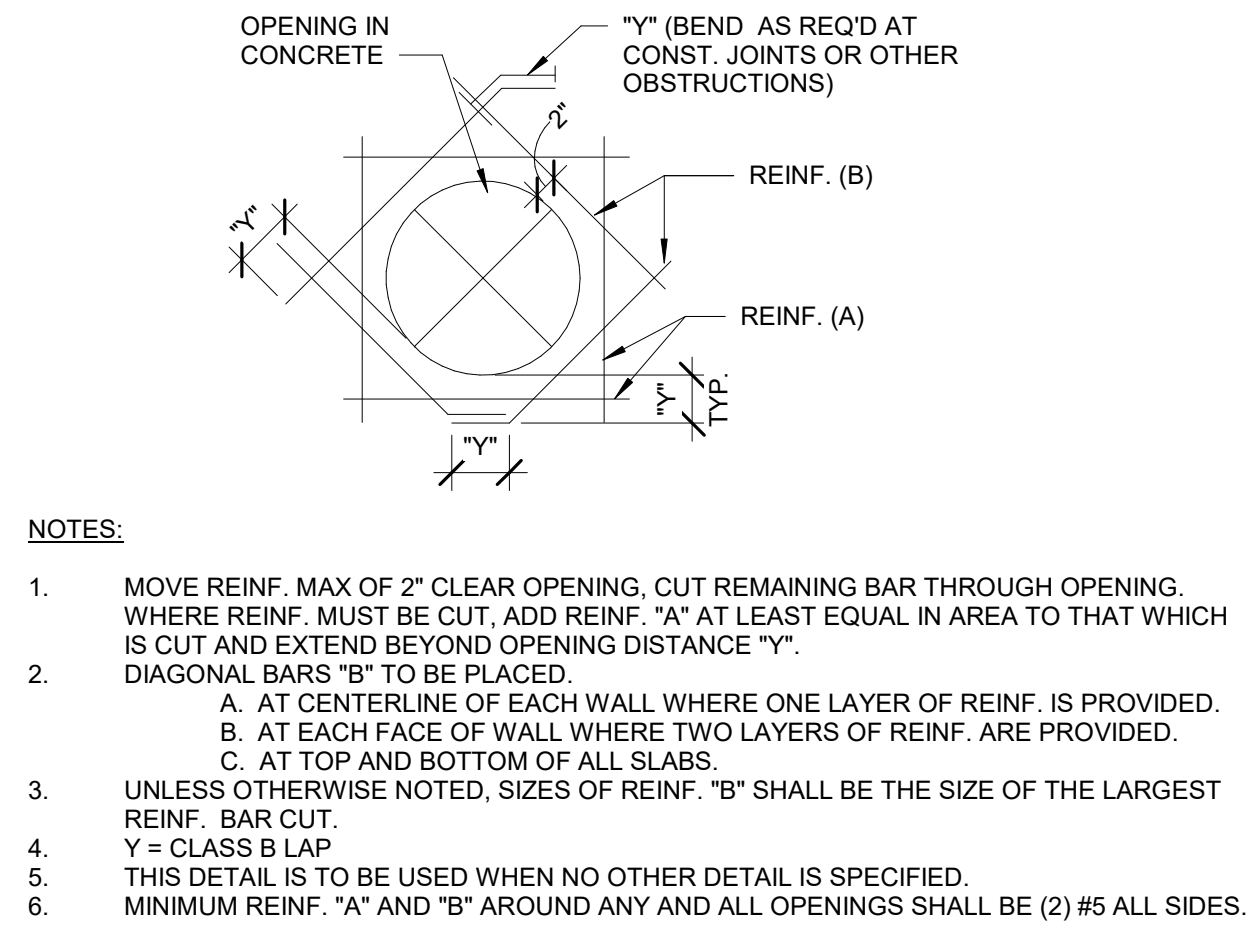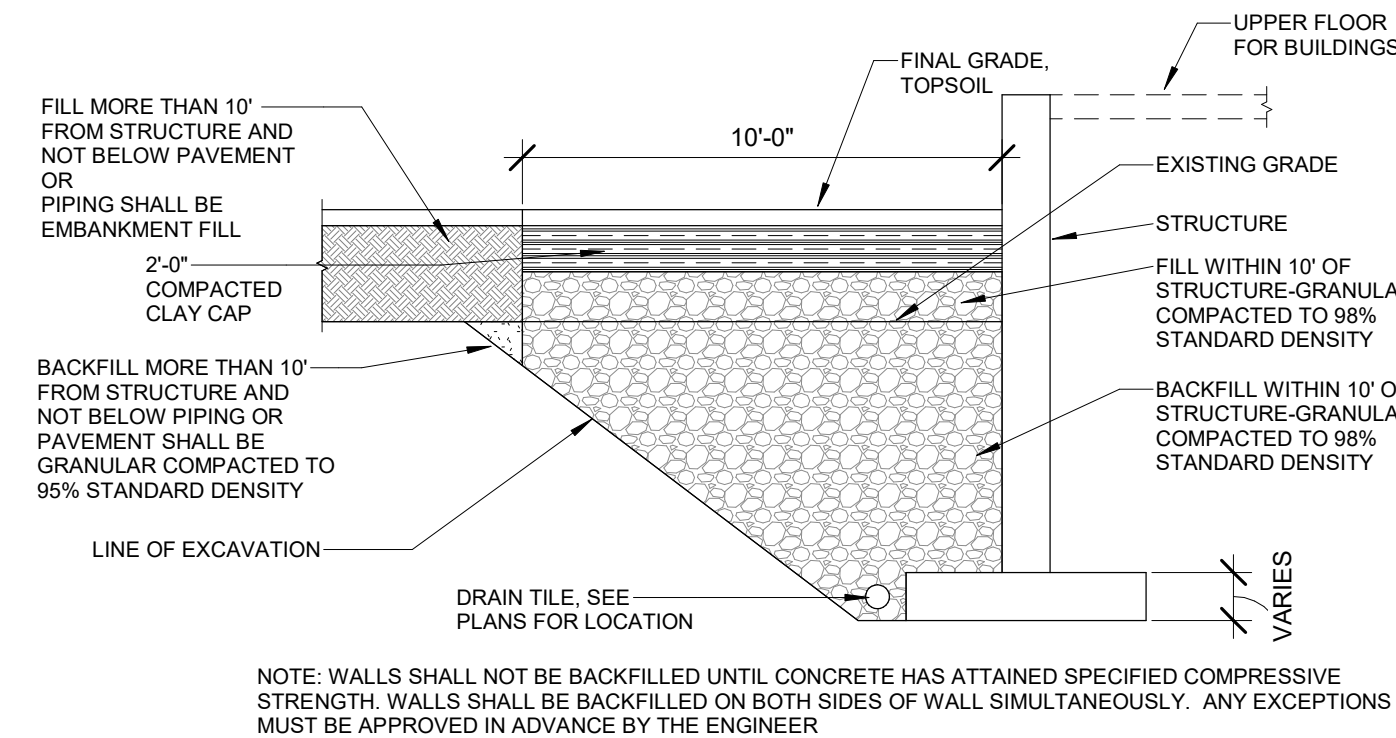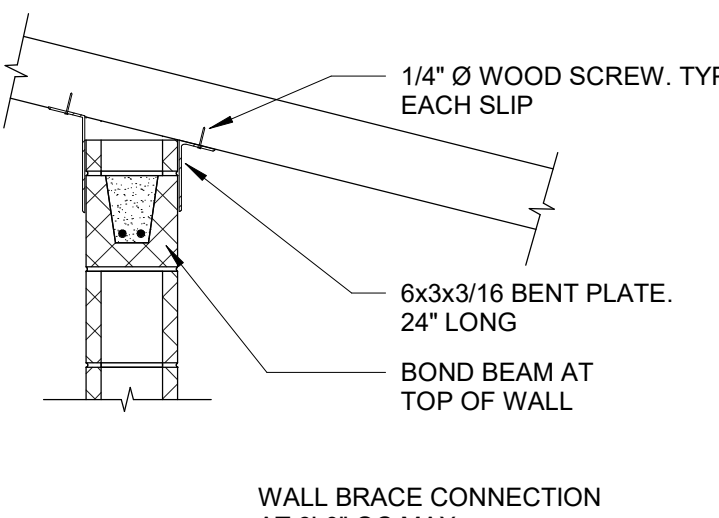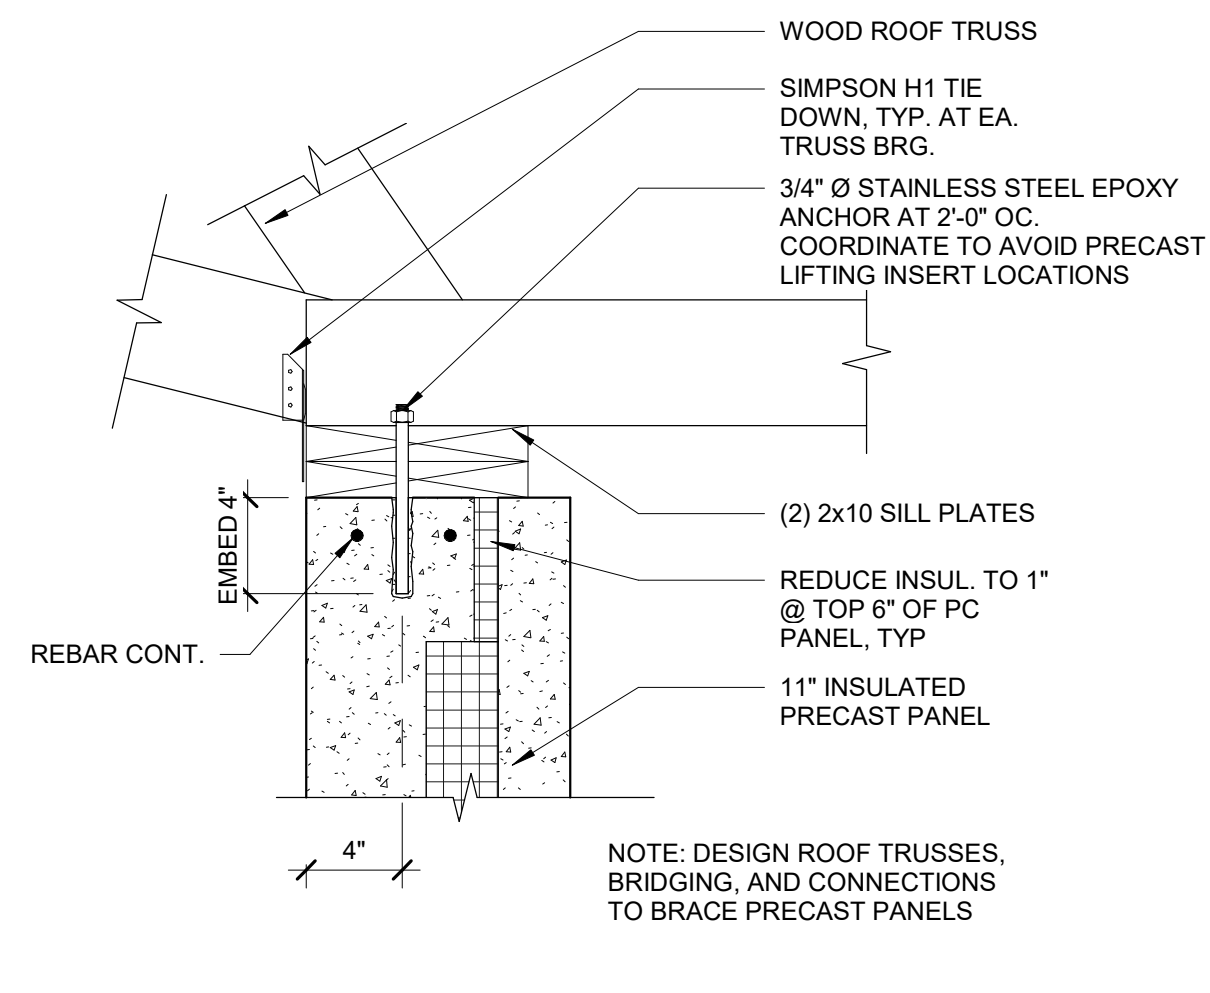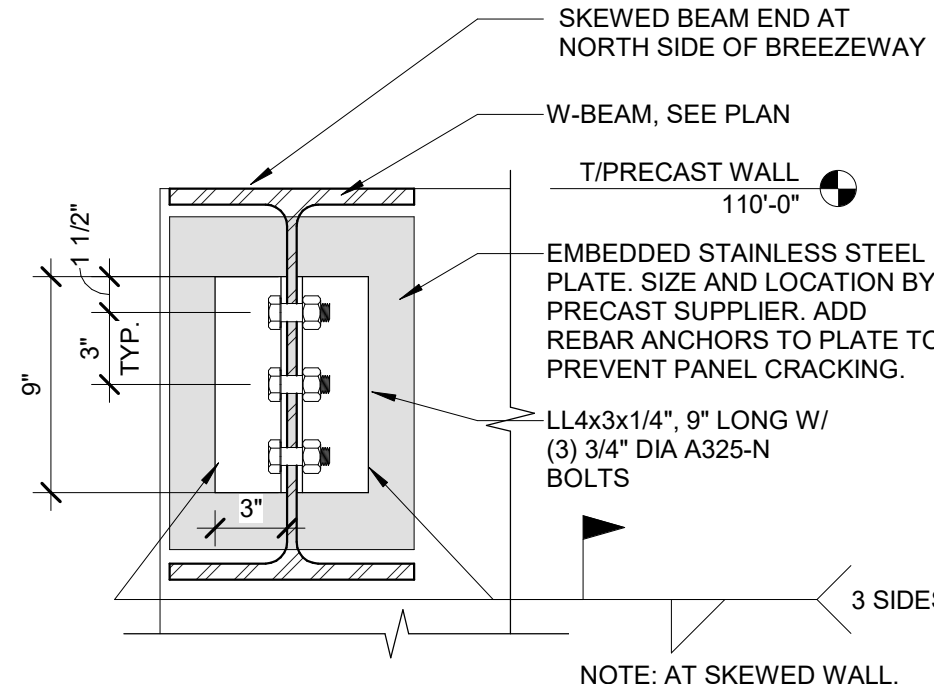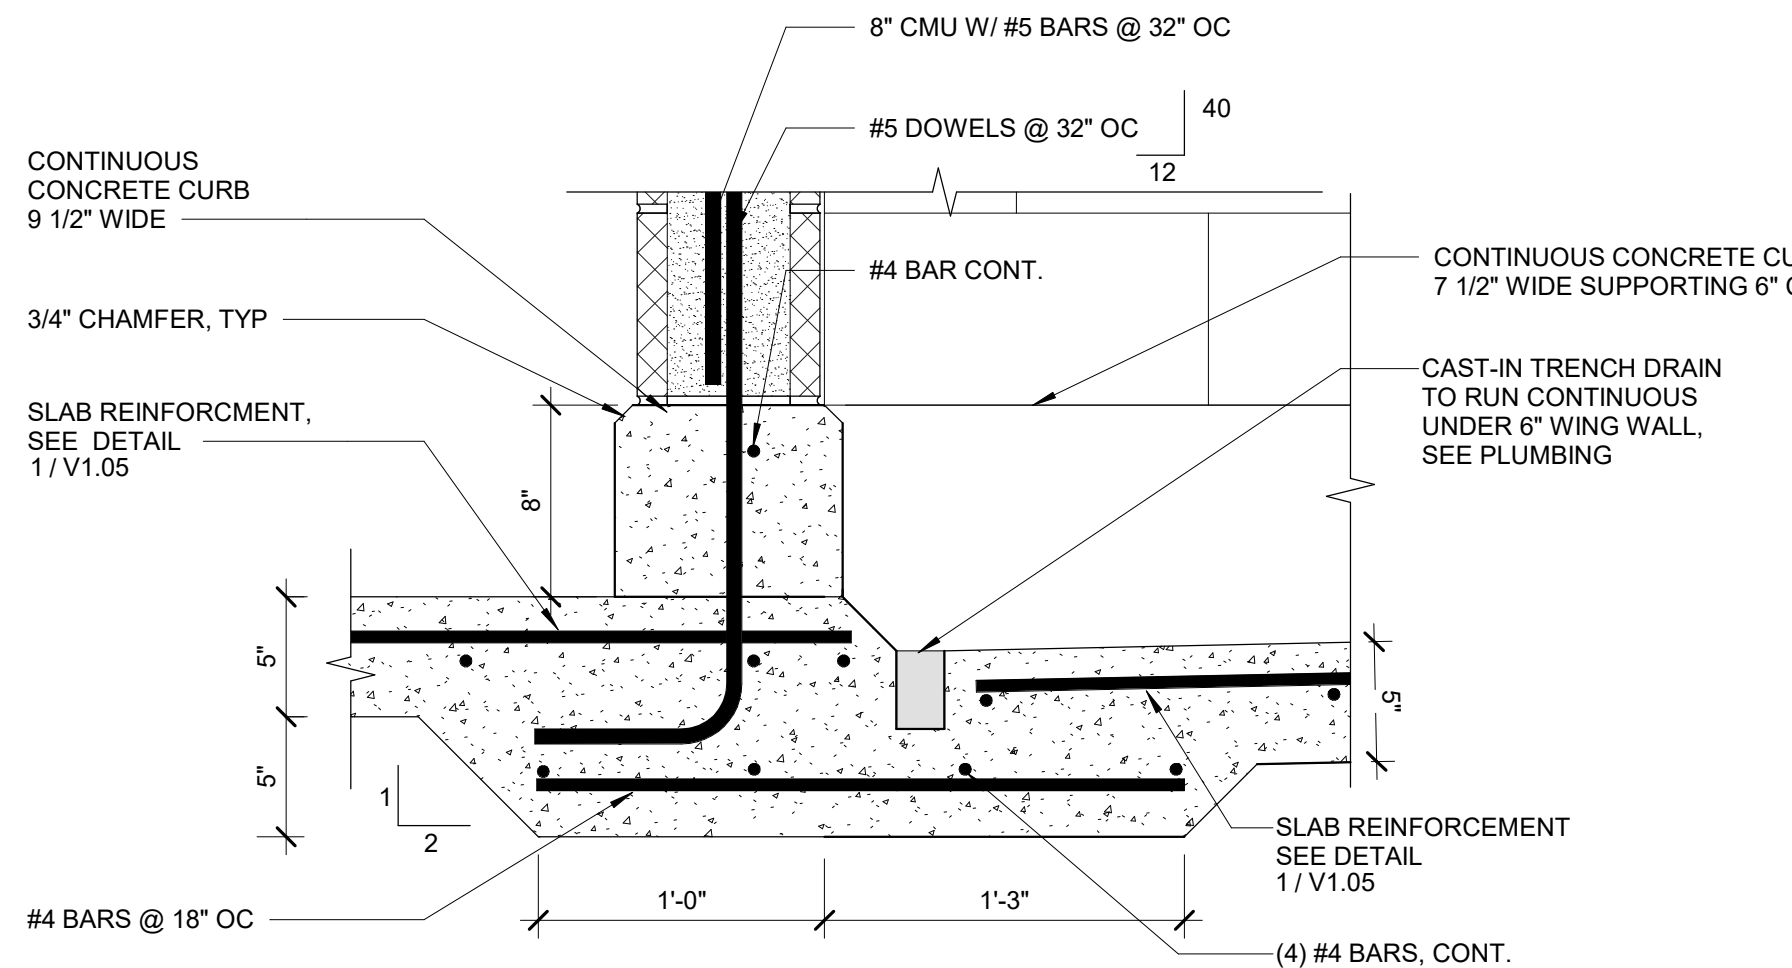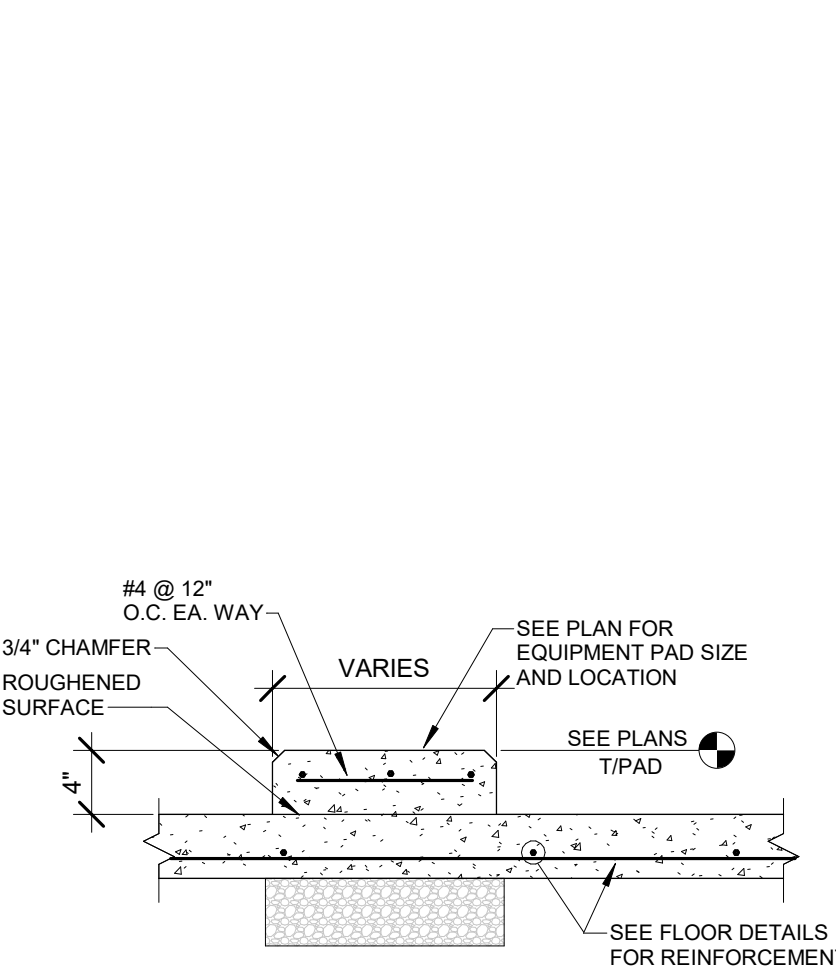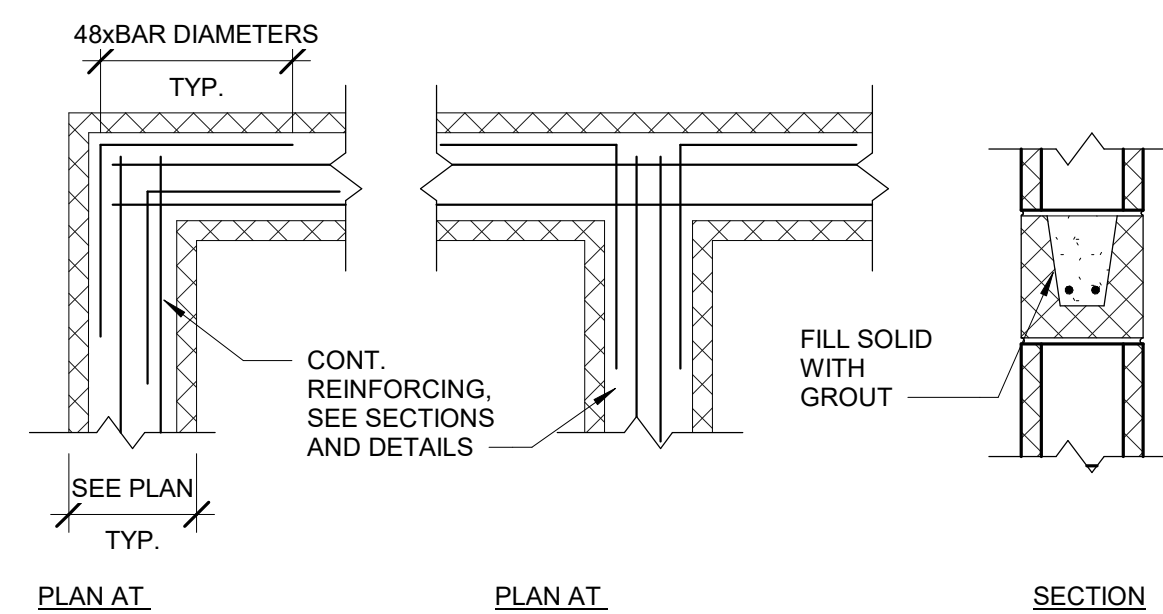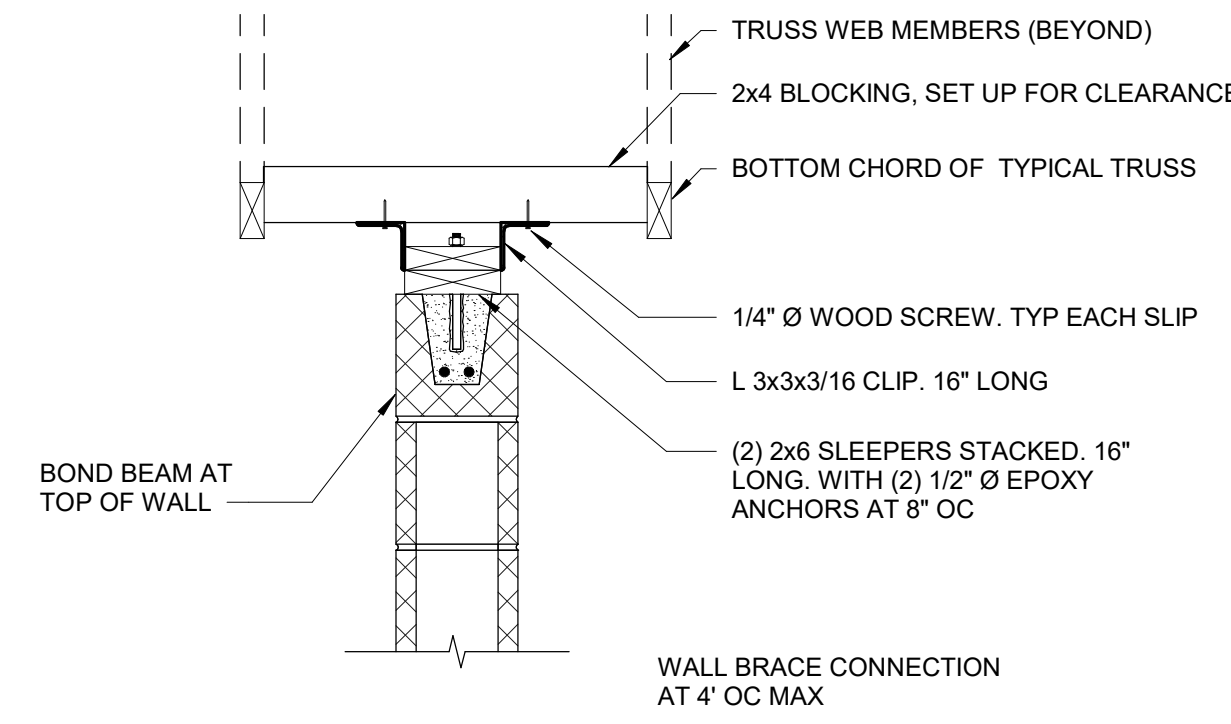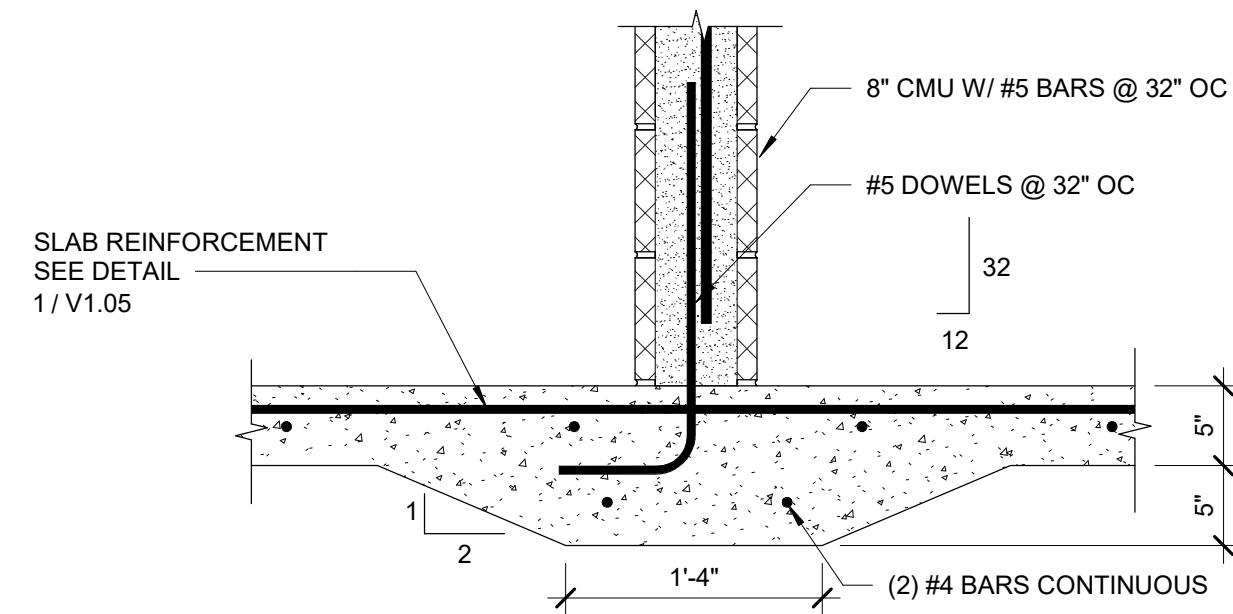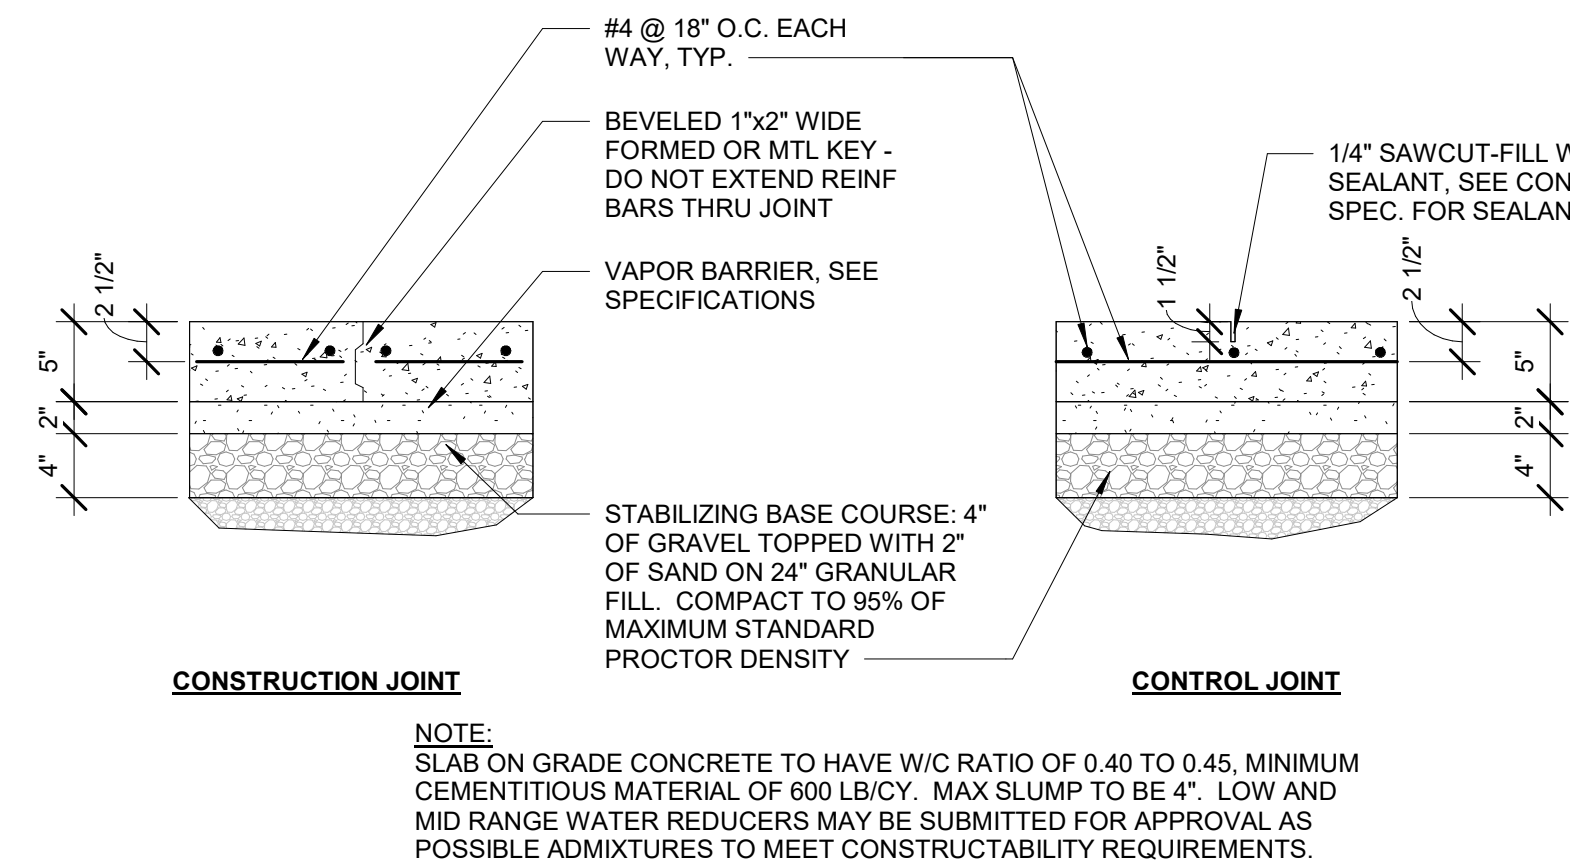

16 TYP. WALL CORNER


LINTEL SCHEDULE	
L-1	BOND BEAM W/ (2) #5 TOP AND BOTTOM
EXTEND REINFORCING 8" BEYOND CLEAR OPENING ON EACH SIDE. MINIMUM BEARING FOR ALL LINTELS SHALL BE 8" EACH SIDE UNLESS OTHERWISE NOTED. CONTINUE VERTICAL WALL REINFORCING AND SPACING ABOVE LINTELS. BOND BEAMS SHALL NOT BE PENETRATED UNLESS APPROVED BY ENGINEER.	

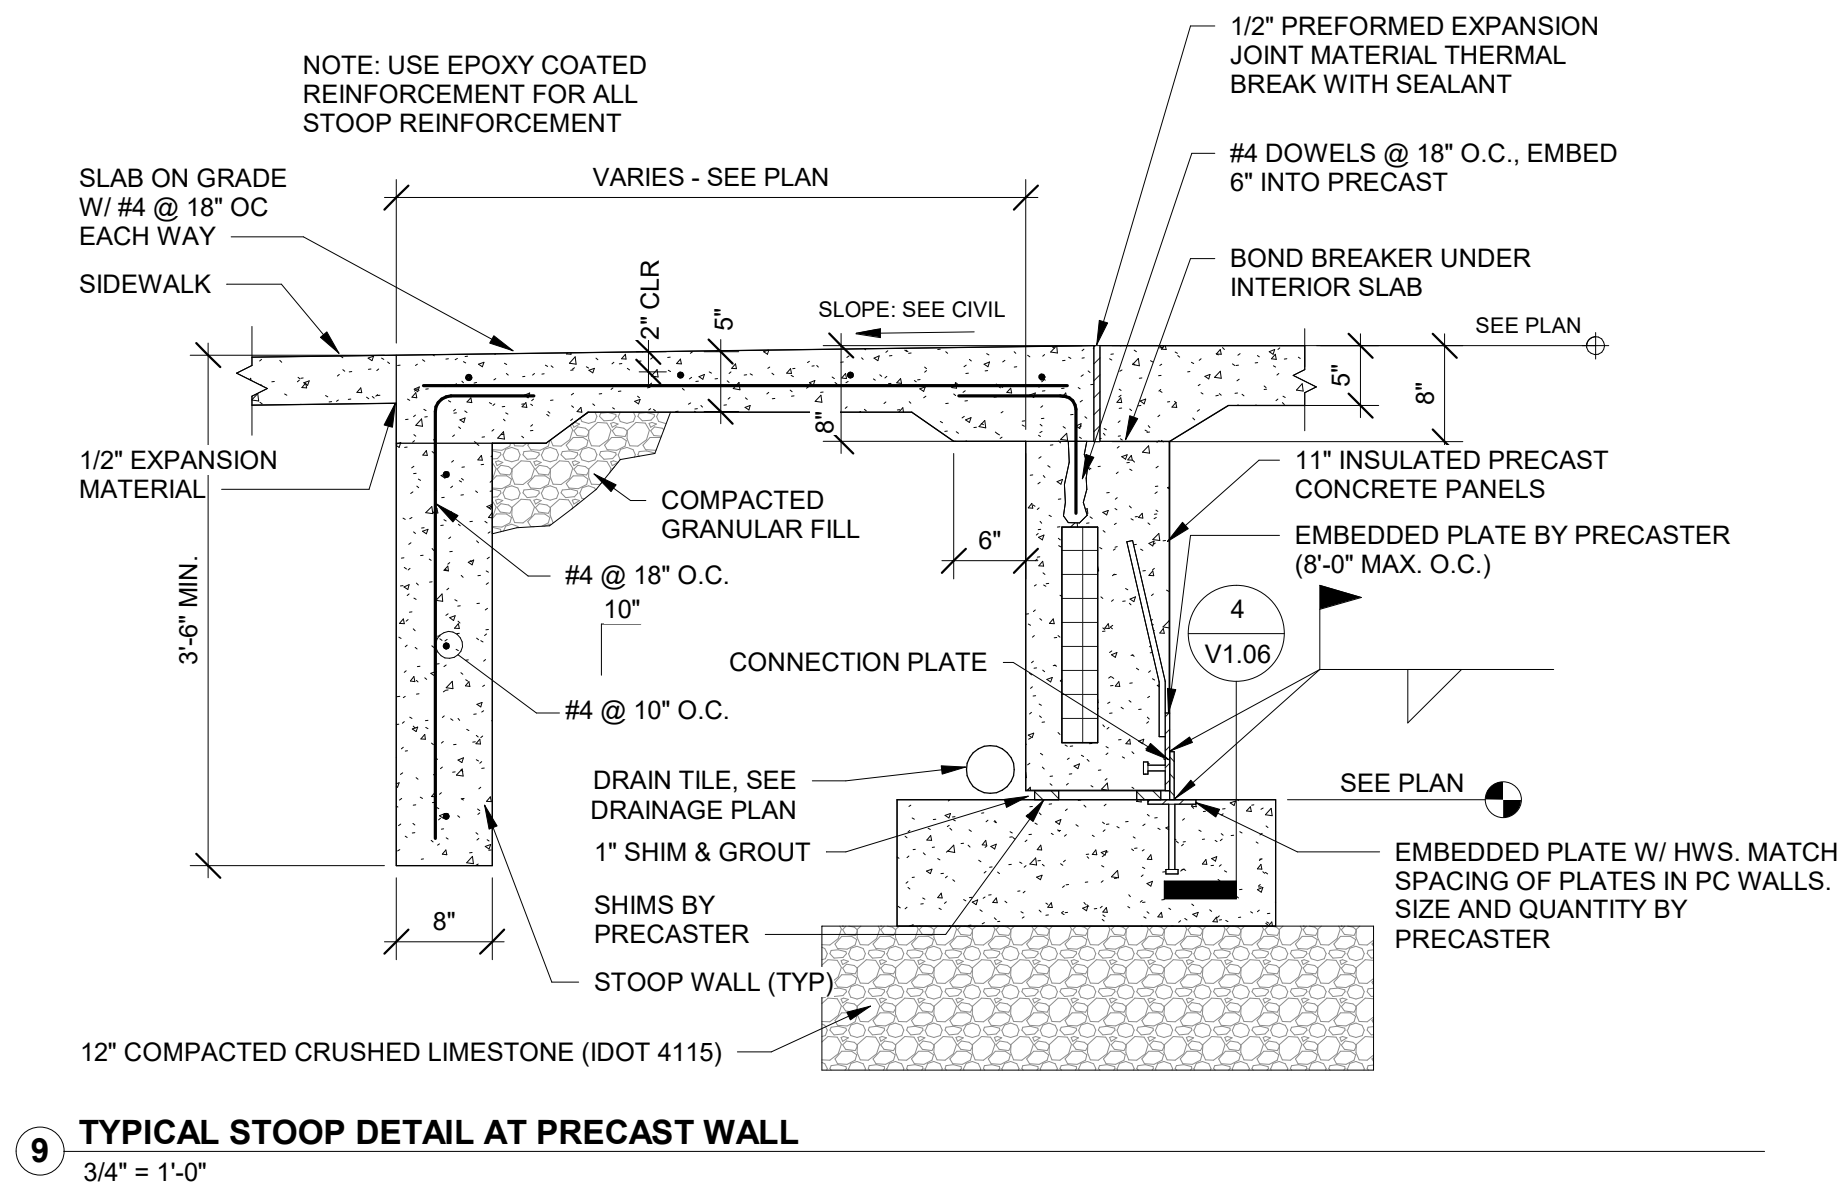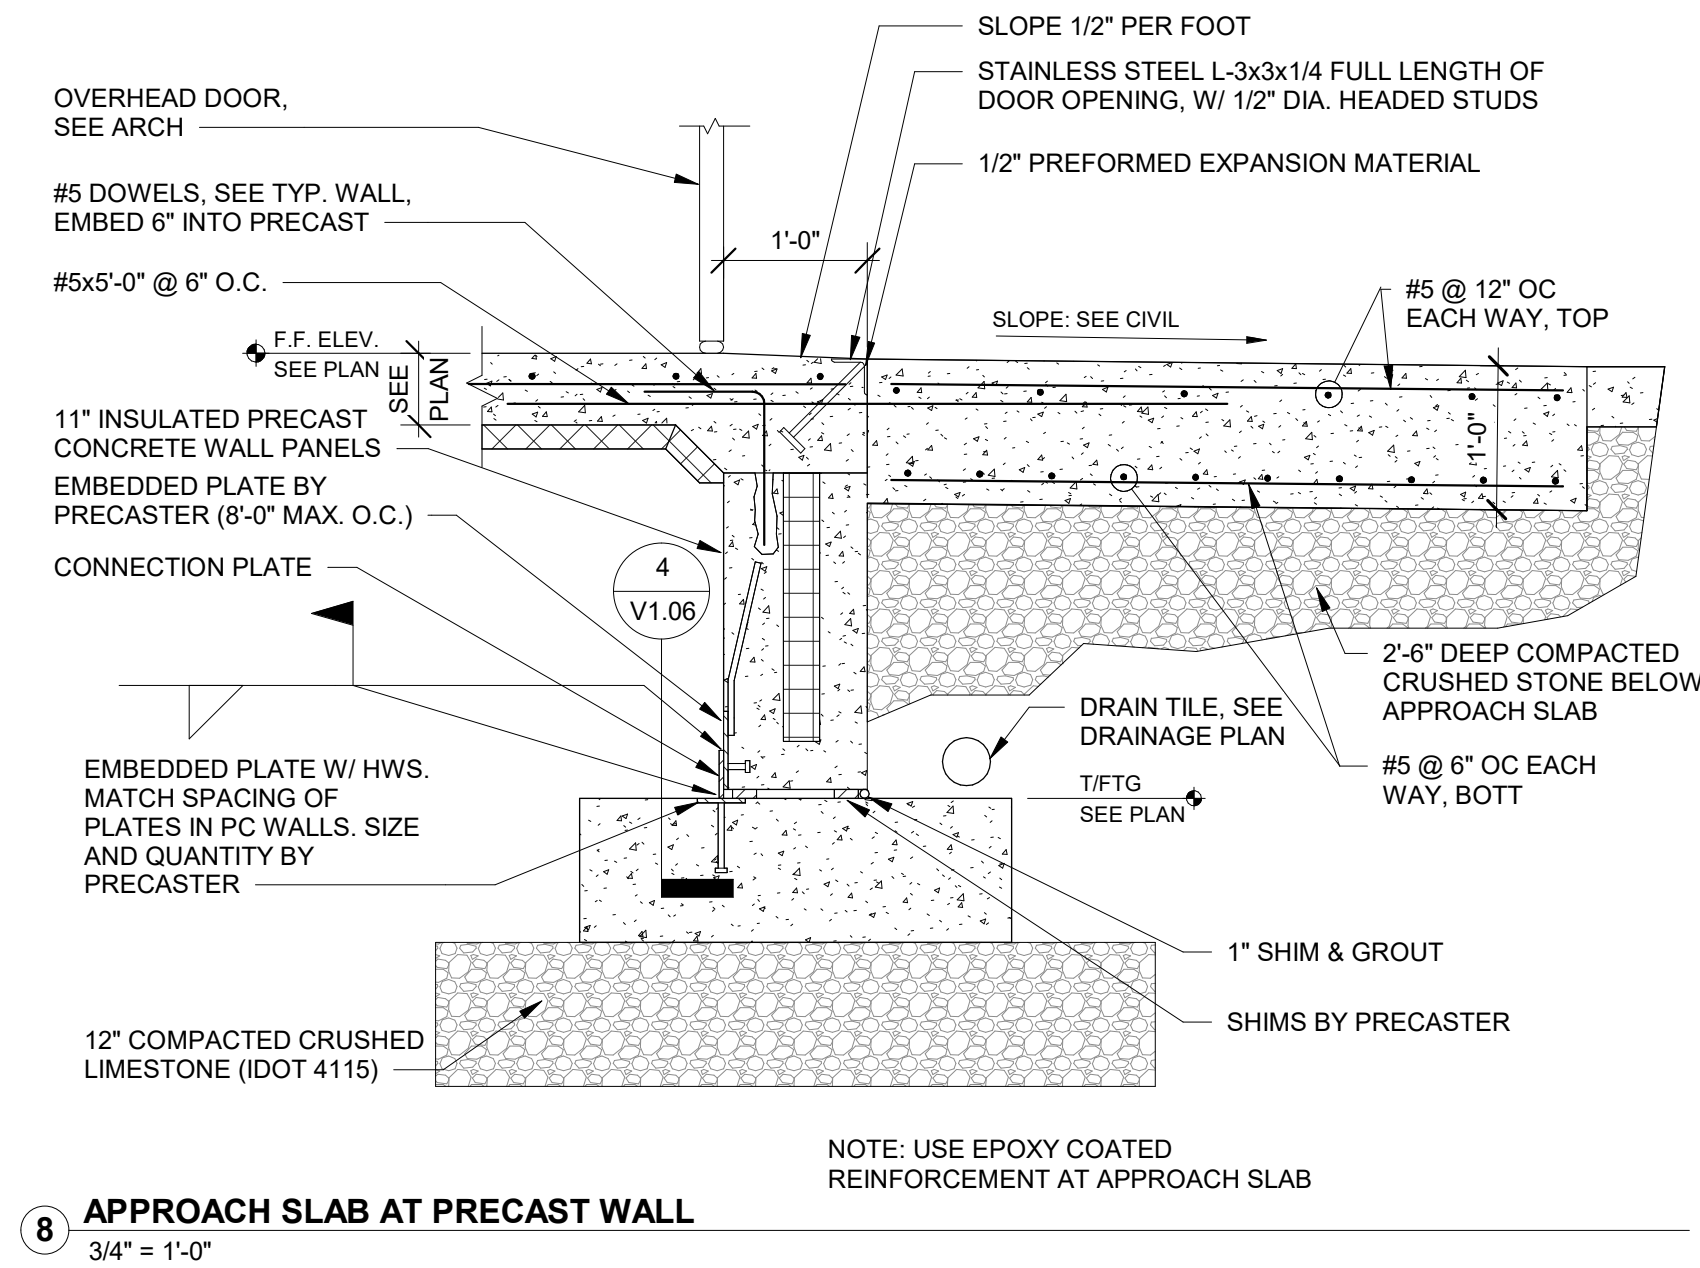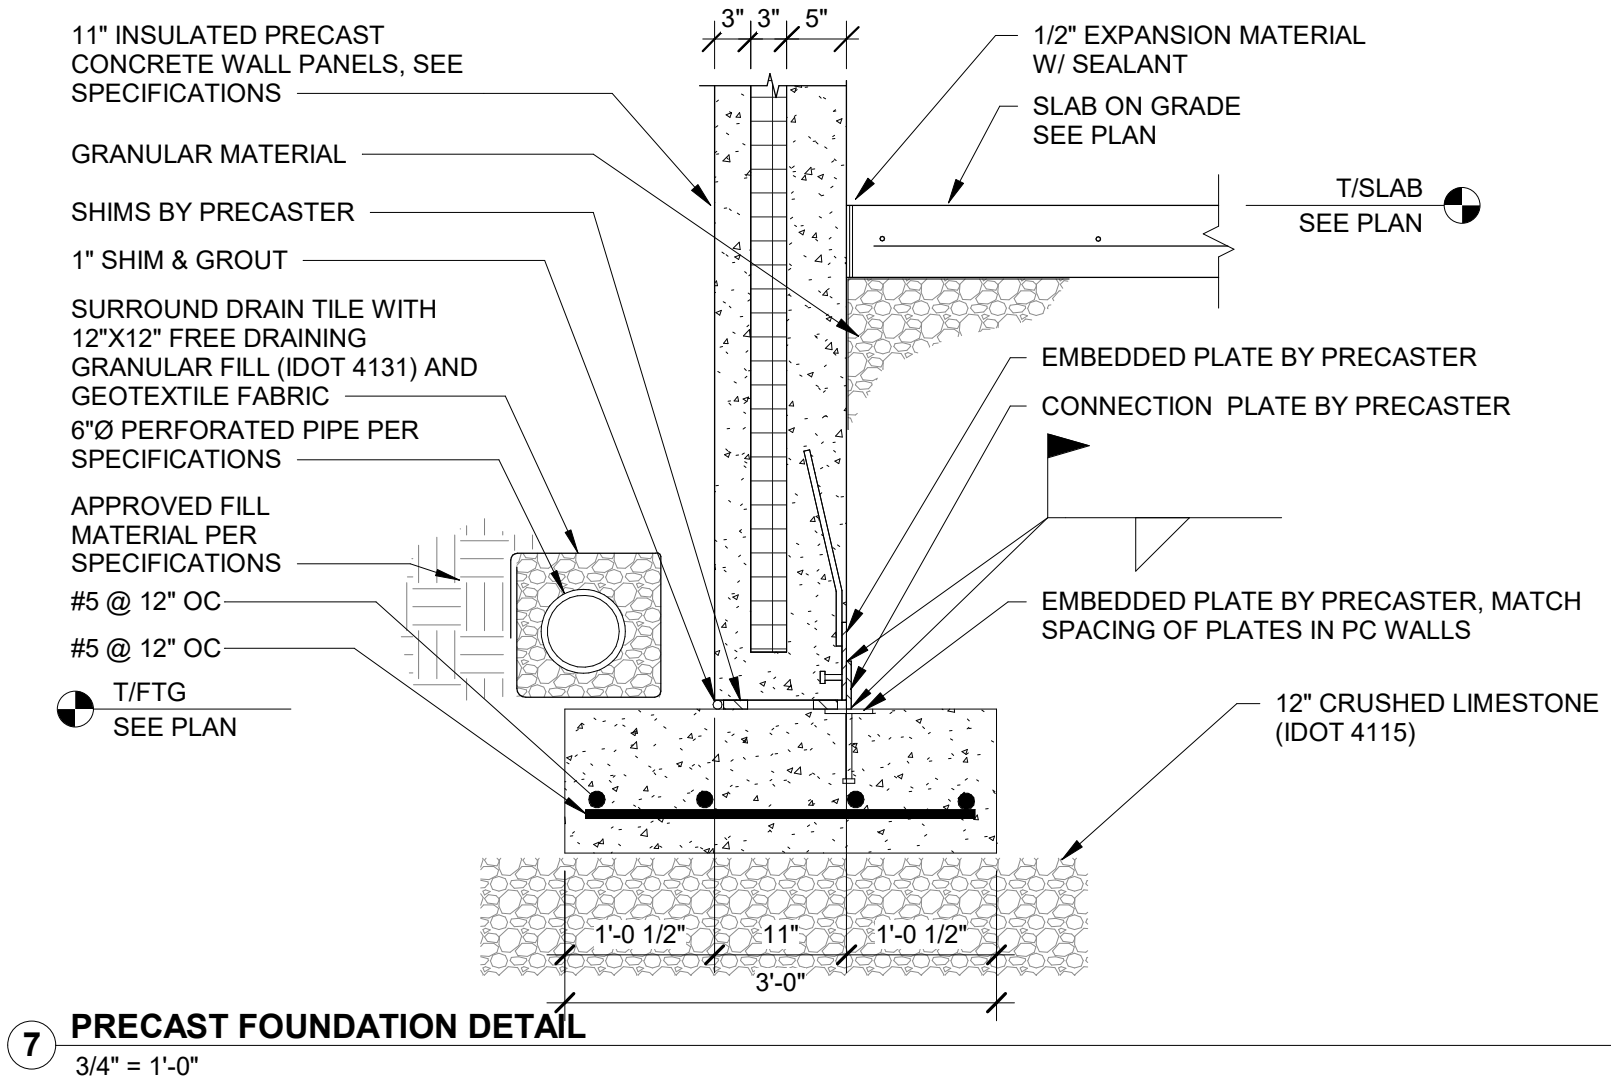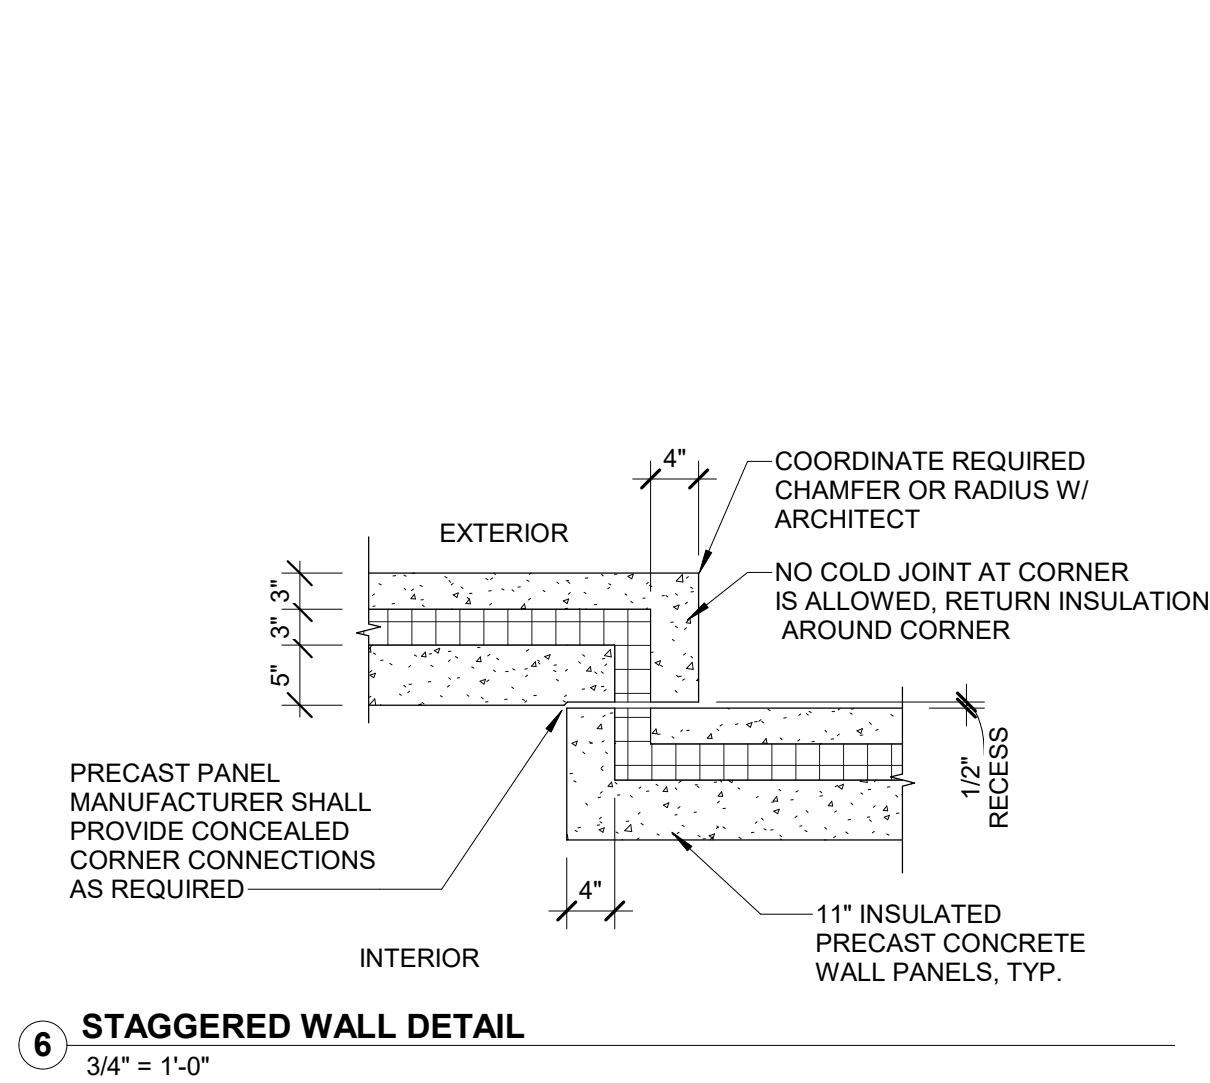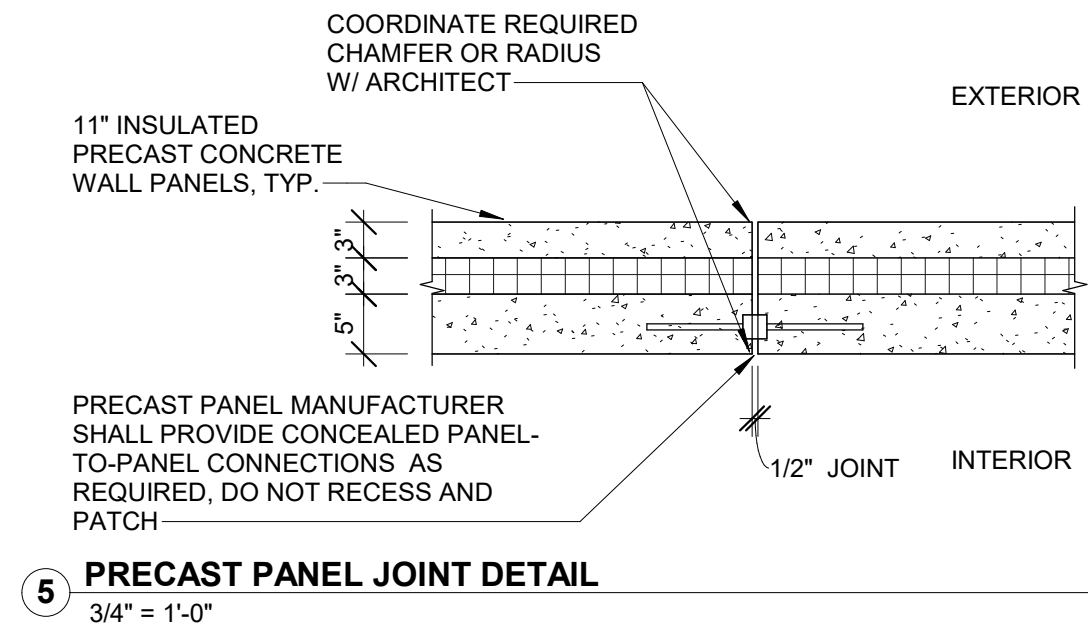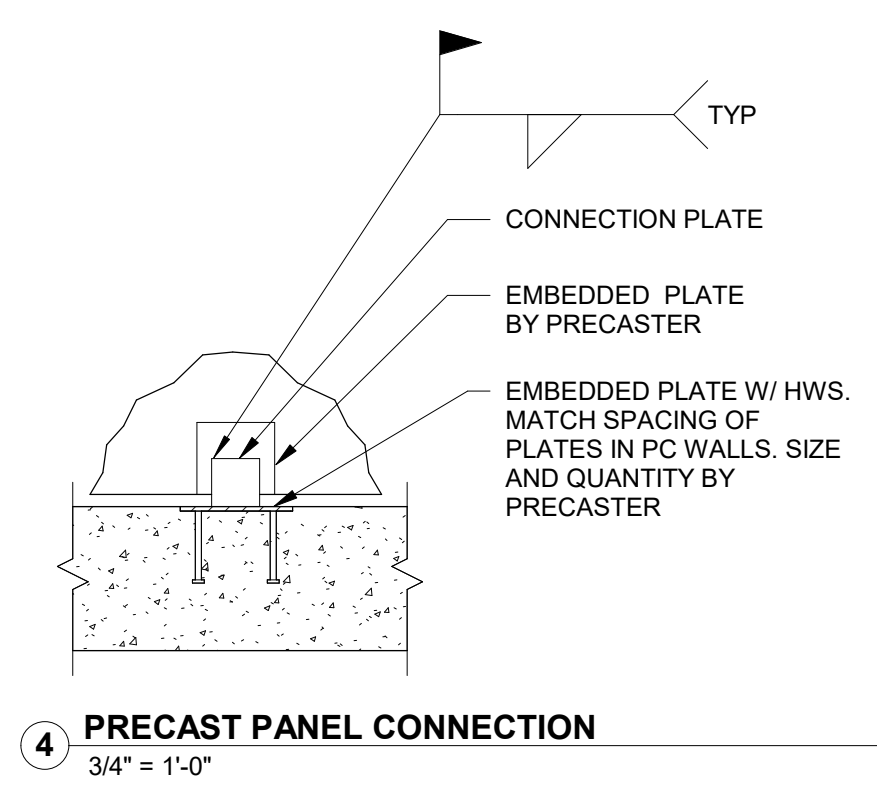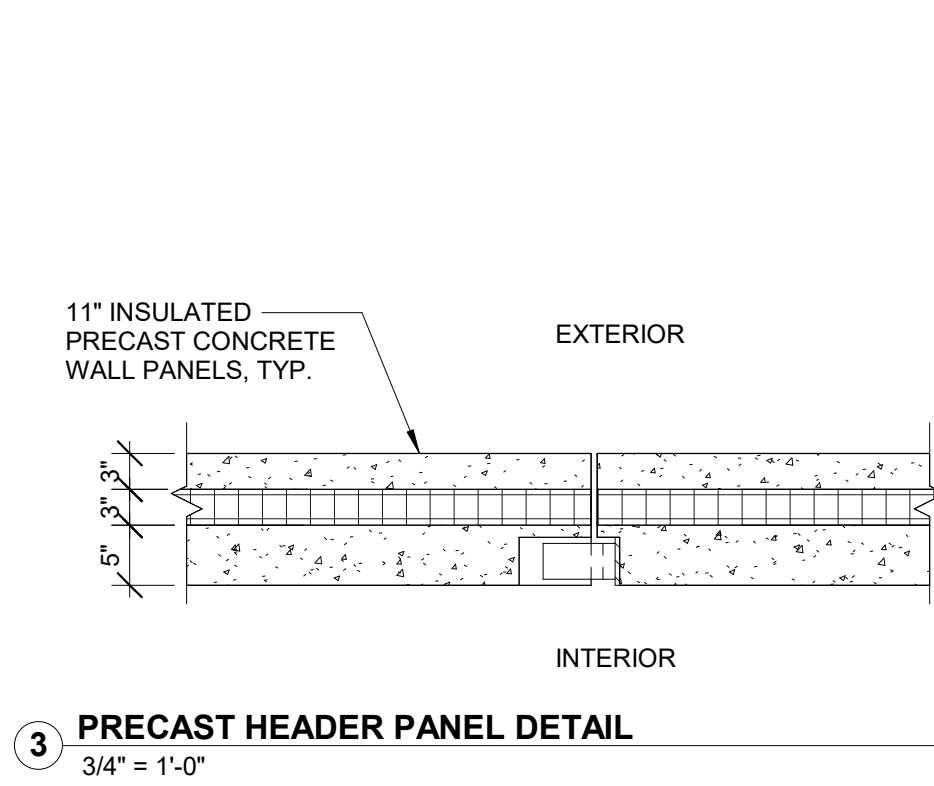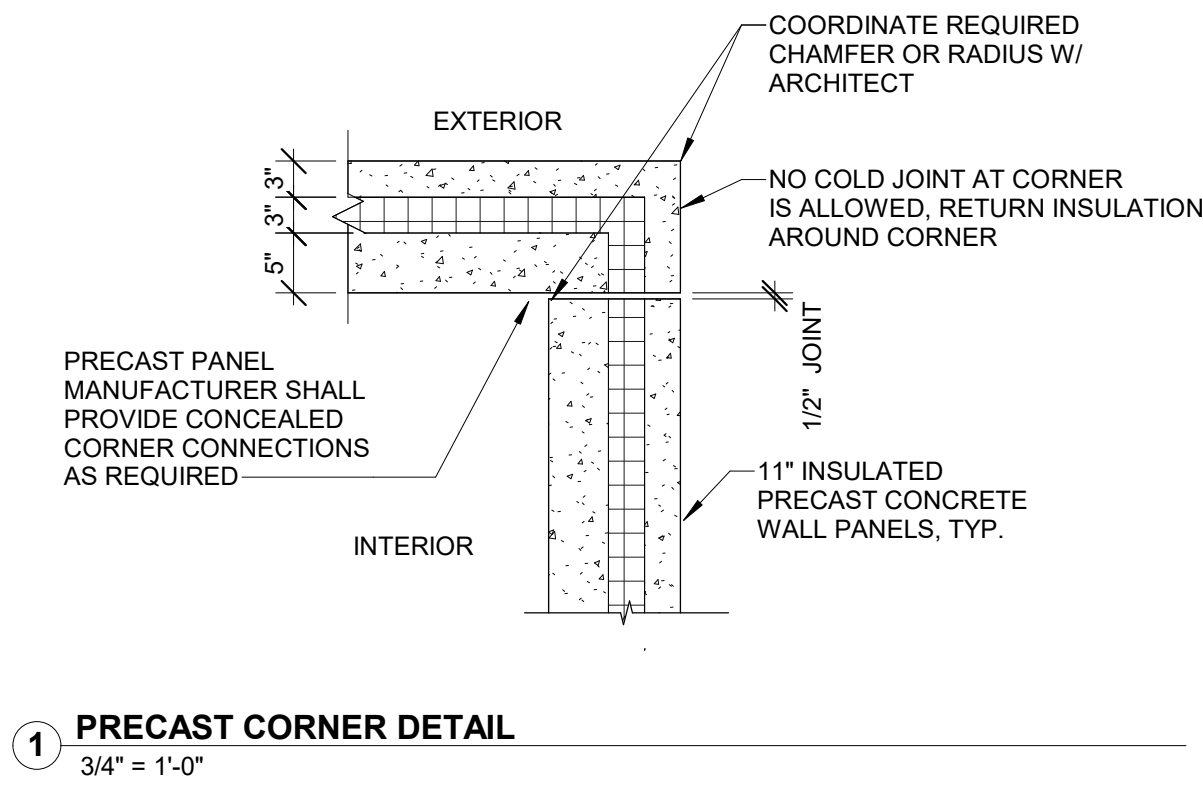




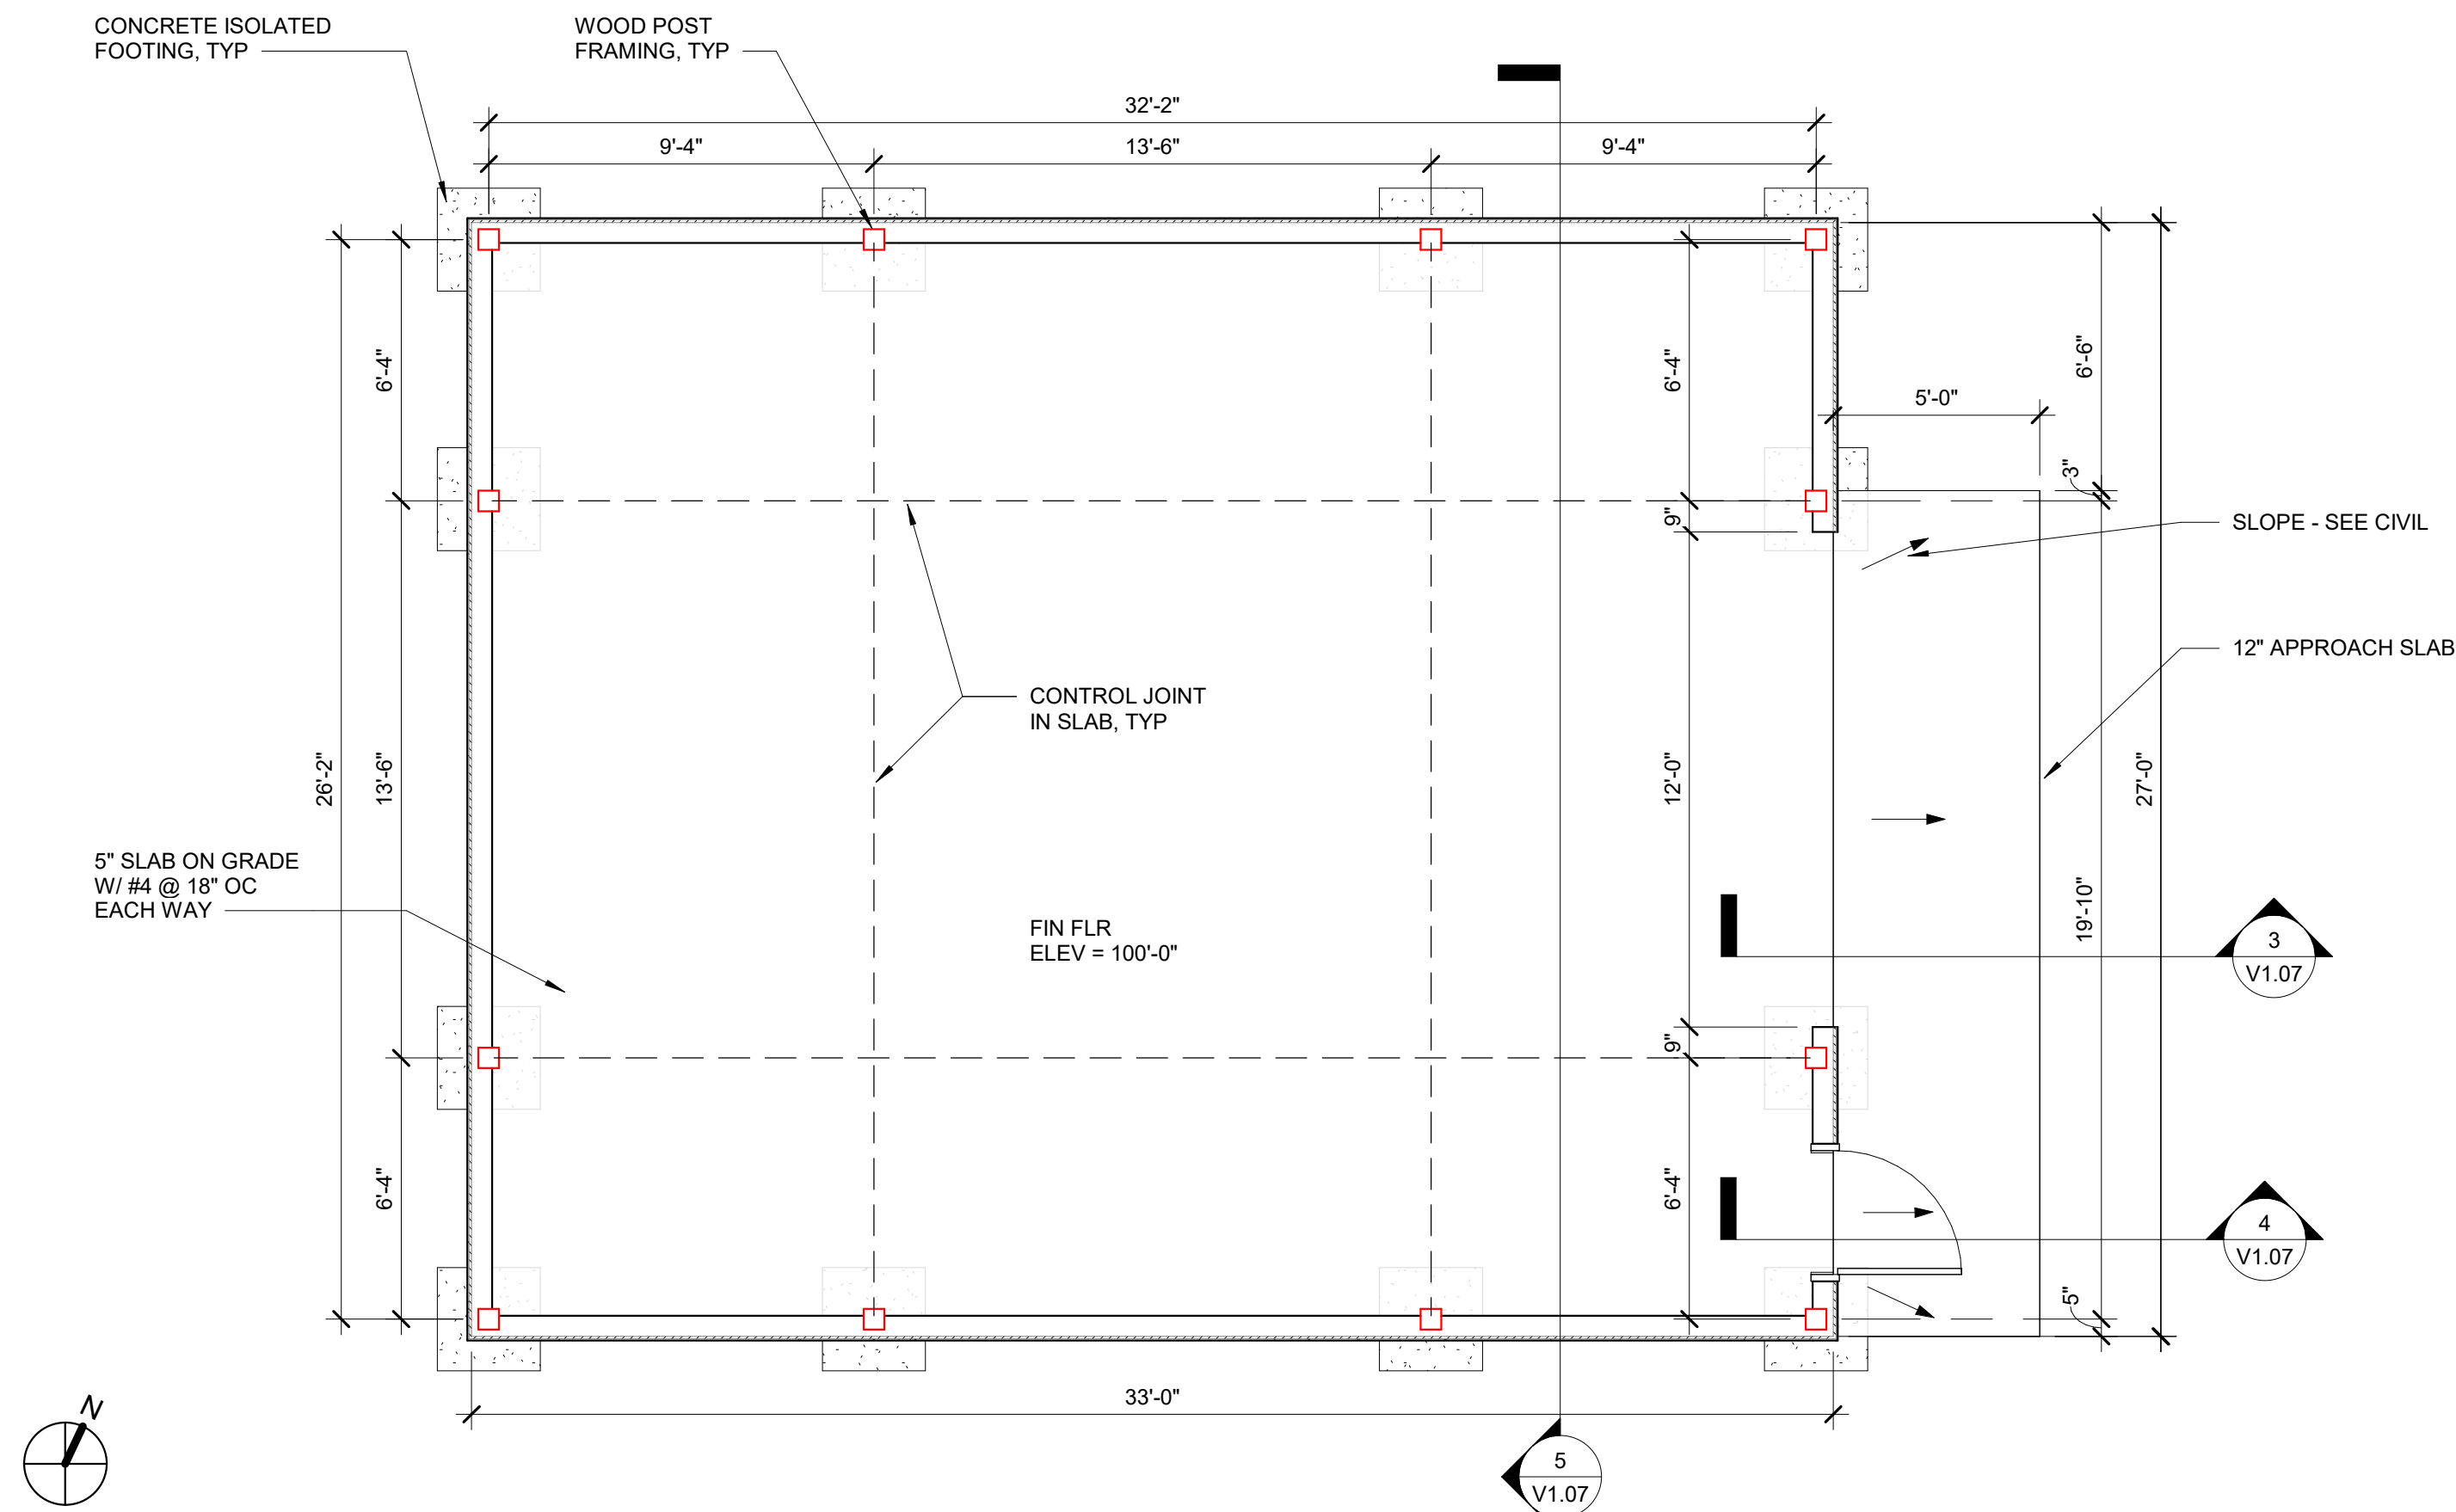


1 WOOD SHED FLOOR PLAN
1/4" = 1'-0"

NOTE: REFER TO SPECIFICATIONS SECTION 13 3400 ENGINEERED POST FRAME STRUCTURES.

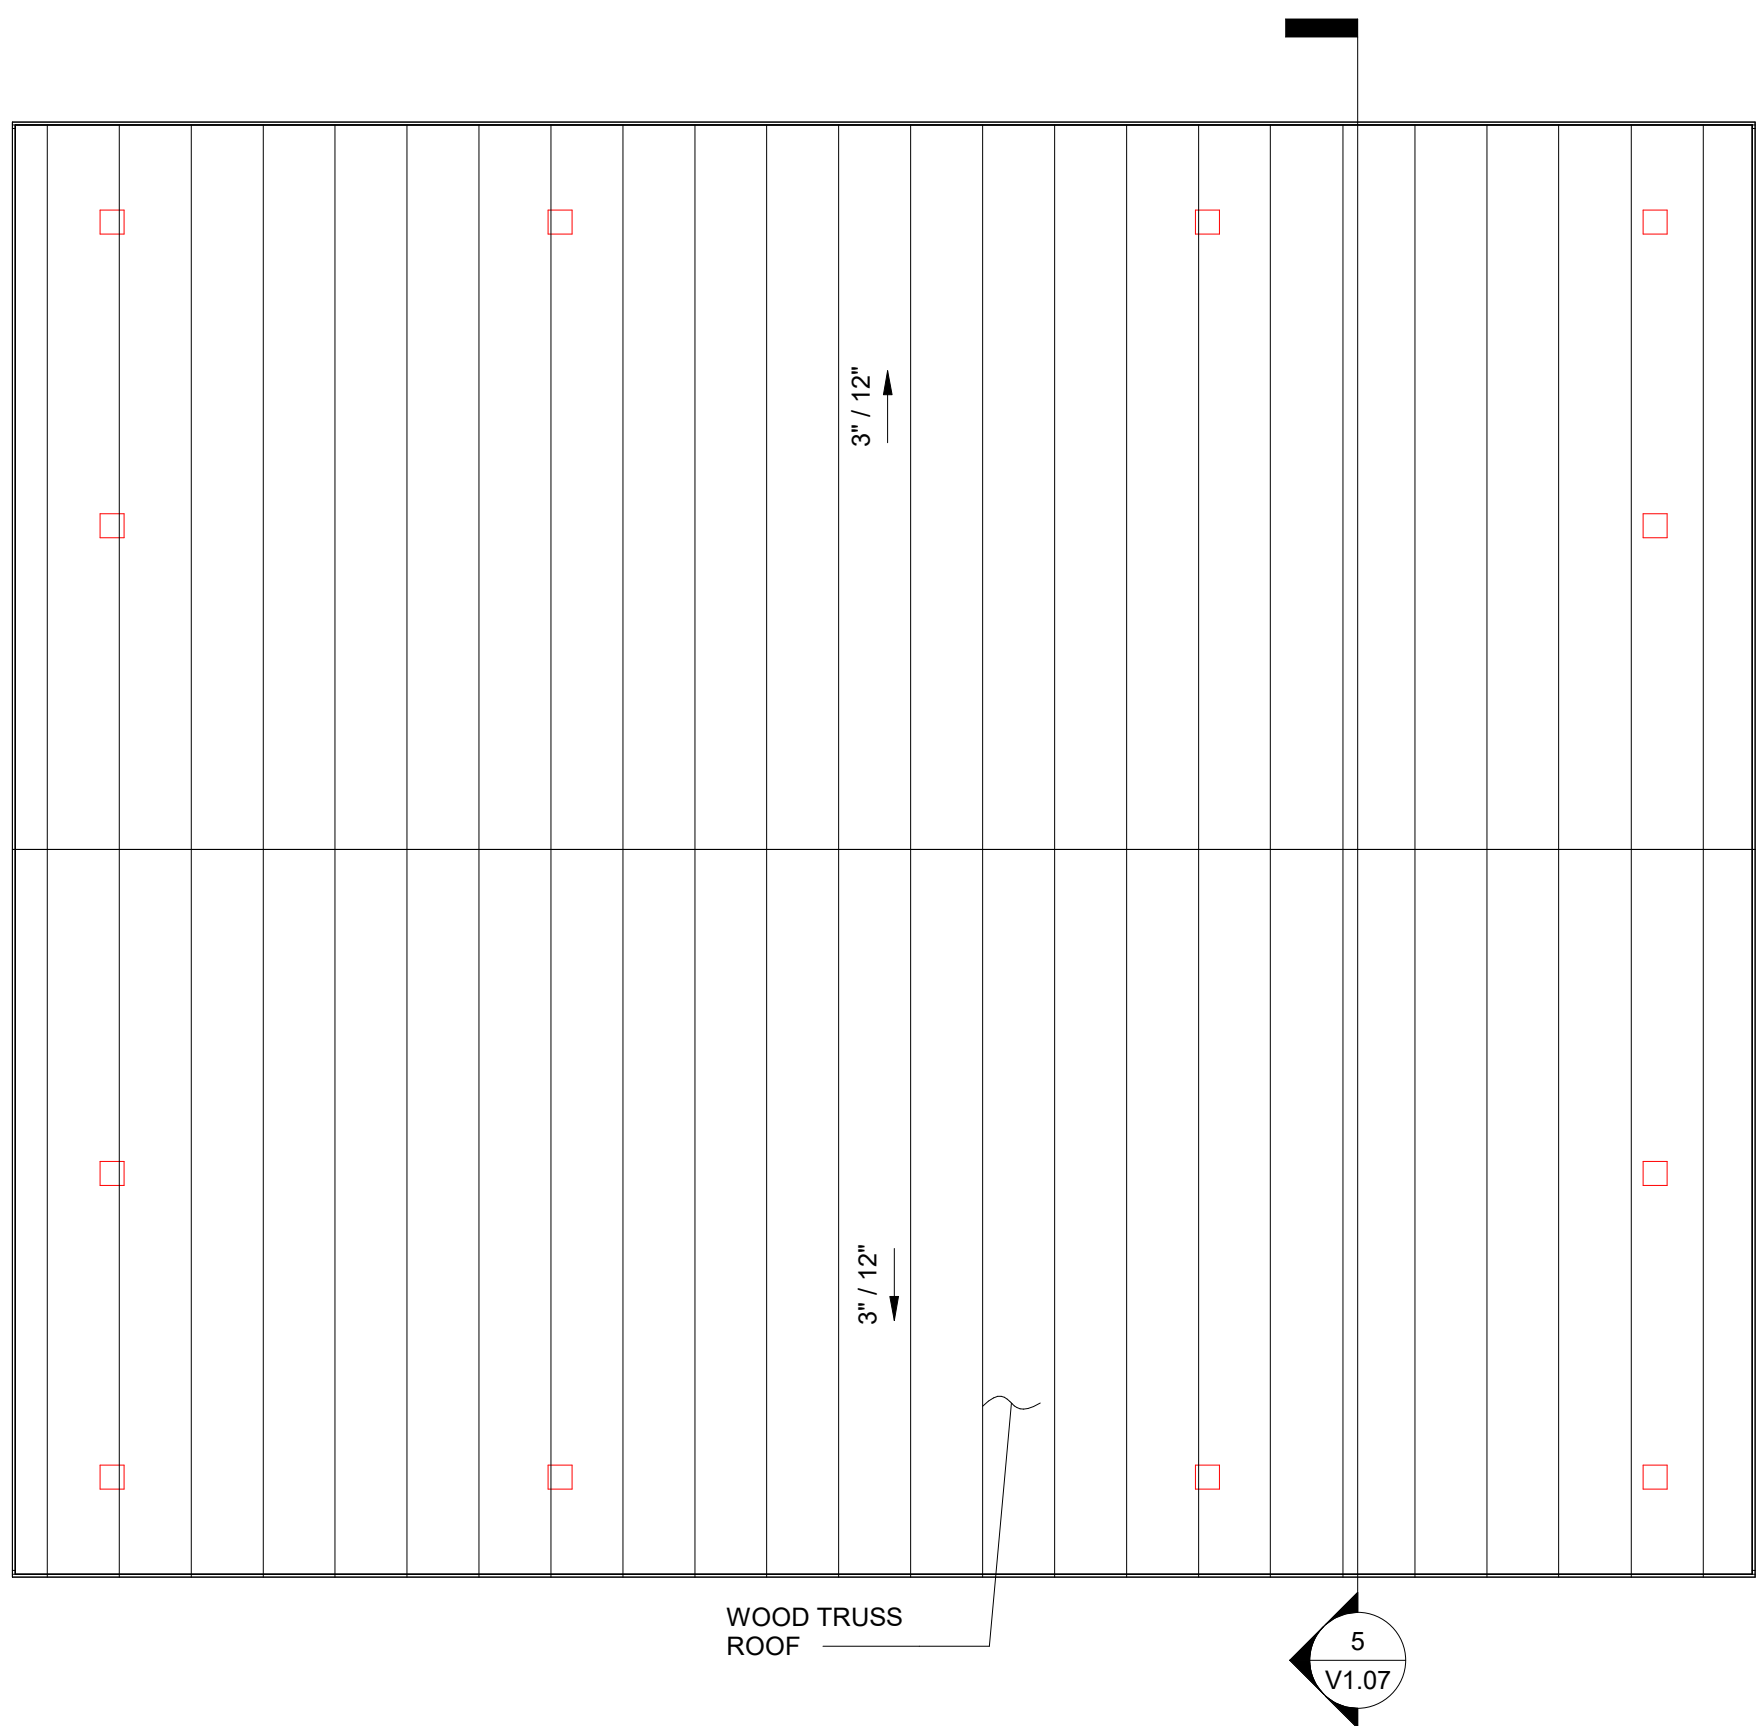

2 WOOD SHED ROOF PLAN
1/4" = 1'-0"

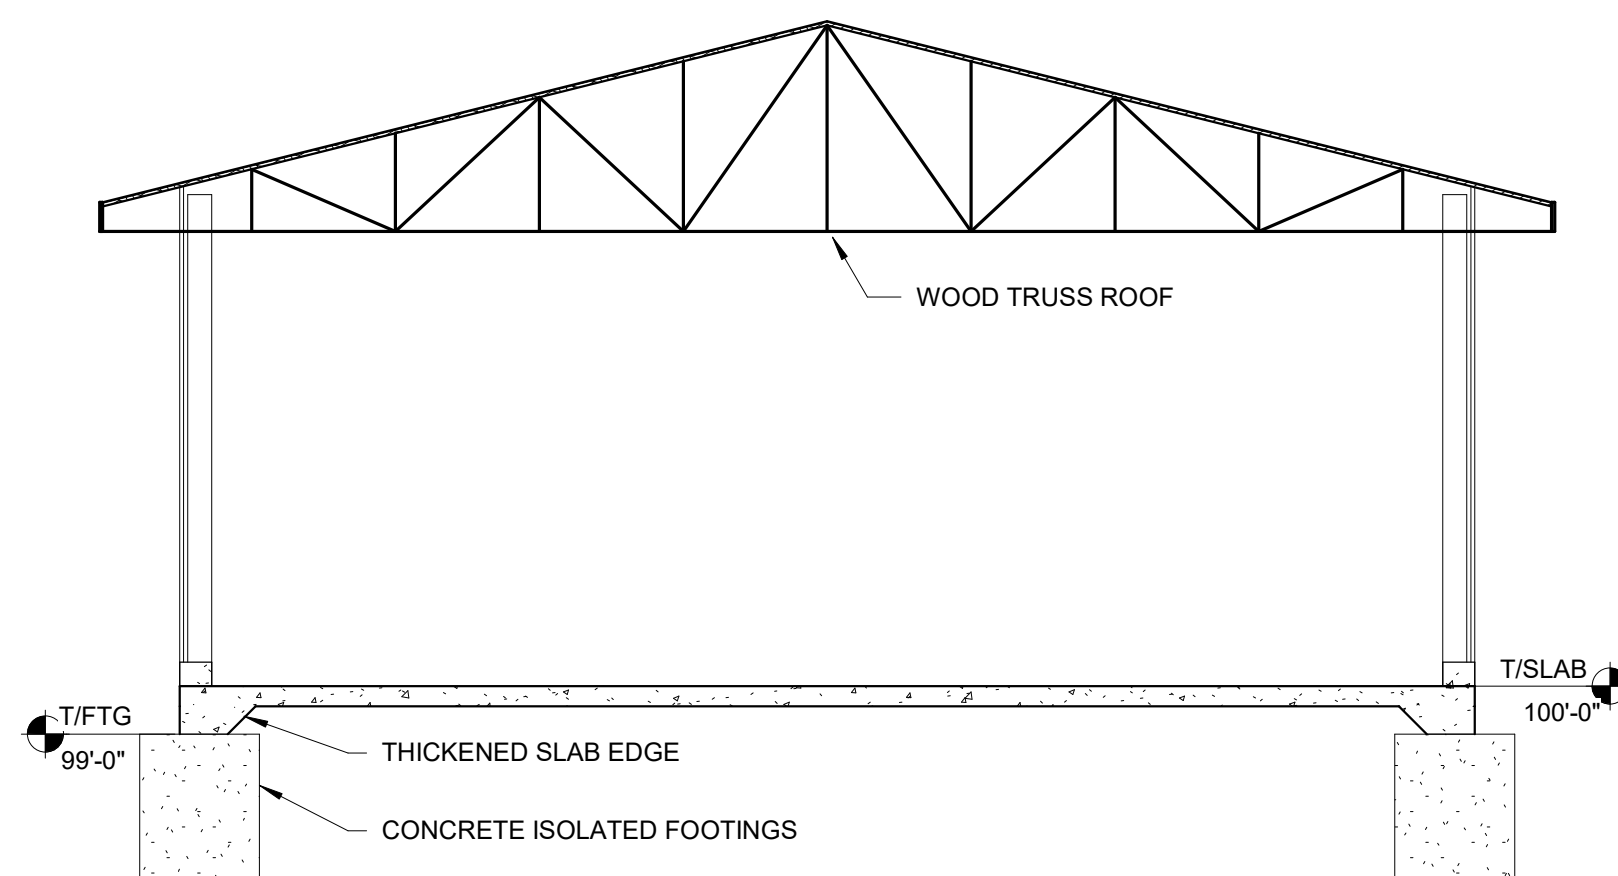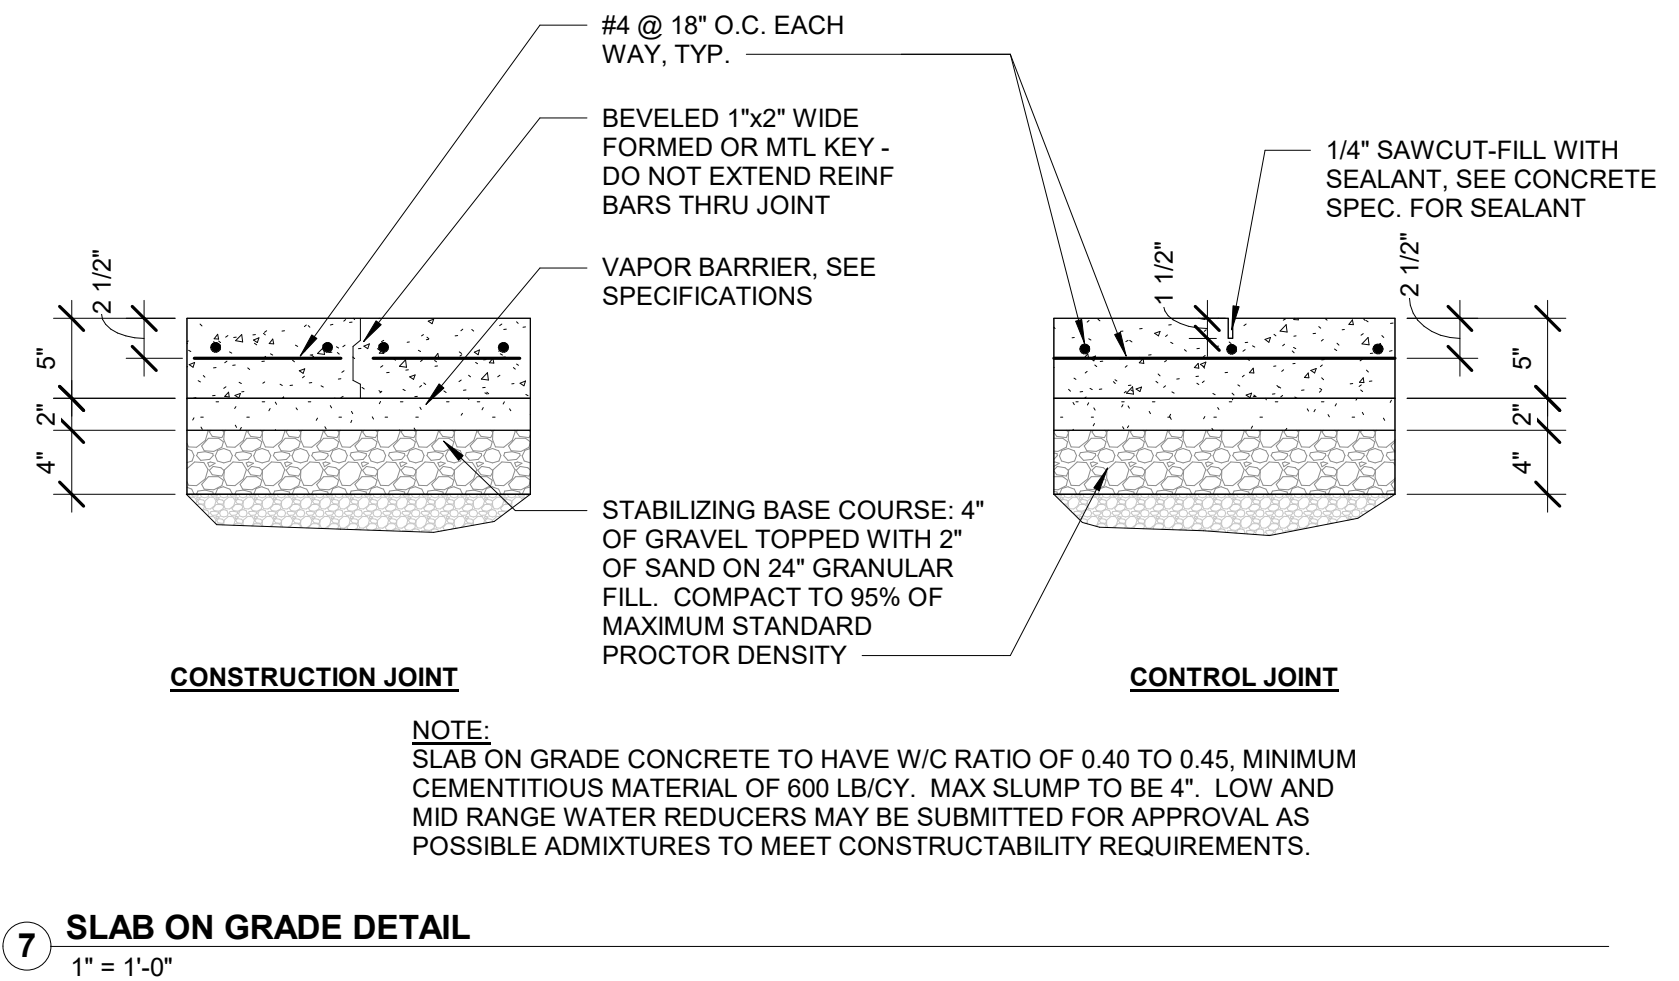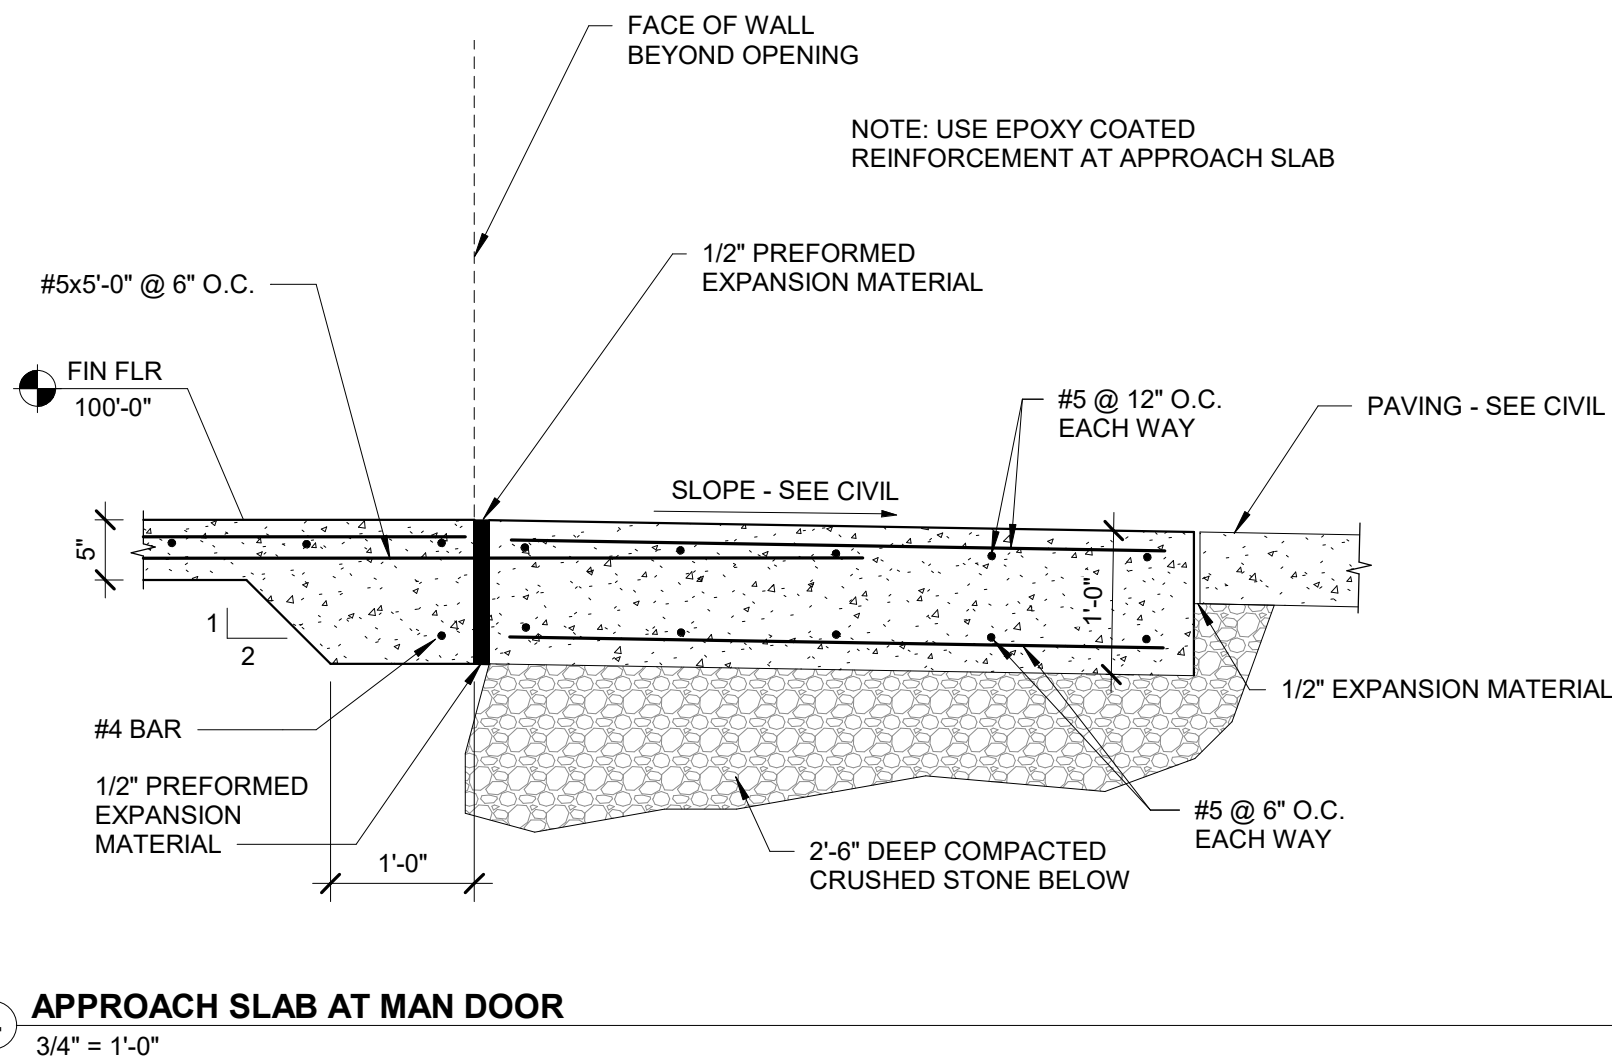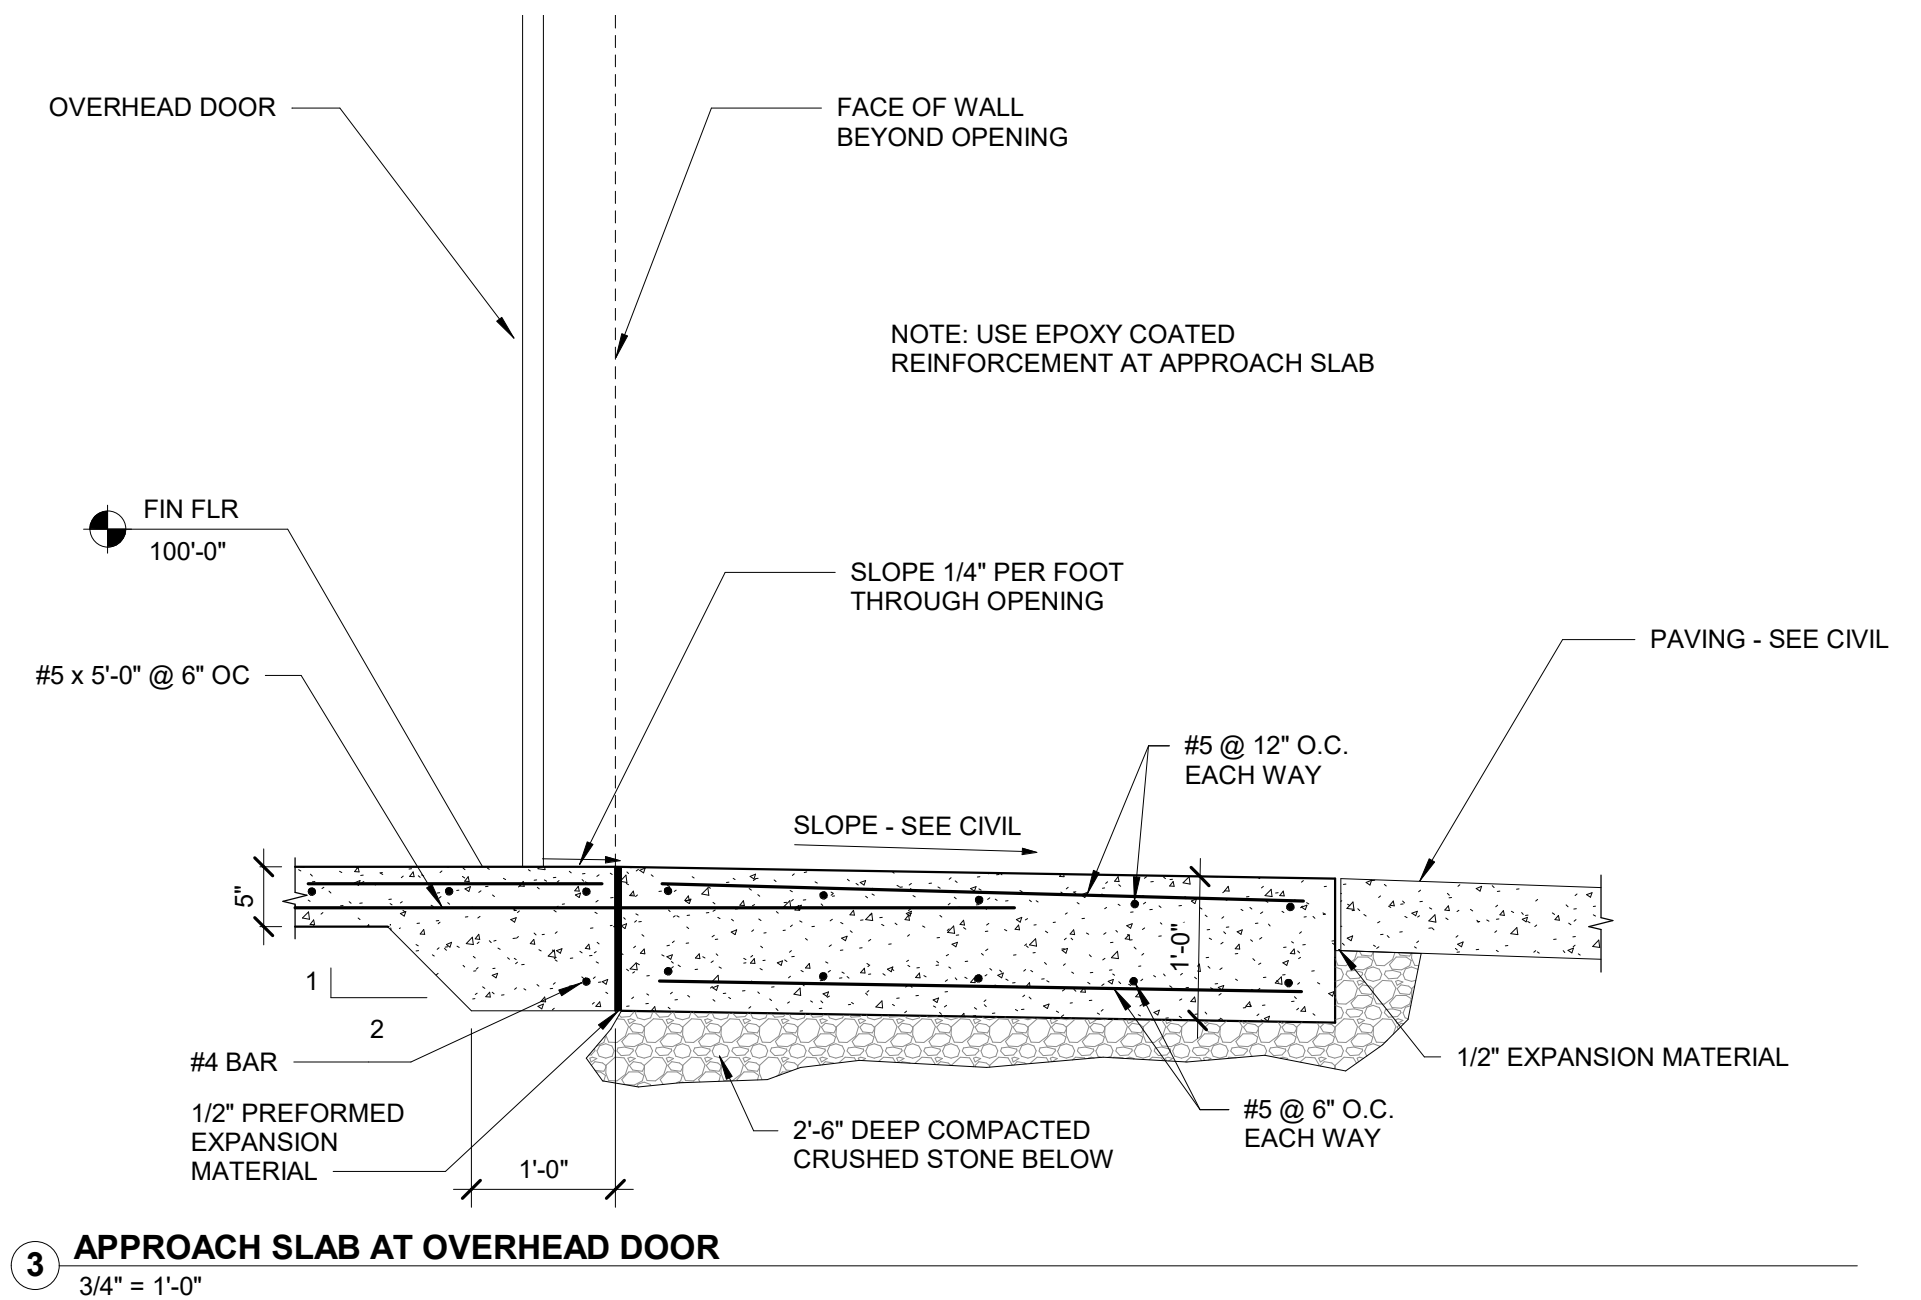

GENERAL CONSTRUCTION NOTES

- COORDINATE WORK WITH ALL OTHER TRADES TO ENSURE PROPER SEQUENCING AND INSTALLATION. THIS SHALL INCLUDE ANY VENDORS CONTRACTED DIRECTLY BY OWNER.
- ALL WORK SHALL BE PERFORMED AND COMPLETED IN COMPLIANCE WITH ALL APPLICABLE BUILDING CODES AND ORDINANCES.
- ANY AND ALL DISCREPANCIES AND DEFICIENCIES SHALL IMMEDIATELY BE BROUGHT TO THE ATTENTION OF THE ARCHITECT.
- COORDINATE WORK SCHEDULES WITH THE OWNER TO ESTABLISH CONSTRUCTION SEQUENCING.
- CONTRACTORS AND MATERIAL SUPPLIERS SHALL VERIFY ALL DIMENSIONS AND CONDITIONS WHICH WILL AFFECT THEIR WORK.
- REMOVE FROM THE SITE ALL DEBRIS AND MATERIALS RESULTING FROM CONSTRUCTION ON A REGULAR BASIS UNLESS NOTED OTHERWISE.
- CONTRACTOR SHALL BE RESPONSIBLE FOR HOOK-UP OF ANY TEMPORARY HEAT OR LIGHTING REQUIRED IN WORK AREAS.
- MAINTAIN ONE SET OF DRAWINGS ON SITE FOR THE PURPOSE OF RECORDING CONSTRUCTION REVISIONS. THIS RECORD SET SHALL BE RETURNED TO THE ARCHITECT UPON CONTRACT CLOSEOUT.
- MAINTAIN ACCESS TO PARK AREAS IN USE OR AS DIRECTED BY OWNER.
- INSTALL TEMPORARY WEATHER AND SECURITY BARRIERS AT EXTERIOR WALL OPENINGS WHEN WORK IS NOT IN PROGRESS.
- INTERIOR ELEVATIONS AT ROOMS 2.010 THRU 2.013 ARE SIMILAR TO THOSE INDICATED ON SHEET 2A.03.
- SLOPE ARROWS ON THE REFLECTED CEILING PLAN POINT TOWARDS THE LOW CEILING SIDE OF THE ROOM.
- COORDINATE SIZE OF ROUGH OPENING WITH DOOR AND WINDOW REQUIREMENTS.
- ALL DIMENSIONS ARE NOMINAL. (EXCEPT ACCESSIBILITY DIAGRAMS ON THIS SHEET).

CODE REVIEW

CODES
2021 INTERNATIONAL BUILDING CODE (IBC)
2012 INTERNATIONAL ENERGY CONSERVATION CODE (IECC)
2021 INTERNATIONAL FIRE CODE (IFC)
2012 INTERNATIONAL MECHANICAL CODE (IMC)
2021 INTERNATIONAL FUEL GAS CODE (IFGC)
2021 UNIFORM PLUMBING CODE (UPC)
OCCUPANT LOAD FOR DETERMINING MINIMUM PLUMBING FIXTURE QUANTITIES SHALL BE PER THE 2021 INTERNATIONAL BUILDING CODE (IBC) SECTION 1004 AND TABLE 1004.5
2020 NATIONAL ELECTRICAL CODE (NEC)

FACILITY DATA

AREA SIZE:
SHOWER ROOMS 1,596 SF
MECHANICAL ROOM 310 SF
CHASE 451 SF
ELECTRICAL/COMMUNICATIONS 136 SF
STORAGE 1,016 SF
TOTAL 3,509 SF

NUMBER OF PROPOSED STORIES: ONE STORY
FACILITY IS NOT SPRINKLERED.
CONSTRUCTION TYPE: V-B
OCCUPANCY CLASSIFICATION: A-3
ALLOWABLE AREA: 6,000 SF
ALLOWABLE HEIGHT: ONE STORY, 40'
AREA SEPARATION: NONSEPARATED OCCUPANCIES (A-3 OCCUPANCY CLASSIFICATION MOST RESTRICTIVE)

OCCUPANT LOAD:
ACCESSORY AREAS (STORAGE, MECHANICAL AND EQUIPMENT ROOMS)
MECHANICAL, CHASE AND ELECTRICAL/COMMUNICATIONS
1,913 SF 300 SF/OCCUPANT 6 OCCUPANTS

ASSEMBLY WITH FIXED SEATS
SHOWER ROOMS
1,596 SF 1 OCCUPANT/SHOWER ROOM 12 OCCUPANTS


TOTAL OCCUPANT LOAD 18 OCCUPANTS

EXIT ACCESS TRAVEL DISTANCE: 200' MAXIMUM, IBC TABLE 1017.2
COMMON PATH OF TRAVEL: 75' MAXIMUM, IBC TABLE 1006.2.1
DEAD-END CORRIDOR: 20' MAXIMUM, IBC 1020.5
REQUIRED EXITS: ONE EXIT, IBC TABLE 1006.2.1
REQUIRED EXITS, (MECHANICAL/CHASE): TWO EXITS, IBC 1006.2.2.1, BOILER EXCEEDS 400,000 BTU
EXITS PROVIDED: 16 EXITS
FIRE EXTINGUISHERS: 75' MAXIMUM TRAVEL DISTANCE, 3 PROVIDED
INTERIOR FINISHES: PER IBC CHAPTER 8
HANDICAP ACCESSIBLE REQUIREMENTS: YES


RESTROOM FACILITIES:
QUANTITIES ARE BASED UPON 2021 UPC AMENDMENTS, TABLE 422.1, ASSEMBLY

	PLUMBING FIXTURE COUNT						
	MALE				FEMALE		
	W.C.	URINAL	LAV	SHOWERS	W.C.	LAV	SHOWERS
REQUIRED	1	0	1	0	1	1	0
EXISTING	2	0	2	2	2	0	2
NEW(UNISEX)	12	0	12	12	SEE MALE QTY. - RESTROOMS ARE UNISEX		


PER 2021 UPC AMENDMENTS: DRINKING FOUNTAINS ARE NOT REQUIRED WHERE THE OCCUPANT LOAD IS 30 OR LESS. URINALS ARE NOT REQUIRED IN UNISEX RESTROOMS.

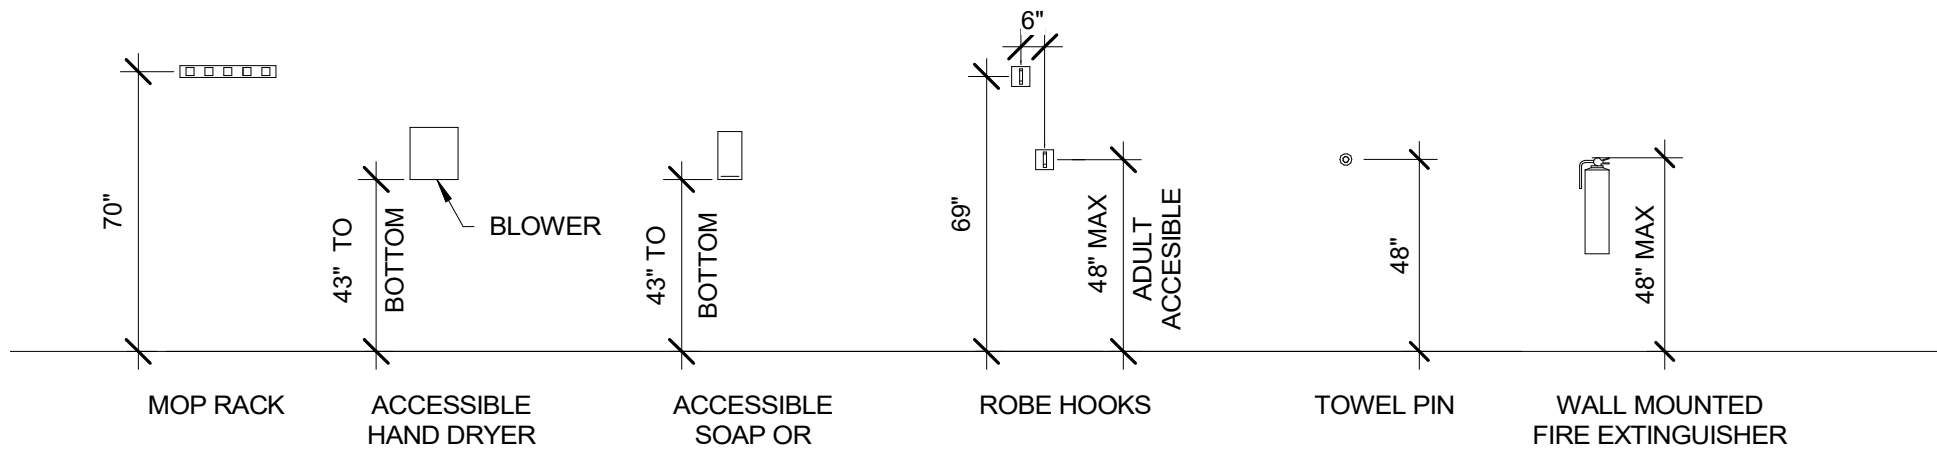


1 ACCESSORY MOUNTING DIAGRAM
1/4" = 1'-0"

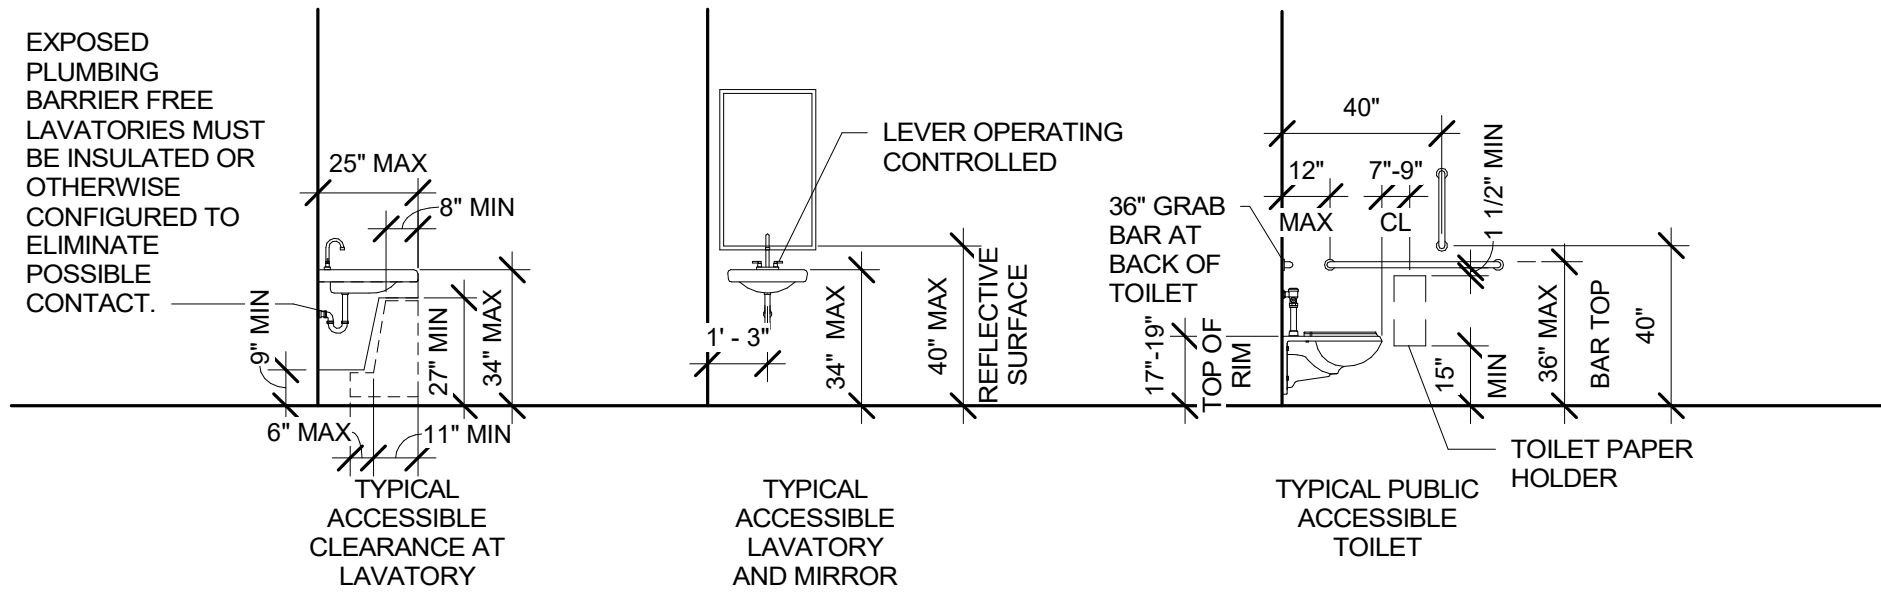

3 TYPICAL ACCESSIBILITY ELEVATIONS
1/4" = 1'-0"

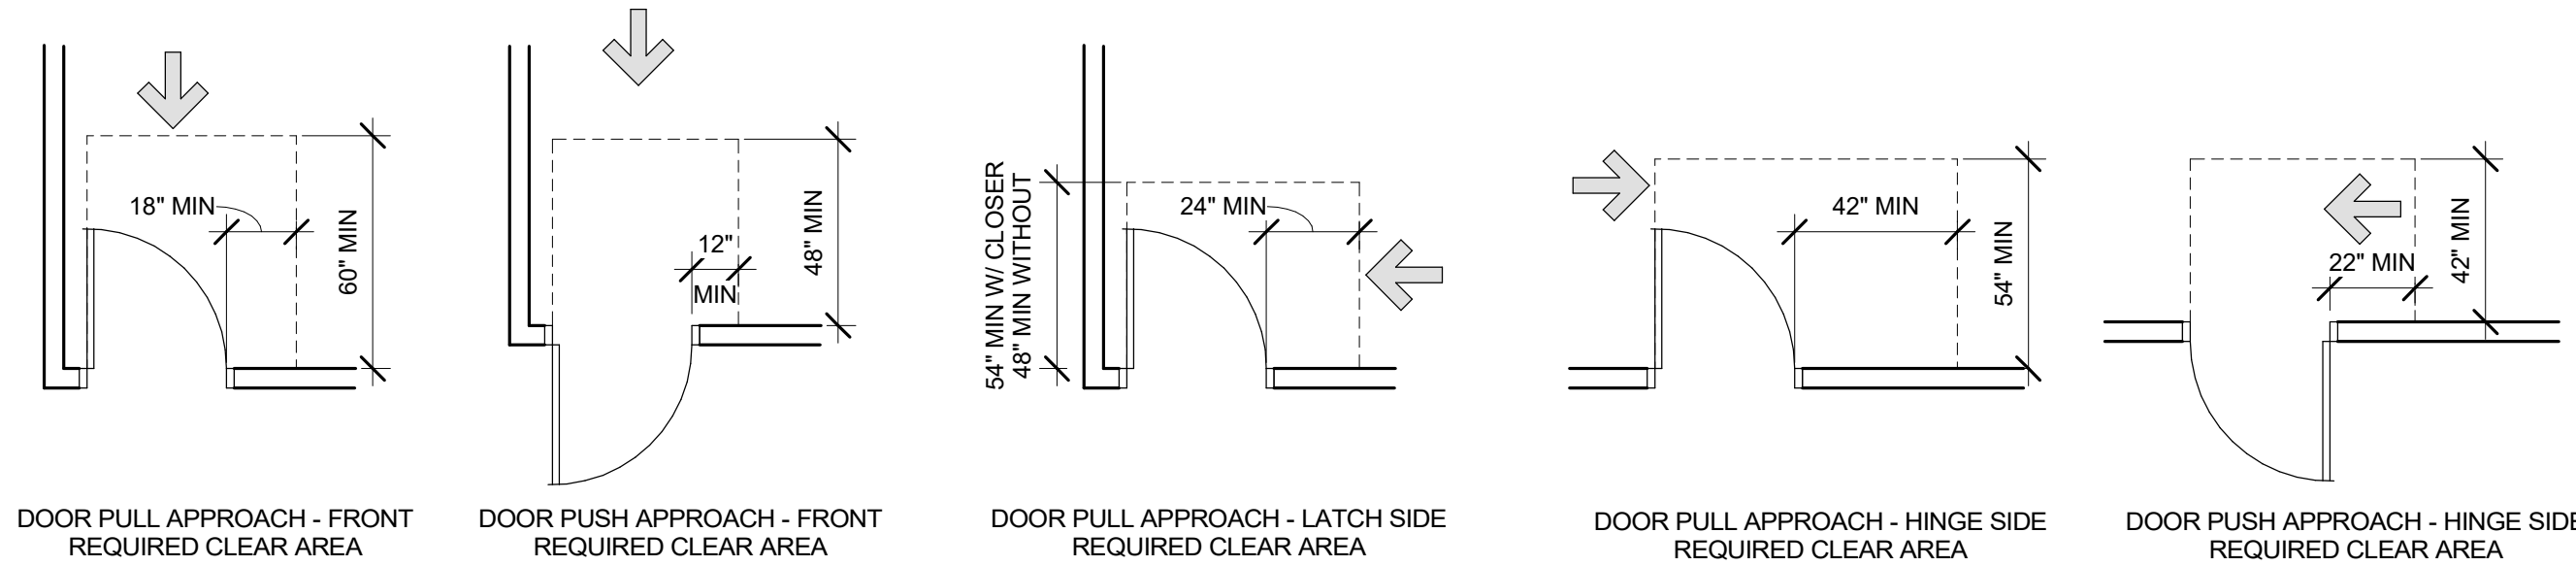




4 TYPICAL DOOR CLEAR FLOOR SPACE REQUIREMENTS
1/4" = 1'-0"

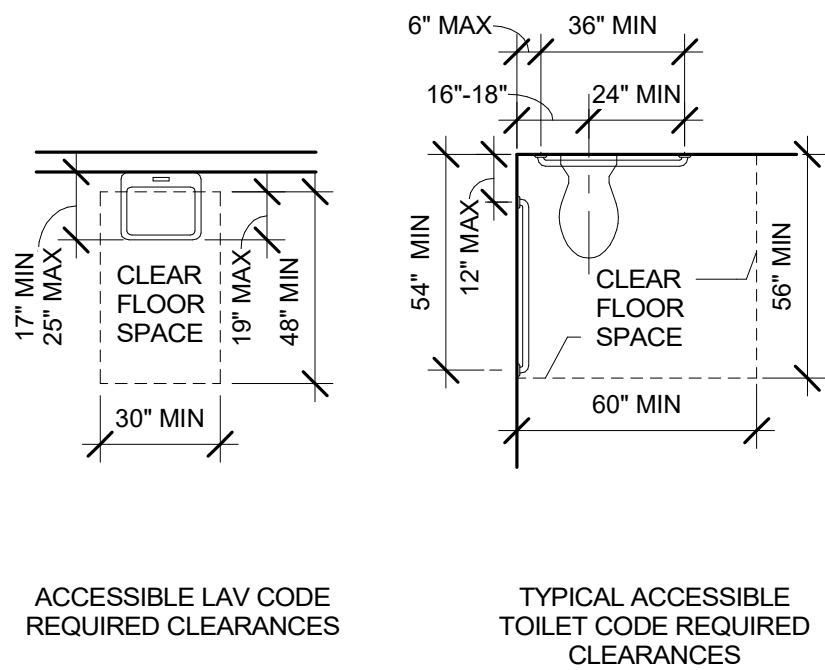

5 TYPICAL FIXTURE CLEAR FLOOR SPACE REQUIREMENTS
1/4" = 1'-0"

ARCHITECTURAL LEGEND

- KEYNOTE
- ROOM NAME
- ROOM TAG
- DOOR TAG
- WINDOW TAG

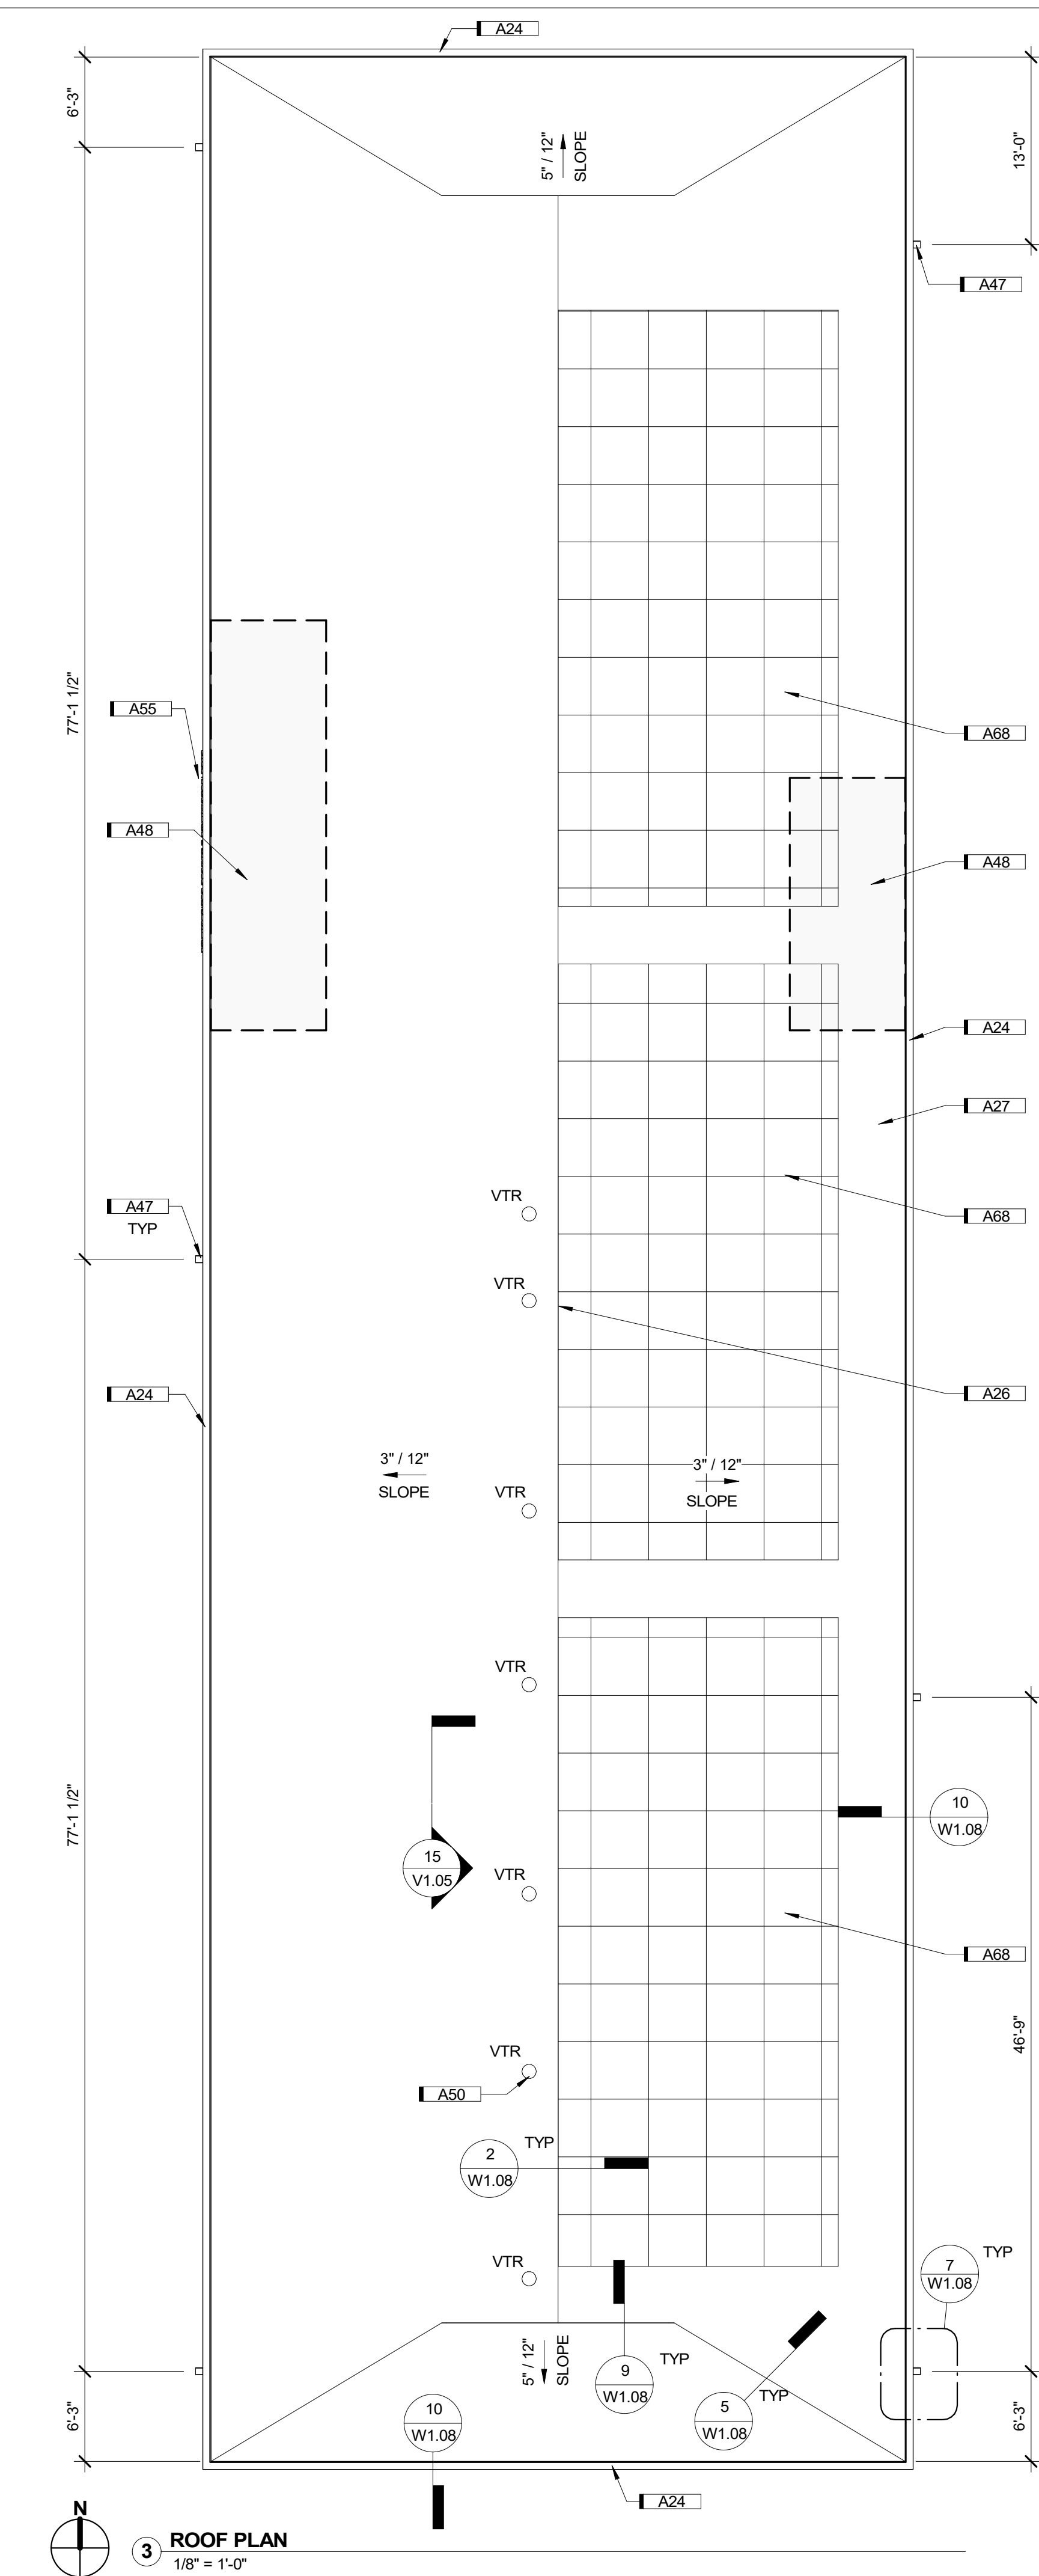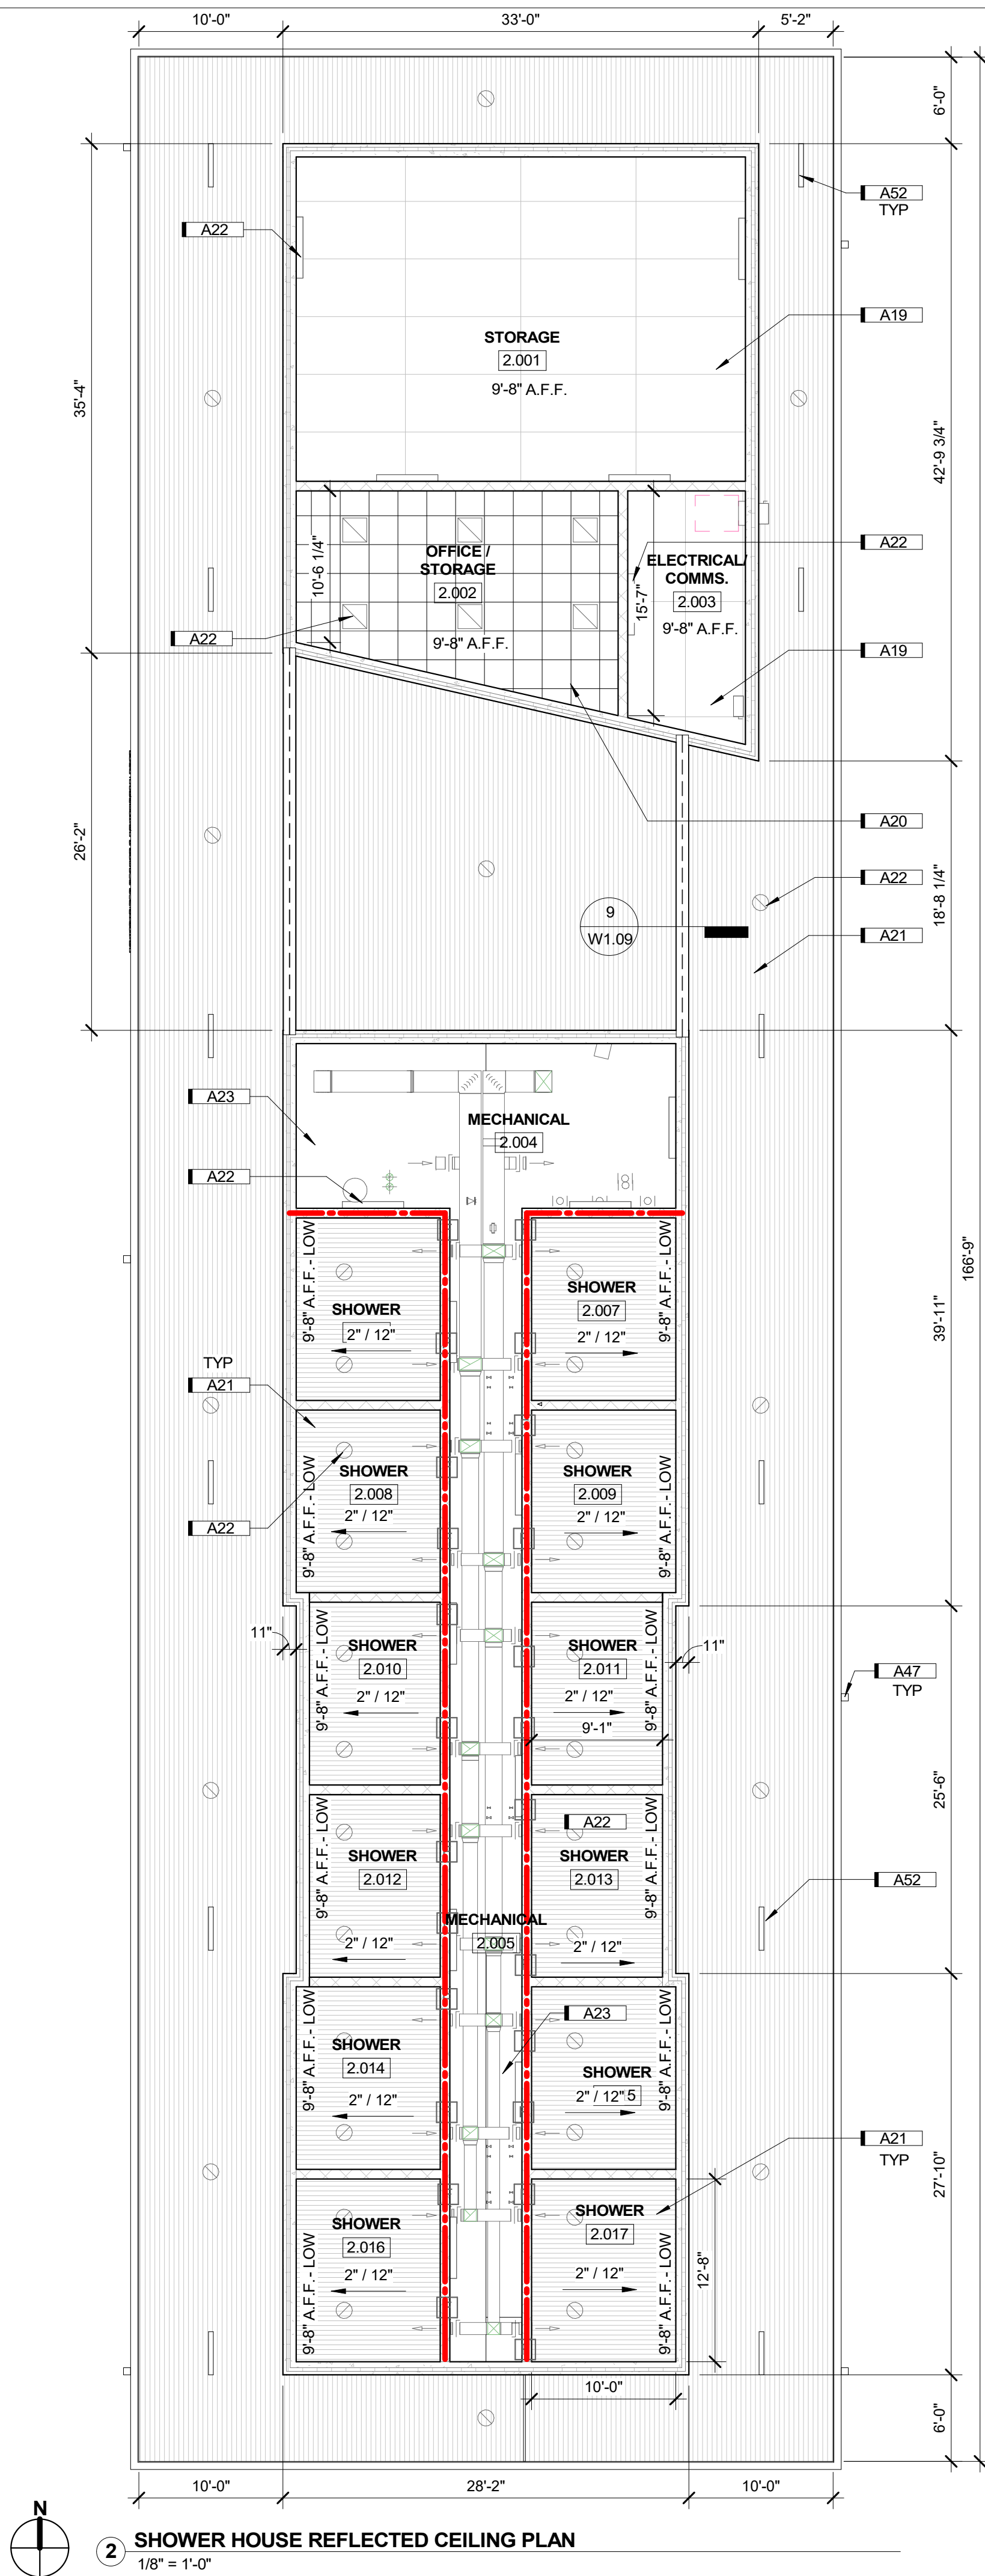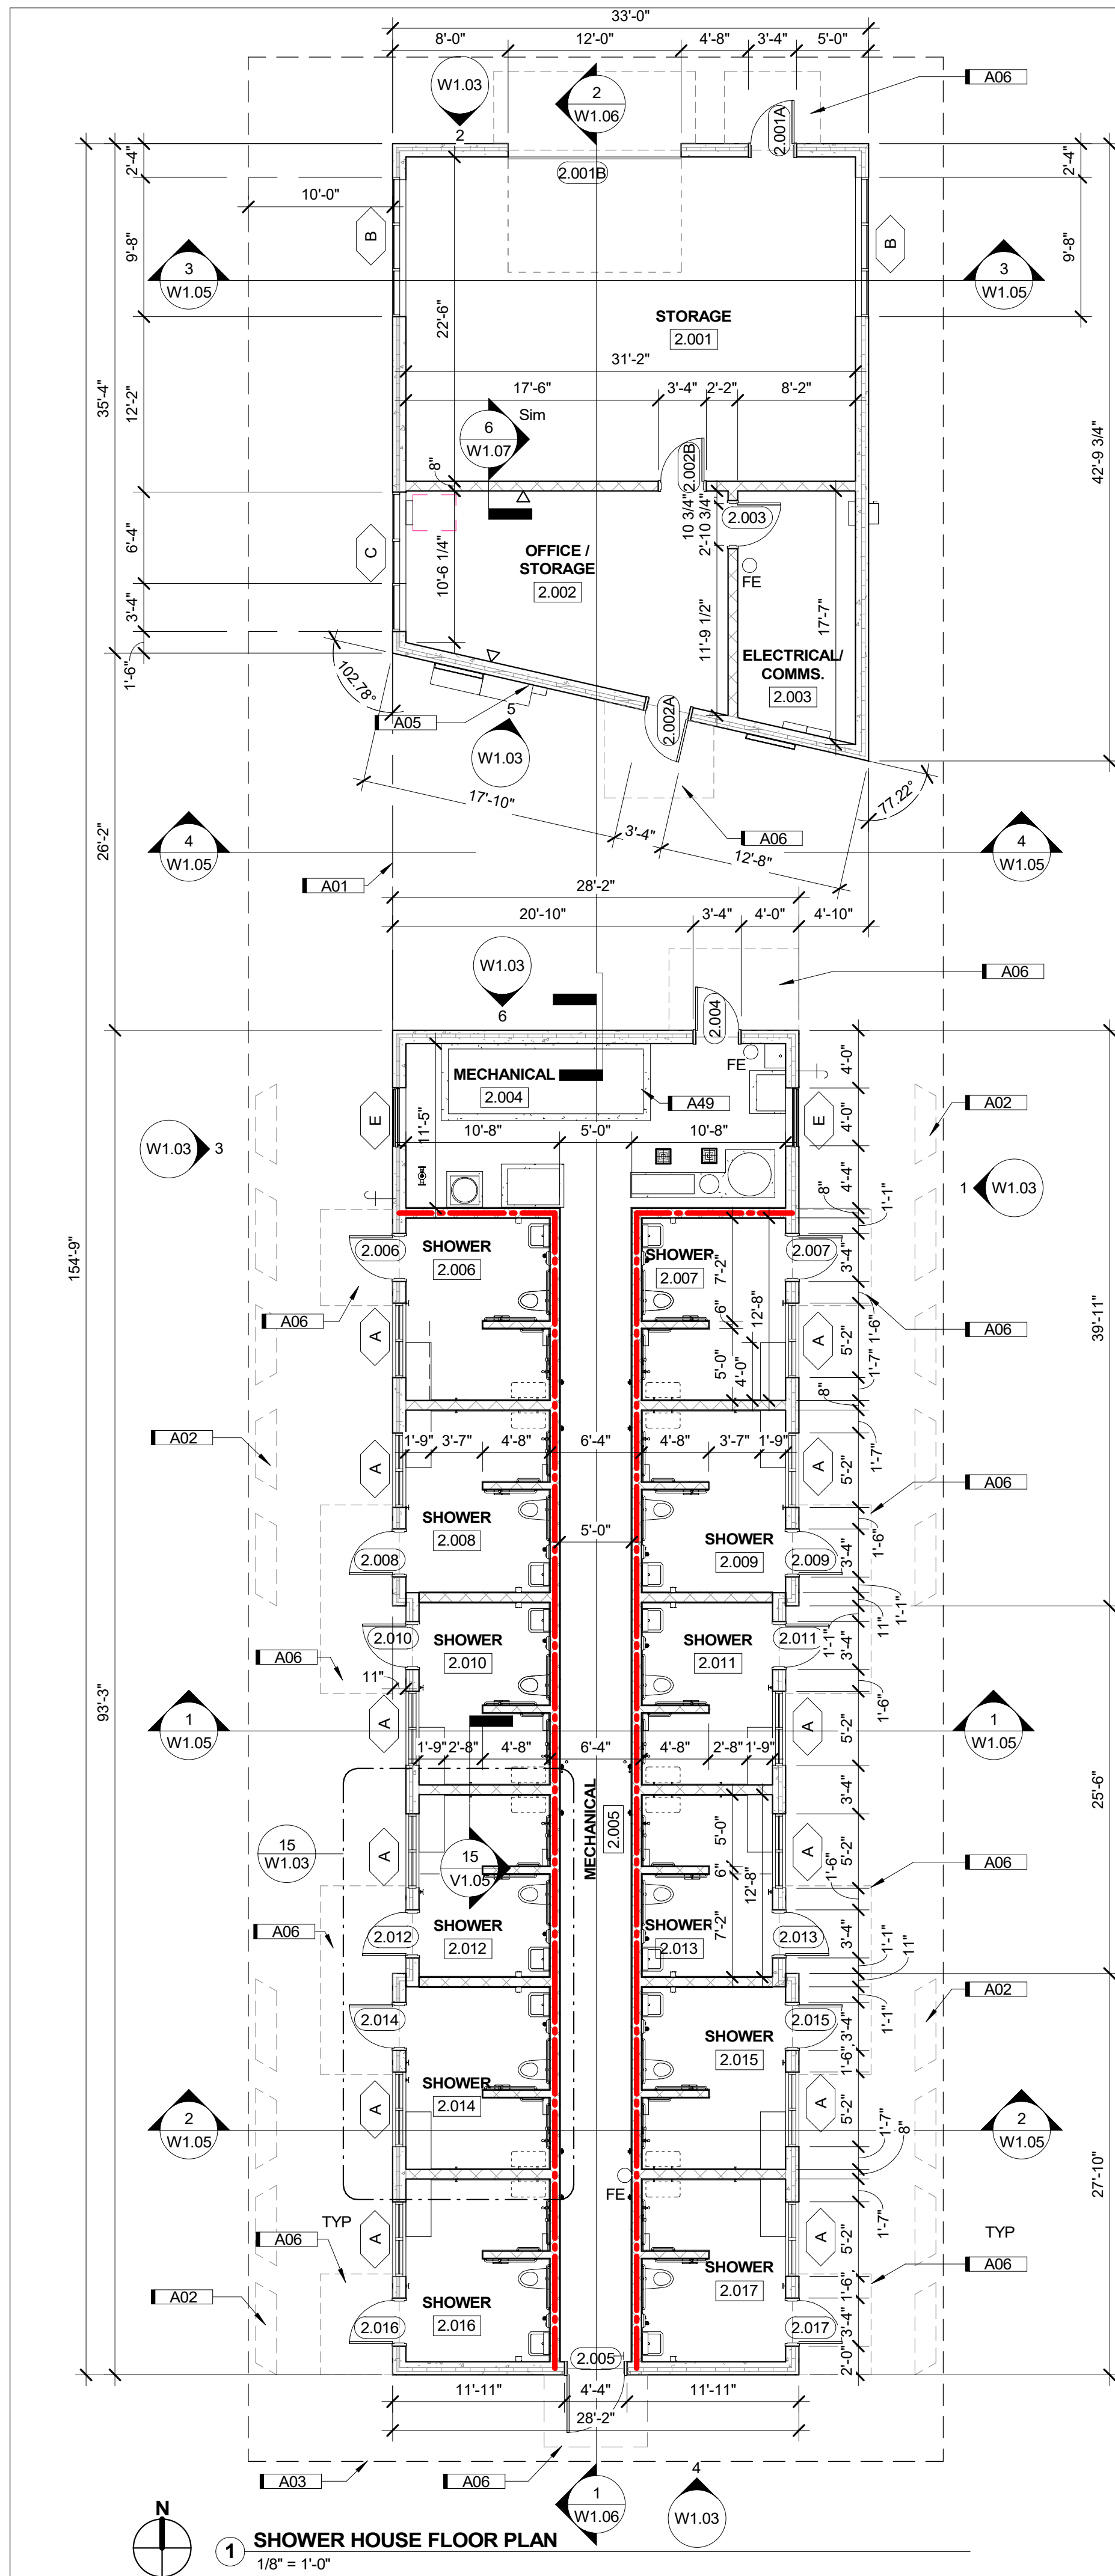

GENERAL ROOFING NOTES

1. THE GENERAL CONTRACTOR SHALL VERIFY ALL CONDITIONS OF THE BUILDING PRIOR TO INSTALLATION OF THE ROOF.
2. NEW ROOFING CONSISTS OF:
 - SHOWER HOUSE**
SIMULATED WOOD SHAKE ROOF SYSTEM
STAINLESS STEEL FLASHING TRIM
ICE AND WATER SHIELD (OVER ENTIRE DECK)
PLYWOOD DECK
 - WOOD SHED**
SIMULATED WOOD SHAKE ROOF SYSTEM
STAINLESS STEEL FLASHING TRIM
UNDERLAYMENT
PLYWOOD DECK
3. REFER TO MANUFACTURER'S STANDARD DETAILS AND RECOMMENDATIONS FOR ANY MISCELLANEOUS DETAILS NOT SHOWN. SUBMIT MANUFACTURER APPROVED ADDITIONAL SHOP DRAWING FOR ANY NON-STANDARD DETAILS NOT SHOWN.
4. ALL ROOFING WORK SHALL BE IN ACCORDANCE WITH THE NATIONAL ROOFING CONTRACTORS ASSOCIATION (NRCA) ROOFING AND WATERPROOFING MANUAL, FOURTH EDITION. ALL SHEET METAL WORK SHALL BE IN ACCORDANCE WITH THE SHEET METAL AND AIR CONDITIONING CONTRACTORS NATIONAL ASSOCIATION, INC. (SMACNA) ARCHITECTURAL SHEET METAL MANUAL, FIFTH EDITION.)
5. FLASH ALL CURBS, VENTS, AND STACKS AS SHOWN IN PLANS. REFER TO MANUFACTURER'S STANDARD DETAILS AND RECOMMENDATIONS FOR ANY MISCELLANEOUS DETAILS NOT SHOWN IN THE PLANS.
6. CONTRACTOR SHALL VERIFY HEIGHT OF ALL WOOD BLOCKING. CONTRACTOR SHALL FASTEN NEW WOOD BLOCKING AND PLYWOOD ACCORDING TO THE FOLLOWING REQUIREMENTS:
 - WOOD TO WOOD CONNECTIONS SHALL BE FASTENED WITH # 12-15x3" WOOD TO WOOD FASTENERS. 2 ROWS STAGGERED 24" OC AND AT 12" OC WITHIN 8'-0" OF OUTSIDE CORNERS. FASTENER MUST MEET MINIMUM OF 100# PULL-OUT VALUE. SEE SPECIFICATIONS FOR APPROVED FASTENERS.
 - WOOD TO MASONRY CONNECTIONS SHALL BE FASTENED WITH 1/4" - # 14x4" SELF DRILLING FASTENER AT 4'-0" OC MAX AND AT 2'-0" OC WITHIN 8'-0" OF OUTSIDE CORNERS. SEE SPECIFICATIONS FOR APPROVED FASTENERS.
 - WOOD TO STEEL CONNECTIONS SHALL BE FASTENED WITH 1/4" - # 12-15x3" WOOD TO STEEL FASTENERS. 2 ROWS STAGGERED 24" OC AND AT 12" OC WITHIN 8'-0" OF OUTSIDE CORNERS. SEE SPECIFICATIONS FOR APPROVED FASTENERS.
 - WOOD TO PLATE STEEL CONNECTIONS SHALL BE FASTENED WITH 1/2" HOT DIPPED GALVANIZED THRU BOLTS AT 4'-0" OC MAX AND AT 2'-0" OC WITHIN 8'-0" OF OUTSIDE CORNERS. SEE SPECIFICATIONS FOR APPROVED FASTENERS.
7. IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO MAINTAIN WATERTIGHT CONDITIONS OF THE ROOF AT ALL TIMES IN AREA OF WORK. ROOF LEAKS OR WET INSULATION CAUSED BY CONTRACTOR'S DEFICIENCIES SHALL BE REPAIRED AT NO COST TO THE OWNER.
8. AT COMPLETION OF PROJECT, BROOM SURFACE OF ROOF CLEAN AND ENSURE REMOVAL OF ALL DEBRIS (CONSTRUCTION OR OTHERWISE).


KEYNOTE LEGEND

A01	ALIGN WEST EXTERIOR WALLS
A02	BENCH - SEE DETAILS
A03	ROOF OVERHANG
A05	CAMPER REGISTRATION DROP BOX
A06	STOOP - SEE STRUCTURAL
A19	PAINTED PLYWOOD
A20	LAY-IN ACOUSTICAL CEILING
A21	PREFINISHED ALUMINUM SLAT SYSTEM
A22	LIGHT FIXTURE - SEE ELECTRICAL
A23	1 HOUR - RATED GYPSUM BOARD ASSEMBLY - SEE UL #P522 WITH ALTERNATE INSULATION PLACEMENT
A24	PREFINISHED METAL GUTTER
A26	VENTED RIDGE CAP. SEE ROOFING DETAILS
A27	SIMULATED WOOD SHAKE ROOF SHINGLES
A47	PREFINISHED METAL SCUPPER
A48	SNOW GUARDS 1'-0" BEYOND BREEZEWAY WALK AREA, BOTH SIDES - SEE DETAIL 8/ W1.08
A49	CONCRETE PAD - SEE STRUCTURAL
A50	VENT THROUGH ROOF. COORDINATE WITH MECHANICAL - SEE ROOFING DETAILS
A52	SOFFIT VENT MANUFACTURER STANDARD SYSTEM
A55	5"H X 3/4"D, 3-DIMENSIONAL LETTERING, (METAL) MOUNTED TO FACE OF SIDING OR TRIM, GARRISON SANS, ALL CAPS
A68	COORDINATE ROOF INSTALLATION WITH SOLAR PANELS - SEE ELECTRICAL





KEYNOTE LEGEND	
A02	BENCH - SEE DETAILS
A05	CAMPER REGISTRATION DROP BOX
A07	LIQUID SOAP DISPENSER - TYPICAL
A08	TOILET TISSUE DISPENSER
A09	18" X 36" MIRROR WITH SHELF - TYPICAL
A10	ELECTRIC AIR HAND DRYER - TYPICAL
A11	14" WIDE, 22 GA STAINLESS STEEL WALL GUARD WITH COUNTER SUNK STAINLESS STEEL SCREWS - INSTALL CONTINUOUS SEALANT AT PERIMETER
A12	42" GRAB BAR - TYPICAL
A13	36" GRAB BAR - TYPICAL
A14	18" GRAB BAR - TYPICAL
A15	FOLD-DOWN SHOWER SHELF - TYPICAL
A16	FOLD-DOWN SHOWER SEAT - TYPICAL
A17	TOWEL PIN - TYPICAL
A18	ROBE HOOK - TYPICAL
A24	PREFINISHED METAL GUTTER
A27	SIMULATED WOOD SHAKE ROOF SHINGLES
A28	PRECAST JOINT
A29	ARCHITECTURAL INSULATED PRECAST PANELS
A30	FIBER CEMENT SIDING
A31	PREFINISHED METAL FASCIA
A32	FOOTING AND FOUNDATION - SEE STRUCTURAL
A33	PREFINISHED METAL LOUVER, COORDINATE WITH MECHANICAL
A47	PREFINISHED METAL SCUPPER
A55	5" H X 3/4", 3-DIMENSIONAL LETTERING, (METAL) MOUNTED TO FACE OF SIGATION OR TRIM, GARRISON SANS, ALL CAPS
A56	30" W X 42" H REGISTRATION INFORMATION, PRINTED ON VINYL SUBSTRATE, ATTACHED TO .080 ALUMINUM BACKING, MOUNTED TO WALL
A57	30" W X 42" H MAP OF CAMPGROUND, PRINTED ON VINYL SUBSTRATE, ATTACHED TO .080 ALUMINUM BACKING, MOUNTED TO WALL
A58	30" W X 42" H LOCKABLE METAL CABINET, CLEAR LEXAN FRONT
A59	ANGLED WRITING SURFACE, WOOD, PAINTED
A60	RACK FOR REGISTRATION FORMS
A61	NEWSLETTER/BROCHURE RACK, WOOD, PAINTED
A62	30" W X 42" H PARK RULES, REGULATIONS, IMPORTANT INFORMATION, PRINTED ON VINYL SUBSTRATE, ATTACHED TO .080 ALUMINUM BACKING, MOUNTED TO WALL
A63	PARK INFORMATION LED SCREEN (FUTURE)




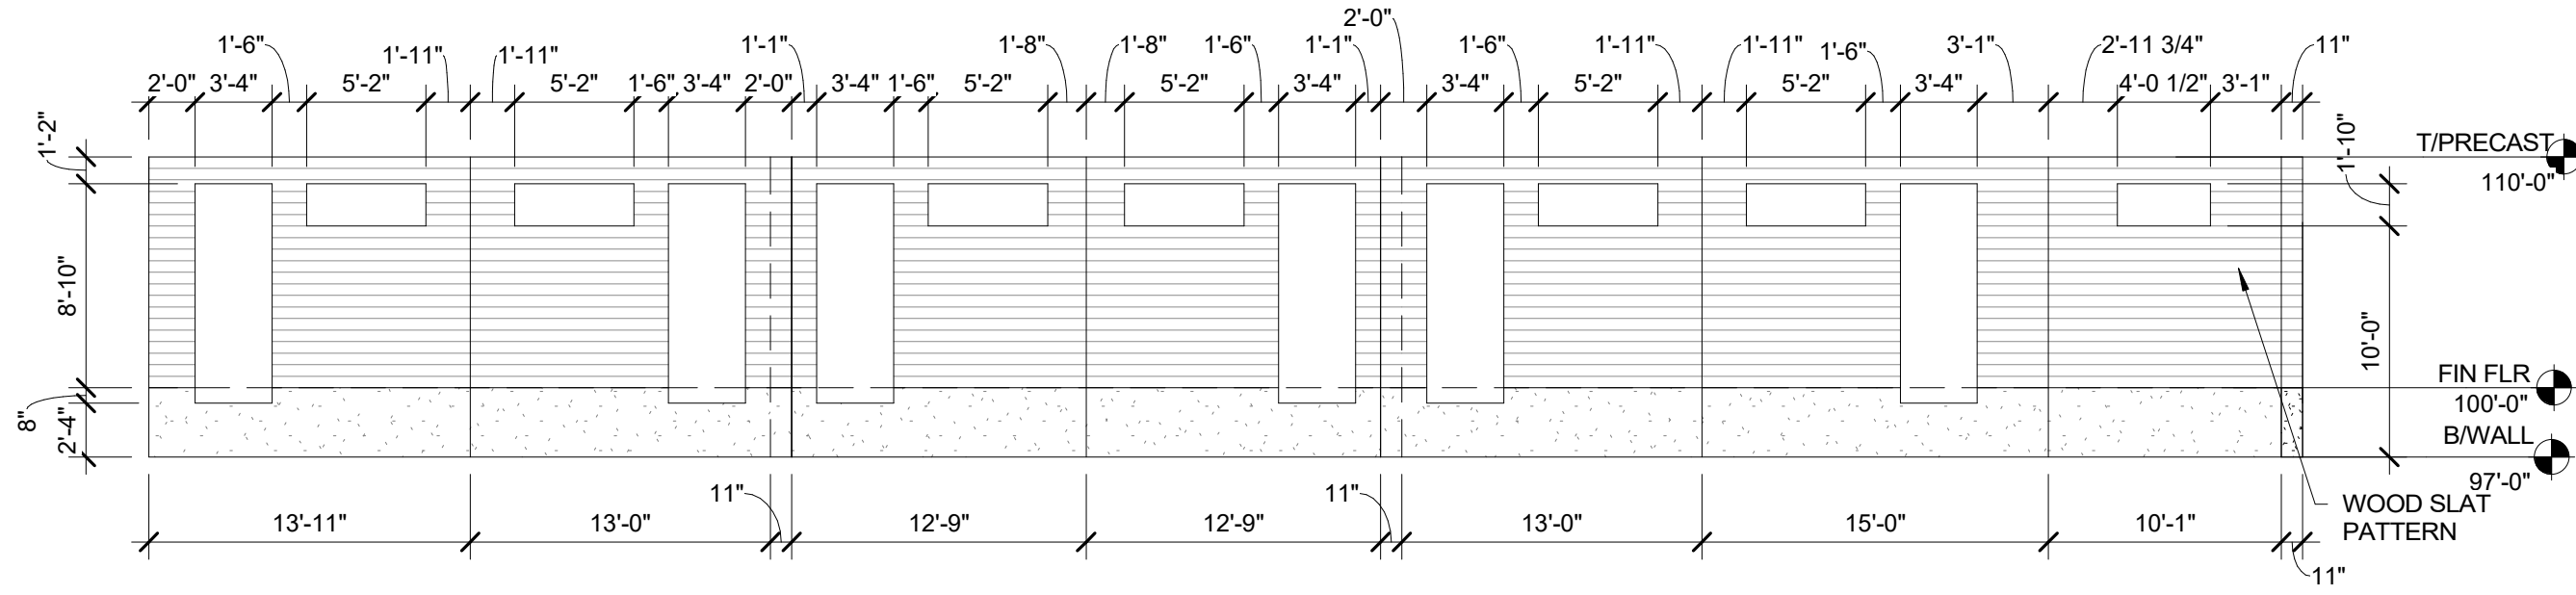



1 PRECAST EAST ELEVATION
1/8" = 1'-0"

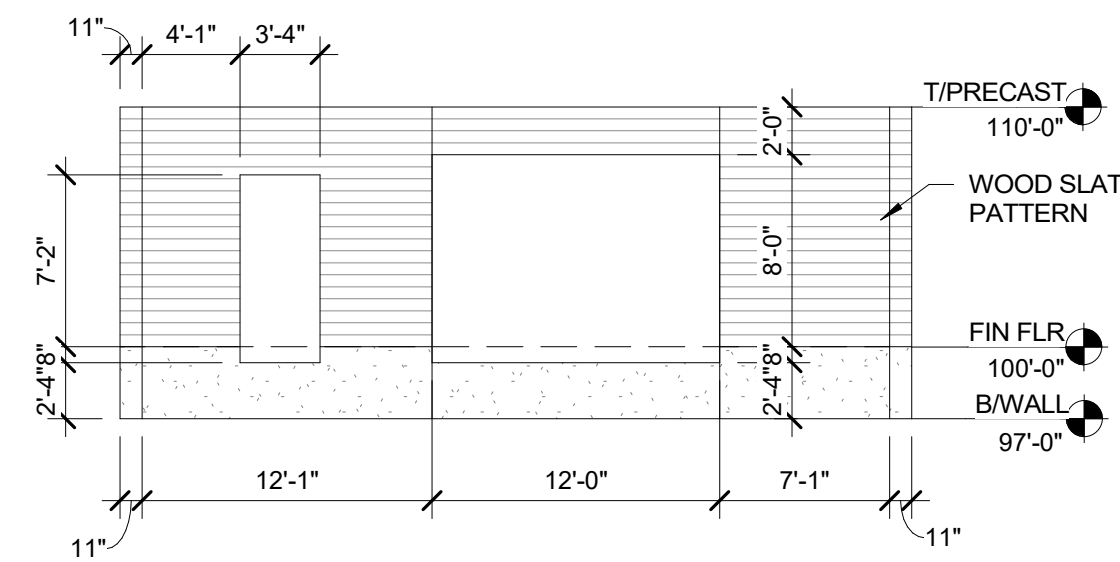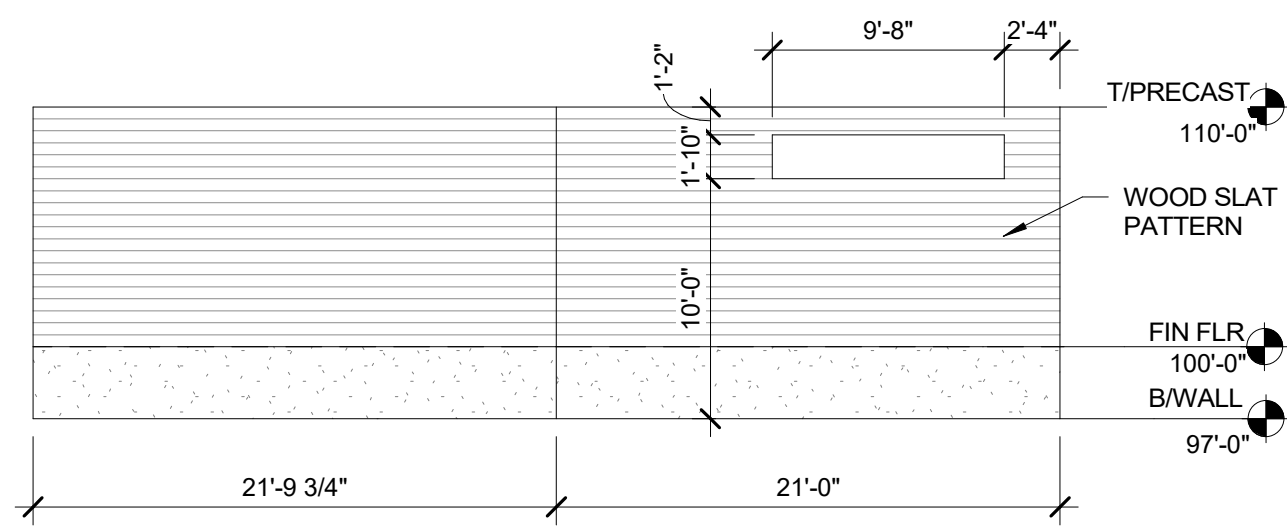


2 PRECAST NORTH ELEVATION
1/8" = 1'-0"

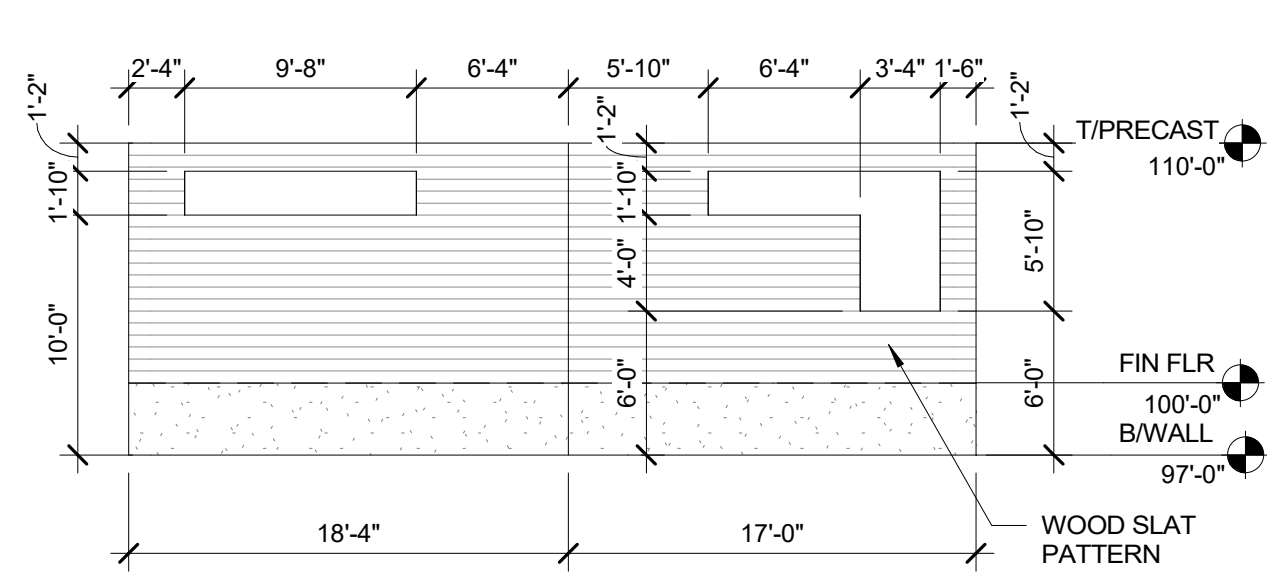


3 PRECAST WEST ELEVATION
1/8" = 1'-0"

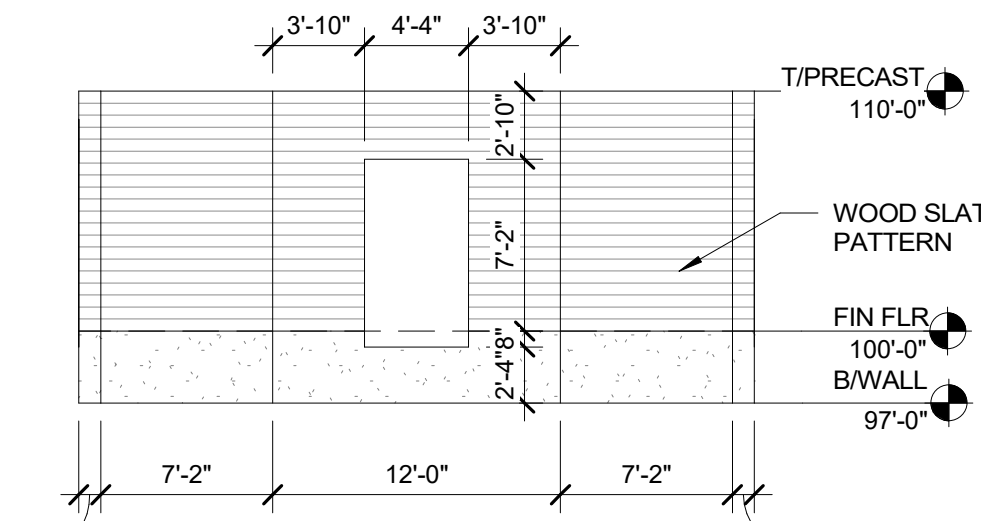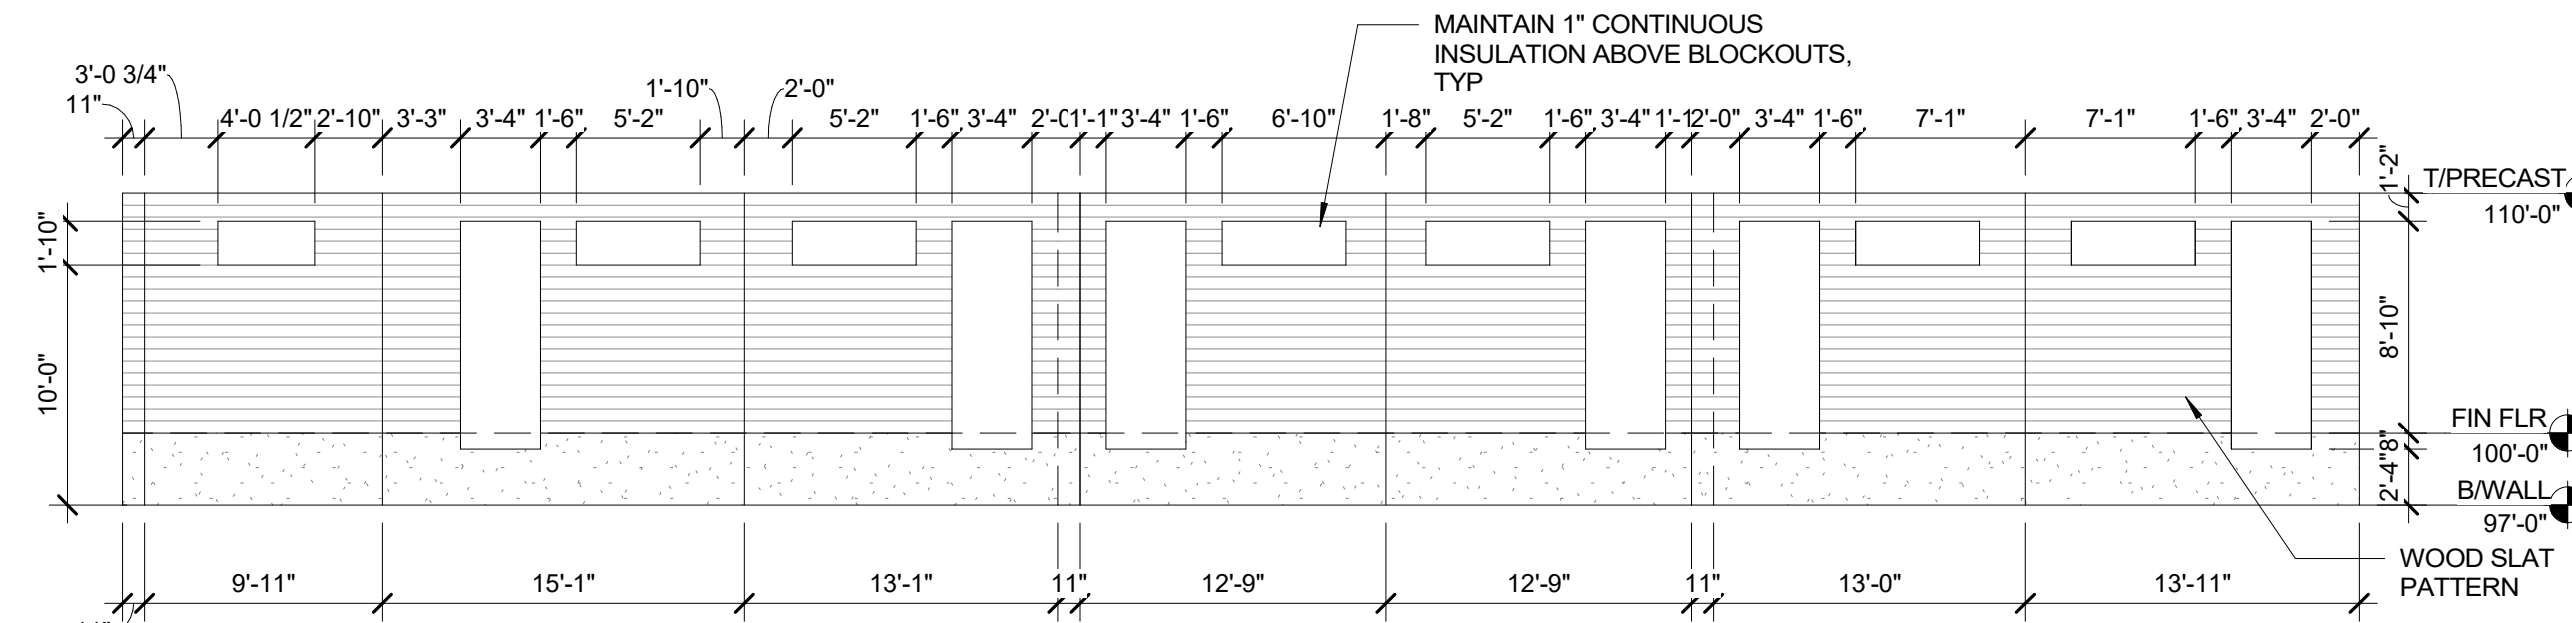


4 PRECAST SOUTH ELEVATION
1/8" = 1'-0"

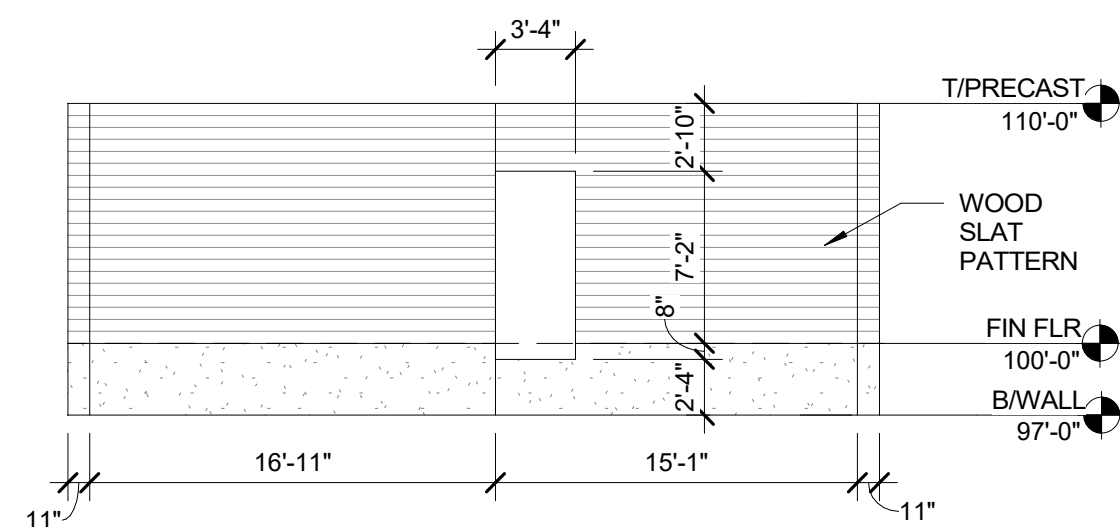


5 BREEZEWAY NORTH PRECAST ELEVATION
1/8" = 1'-0"

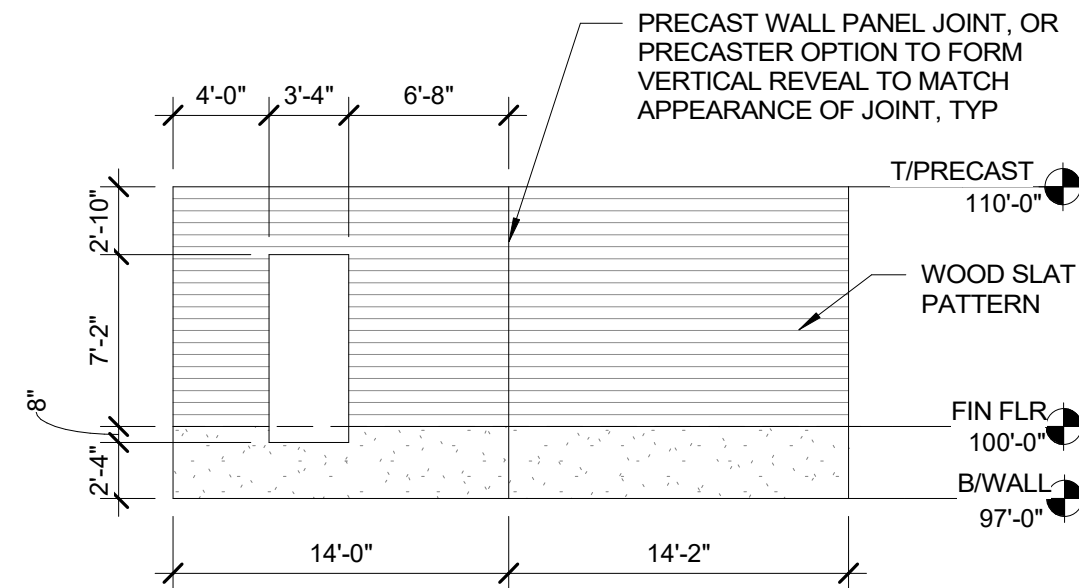


6 BREEZEWAY SOUTH PRECAST ELEVATION
1/8" = 1'-0"

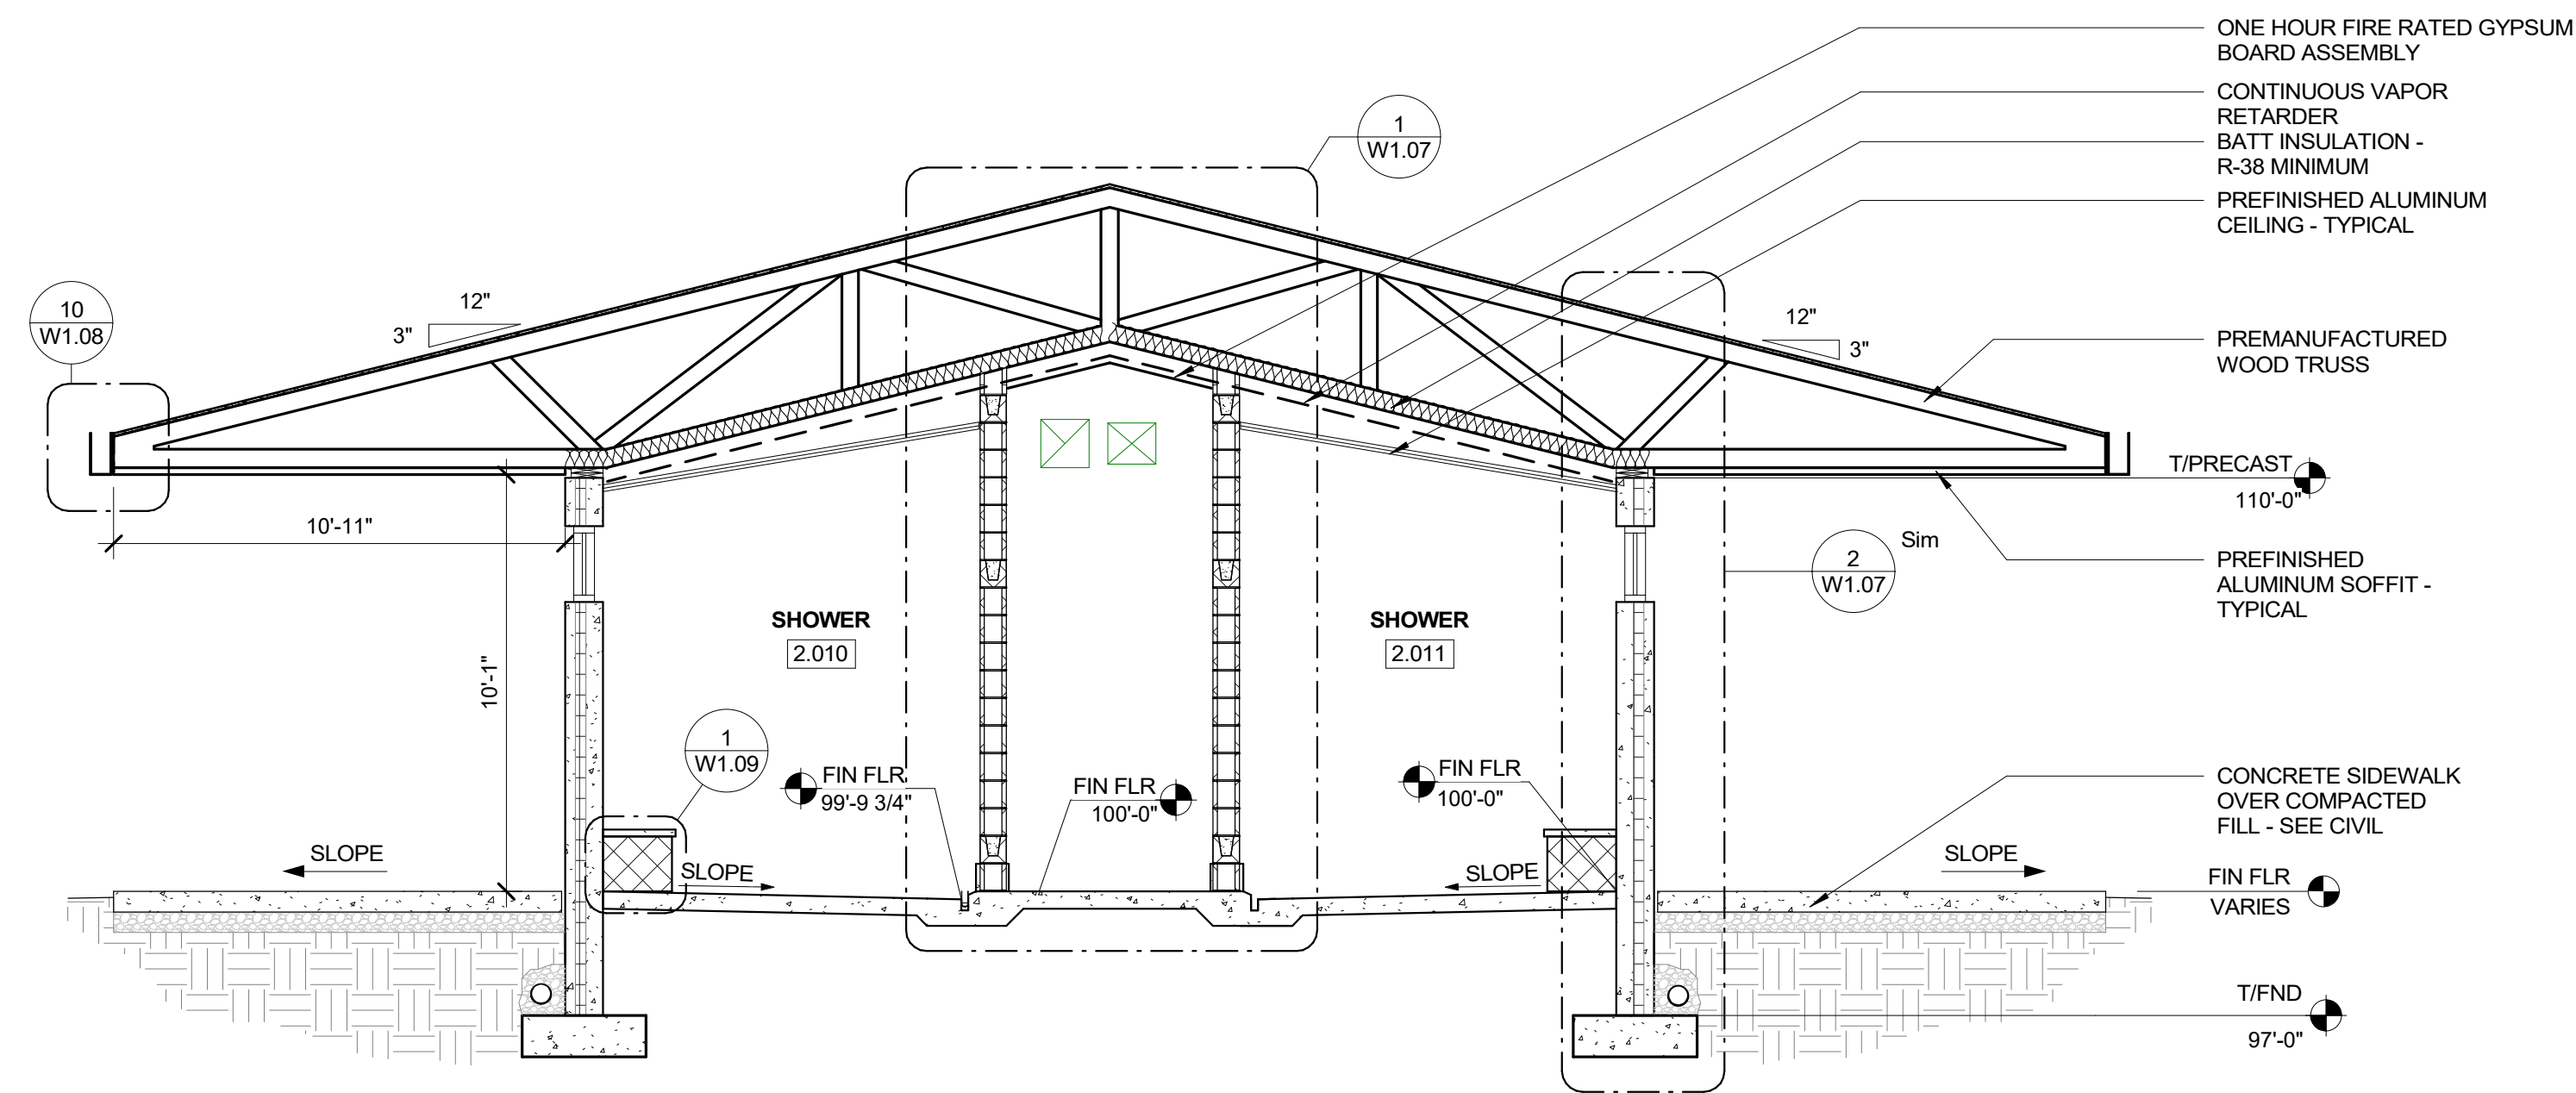


1 E-W BUILDING SECTION
1/4" = 1'-0"

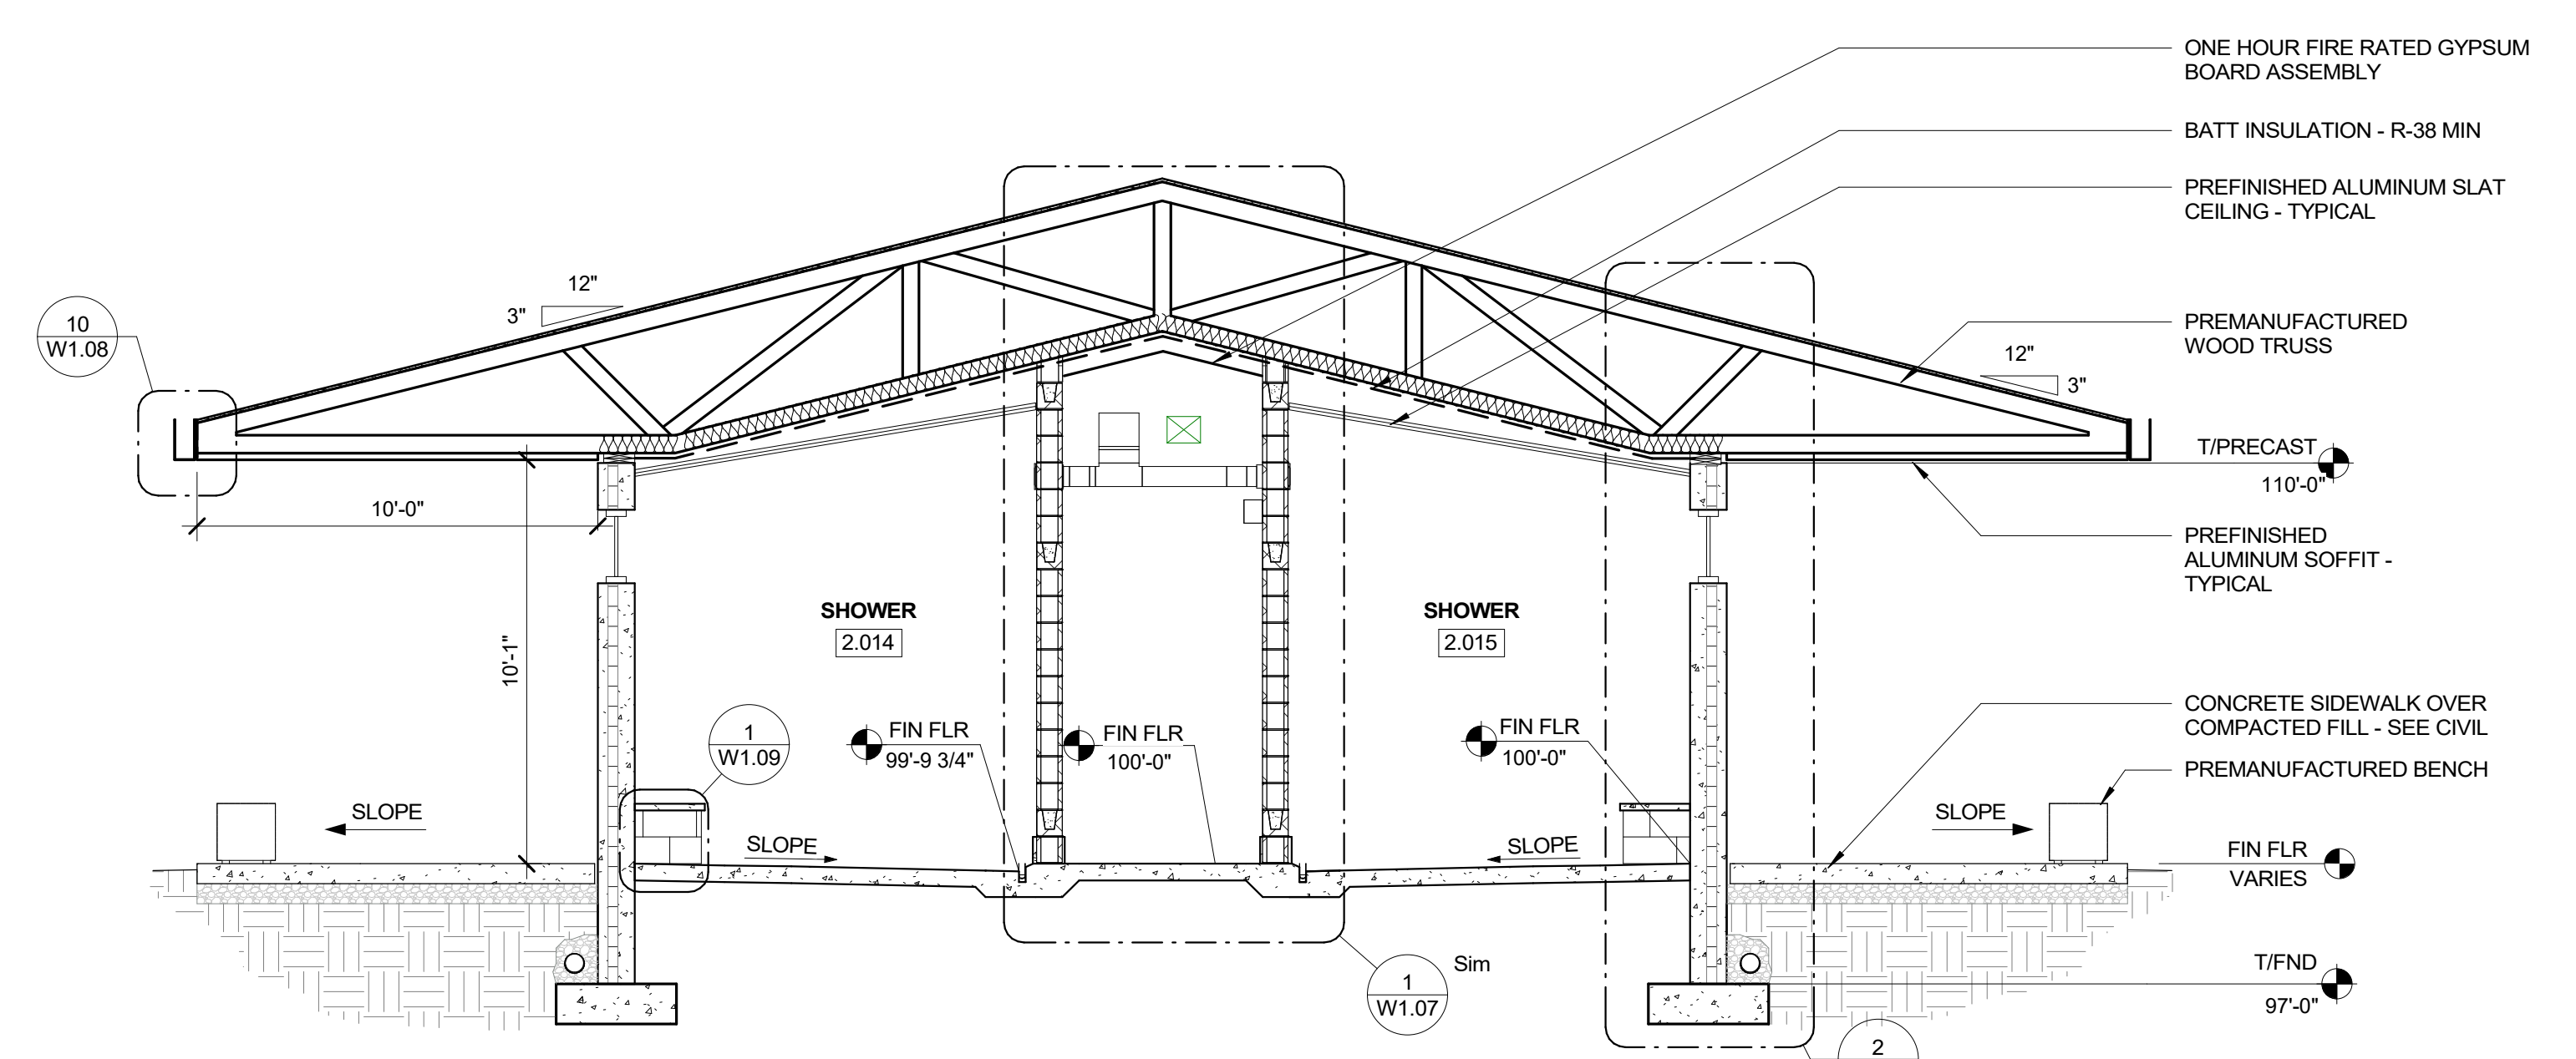


2 E-W BUILDING SECTION AT DEEP SHOWER
1/4" = 1'-0"

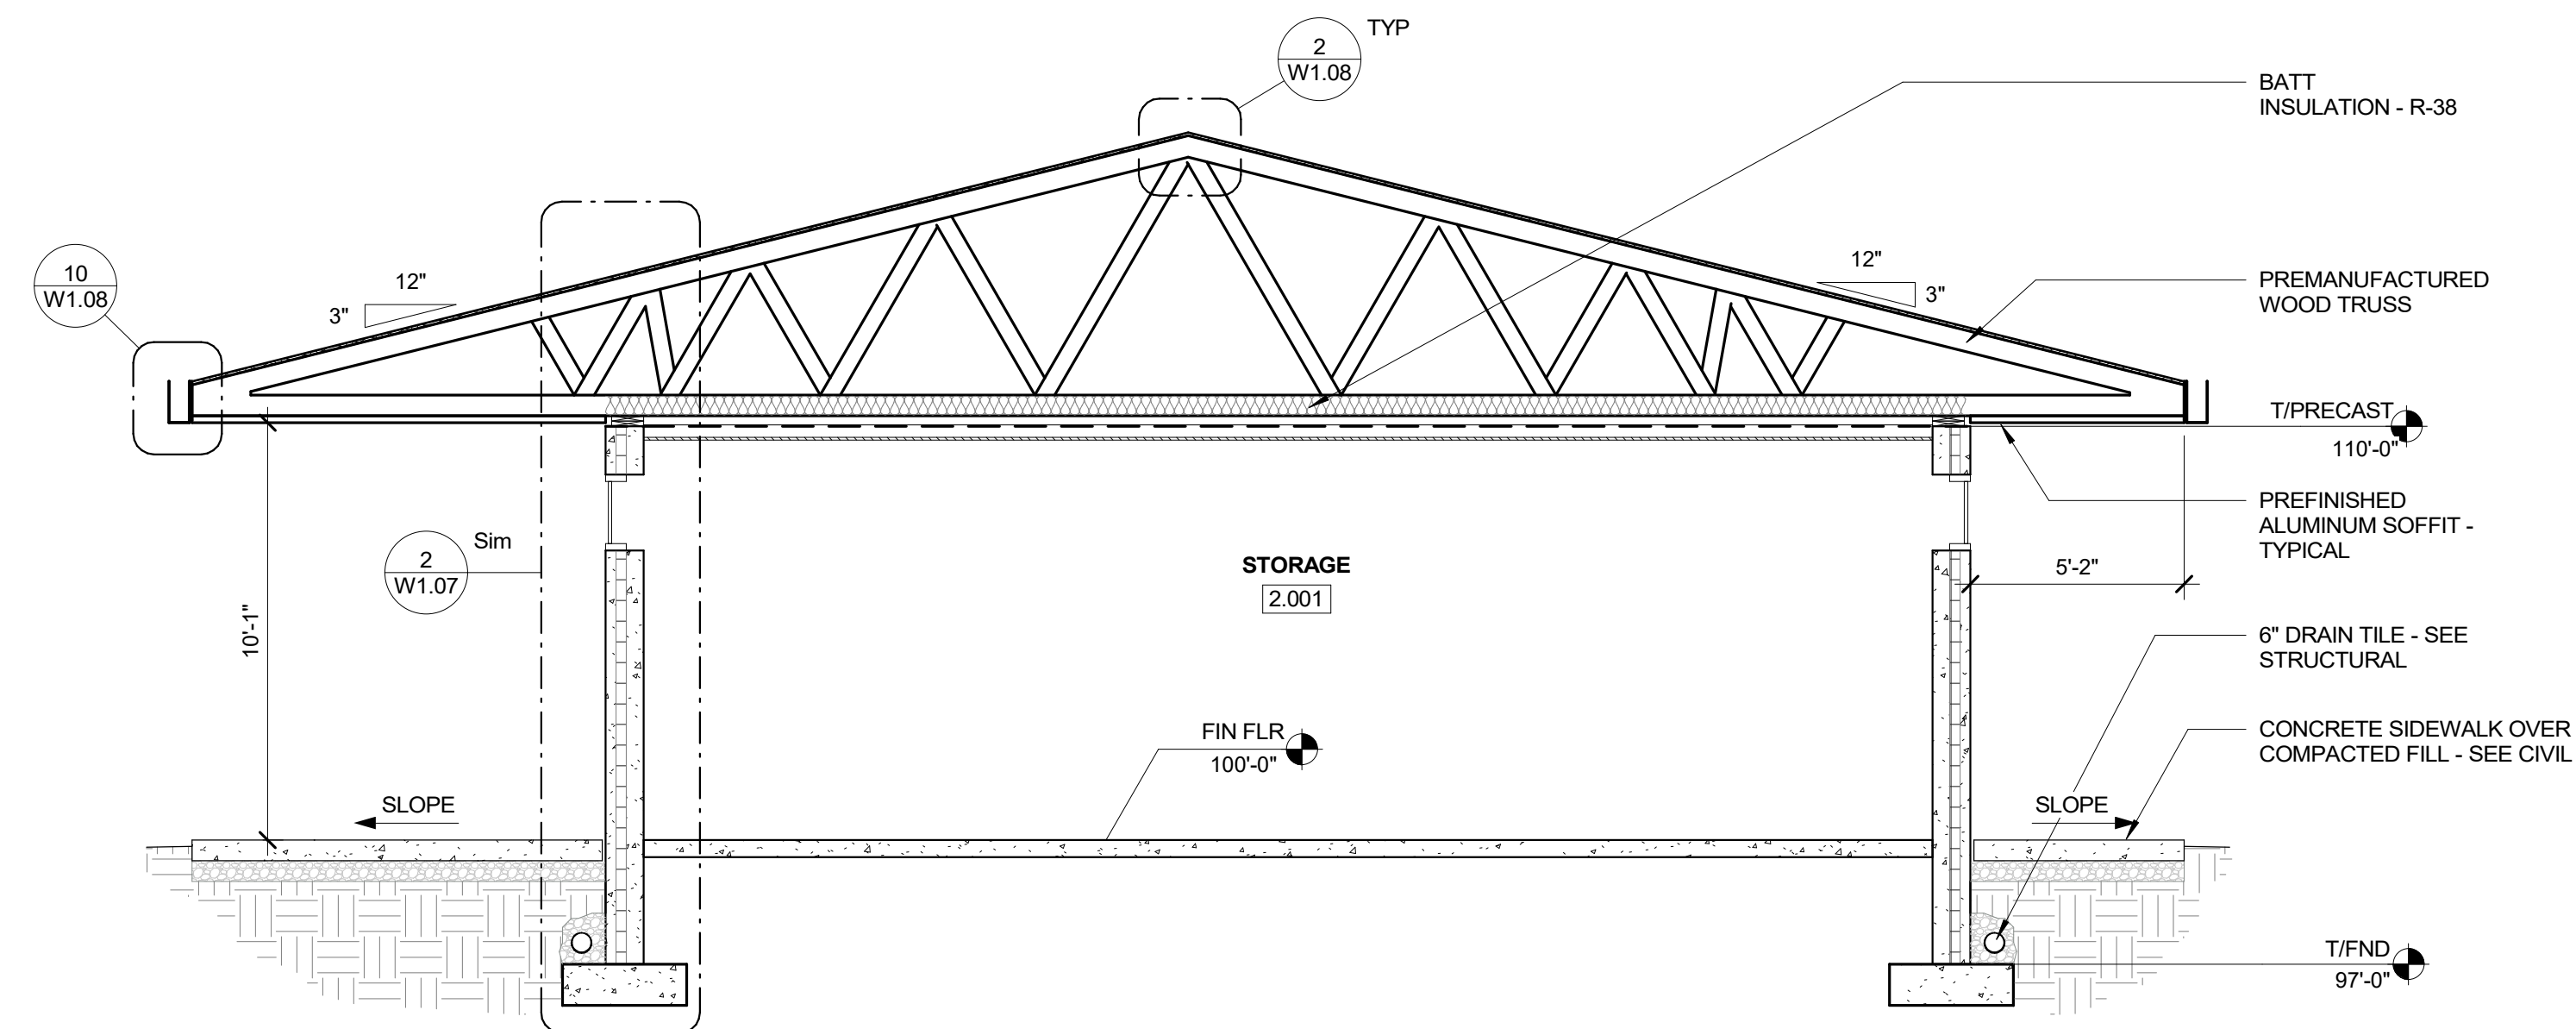


3 E-W BUILDING SECTION AT STORAGE
1/4" = 1'-0"

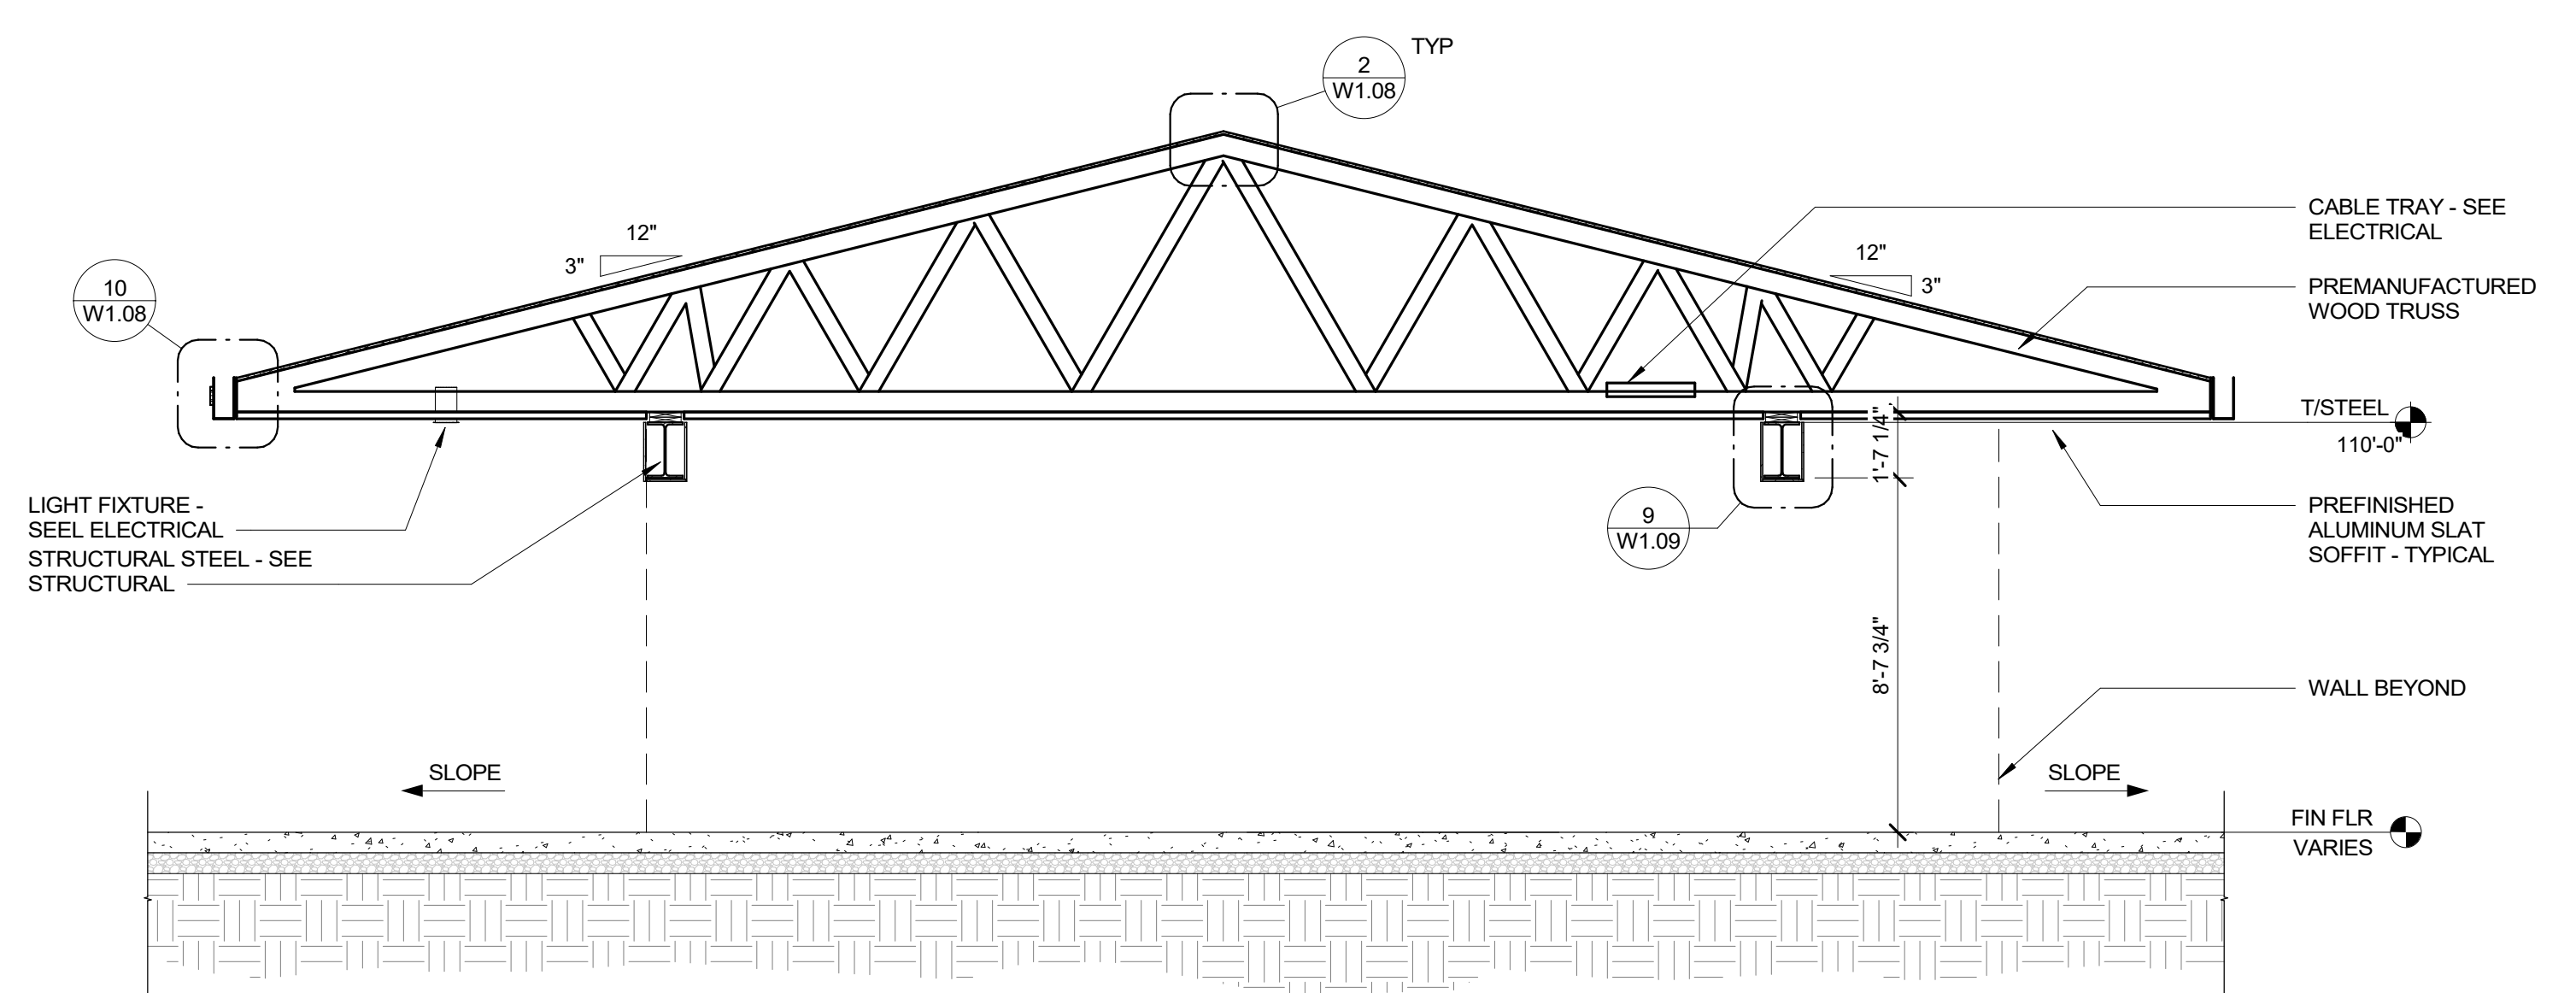


4 E-W BUILDING SECTION AT BREEZEWAY
1/4" = 1'-0"

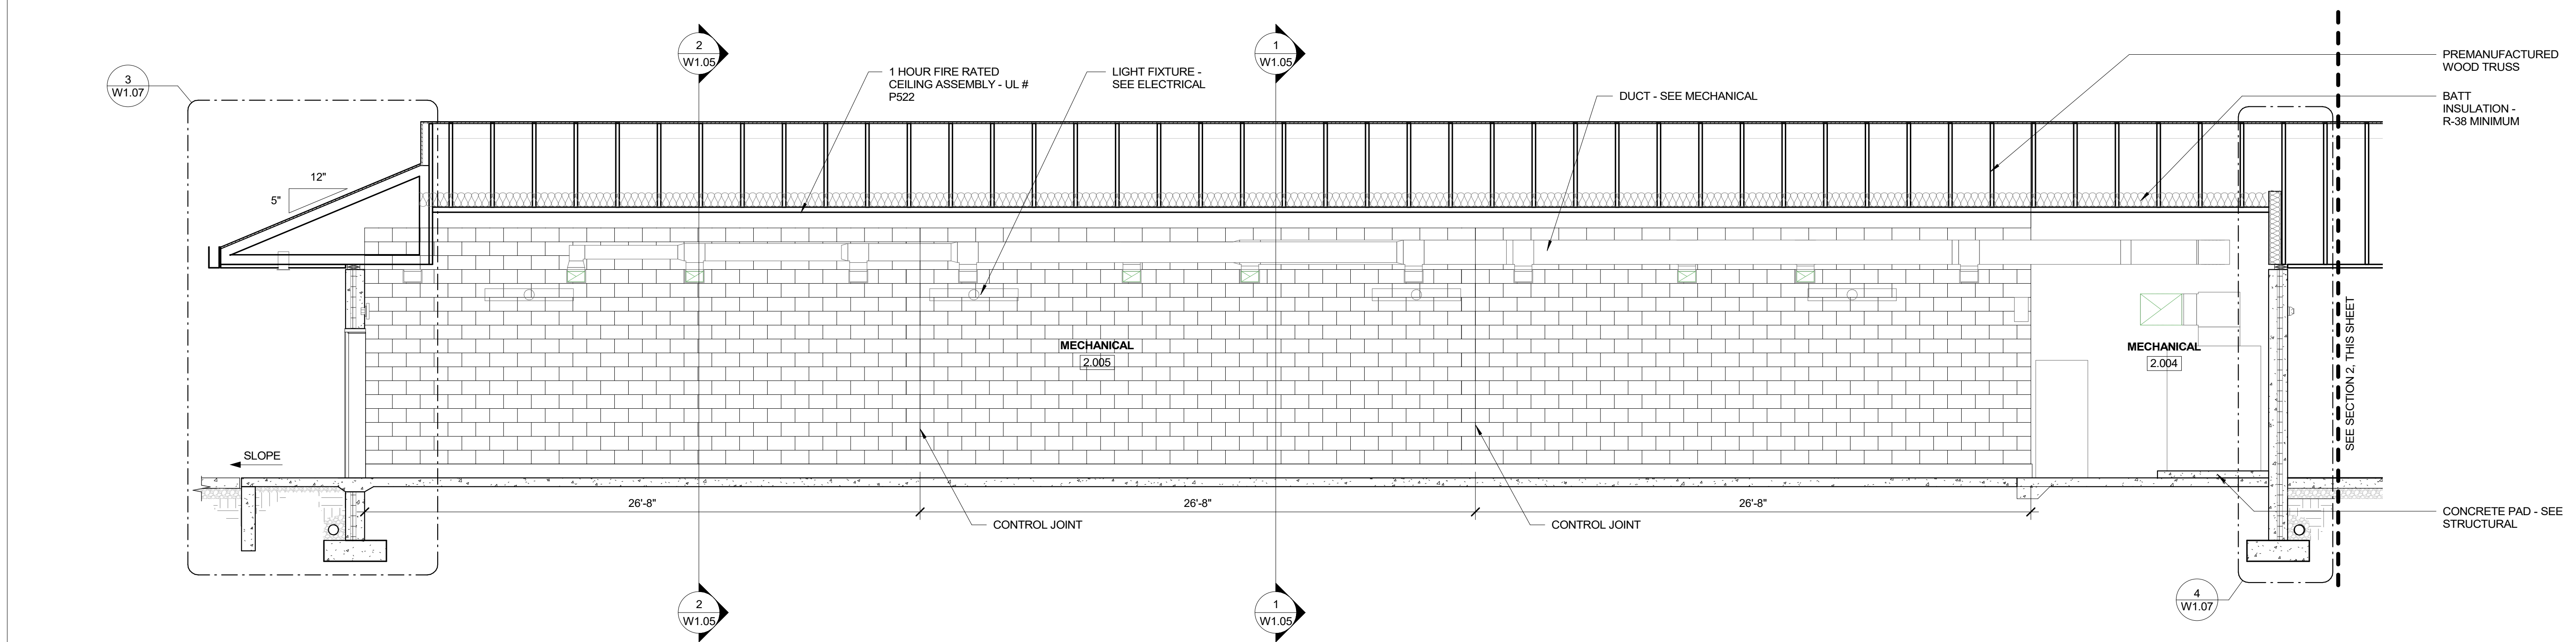


1 N-S BUILDING SECTION - SOUTH
1/4" = 1'-0"

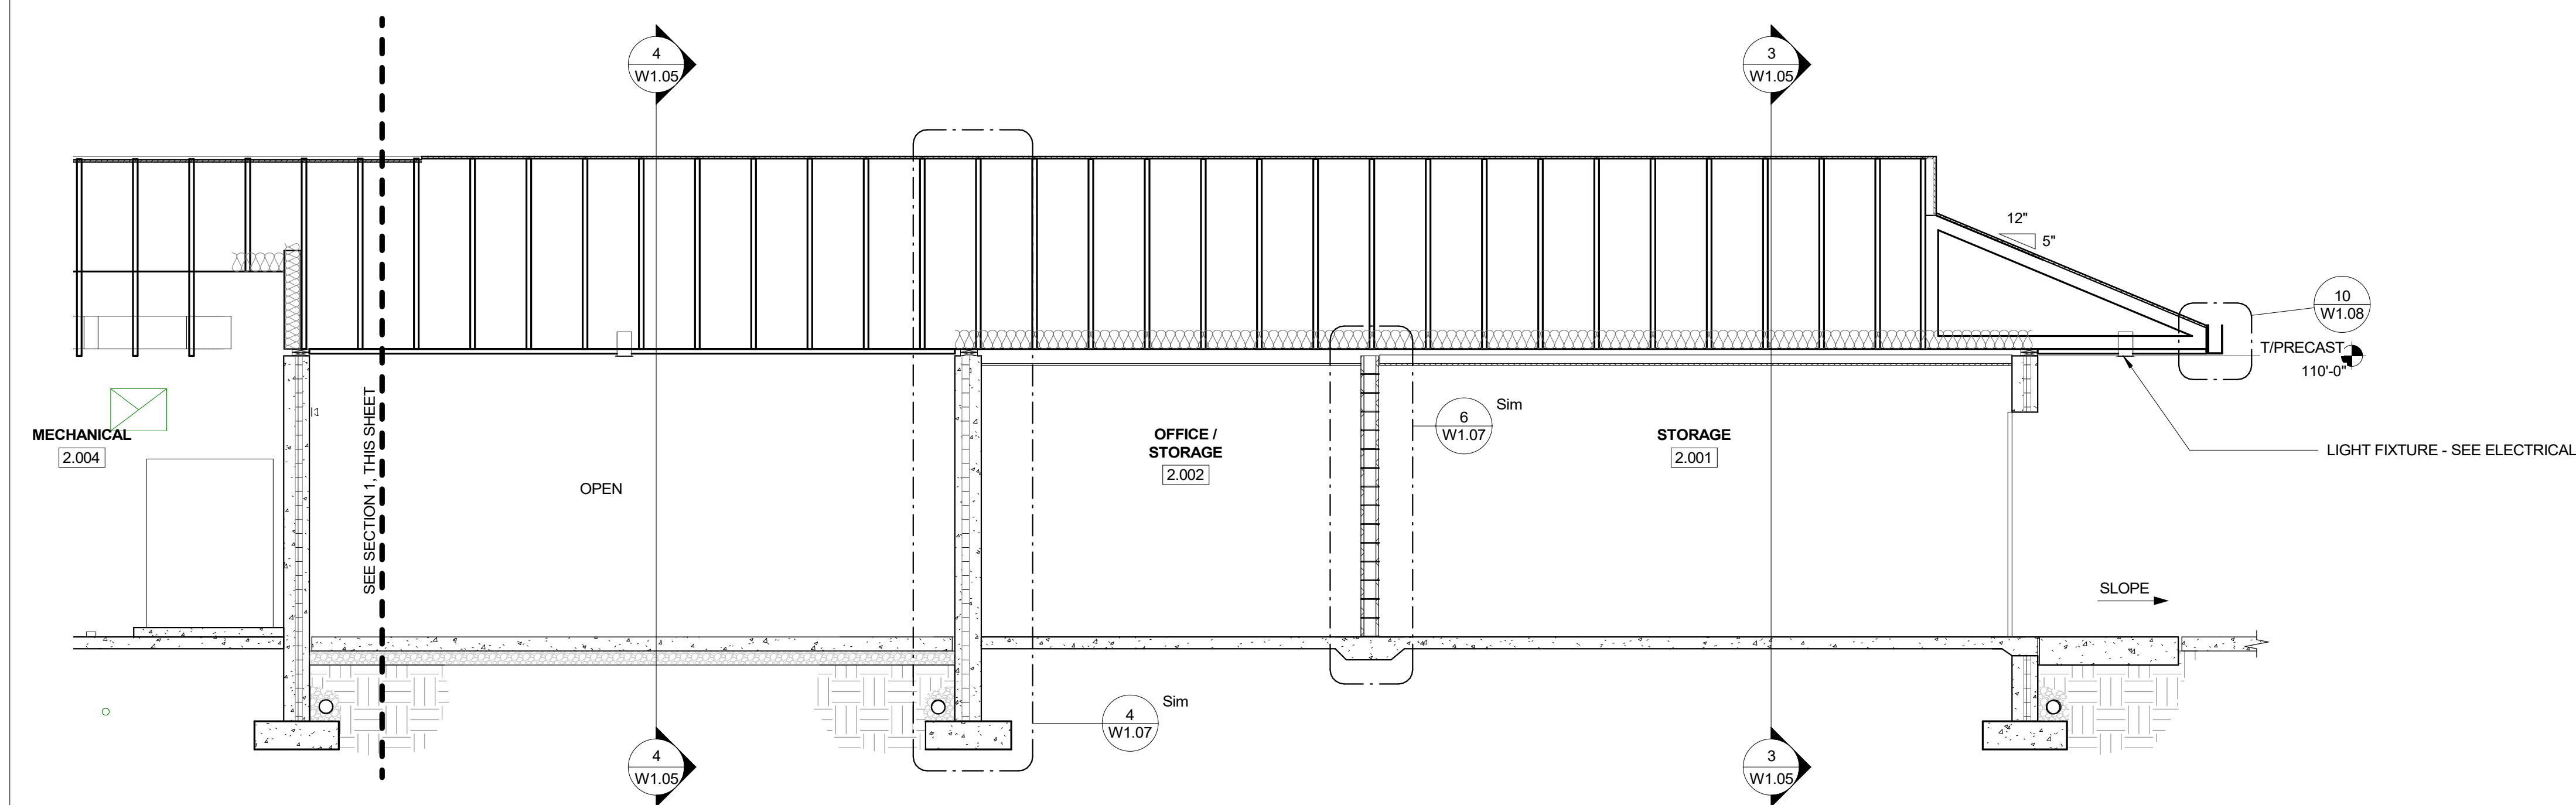


2 N-S BUILDING SECTION - NORTH
1/4" = 1'-0"




1. A 3/8" MIN. GAP IS REQUIRED BETWEEN ROOF TILES TO ROOF TILES AS WELL AS BETWEEN ROOF TILES TO WALLS MEASURING THE EDGE OF TILE TO VERTICAL FACE OF SHEET METAL FLASHING.
2. PROVIDE 3/4" OVERHANG FOR ROOF TILES AT ALL ROOF EDGES AS SHOWN IN DETAIL 9/ W1.08
3. MINIMUM 2" HORIZONTAL SIDE LAP OVER ALL FASTENERS.

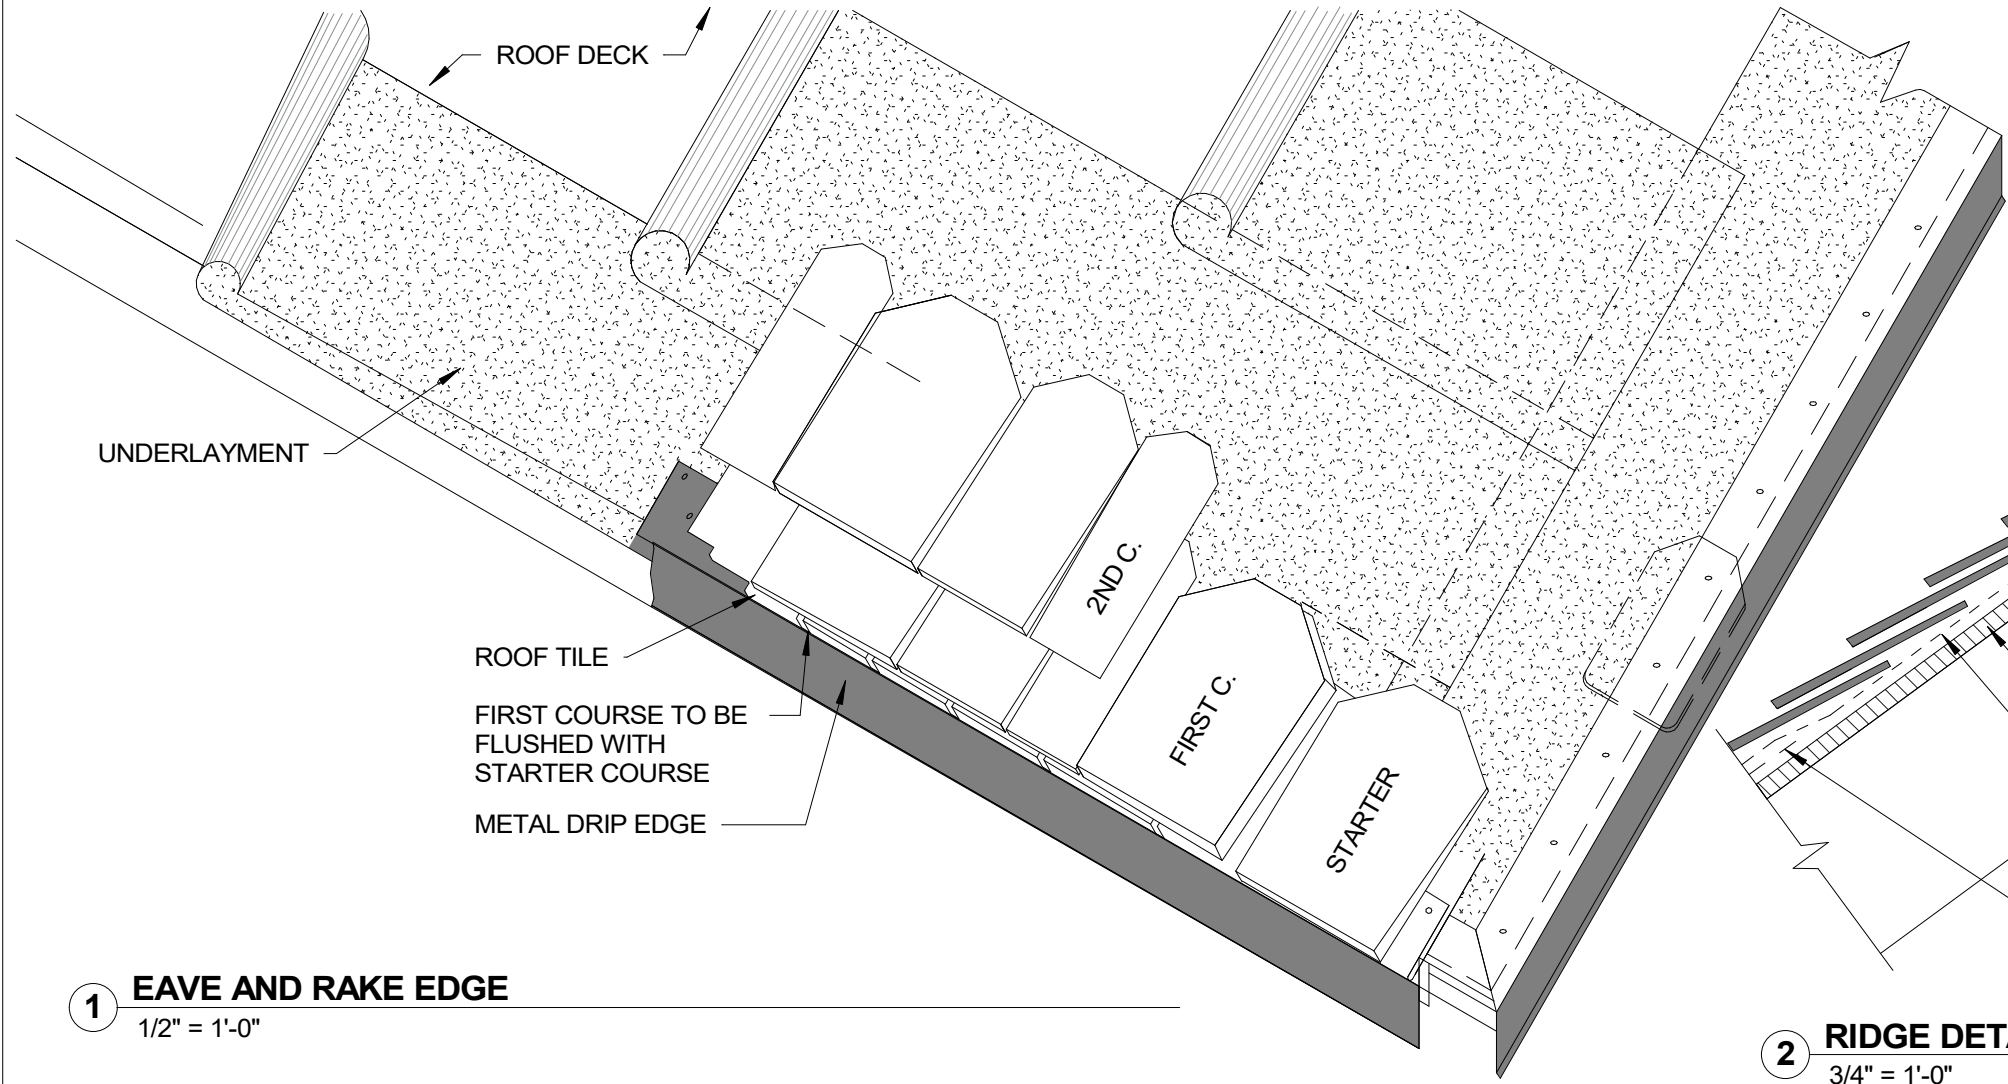


1 EAVE AND RAKE EDGE
1/2" = 1'-0"

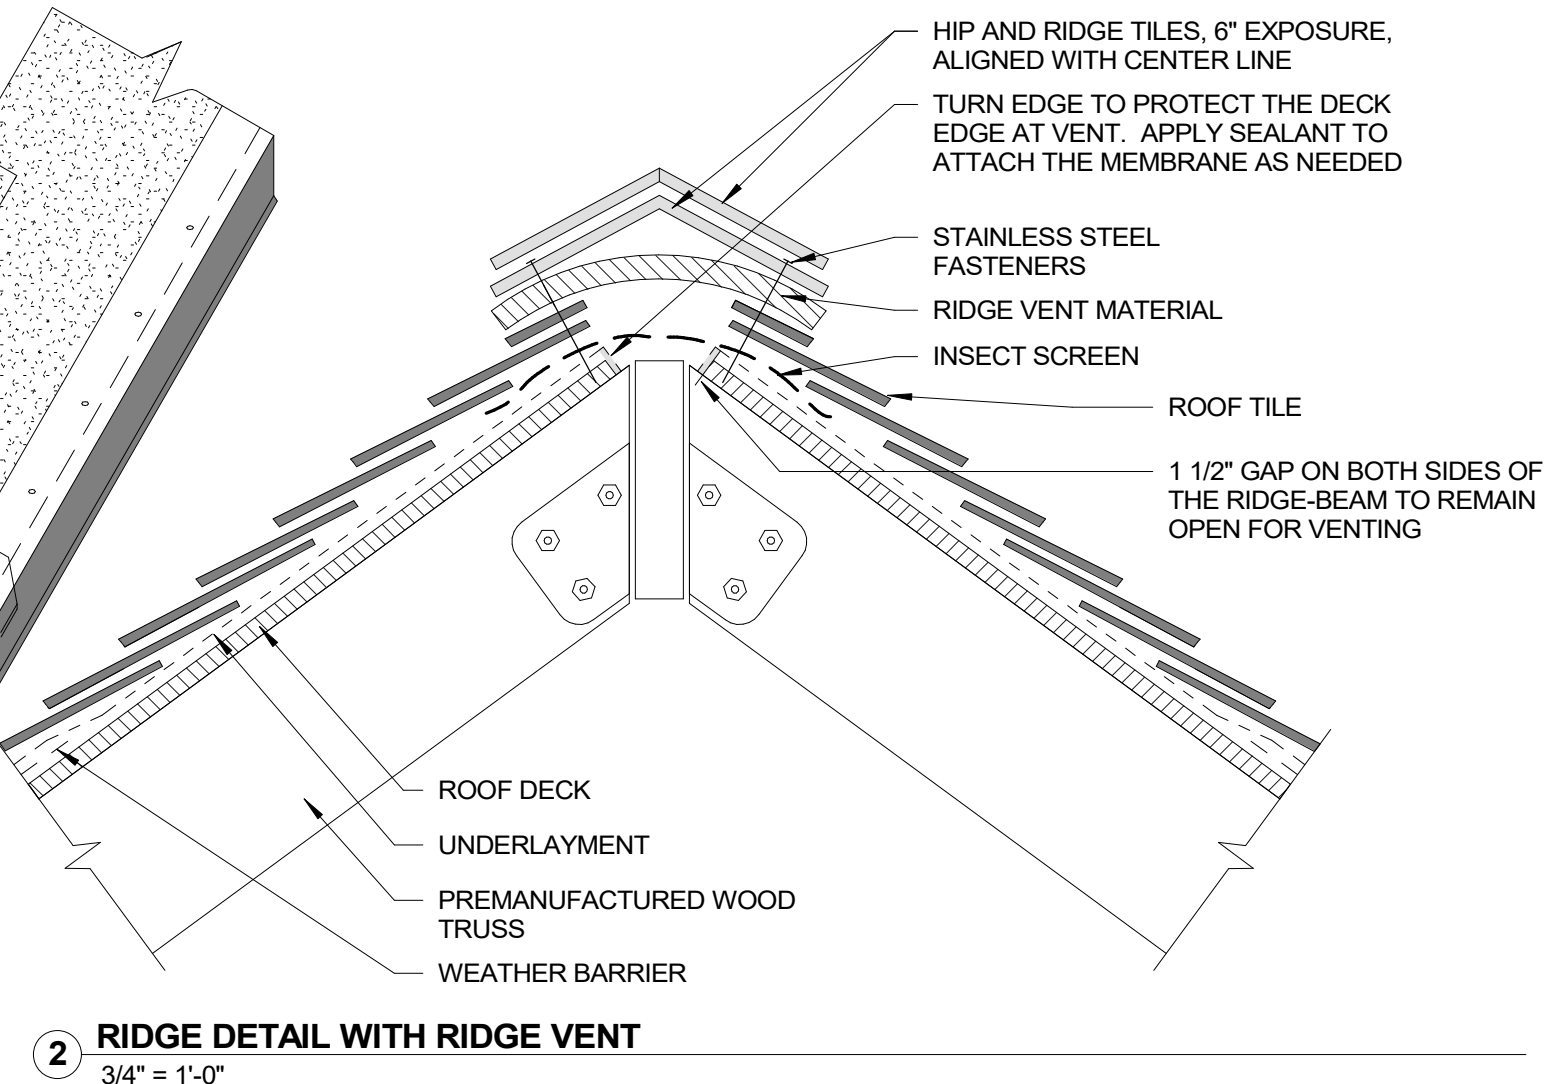


2 RIDGE DETAIL WITH RIDGE VENT
3/4" = 1'-0"

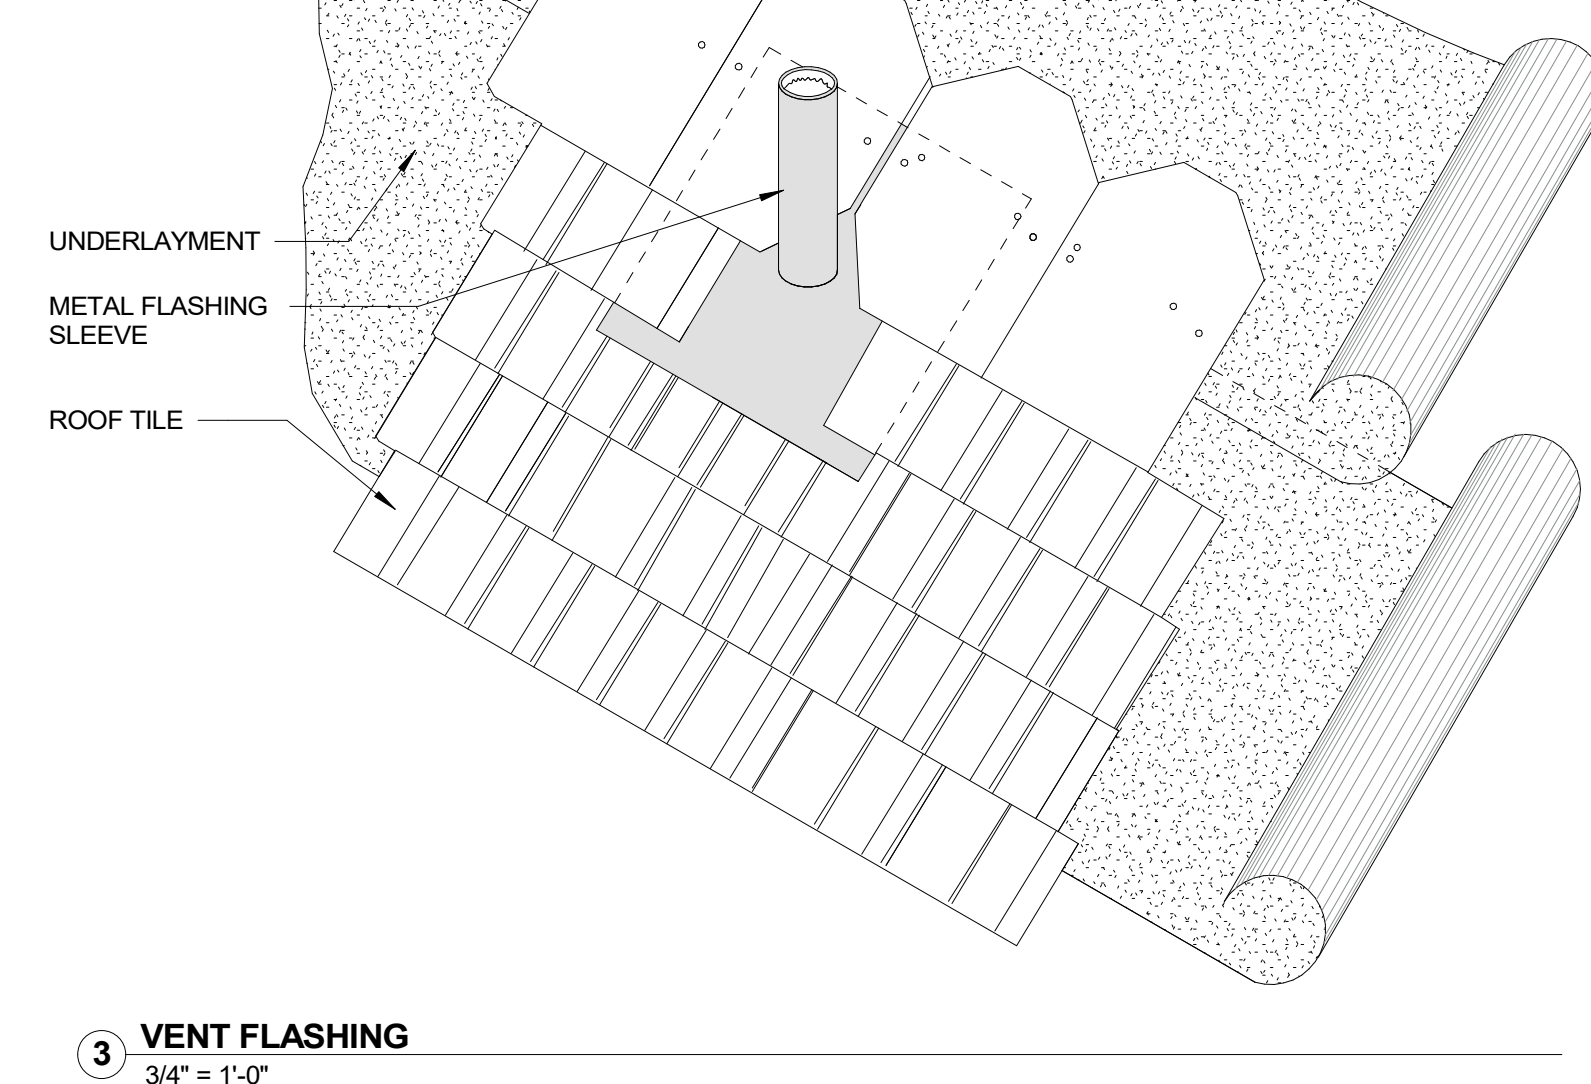


3 VENT FLASHING
3/4" = 1'-0"

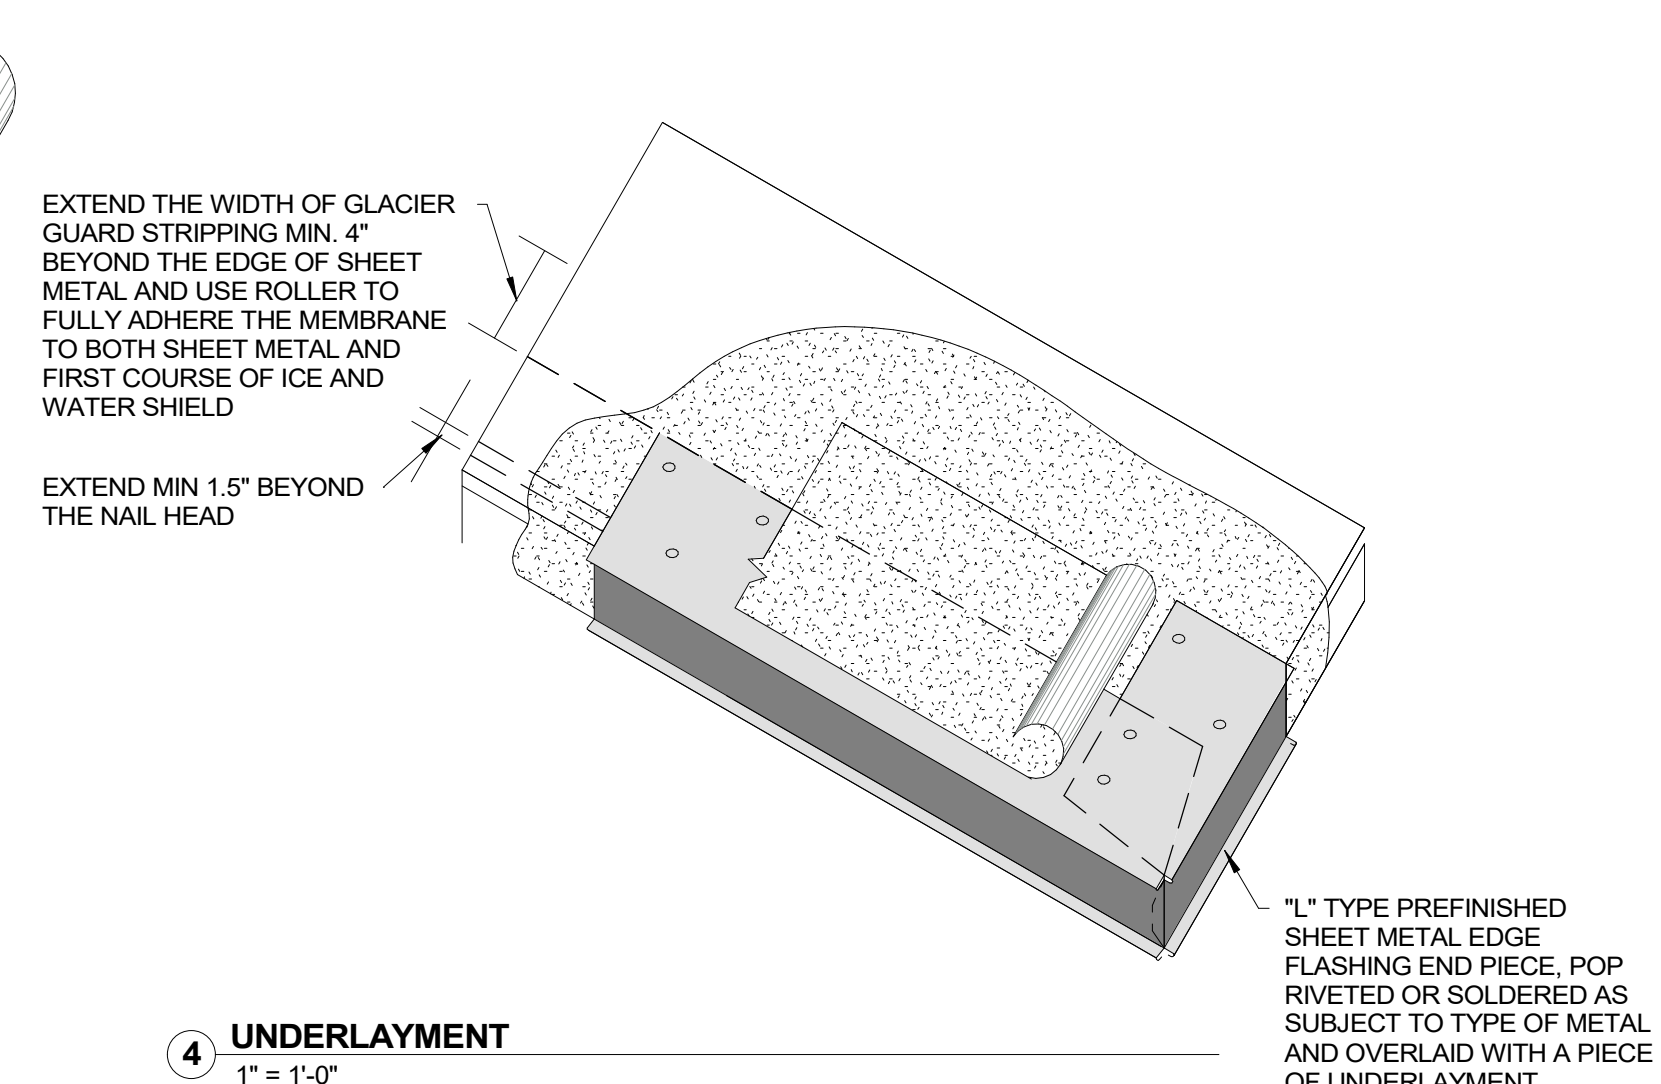


4 UNDERLAYMENT
1" = 1'-0"

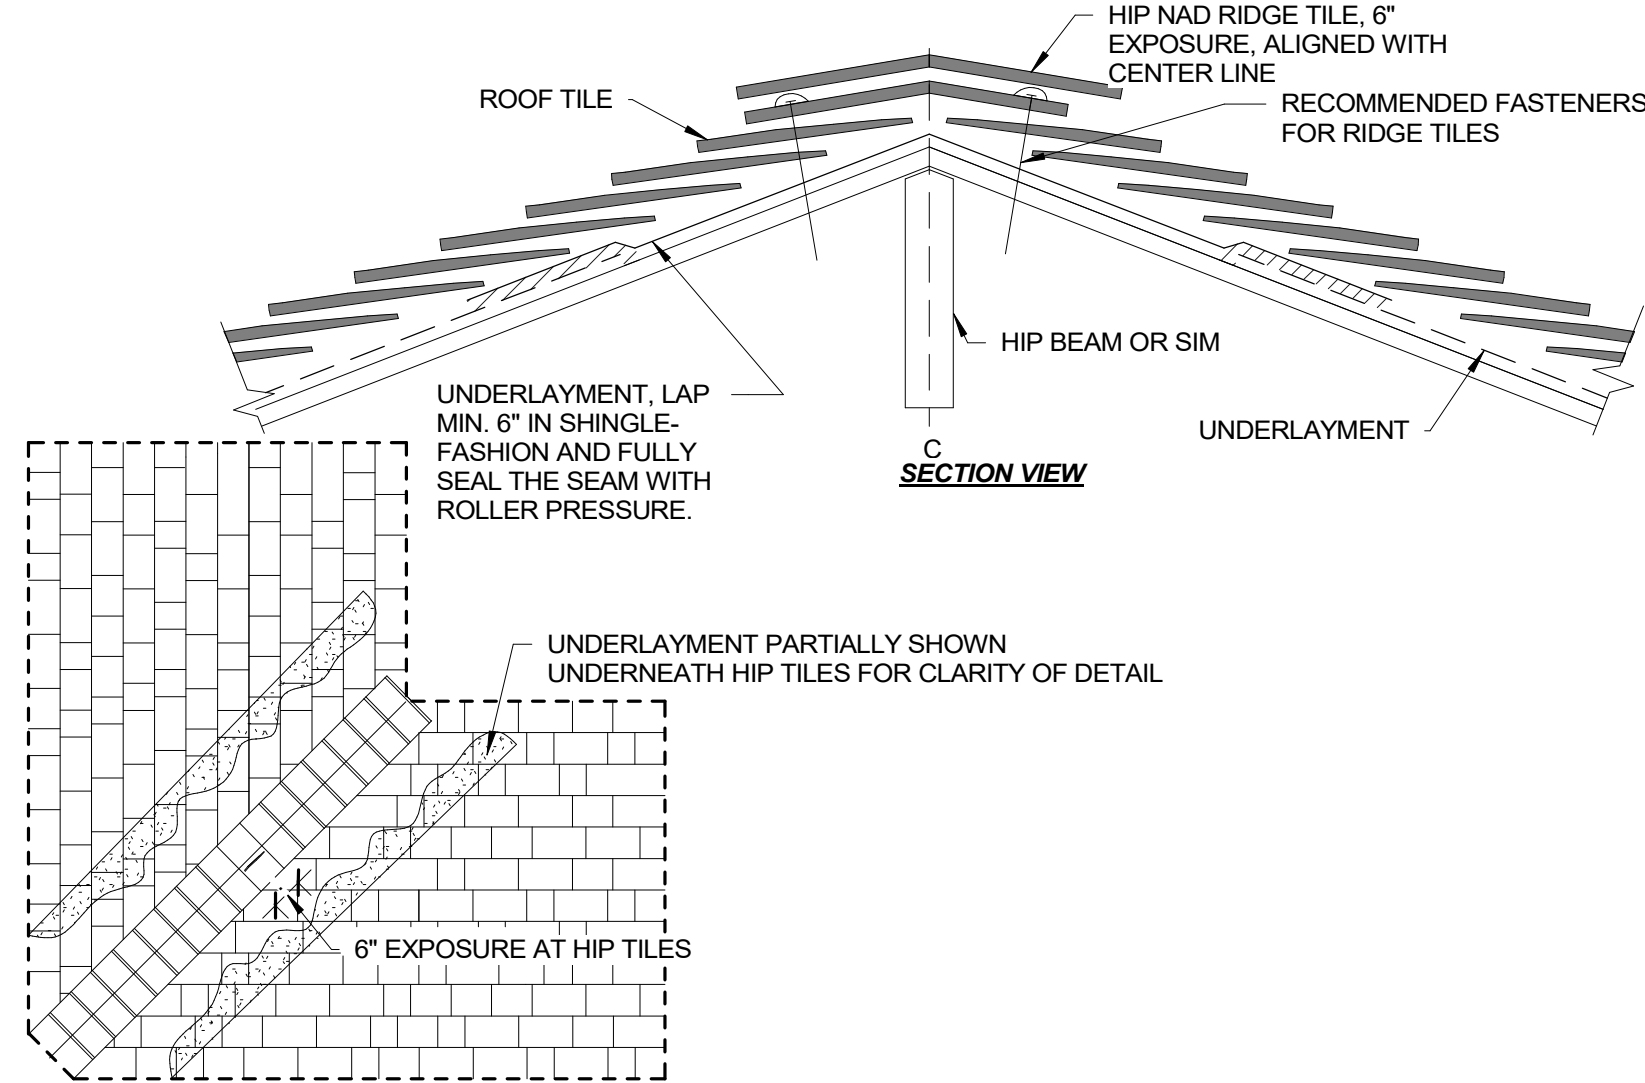


5 HIP DETAIL
3/4" = 1'-0"

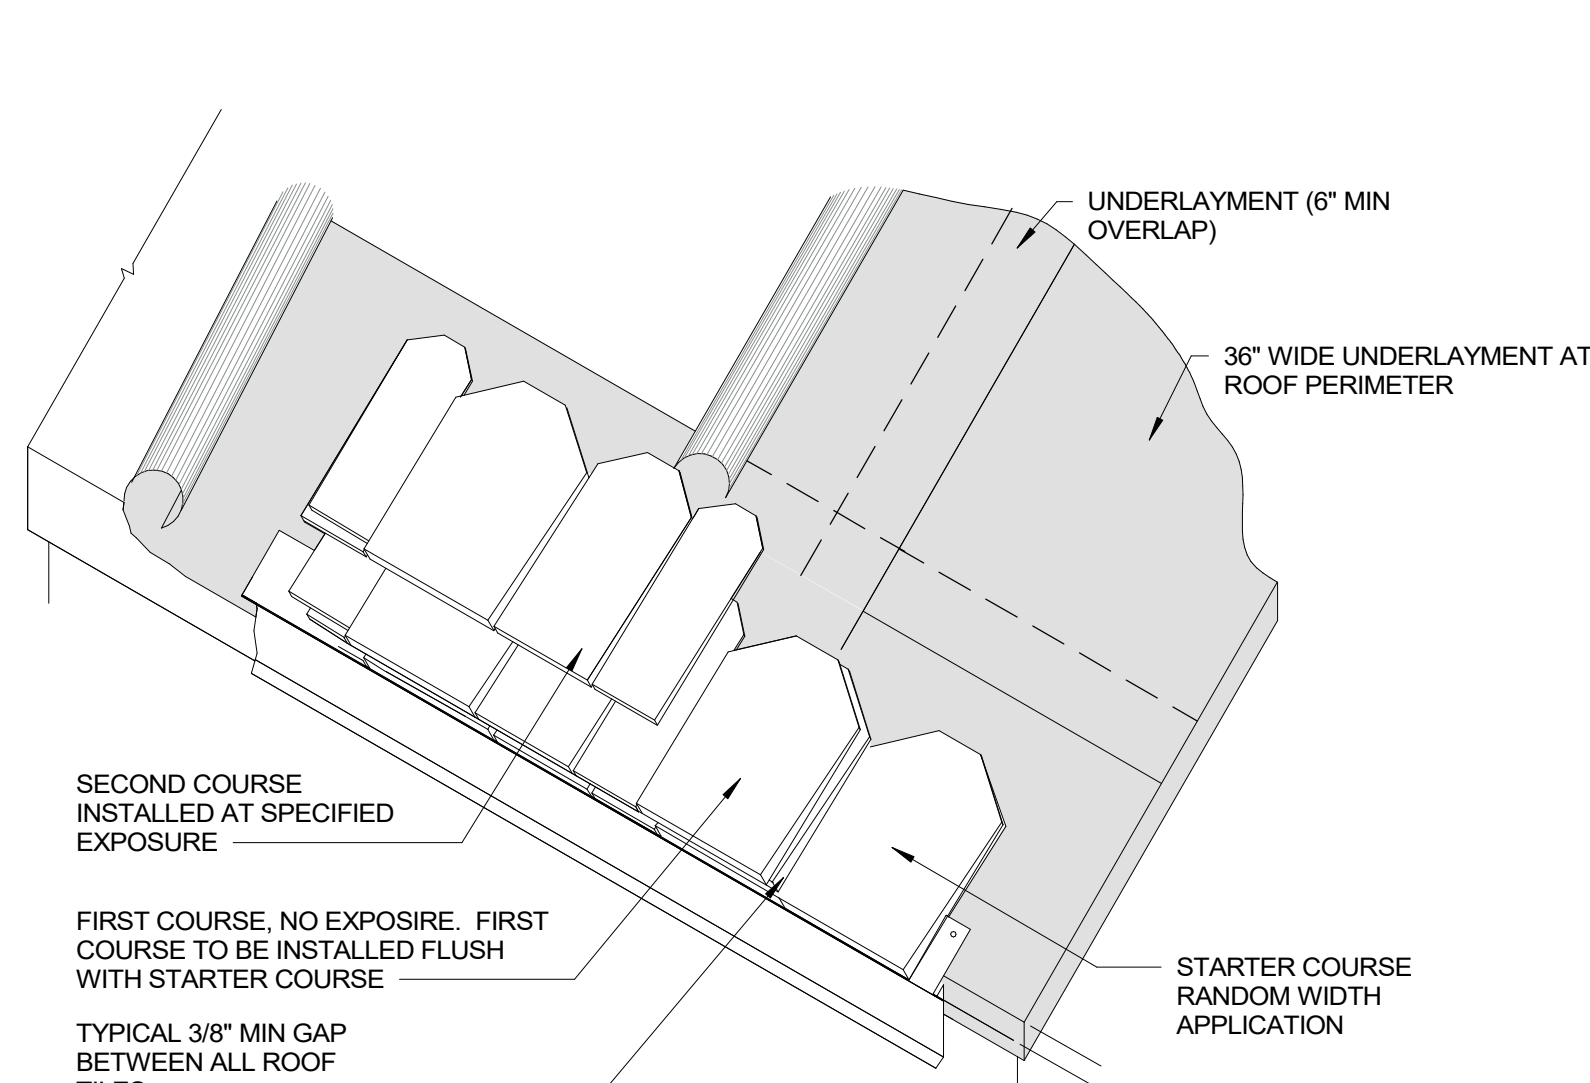

6 STARTER COURSE
3/4" = 1'-0"

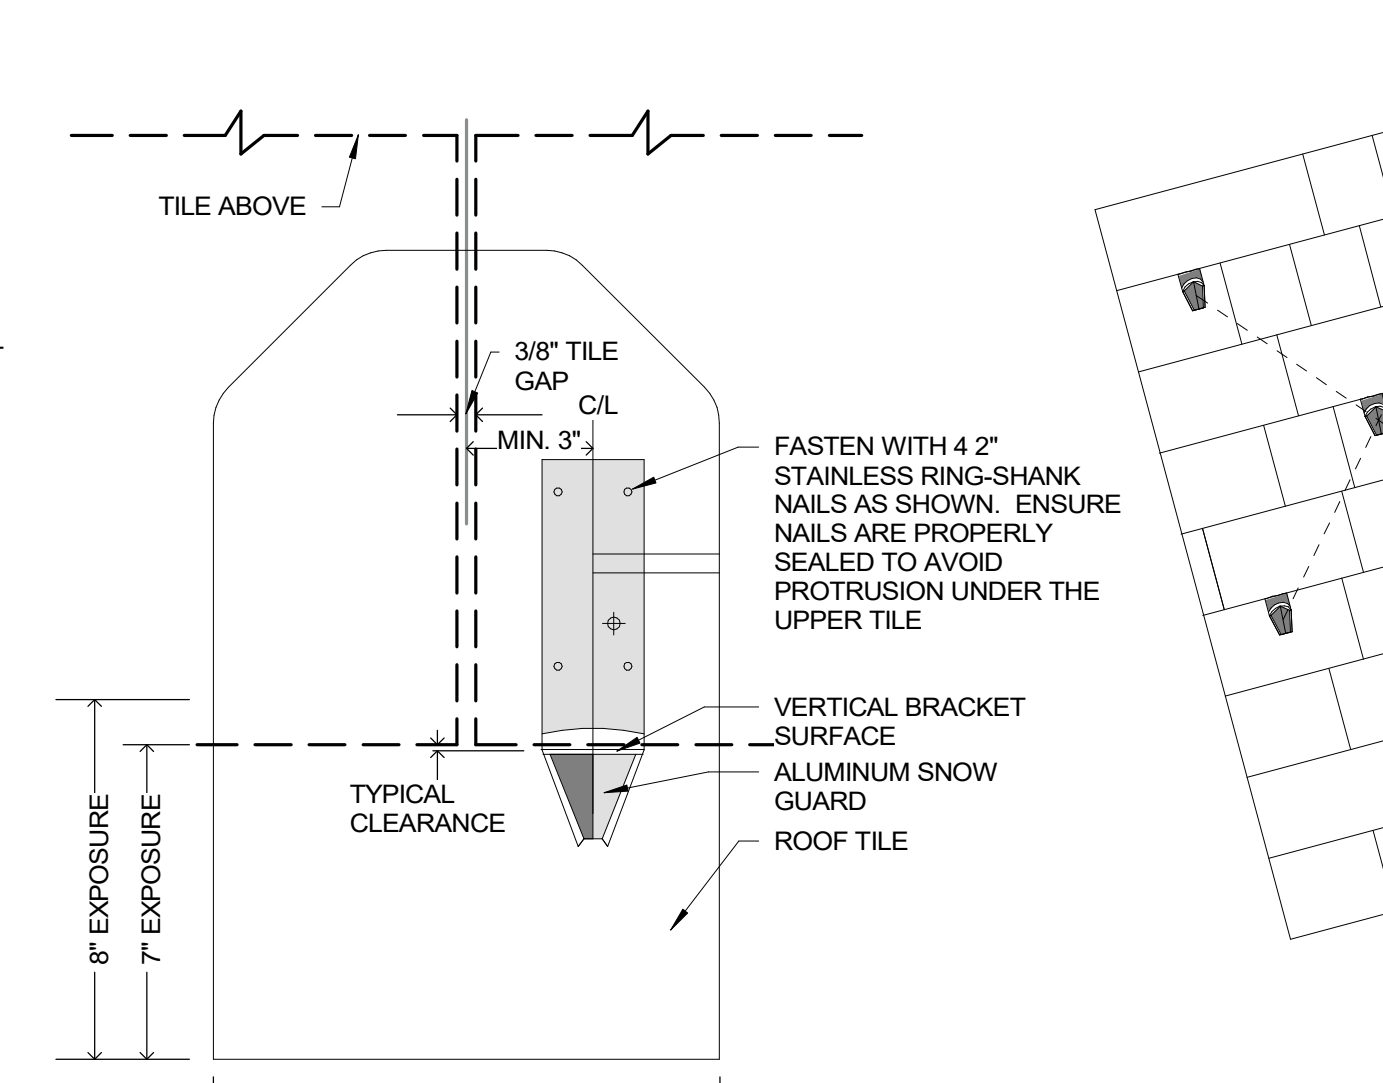


7 SNOW GUARD LAYOUT
3/4" = 1'-0"

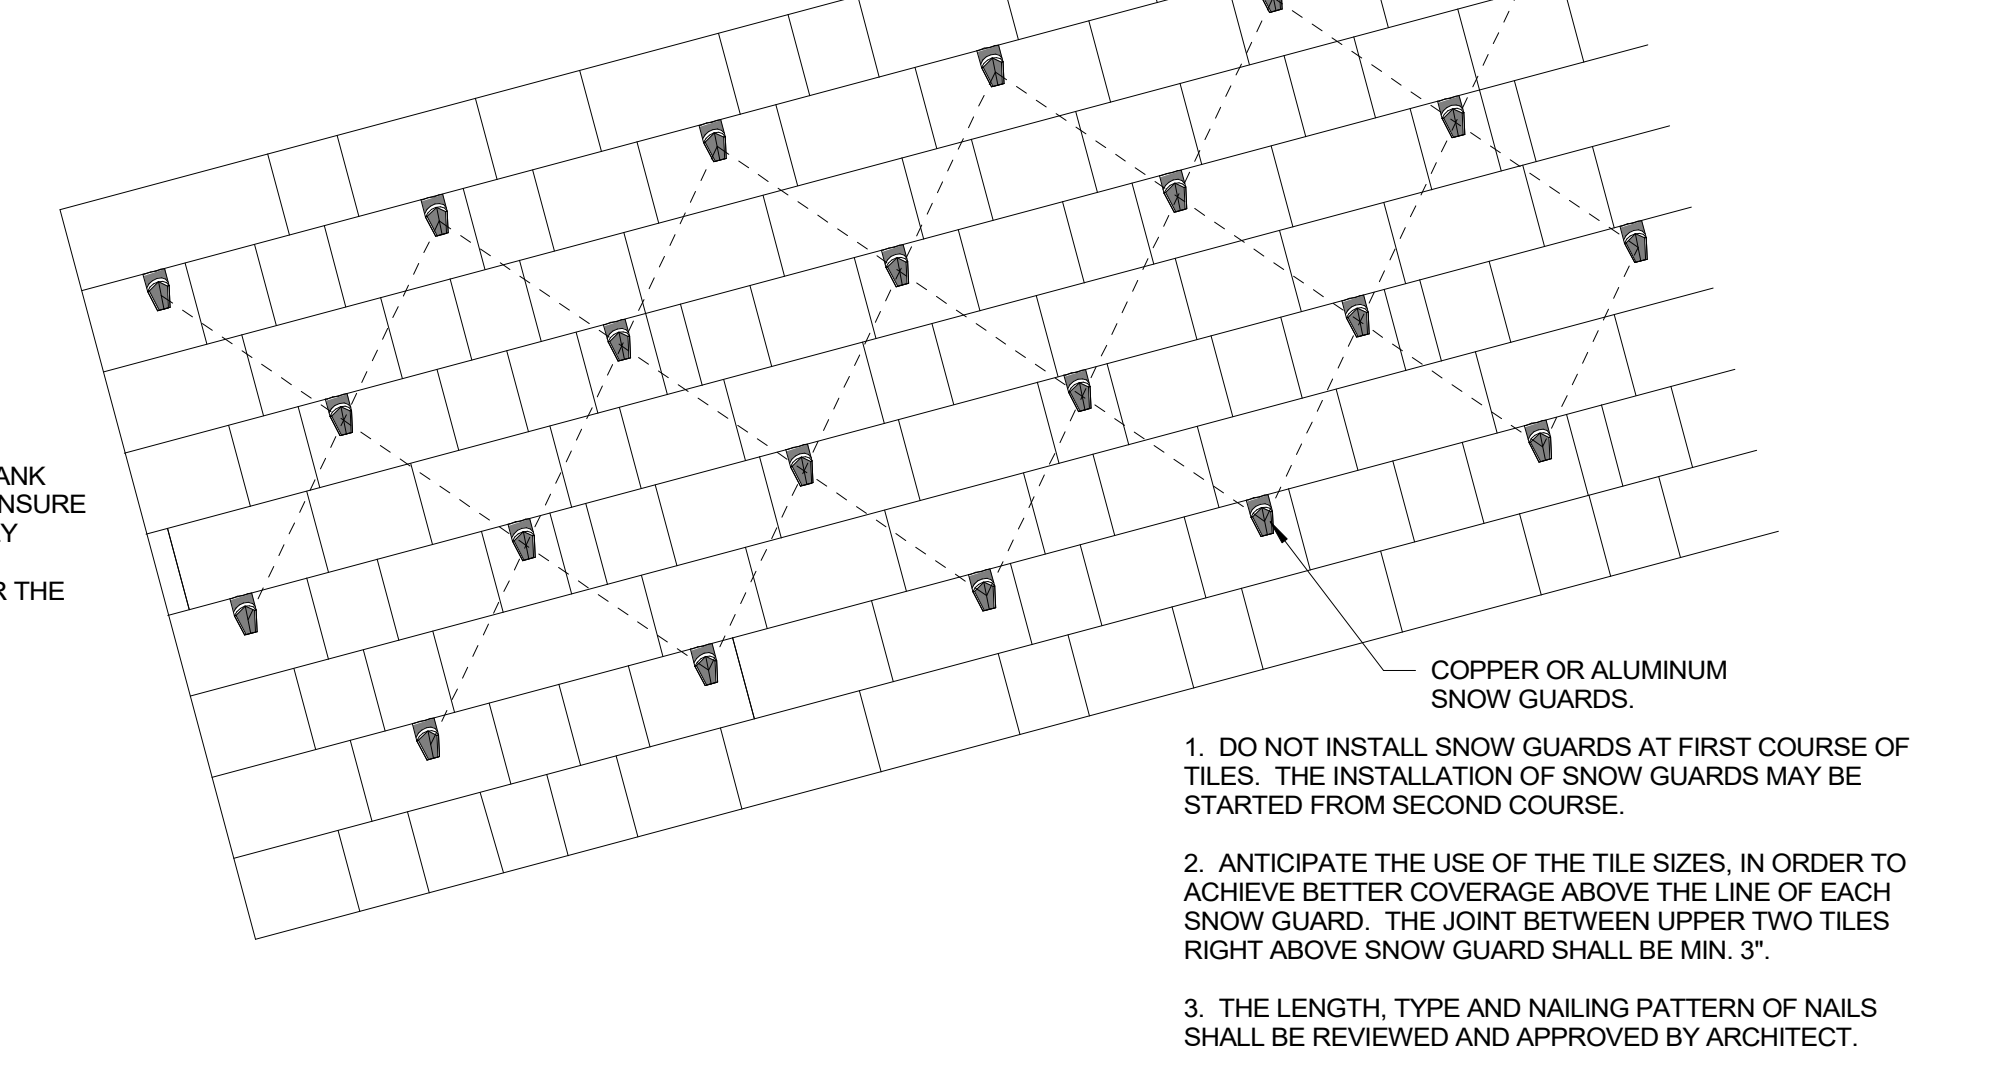



8 SNOW GUARDS
1" = 1'-0"

1. DO NOT INSTALL SNOW GUARDS AT FIRST COURSE OF TILES. THE INSTALLATION OF SNOW GUARDS MAY BE STARTED FROM SECOND COURSE.
2. ANTICIPATE THE USE OF THE TILE SIZES, IN ORDER TO ACHIEVE BETTER COVERAGE ABOVE THE LINE OF EACH SNOW GUARD. THE JOINT BETWEEN UPPER TWO TILES RIGHT ABOVE SNOW GUARD SHALL BE MIN. 3".
3. THE LENGTH, TYPE AND NAILING PATTERN OF NAILS SHALL BE REVIEWED AND APPROVED BY ARCHITECT.
4. NAILS WITHDRAWAL RESISTANCE SHALL BE VERIFIED PRIOR TO START OF PROJECT AND SHALL BE COORDINATED WITH THE ARCHITECT.

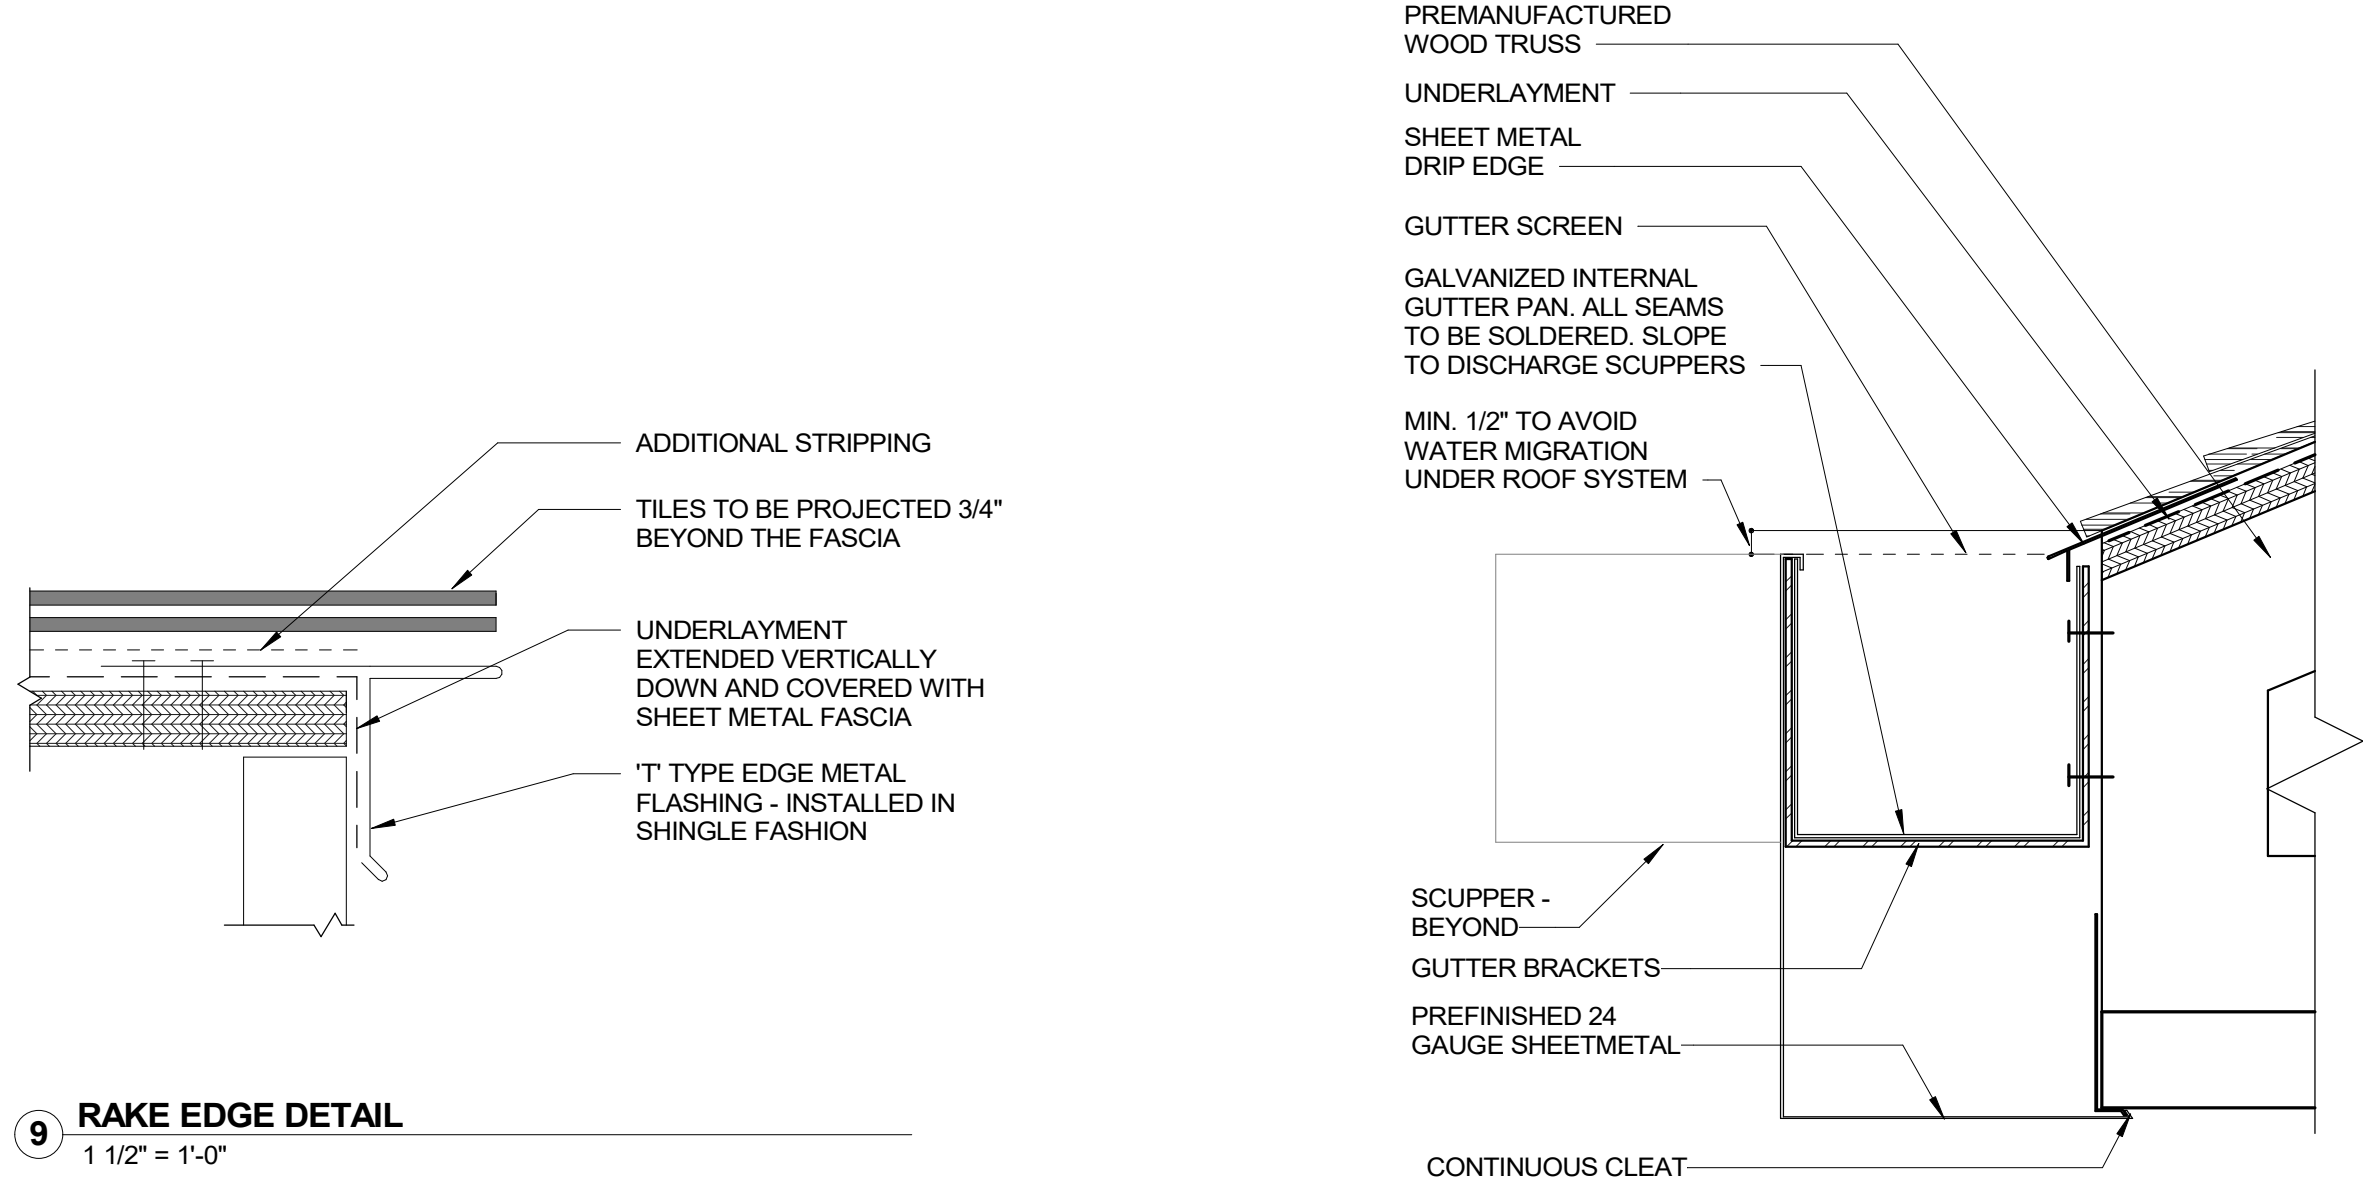


9 RAKE EDGE DETAIL
1 1/2" = 1'-0"

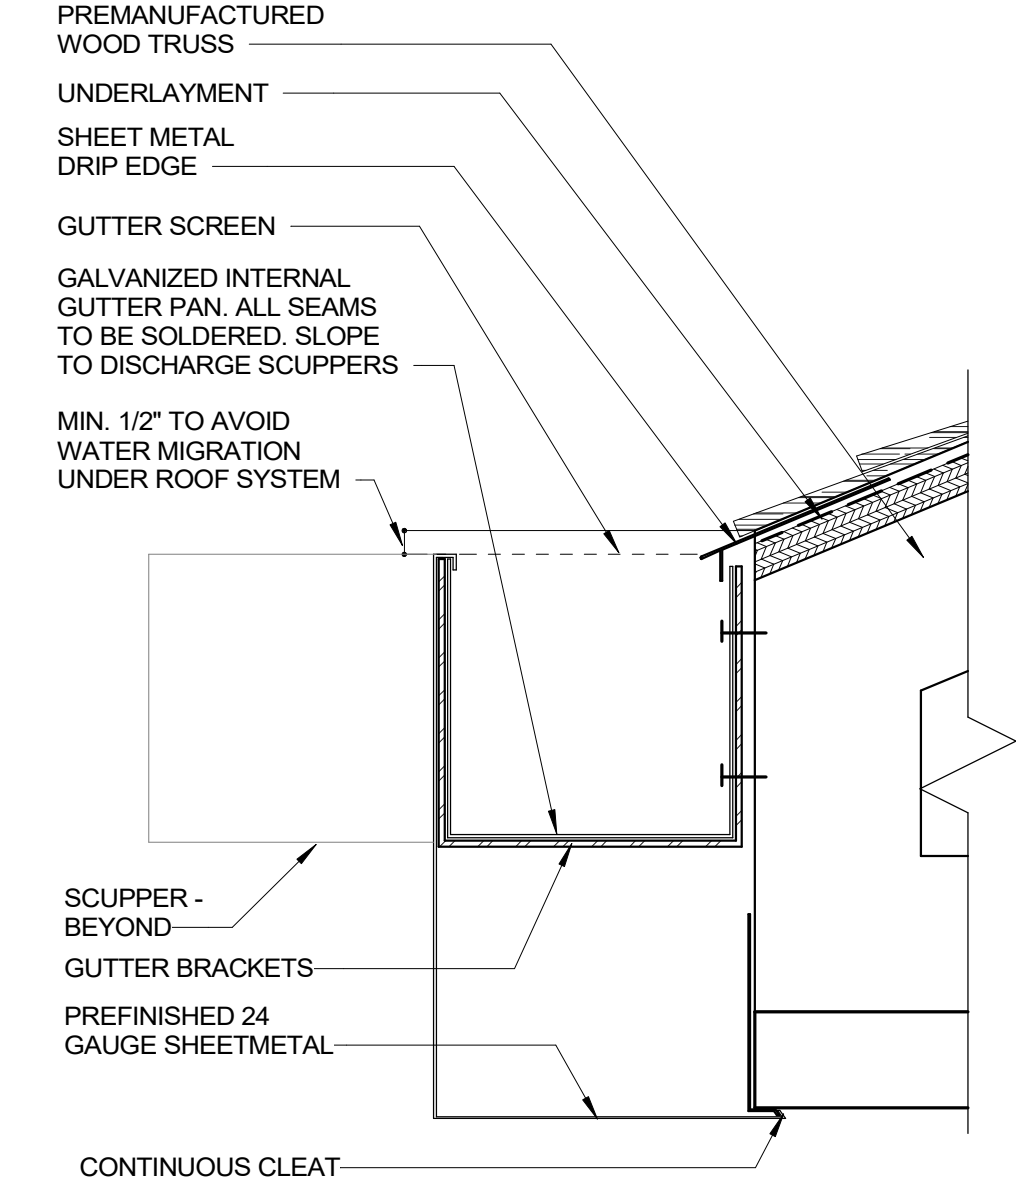


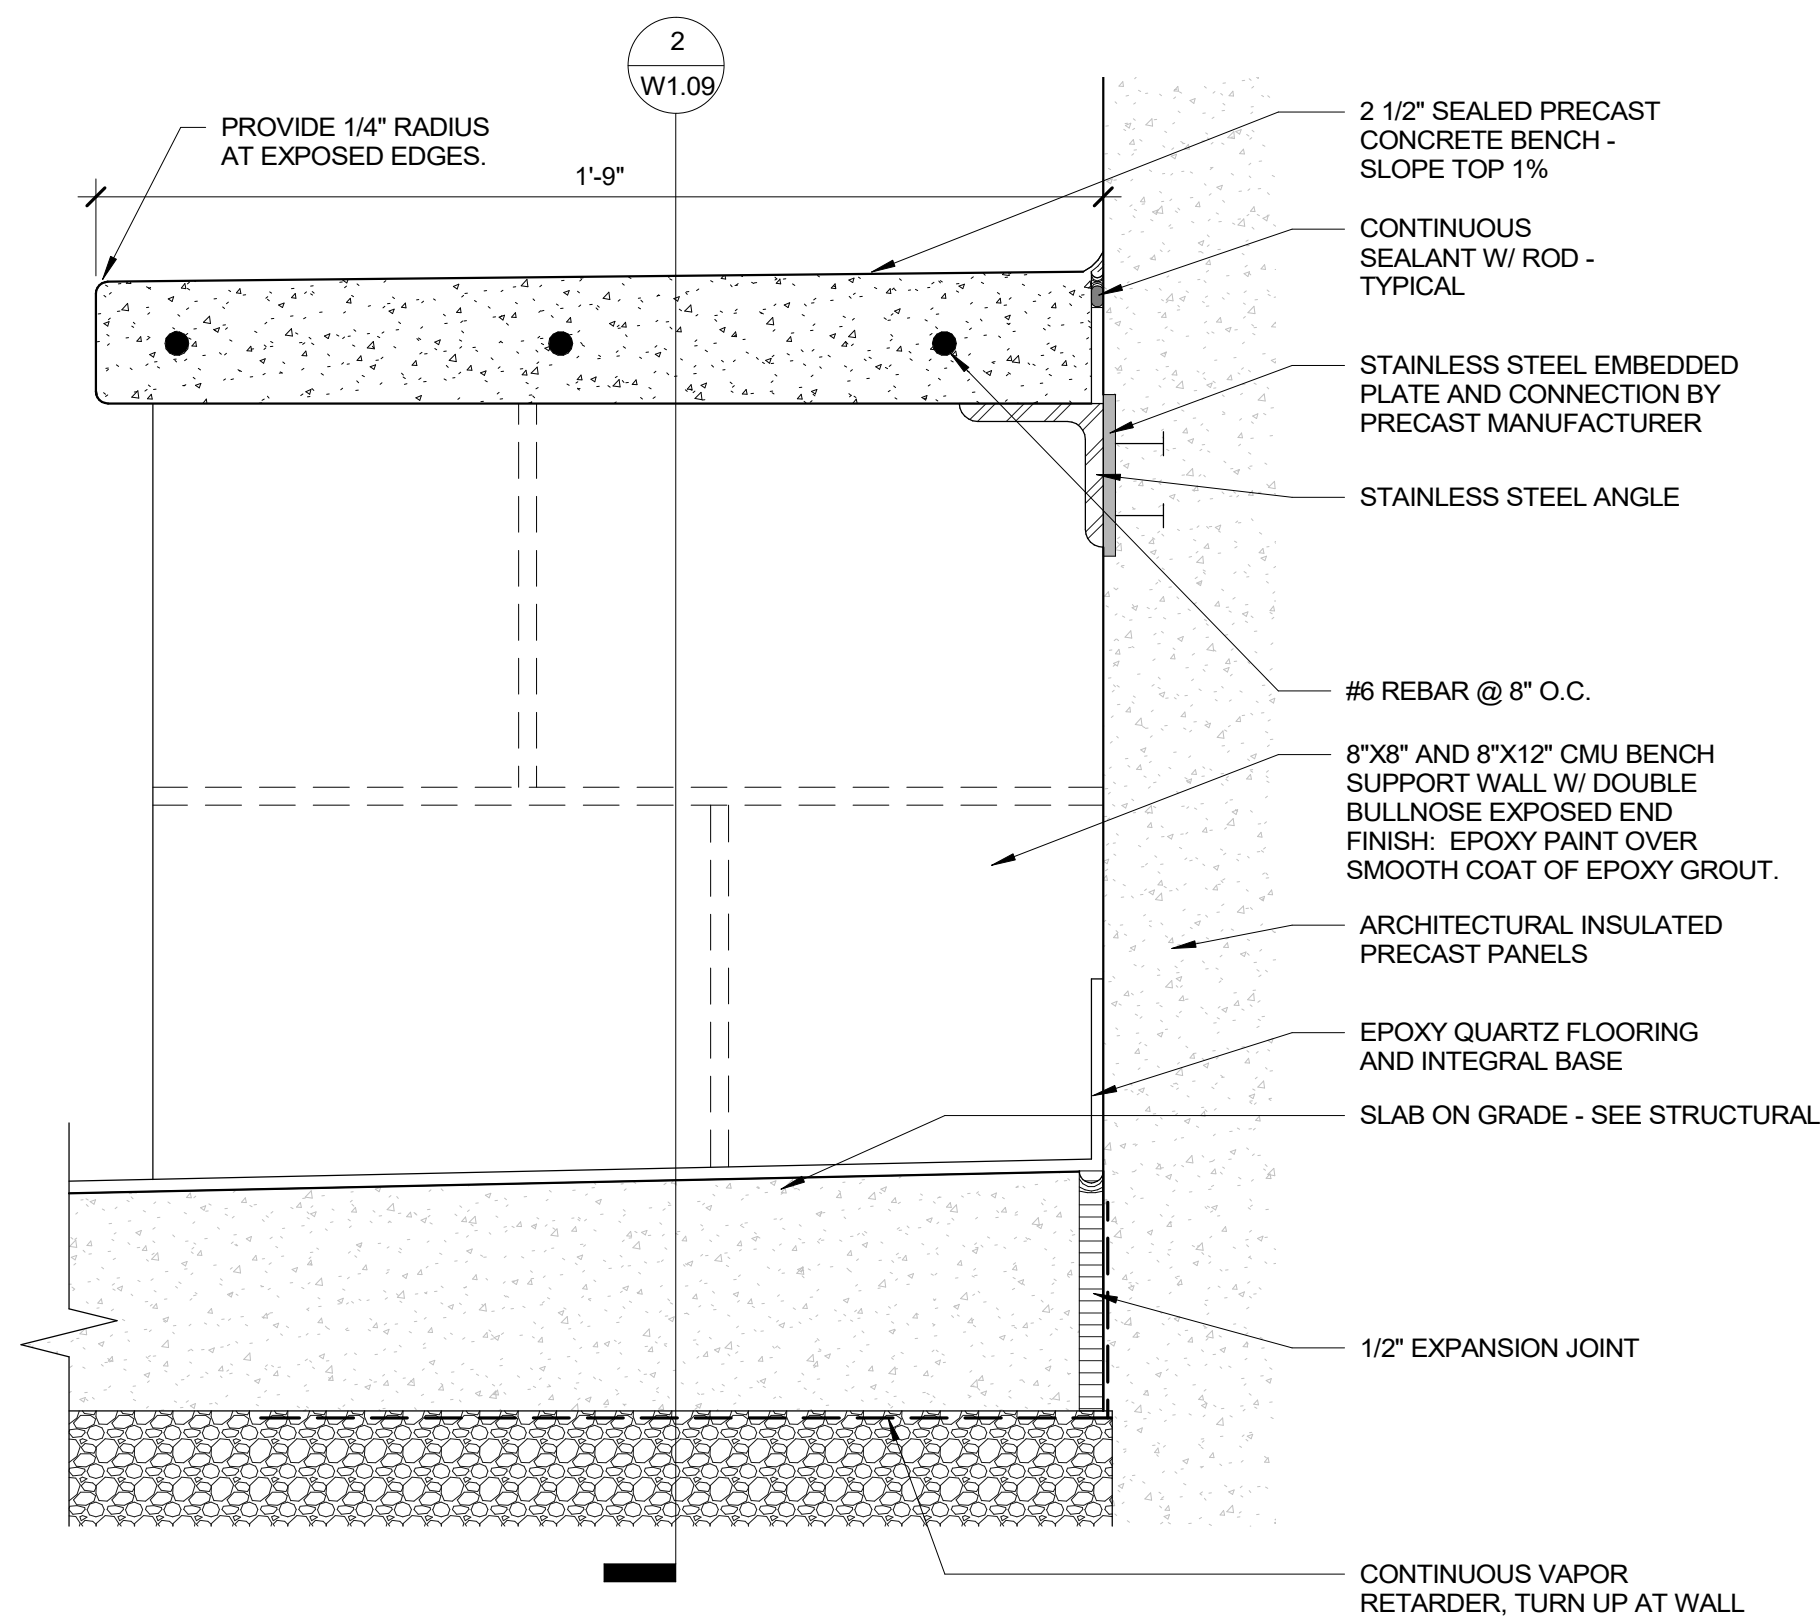


1 BENCH DETAIL
3" = 1'-0"

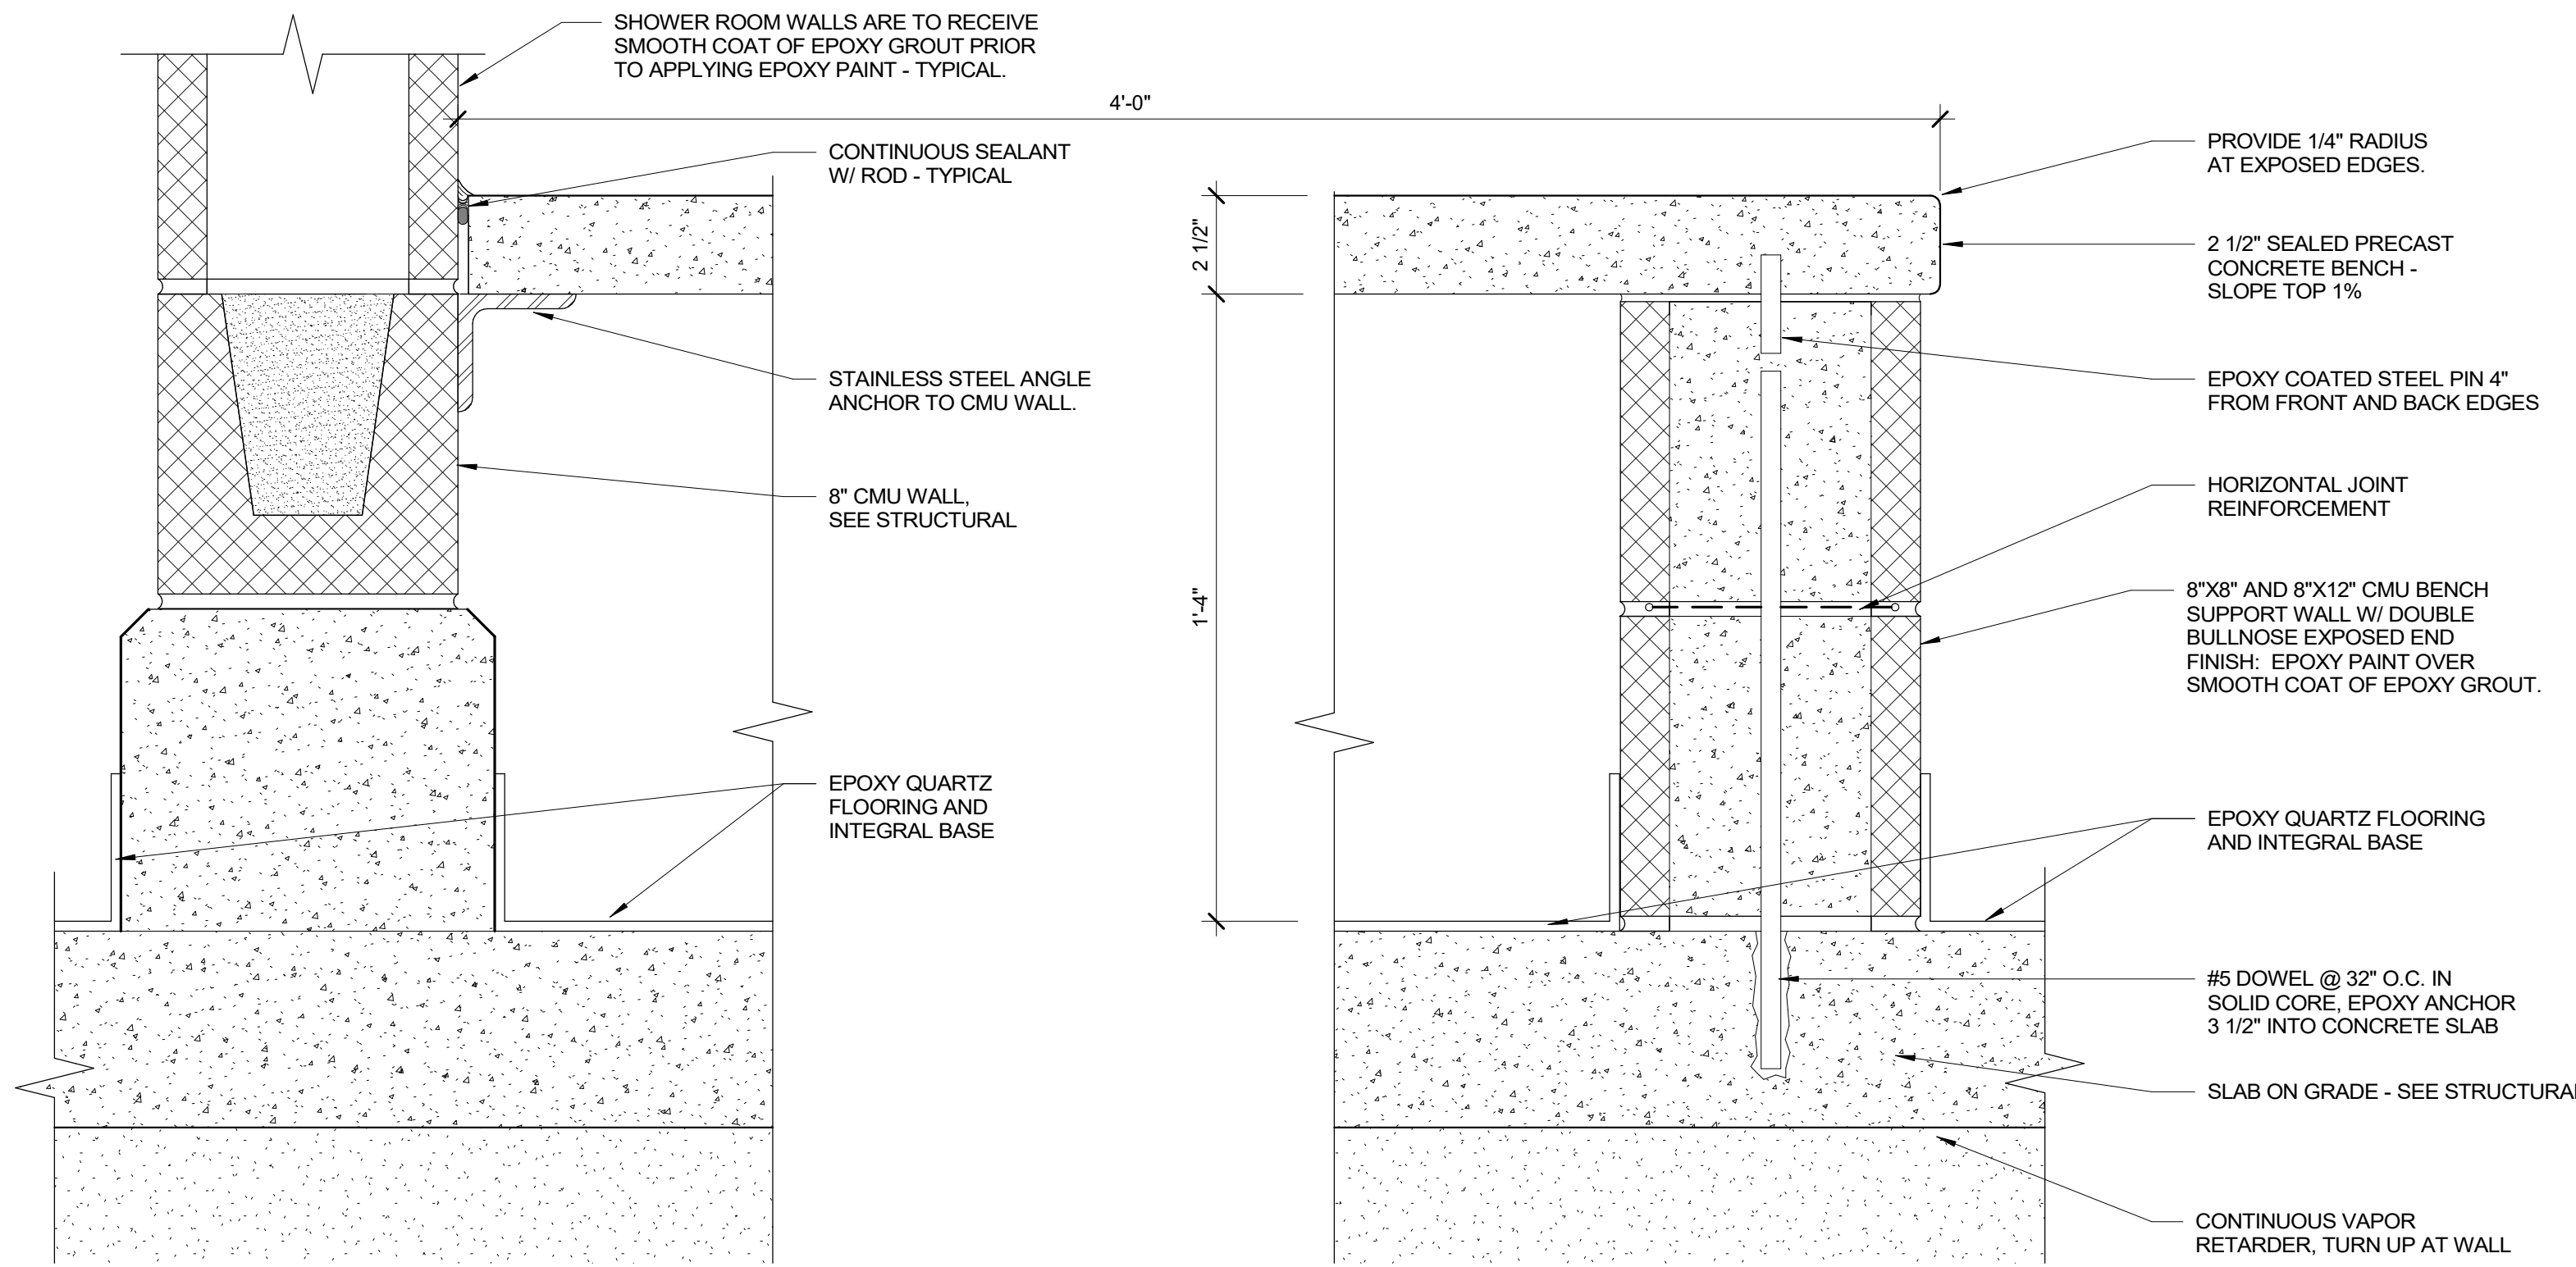


2 BENCH SECTION
3" = 1'-0"

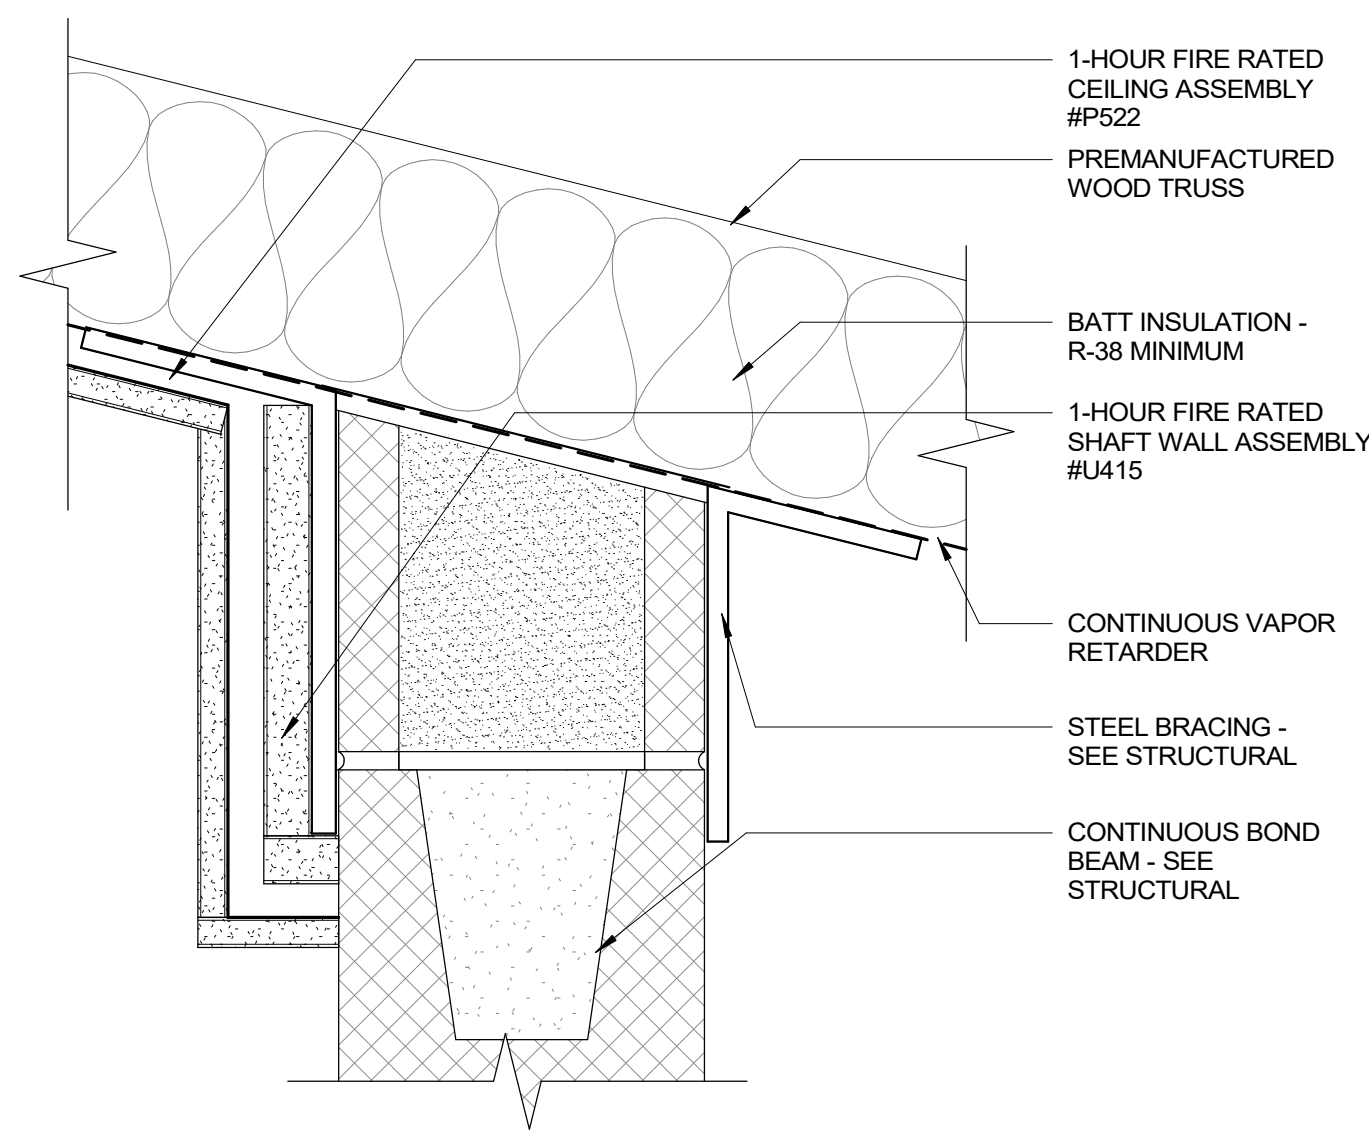


4 WALL DETAIL AT MECHANICAL CHASE
3" = 1'-0"

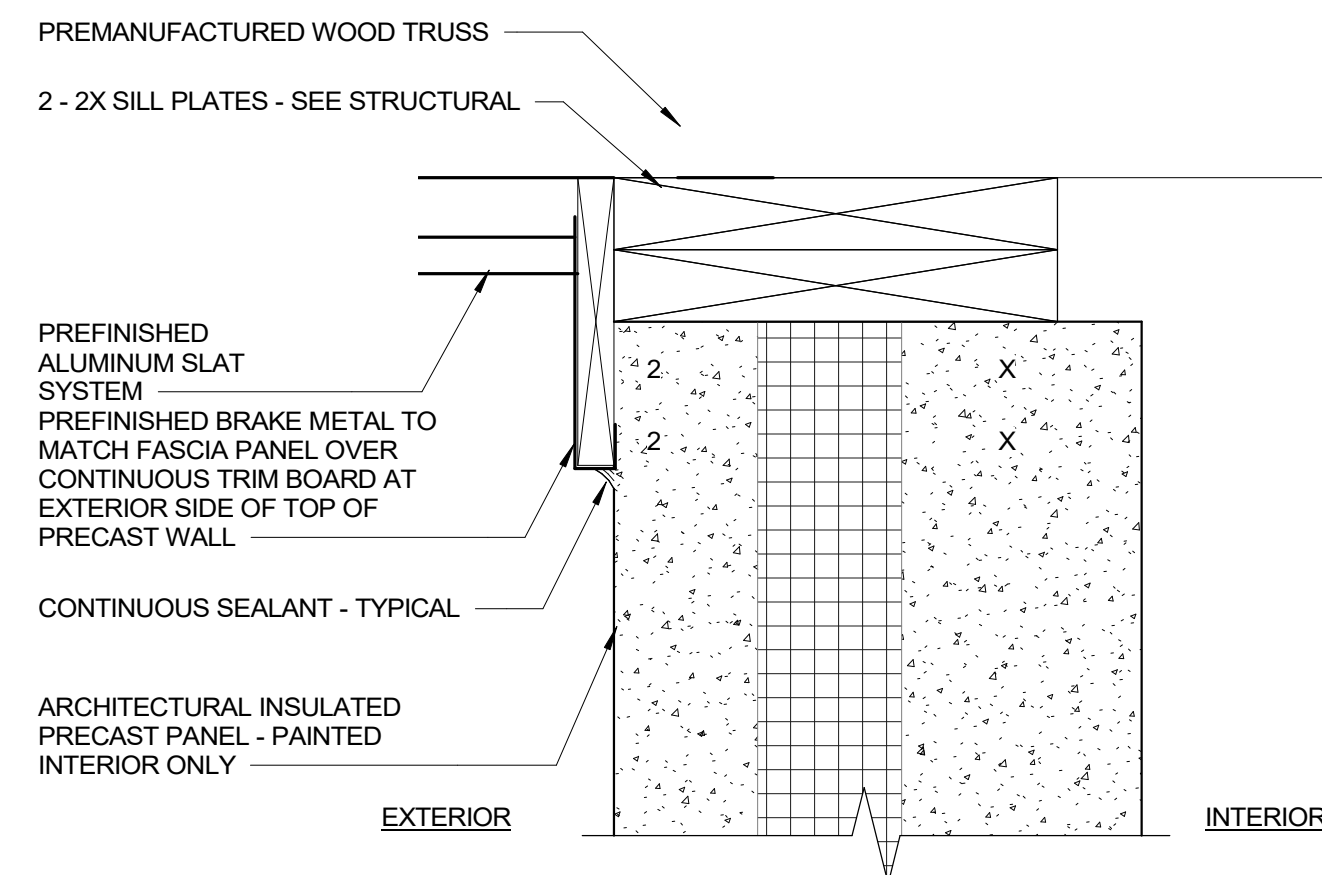


5 TOP OF PRECAST WALL DETAIL
3" = 1'-0"

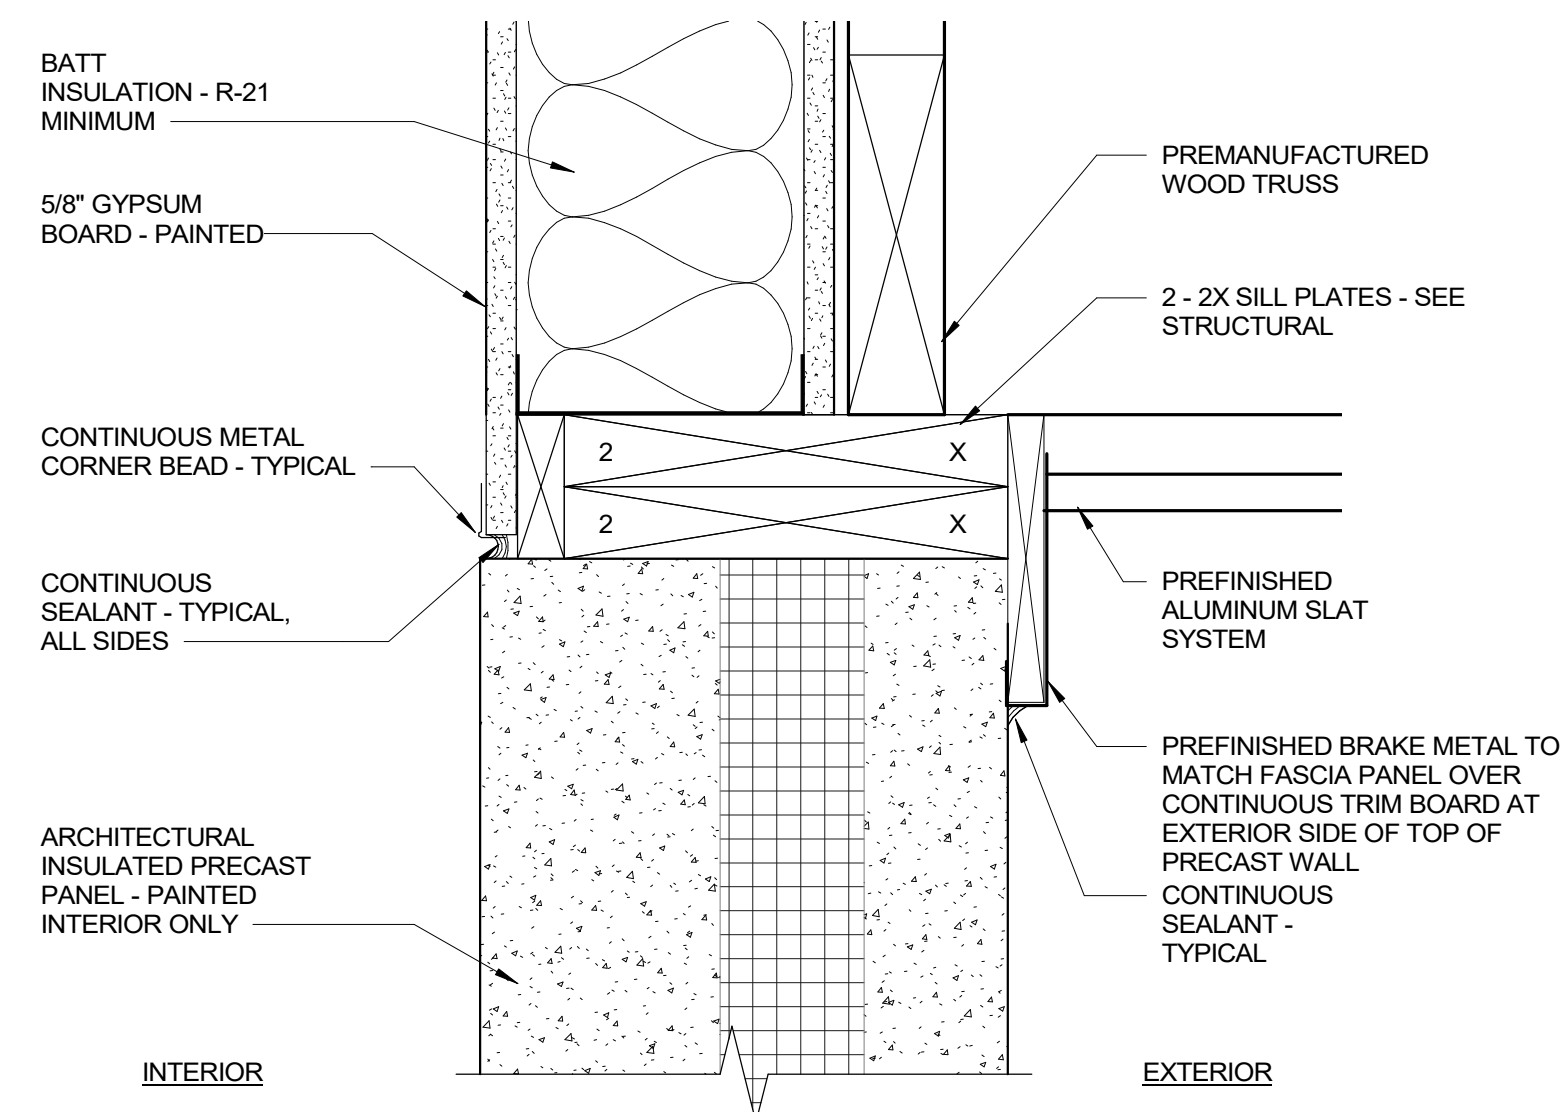


6 TOP OF PRECAST WALL AT BREEZEWAY
3" = 1'-0"

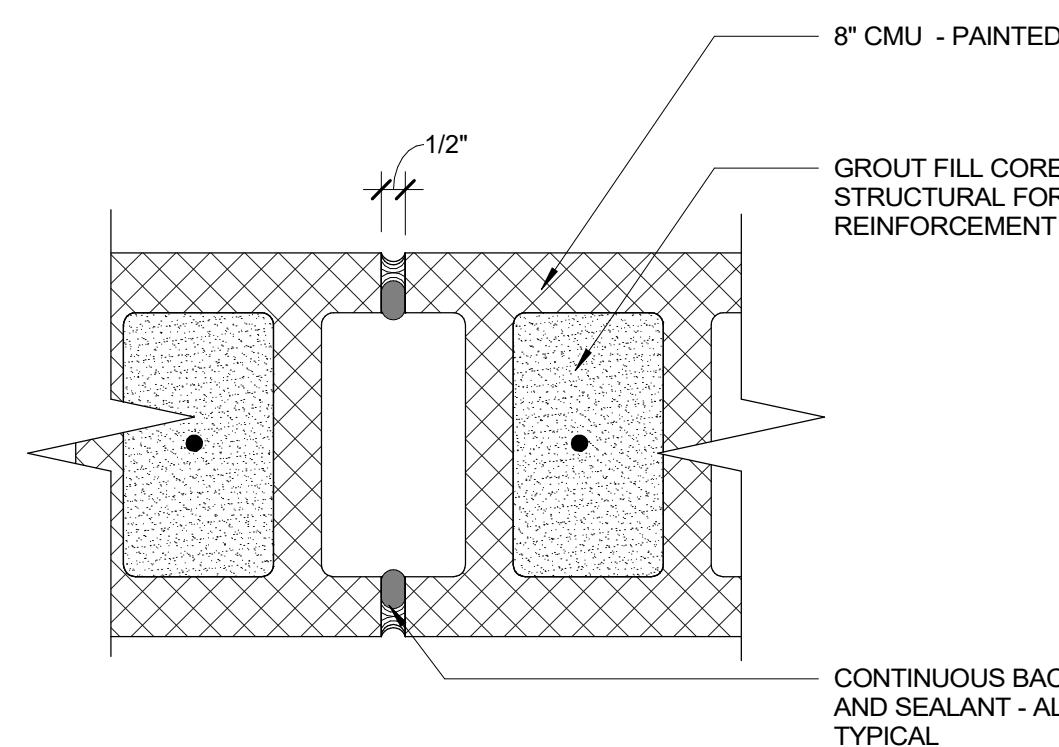


7 TYPICAL CMU CONTROL JOINT
3" = 1'-0"

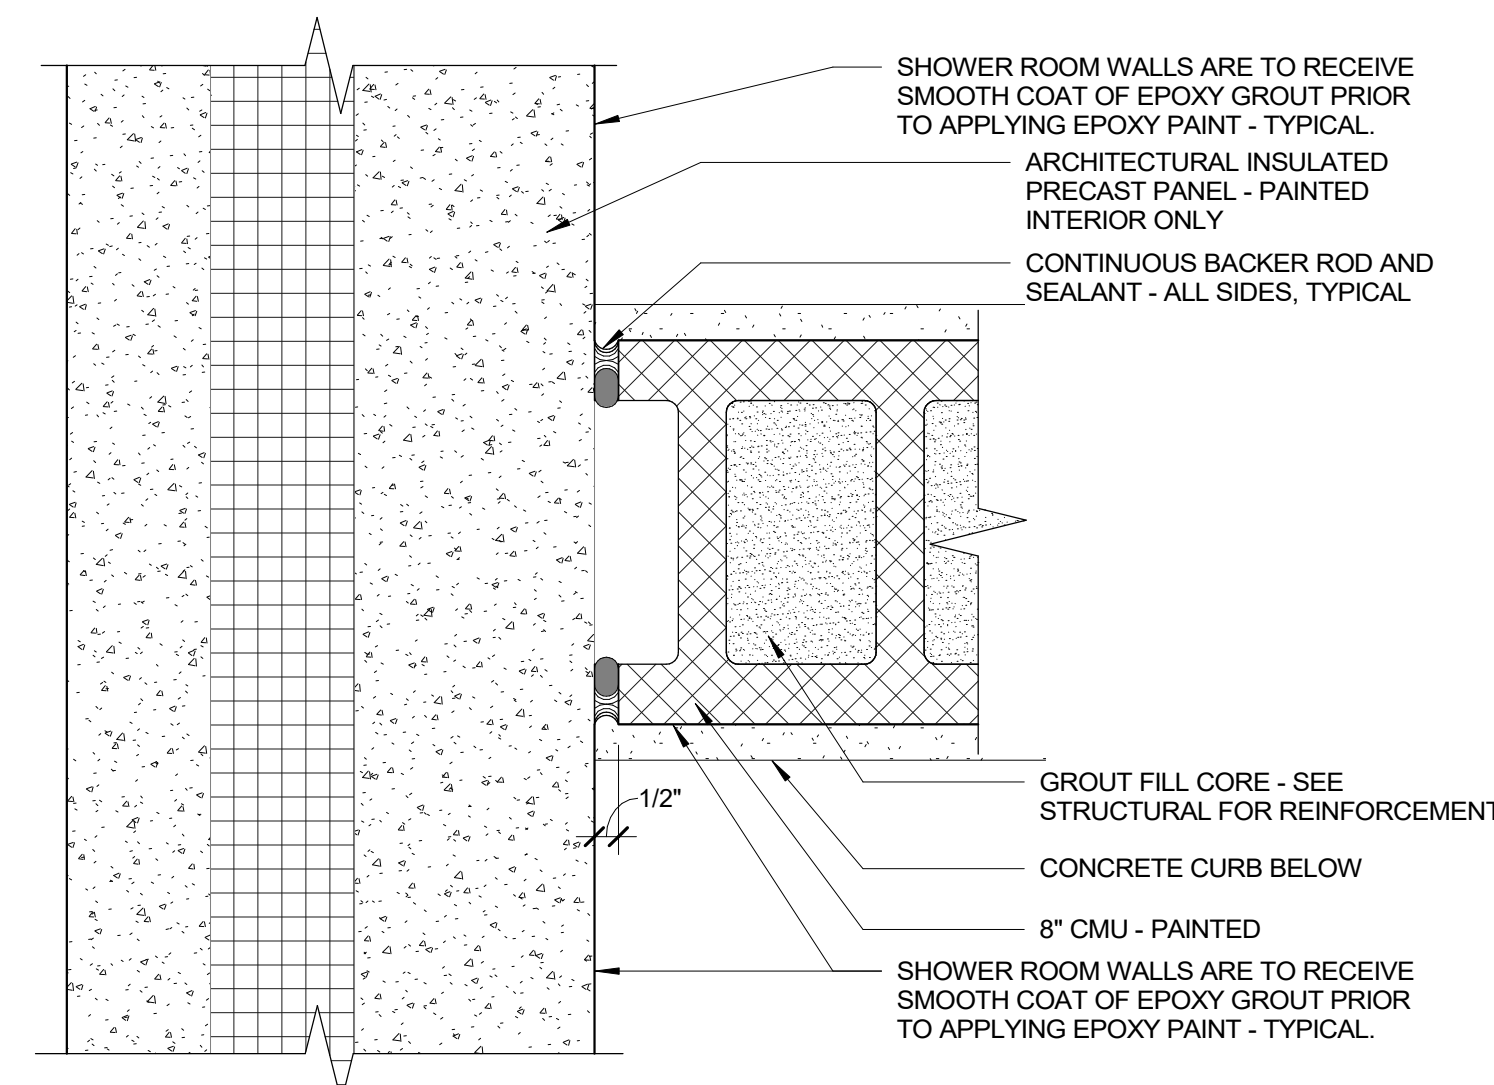


8 CMU EXPANSION JOINT AT PRECAST PANEL
3" = 1'-0"

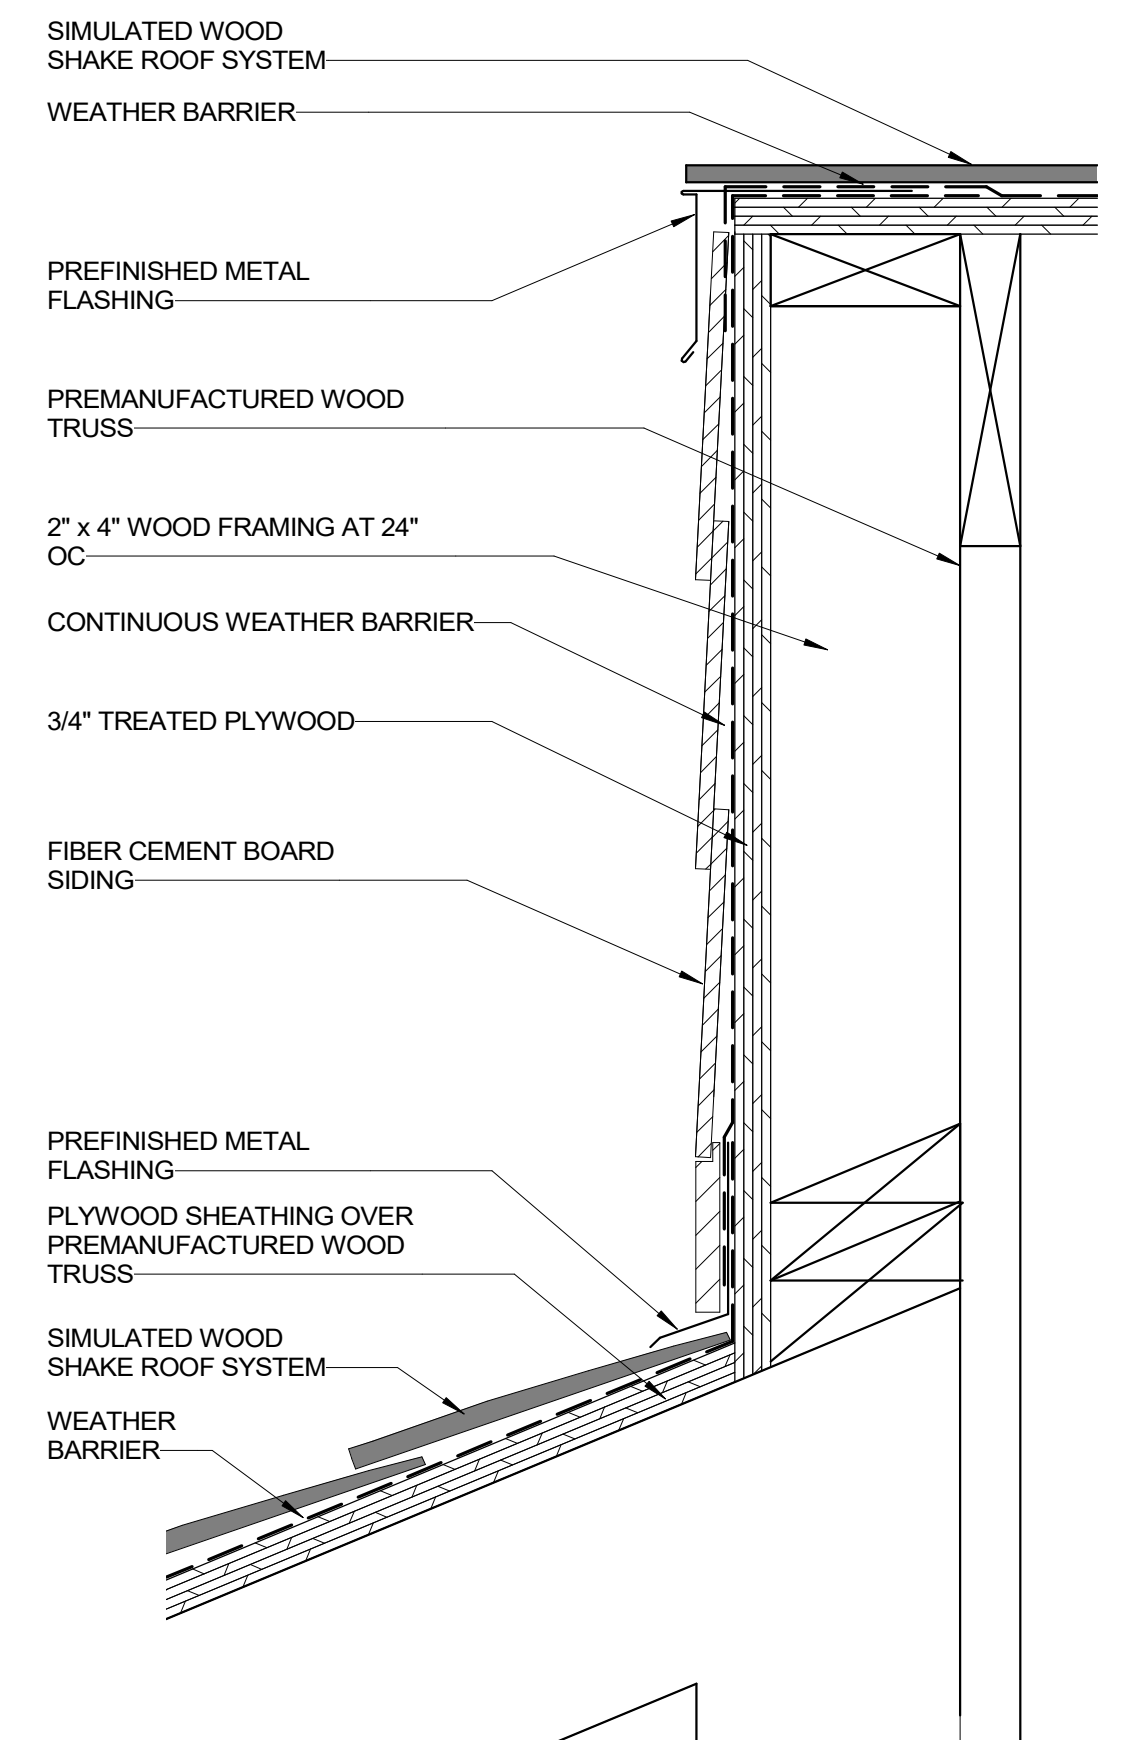


3 ROOF TO WALL DETAIL
3" = 1'-0"

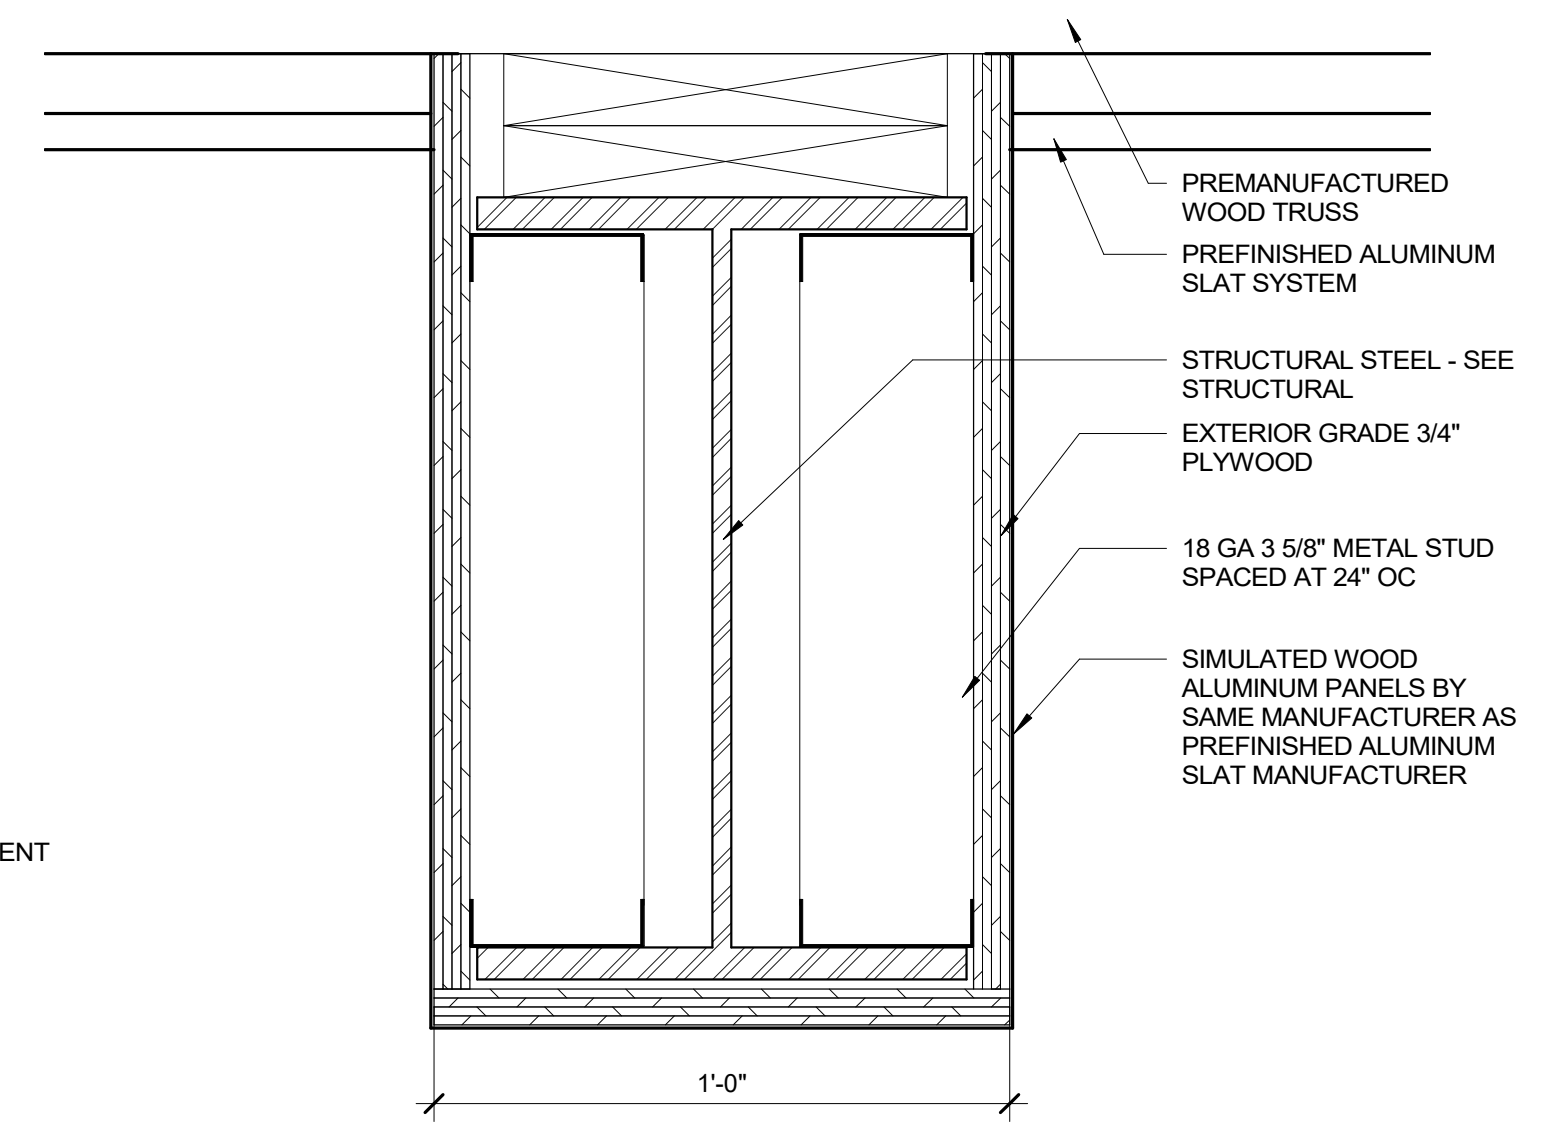

9 BEAM WRAP DETAIL
3" = 1'-0"

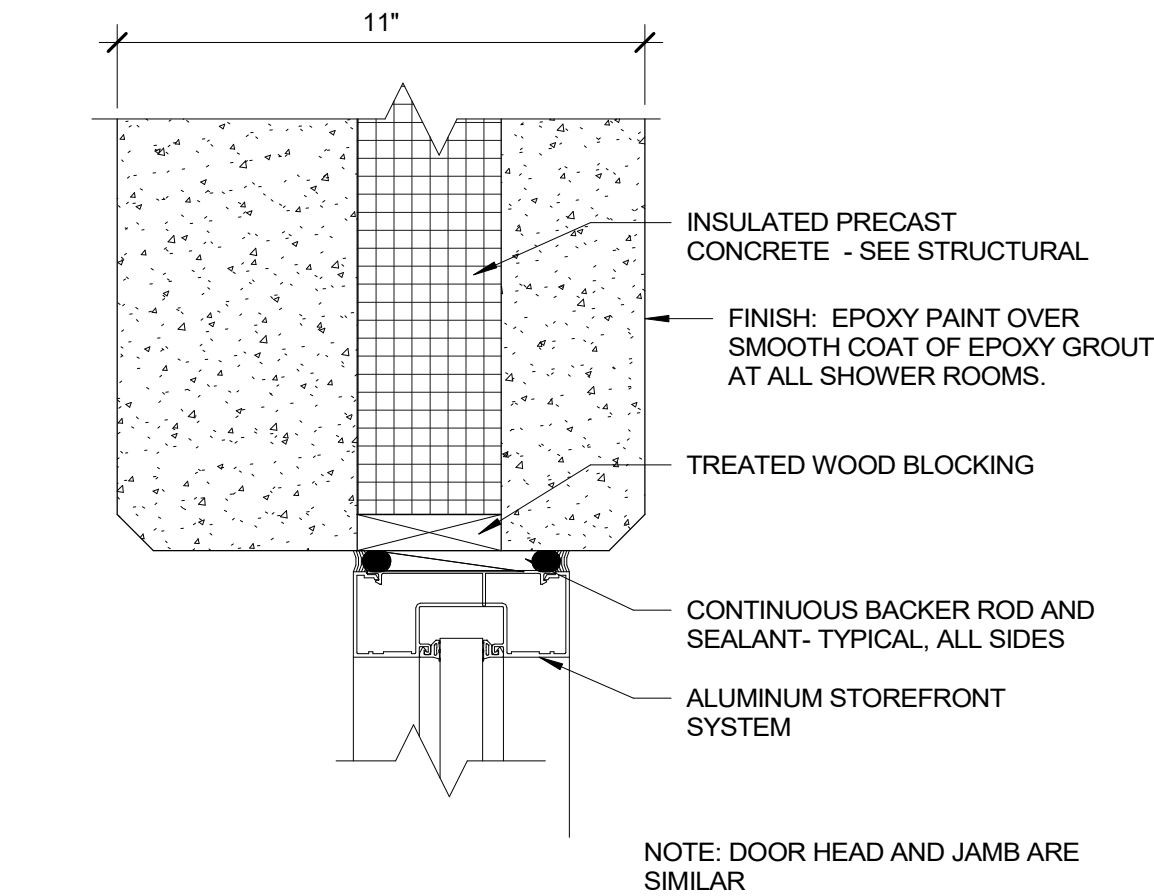



1 WINDOW HEAD AND JAMB DETAIL - PRECAST
3" = 1'-0"

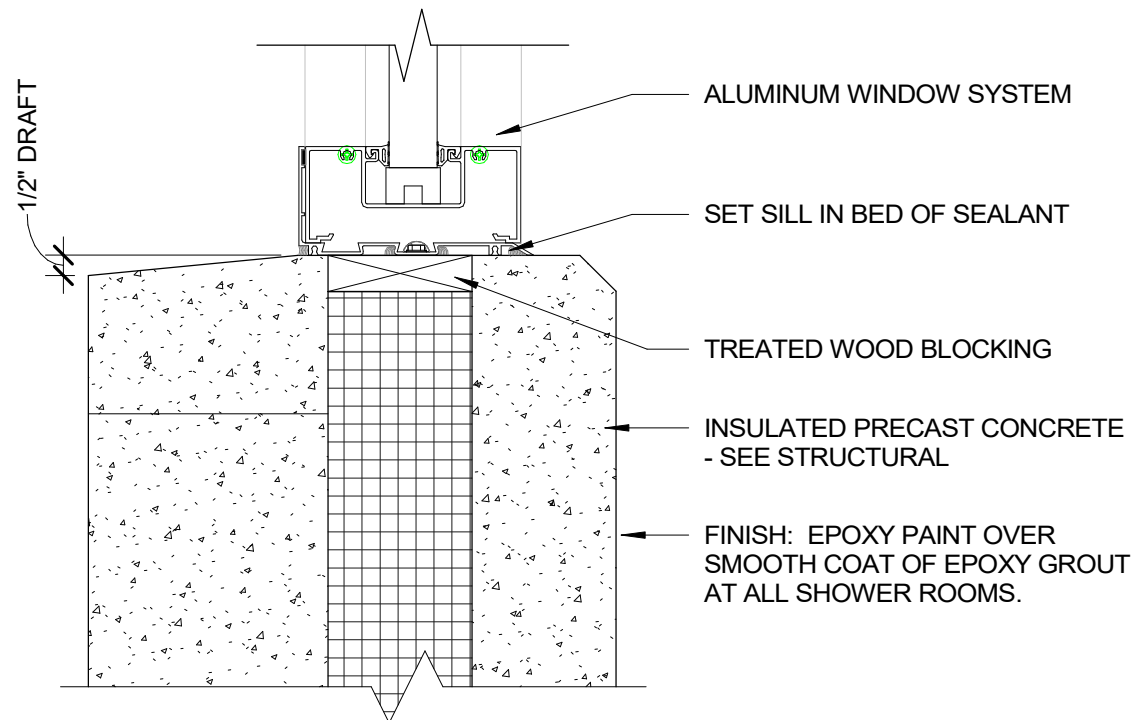

2 WINDOW SILL DETAIL - PRECAST
3" = 1'-0"


ROOM FINISH SCHEDULE										
ROOM NUMBER	ROOM NAME	FLR	BASE	WALLS				CEILINGS		REMARKS
				NORTH	EAST	SOUTH	WEST	MTL	HEIGHT	
2.001	STORAGE	DNSFR	-	PNT	PNT	PNT	PNT	PLY PNT	9'-8"	
2.002	OFFICE / STORAGE	DNSFR	-	PNT	PNT	PNT	PNT	ACT	9'-8"	
2.003	ELECTRICAL/ COMMS.	DNSFR	-	PNT	PNT	PNT	PNT	PLY PNT	9'-8"	
2.004	MECHANICAL	SLD CONC	-	PNT	PNT	PNT	PNT	GWB PNT	VARIES	
2.005	MECHANICAL	DNSFR	-	PNT	PNT	PNT	PNT	GWB PNT	VARIES	
2.006	SHOWER	QTZ FLR	QTZ	EPXY PNT	EPXY PNT	EPXY PNT	EPXY PNT	PREFIN ALUM	VARIES	
2.007	SHOWER	QTZ FLR	QTZ	EPXY PNT	EPXY PNT	EPXY PNT	EPXY PNT	PREFIN ALUM	VARIES	
2.008	SHOWER	QTZ FLR	QTZ	EPXY PNT	EPXY PNT	EPXY PNT	EPXY PNT	PREFIN ALUM	VARIES	
2.009	SHOWER	QTZ FLR	QTZ	EPXY PNT	EPXY PNT	EPXY PNT	EPXY PNT	PREFIN ALUM	VARIES	
2.010	SHOWER	QTZ FLR	QTZ	EPXY PNT	EPXY PNT	EPXY PNT	EPXY PNT	PREFIN ALUM	VARIES	
2.011	SHOWER	QTZ FLR	QTZ	EPXY PNT	EPXY PNT	EPXY PNT	EPXY PNT	PREFIN ALUM	VARIES	
2.012	SHOWER	QTZ FLR	QTZ	EPXY PNT	EPXY PNT	EPXY PNT	EPXY PNT	PREFIN ALUM	VARIES	
2.013	SHOWER	QTZ FLR	QTZ	EPXY PNT	EPXY PNT	EPXY PNT	EPXY PNT	PREFIN ALUM	VARIES	
2.014	SHOWER	QTZ FLR	QTZ	EPXY PNT	EPXY PNT	EPXY PNT	EPXY PNT	PREFIN ALUM	VARIES	
2.015	SHOWER	QTZ FLR	QTZ	EPXY PNT	EPXY PNT	EPXY PNT	EPXY PNT	PREFIN ALUM	VARIES	
2.016	SHOWER	QTZ FLR	QTZ	EPXY PNT	EPXY PNT	EPXY PNT	EPXY PNT	PREFIN ALUM	VARIES	
2.017	SHOWER	QTZ FLR	QTZ	EPXY PNT	EPXY PNT	EPXY PNT	EPXY PNT	PREFIN ALUM	VARIES	
2.018	WOOD SHED	DNSFR	-	-	-	-	-	EXPOSED	-	

DOOR AND FRAME SCHEDULE										
DOOR NUMBER	SWING TYPE	DOOR			FRAME				HWDR	REMARKS
		WD	HT	TK	LEAF TYPE	LEAF MTRL	MTRL-TYPE	GLAZ		
2.001A	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-001	-	-	HW-4
2.001B	OHS	12'-0"	8'-0"	1 3/4"	OHSP	-	OHS	-	-	HW-7
2.002A	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-001	-	-	HW-6
2.002B	S	3'-0"	7'-0"	1 3/4"	F	HM	HM-001	-	-	HW-5
2.003	S	3'-0"	7'-0"	1 3/4"	F	HM	HM-001	-	-	HW-5
2.004	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-001	-	-	HW-2
2.005	S	4'-0"	7'-0"	1 3/4"	F	FRP	AL-001	-	-	HW-2
2.006	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-101	IGU - 1	-	HW-1
2.007	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-101	IGU - 1	-	HW-1
2.008	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-101	IGU - 1	-	HW-1
2.009	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-101	IGU - 1	-	HW-1
2.010	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-101	IGU - 1	-	HW-1
2.011	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-101	IGU - 1	-	HW-1
2.012	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-101	IGU - 1	-	HW-1
2.013	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-101	IGU - 1	-	HW-1
2.014	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-101	IGU - 1	-	HW-1
2.015	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-101	IGU - 1	-	HW-1
2.016	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-101	IGU - 1	-	HW-1
2.017	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-101	IGU - 1	-	HW-1
2.018A	S	3'-0"	7'-0"	1 3/4"	F	FRP	AL-001	-	-	HW-4
2.018B	OHS	12'-0"	8'-0"	1 3/4"	OHSP	-	OHS	-	-	HW-7

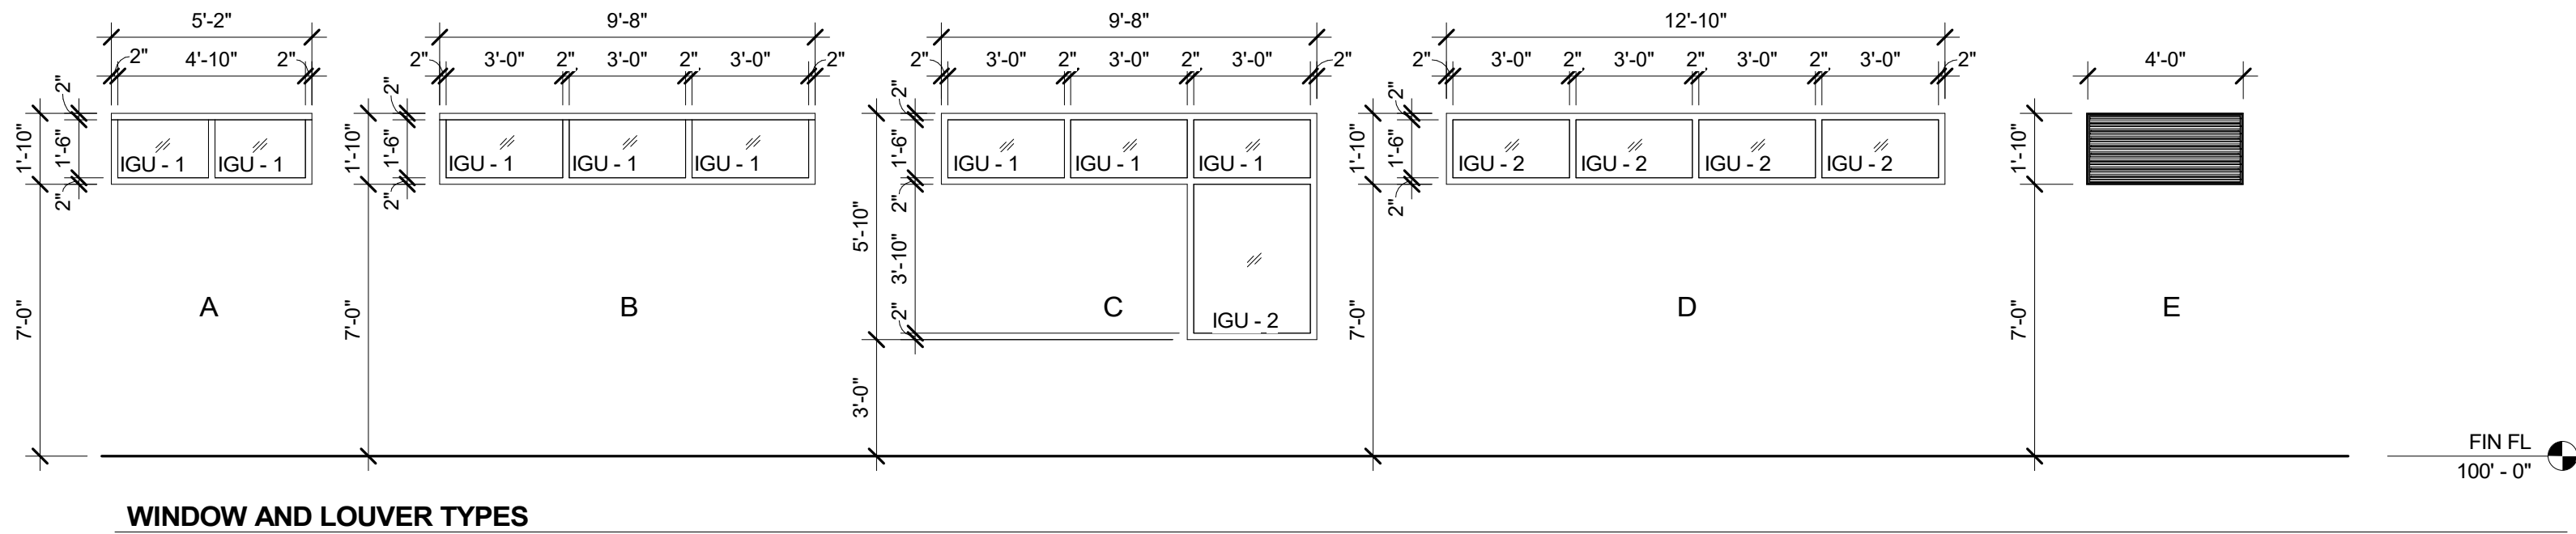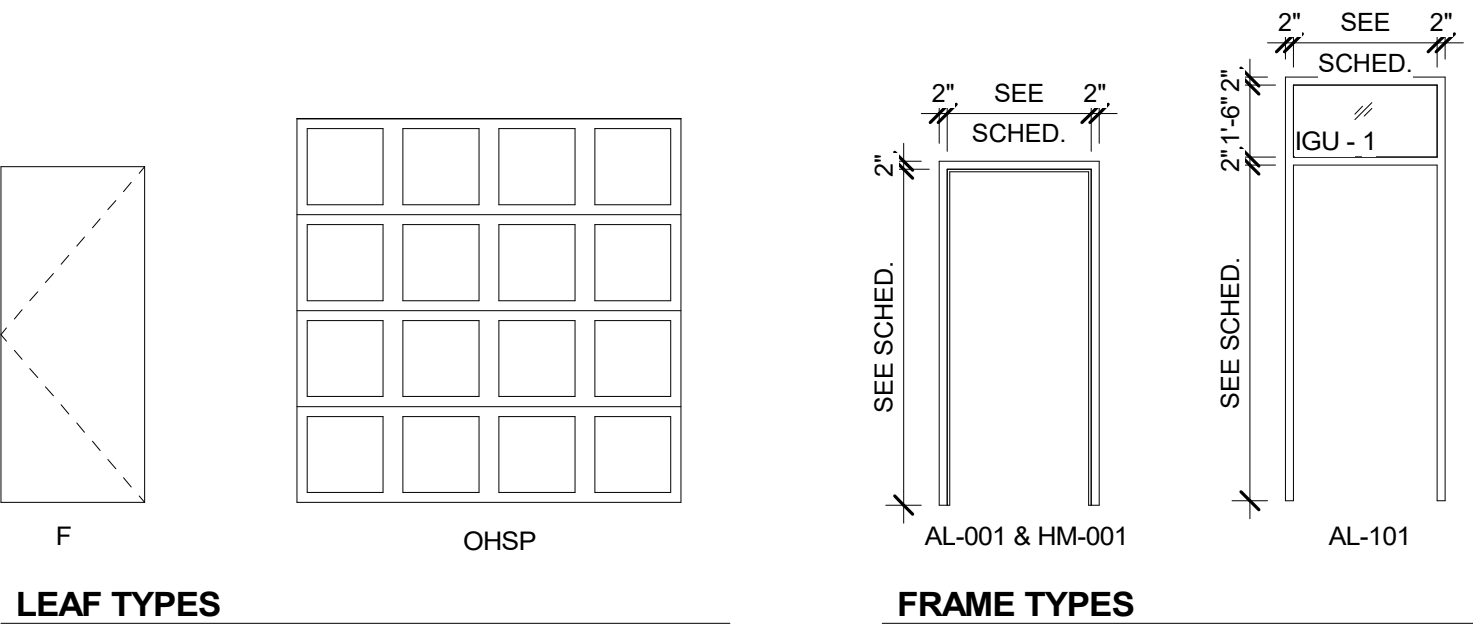


ABBREVIATIONS	
ACT	ACOUSTICAL CEILING TILE
AL	ALUMINUM
EPXY PNT	EPOXY PAINT
EXP INSUL	EXPOSED INSULATION
F	FLUSH
FRP	FIBERGLASS REINFORCED PANEL
HM	HOLLOW METAL
IGU - 1	INSULATING GLAZING UNIT WITH ACID ETCHED EXTERIOR PANE
IGU - 2	INSULATING GLAZING UNIT WITH CLEAR EXTERIOR PANE
OHS	OVERHEAD SECTIONAL DOOR TRACK
OHSP	OVERHEAD SECTIONAL PANEL DOOR
PREFIN	PREFINISHED
PREFIN ALUM	PREFINISHED ALUMINUM
PLY PNT	PLYWOOD, PAINT
PNT	PAINT
QTZ FLR	QUARTZ FLOORING
S	SINGLE
DNSFR	CONCRETE WITH DENSIFIER


NOTE:
SHOWER ROOM WALLS ARE TO RECEIVE SMOOTH COAT OF EPOXY GROUT PRIOR TO APPLYING EPOXY PAINT.

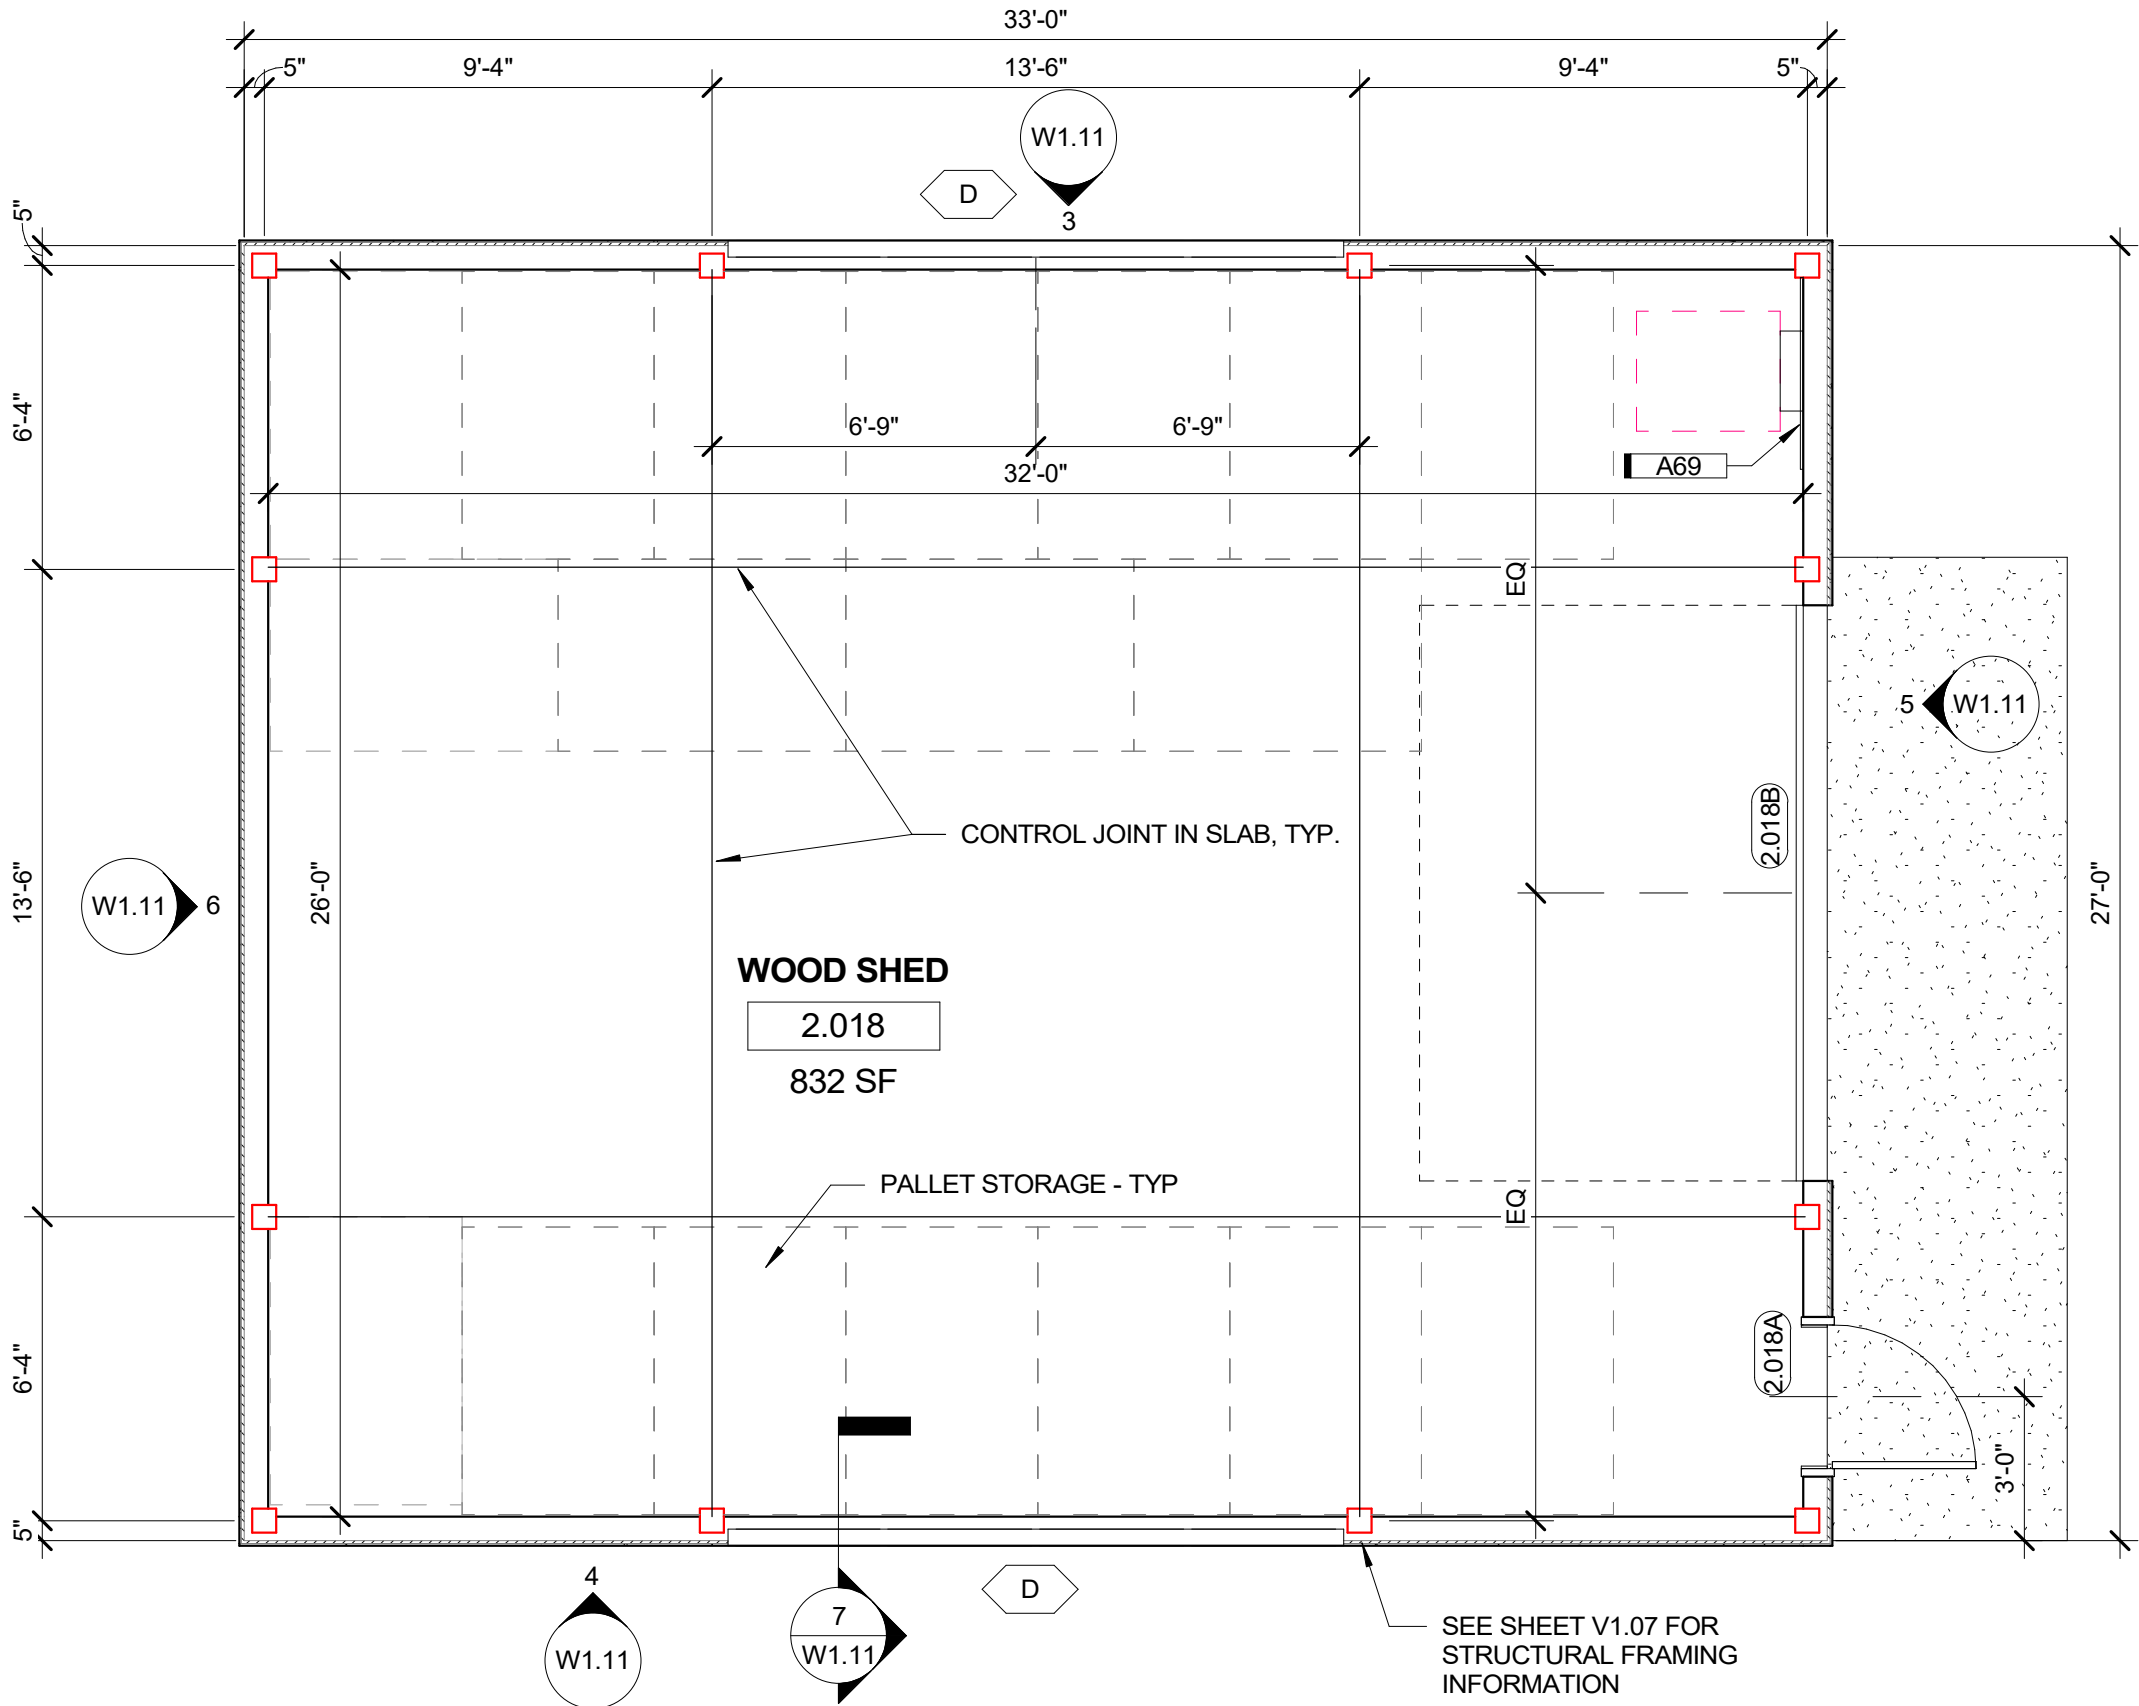


1 WOOD SHED FLOOR PLAN
1/4" = 1'-0"

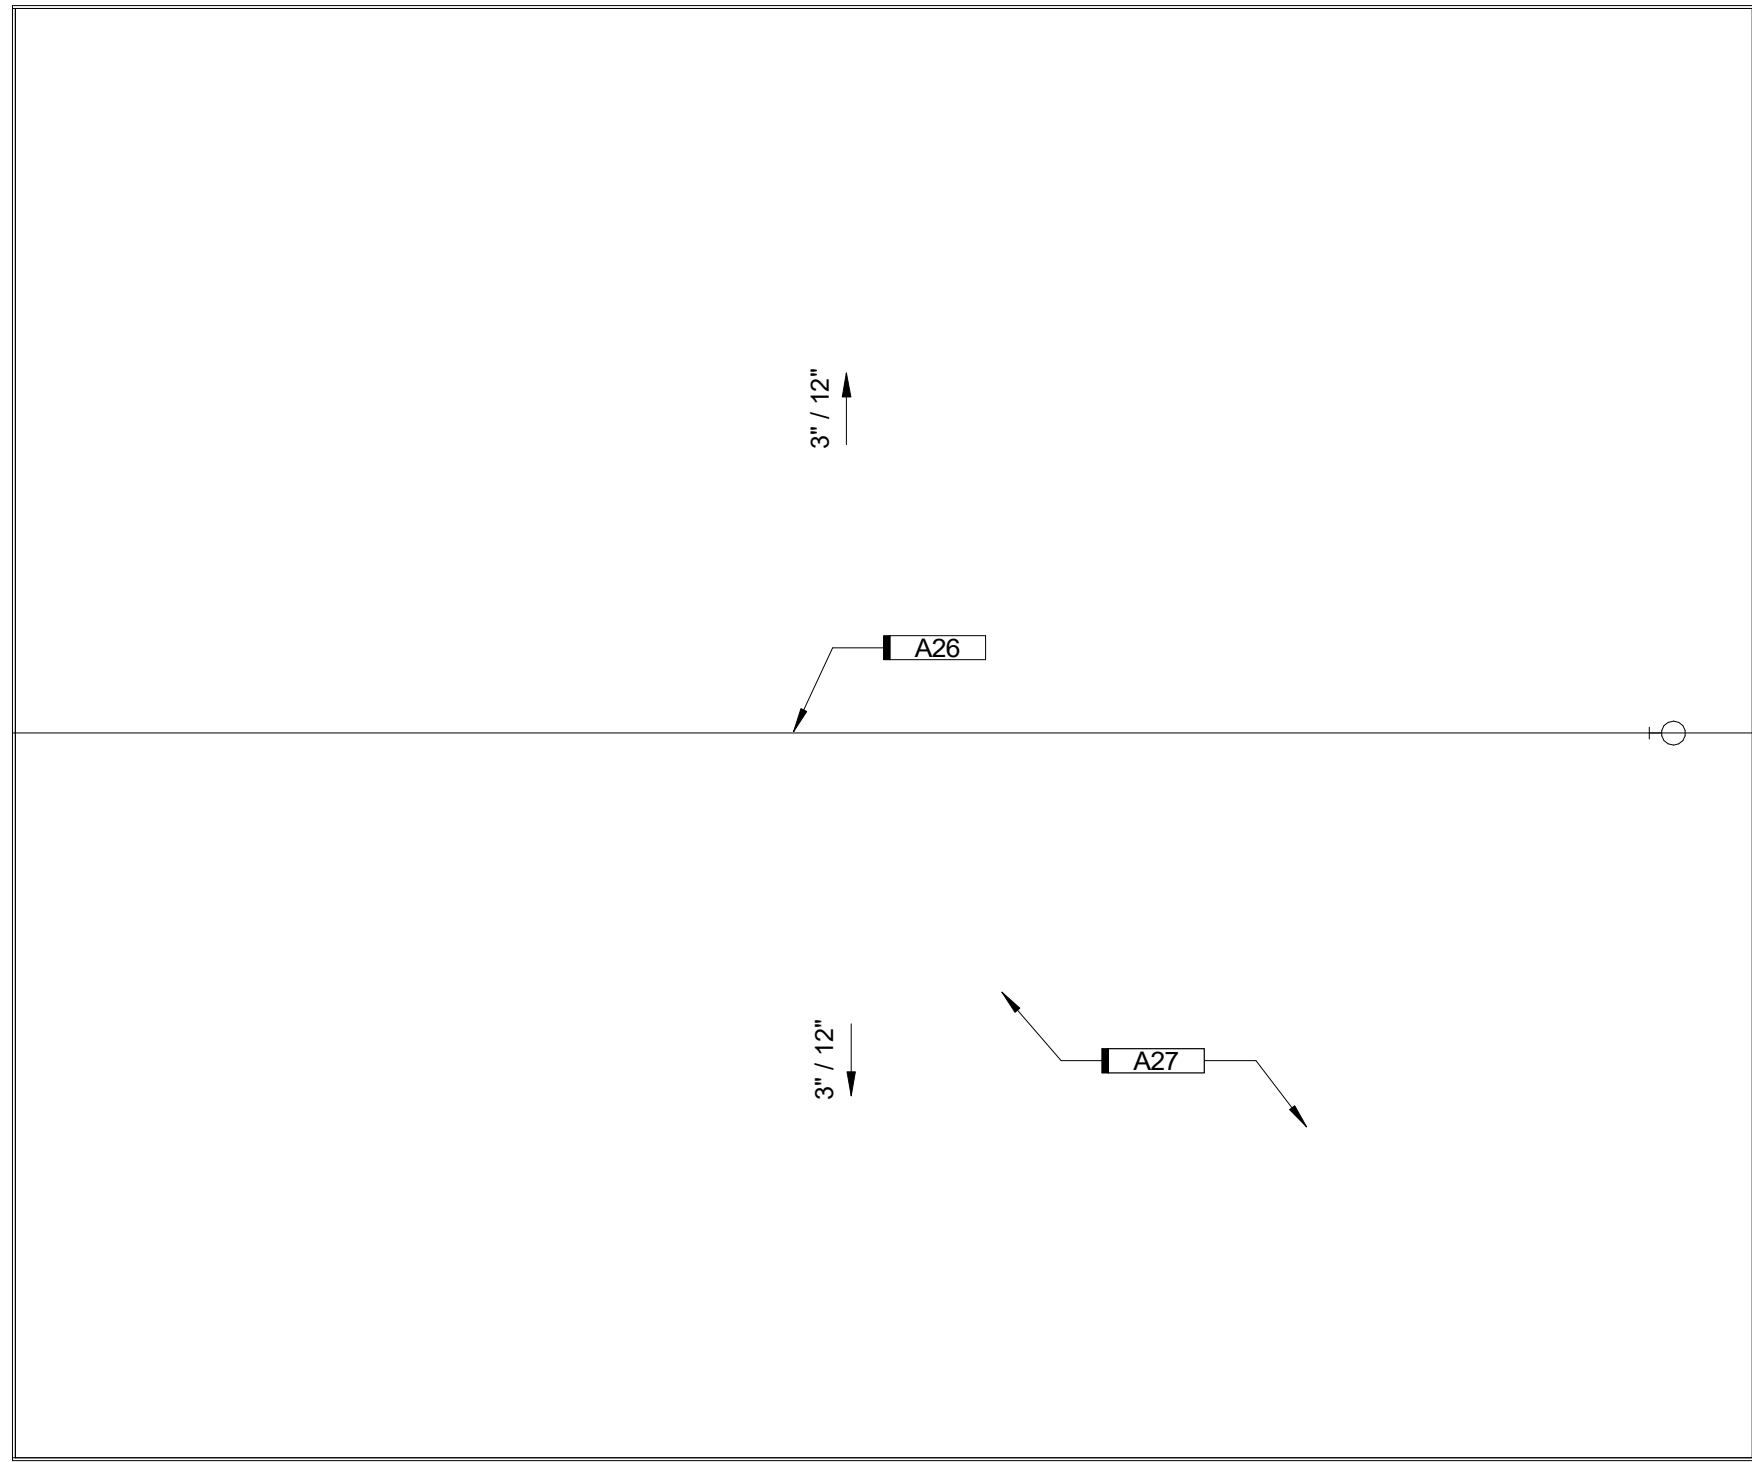


2 ROOF PLAN
1/4" = 1'-0"

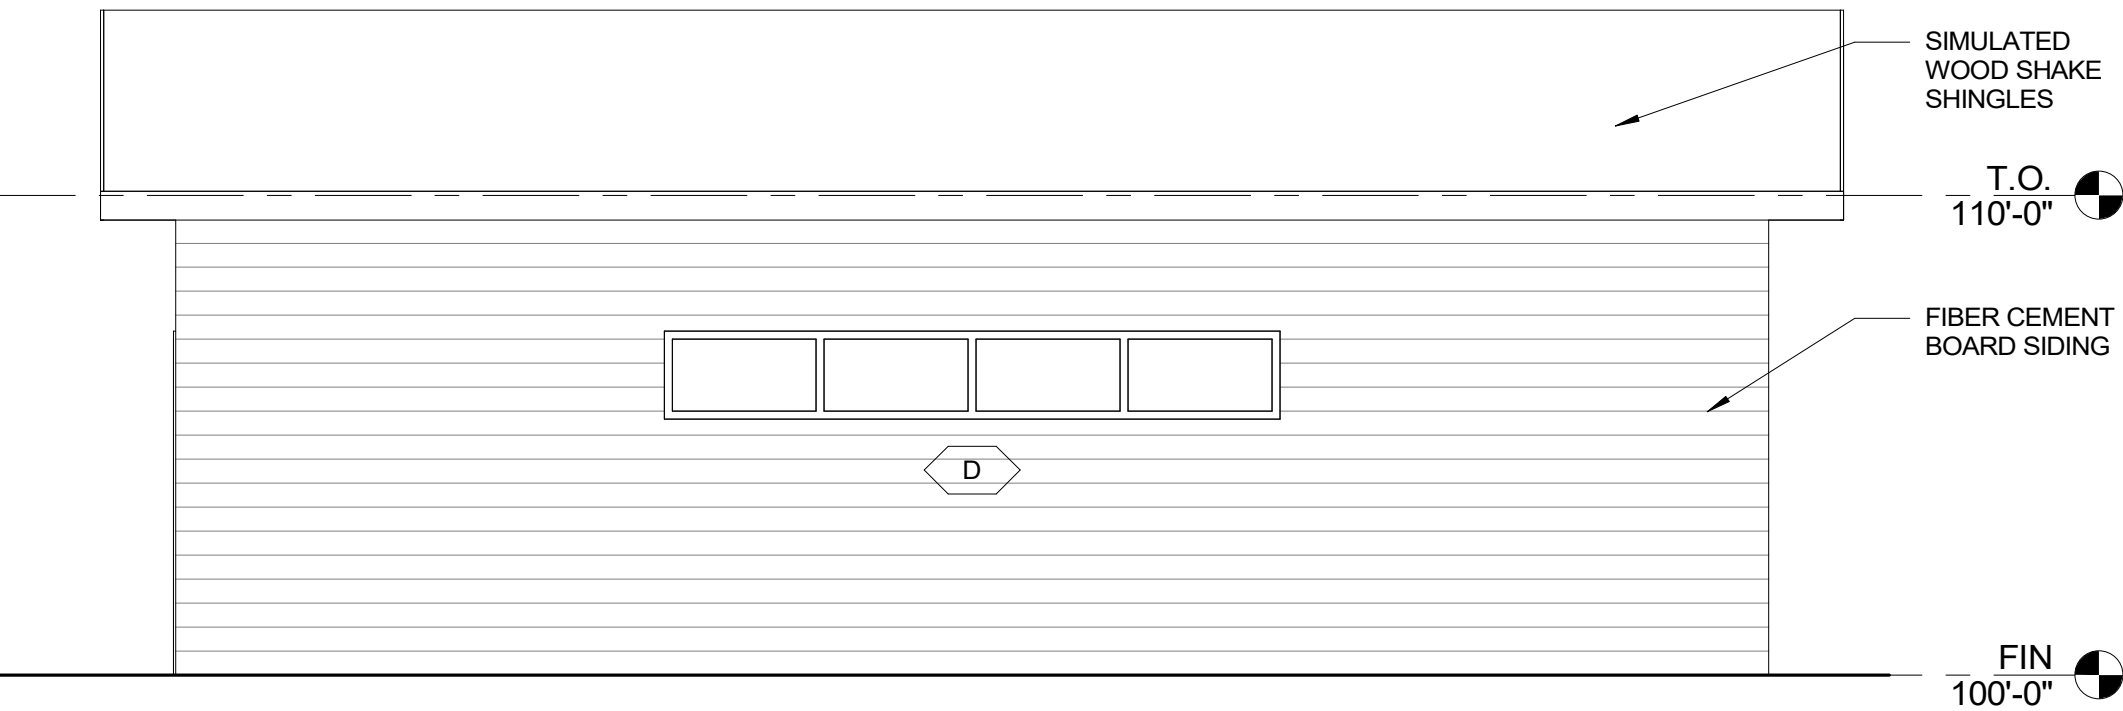


3 NORTH ELEVATION
1/4" = 1'-0"

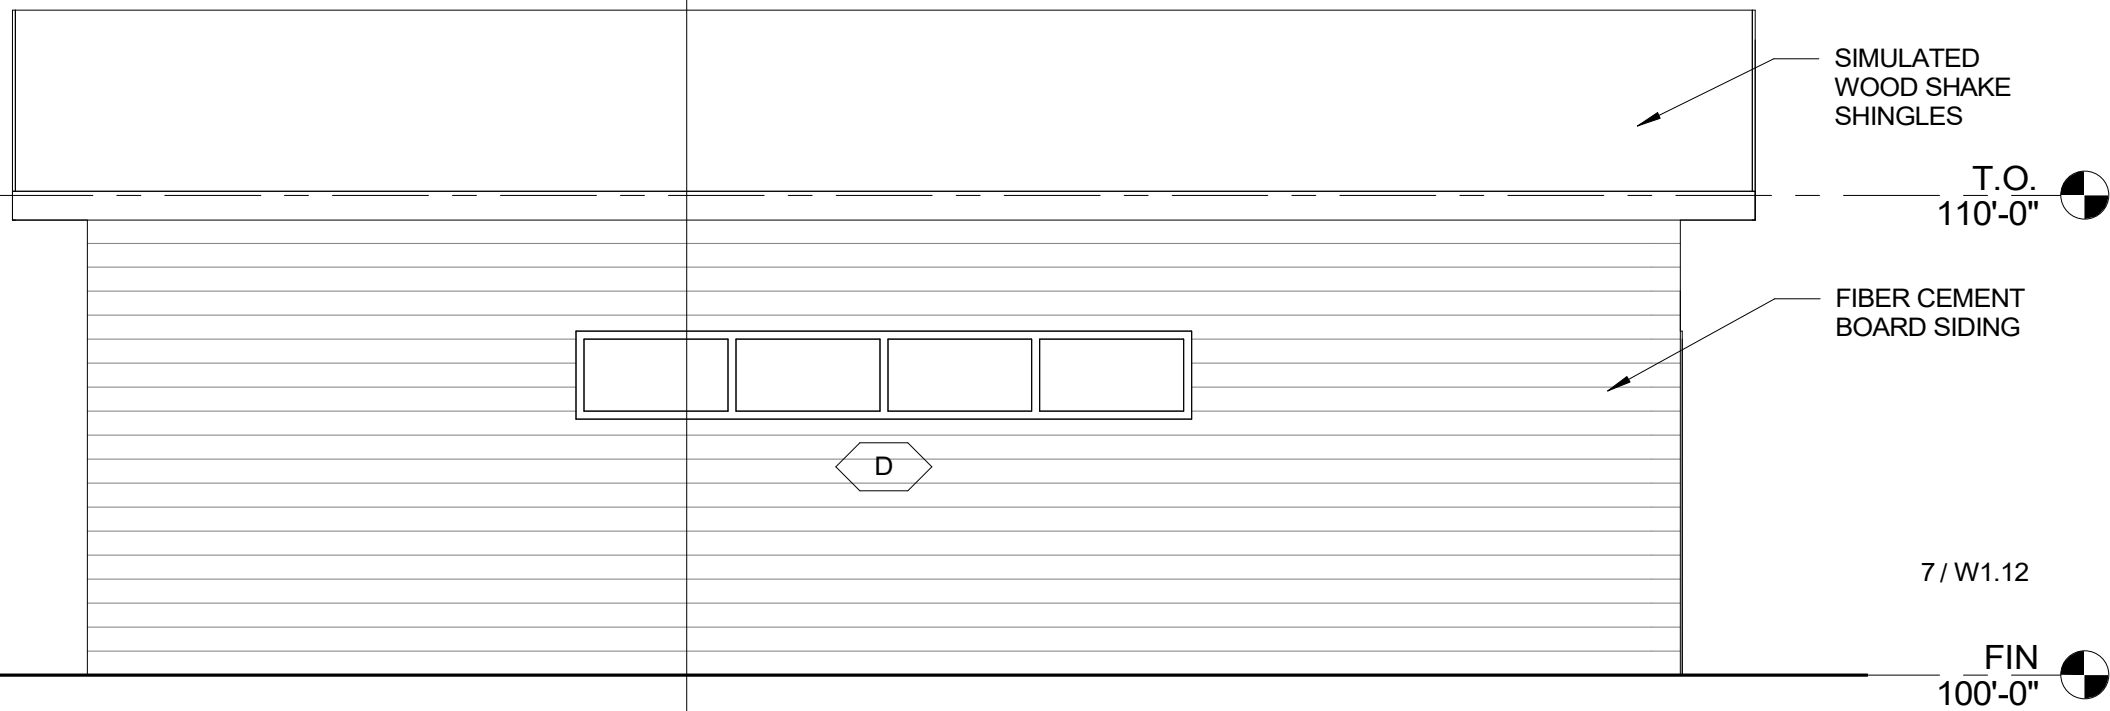


4 SOUTH ELEVATION
1/4" = 1'-0"

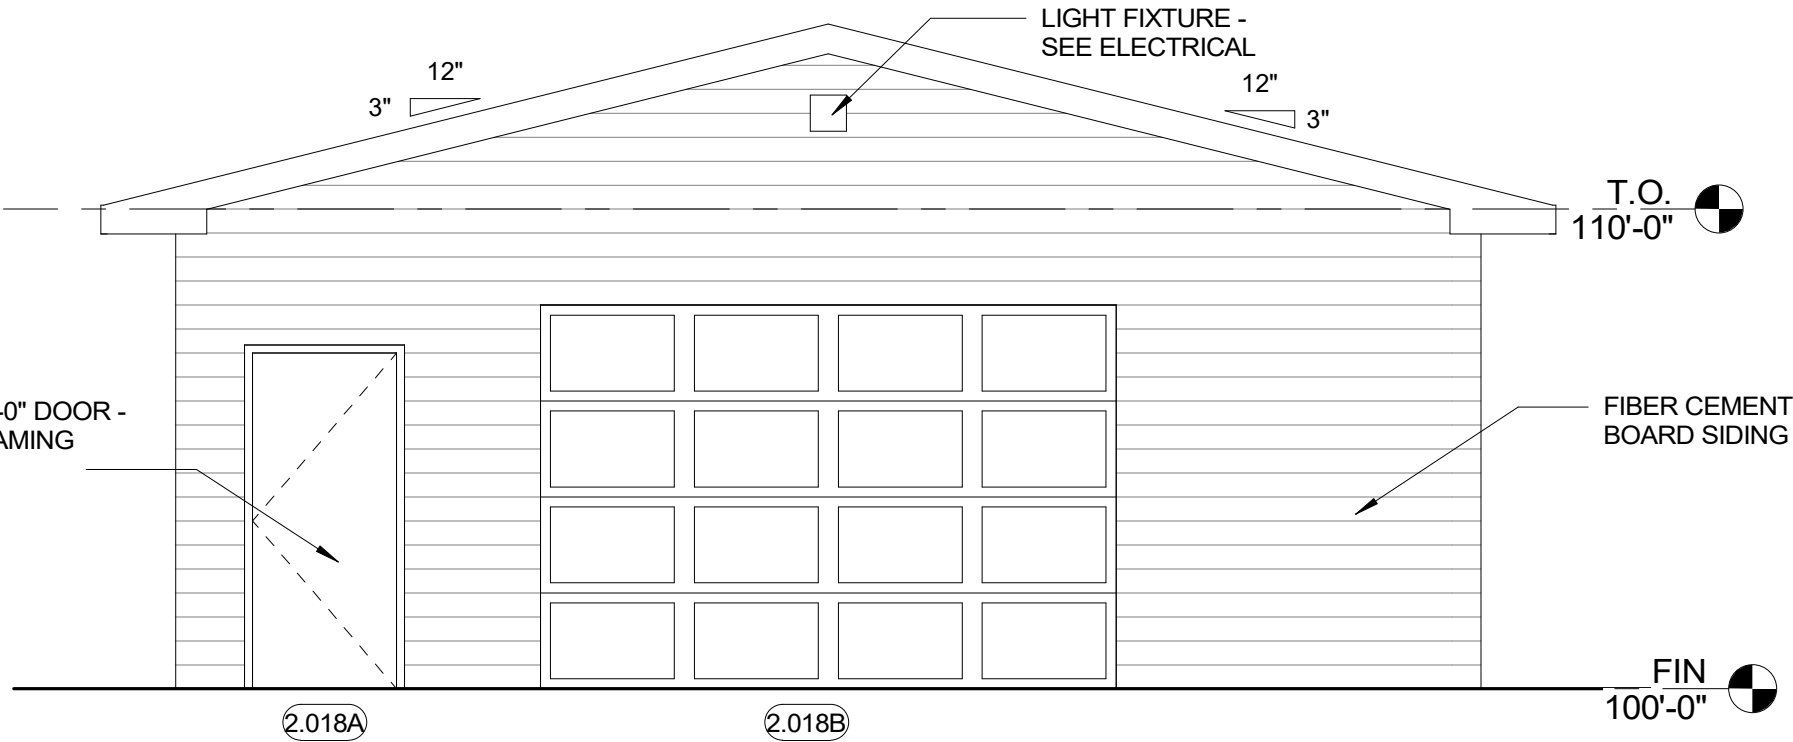

5 EAST ELEVATION
1/4" = 1'-0"

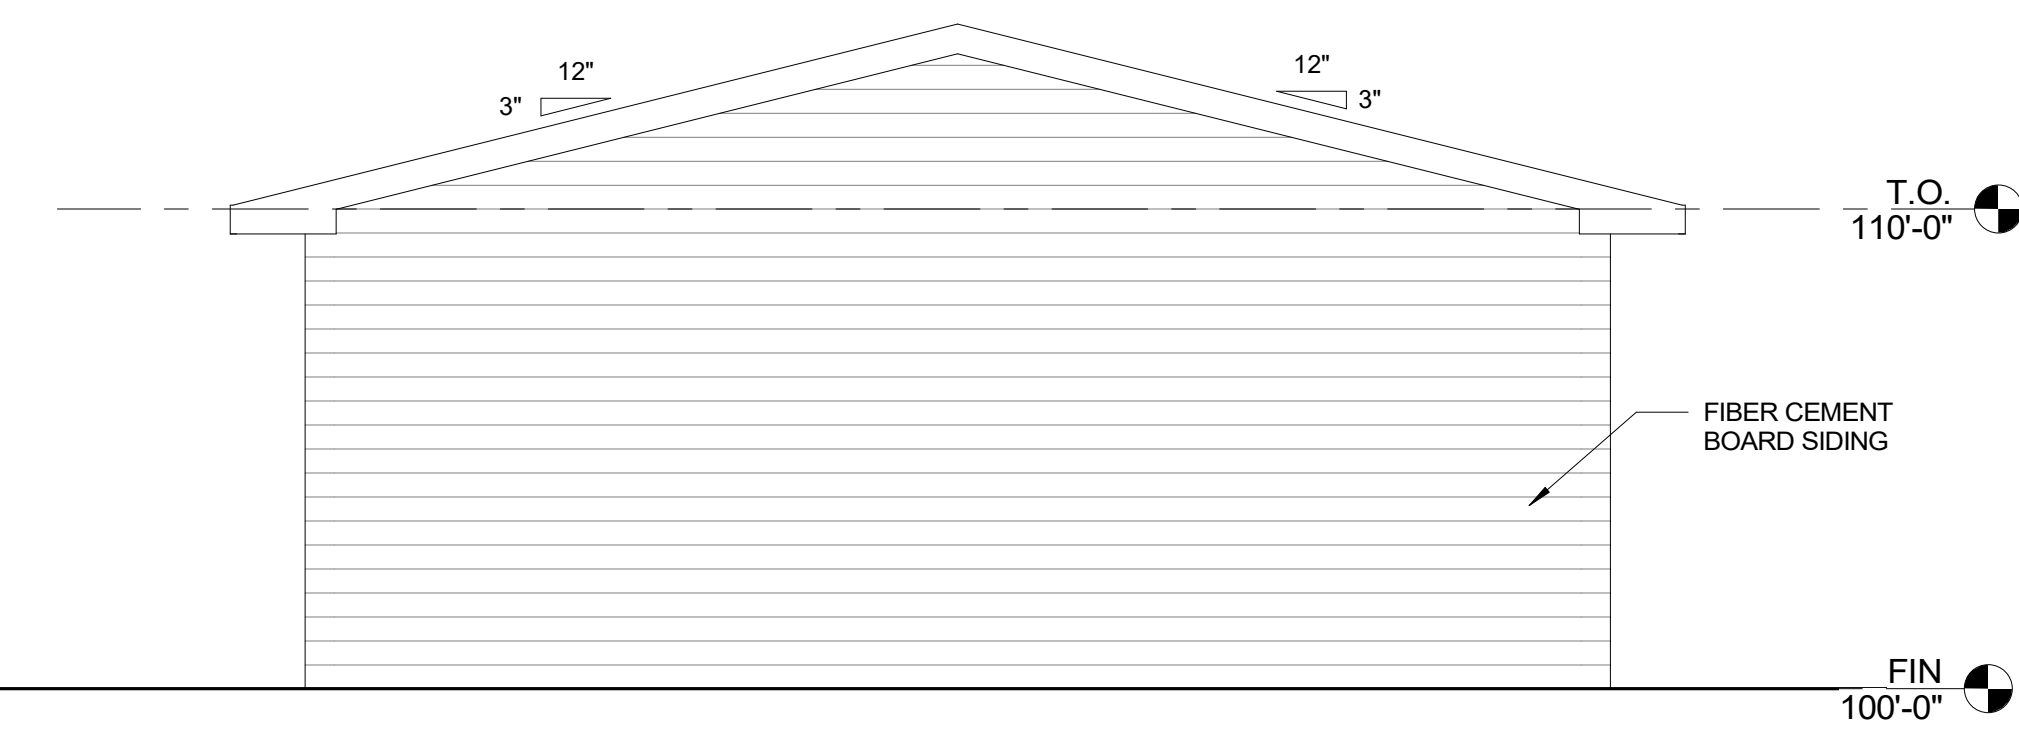

6 WEST ELEVATION
1/4" = 1'-0"

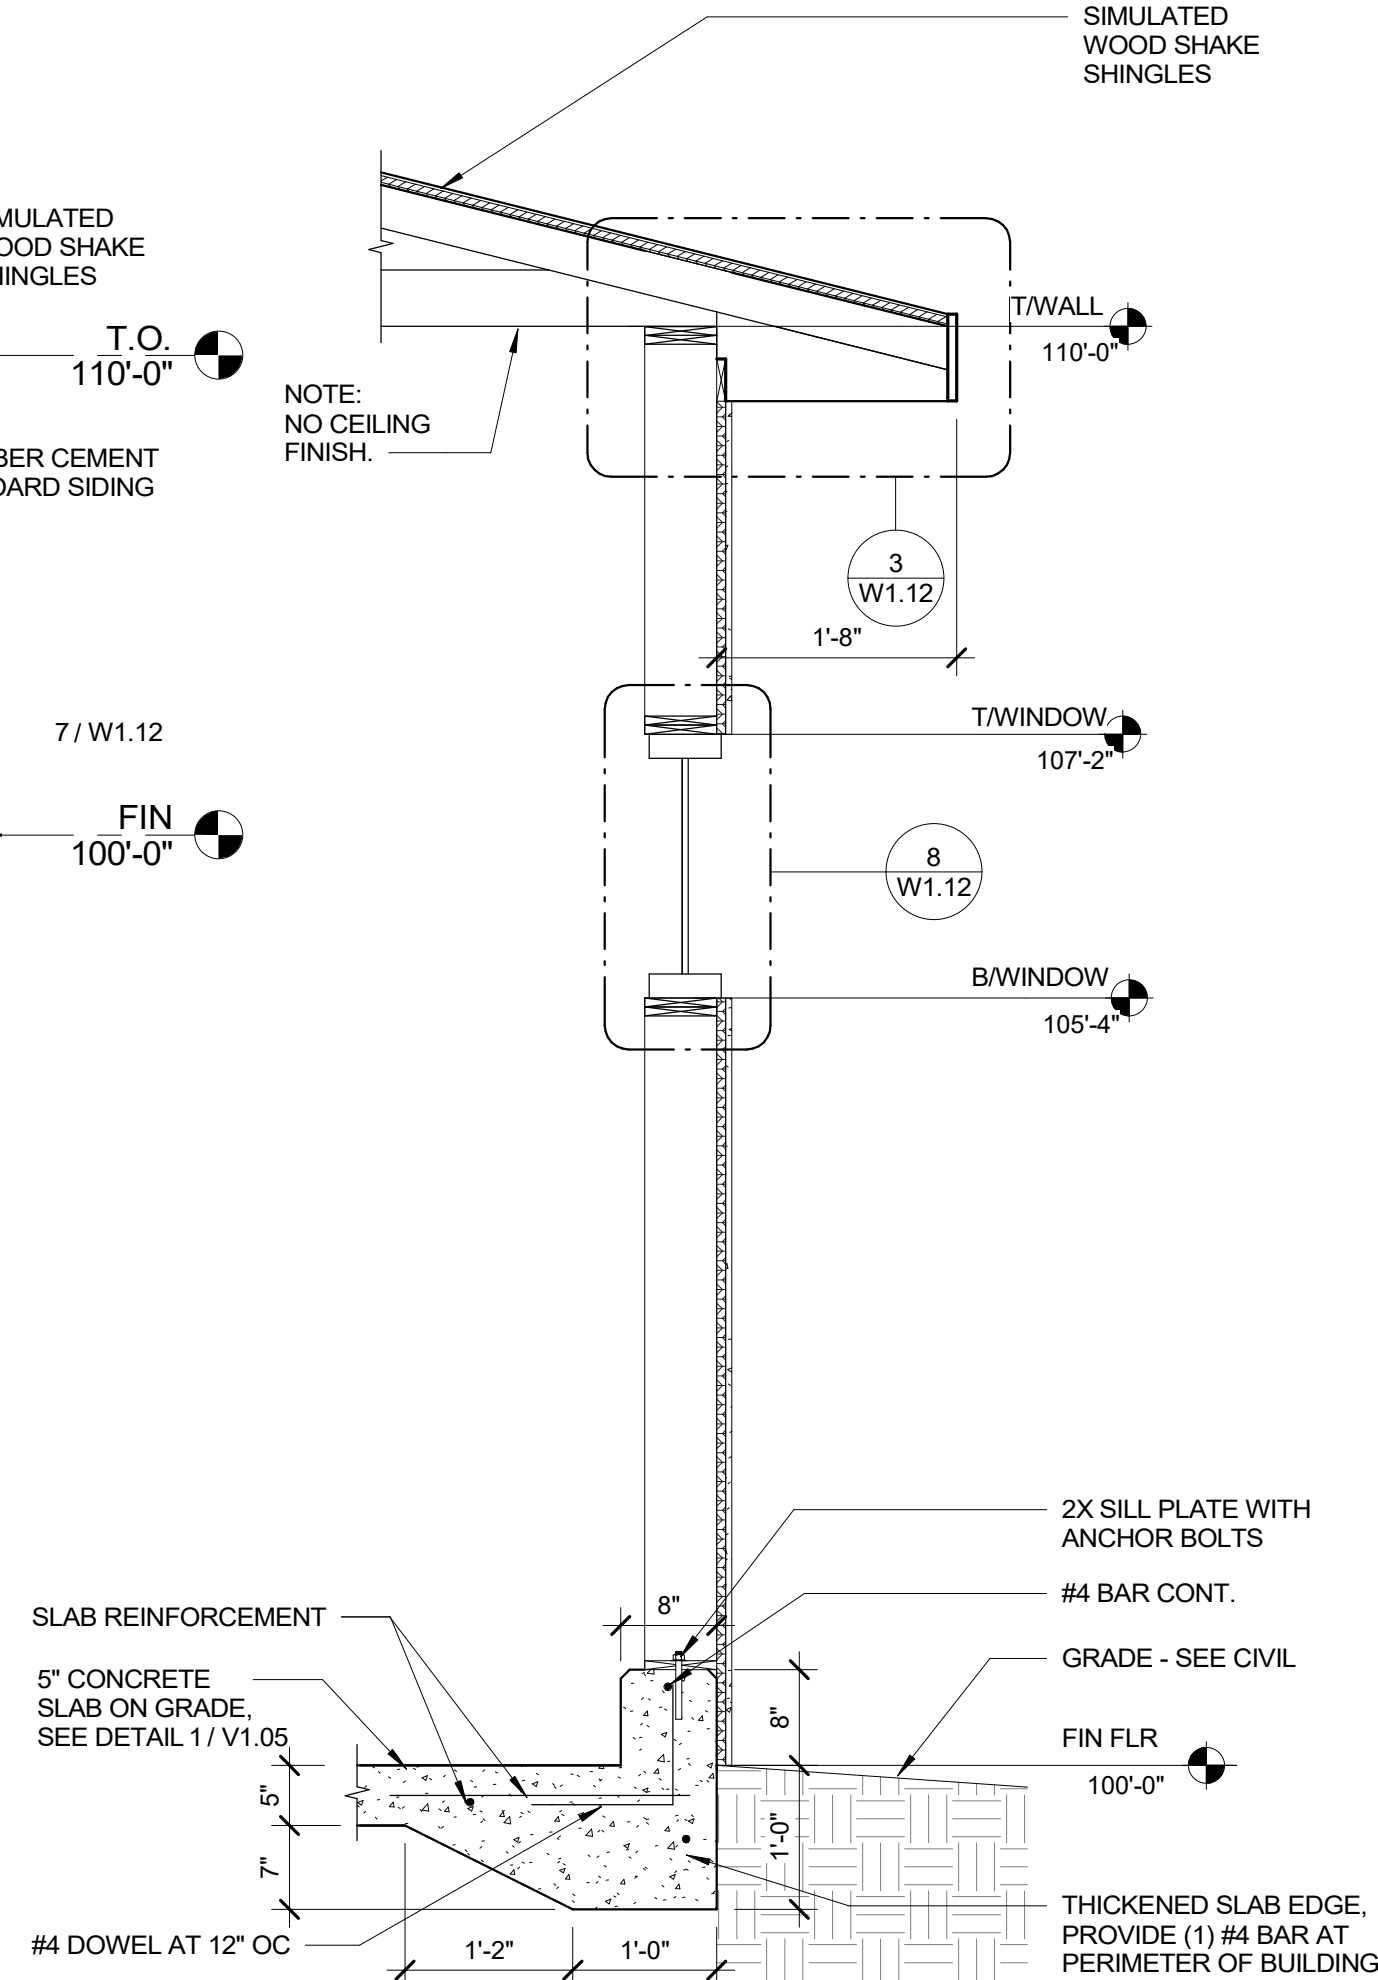

7 WALL SECTION
3/4" = 1'-0"

GENERAL CONSTRUCTION NOTES- WOOD SHED


- COORDINATE WORK WITH ALL OTHER TRADES TO ENSURE PROPER SEQUENCING AND INSTALLATION. THIS SHALL INCLUDE ANY VENDORS CONTRACTED DIRECTLY BY OWNER.
- ALL WORK SHALL BE PERFORMED AND COMPLETED IN COMPLIANCE WITH ALL APPLICABLE BUILDING CODES AND ORDINANCES.
- ANY AND ALL DISCREPANCIES AND DEFICIENCIES SHALL IMMEDIATELY BE BROUGHT TO THE ATTENTION OF THE ARCHITECT.
- COORDINATE WORK SCHEDULES WITH THE OWNER TO ESTABLISH CONSTRUCTION SEQUENCING.
- CONTRACTORS AND MATERIAL SUPPLIERS SHALL VERIFY ALL DIMENSIONS AND CONDITIONS WHICH WILL AFFECT THEIR WORK.
- REMOVE FROM THE SITE ALL DEBRIS AND MATERIALS RESULTING FROM CONSTRUCTION ON A REGULAR BASIS UNLESS NOTED OTHERWISE.
- CONTRACTOR SHALL BE RESPONSIBLE FOR HOOK-UP OF ANY TEMPORARY HEAT OR LIGHTING REQUIRED IN WORK AREAS.
- MAINTAIN ONE SET OF DRAWINGS ON SITE FOR THE PURPOSE OF RECORDING CONSTRUCTION REVISIONS. THIS RECORD SET SHALL BE RETURNED TO THE ARCHITECT UPON CONTRACT CLOSEOUT.
- MAINTAIN ACCESS TO PARK AREAS IN USE OR AS DIRECTED BY OWNER.
- INSTALL TEMPORARY WEATHER AND SECURITY BARRIERS AT EXTERIOR WALL OPENINGS WHEN WORK IS NOT IN PROGRESS.
- INTERIOR ELEVATIONS AT ROOMS 2.010 THRU 2.013 ARE SIMILAR TO THOSE INDICATED ON SHEET 2A.03.
- SLOPE ARROWS ON THE REFLECTED CEILING PLAN POINT TOWARDS THE LOW CEILING SIDE OF THE ROOM.
- COORDINATE SIZE OF ROUGH OPENING WITH DOOR AND WINDOW REQUIREMENTS.
- ALL DIMENSIONS ARE NOMINAL. (EXCEPT ACCESSIBILITY DIAGRAMS ON THIS SHEET).

KEYNOTE LEGEND


A26	VENTED RIDGE CAP. SEE ROOFING DETAILS
A27	SIMULATED WOOD SHAKE ROOF SHINGLES
A69	3/4" PLYWOOD BACK PANEL TO MOUNT ELECTRICAL PANEL

ARCHITECTURAL LEGEND


KEYNOTE	
ROOM NAME	ROOM TAG
DOOR TAG	DOOR TAG
WINDOW TAG	WINDOW TAG

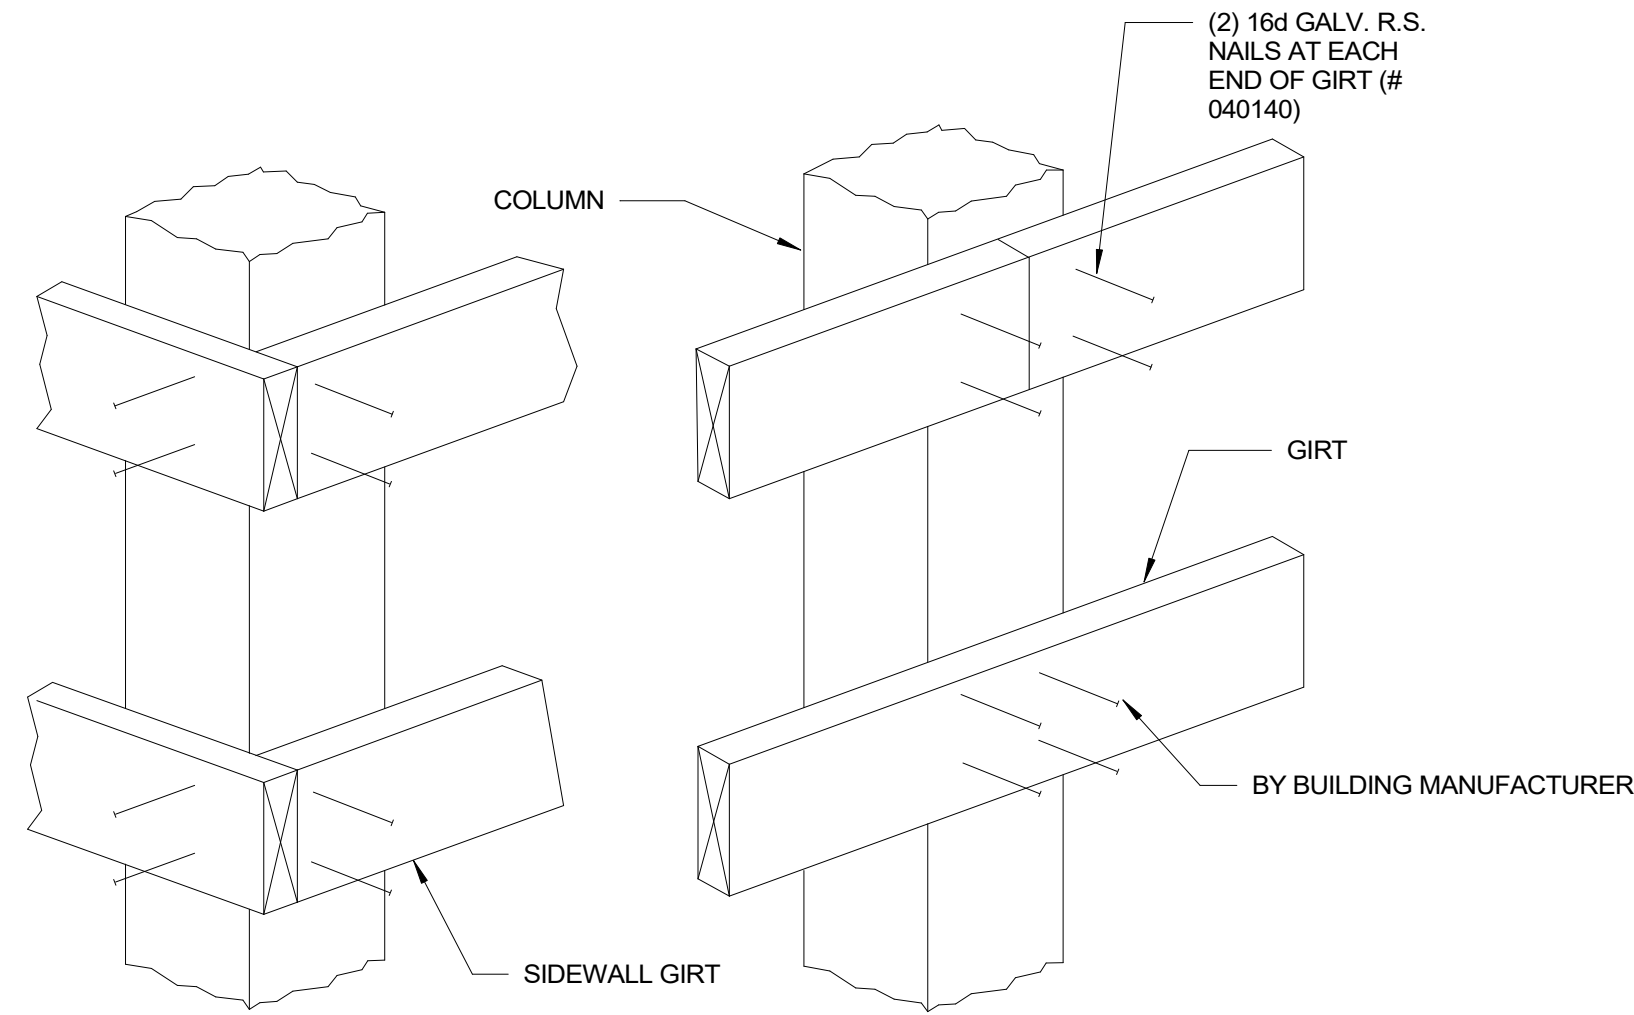


1 BYPASS GIRT DETAIL
1 1/2" = 1'-0"

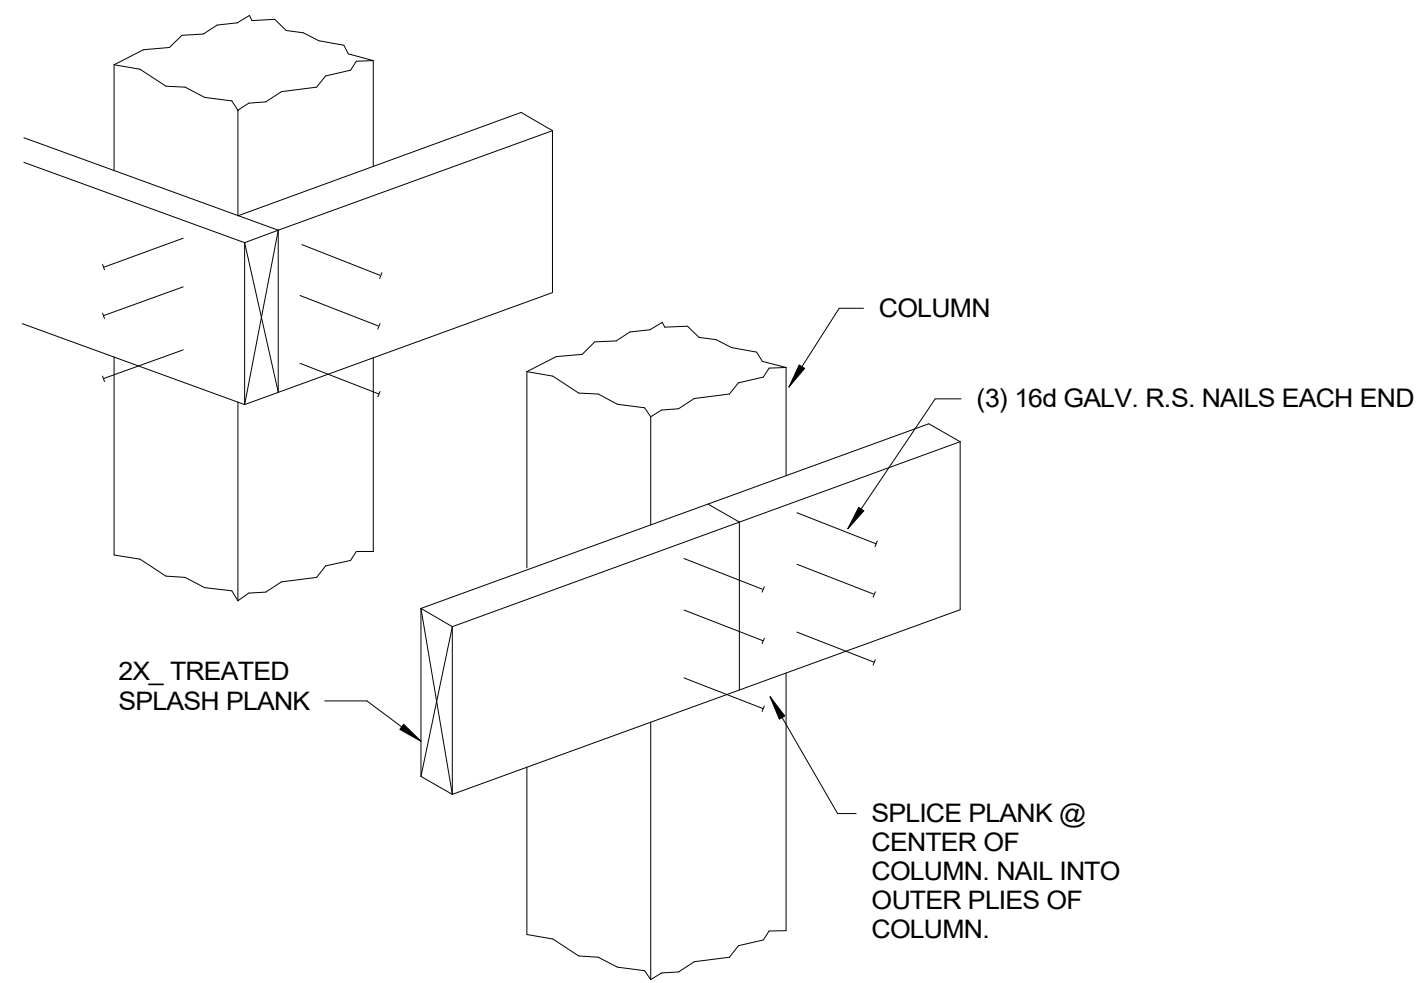


2 BYPASS SPLASH PLANK DETAIL
1 1/2" = 1'-0"

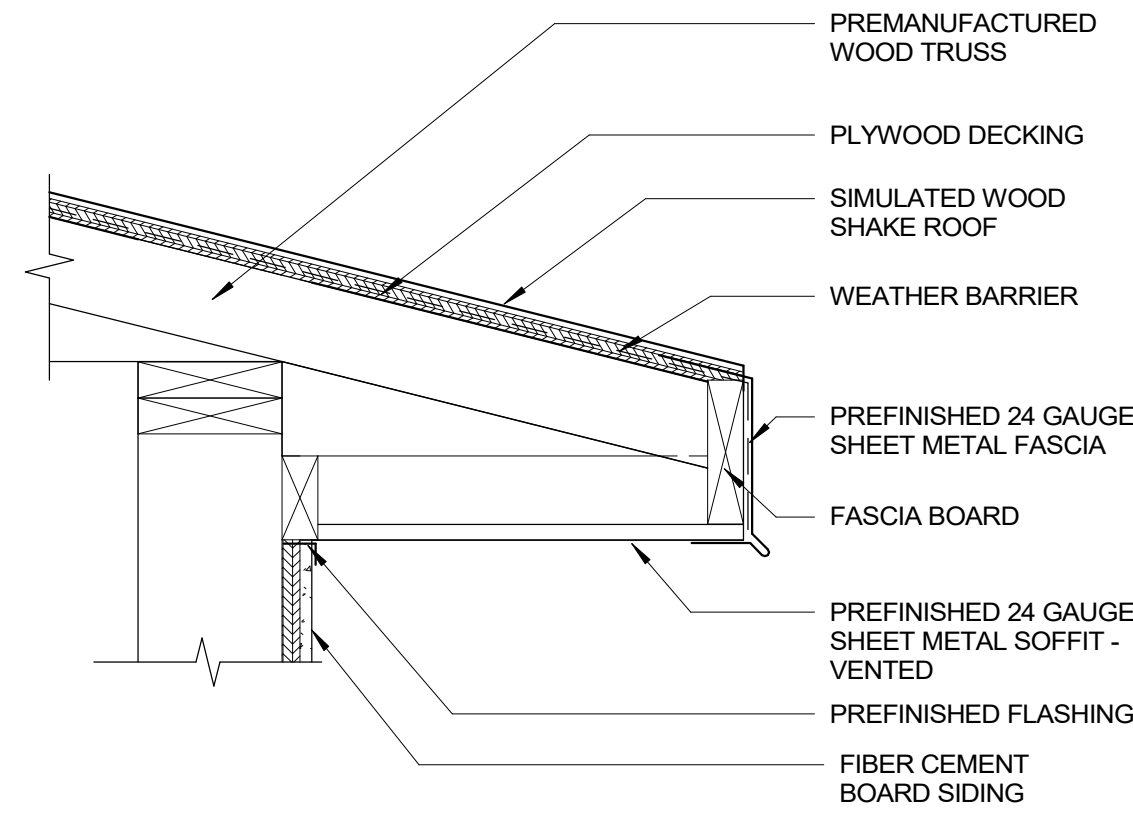


3 ROOF OVERHANG
1 1/2" = 1'-0"

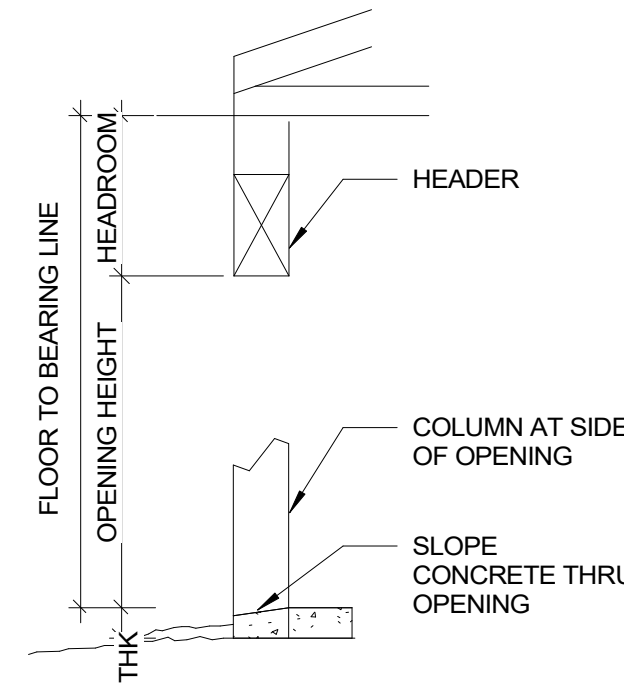



4 OVERHEAD DOOR
3/4" = 1'-0"

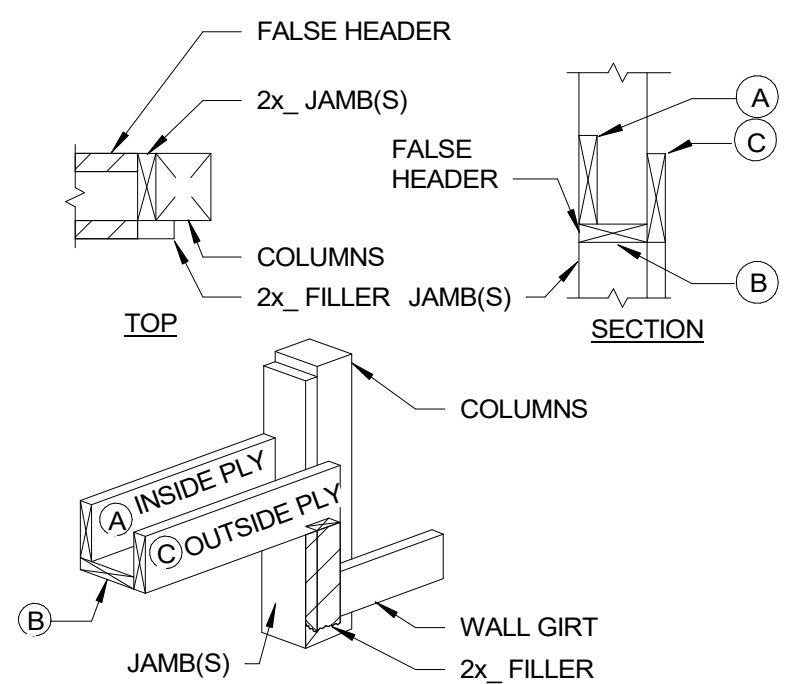


5 OVERHEAD DOOR FRAMING
3/4" = 1'-0"

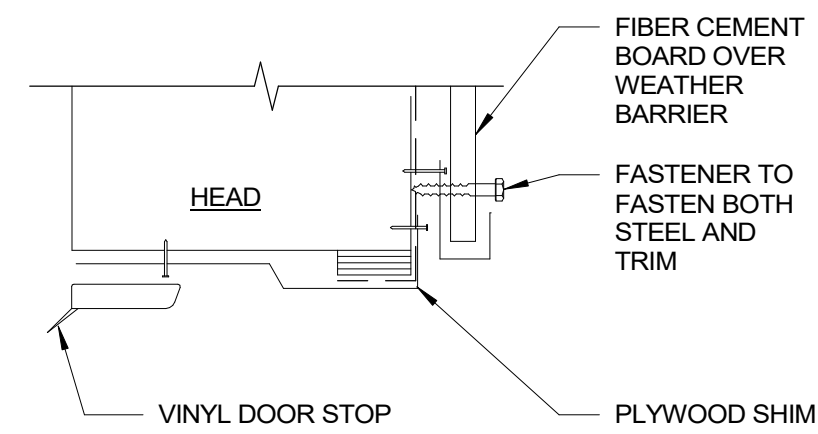


6 OVERHEAD DOOR FLASHING
1 1/2" = 1'-0"

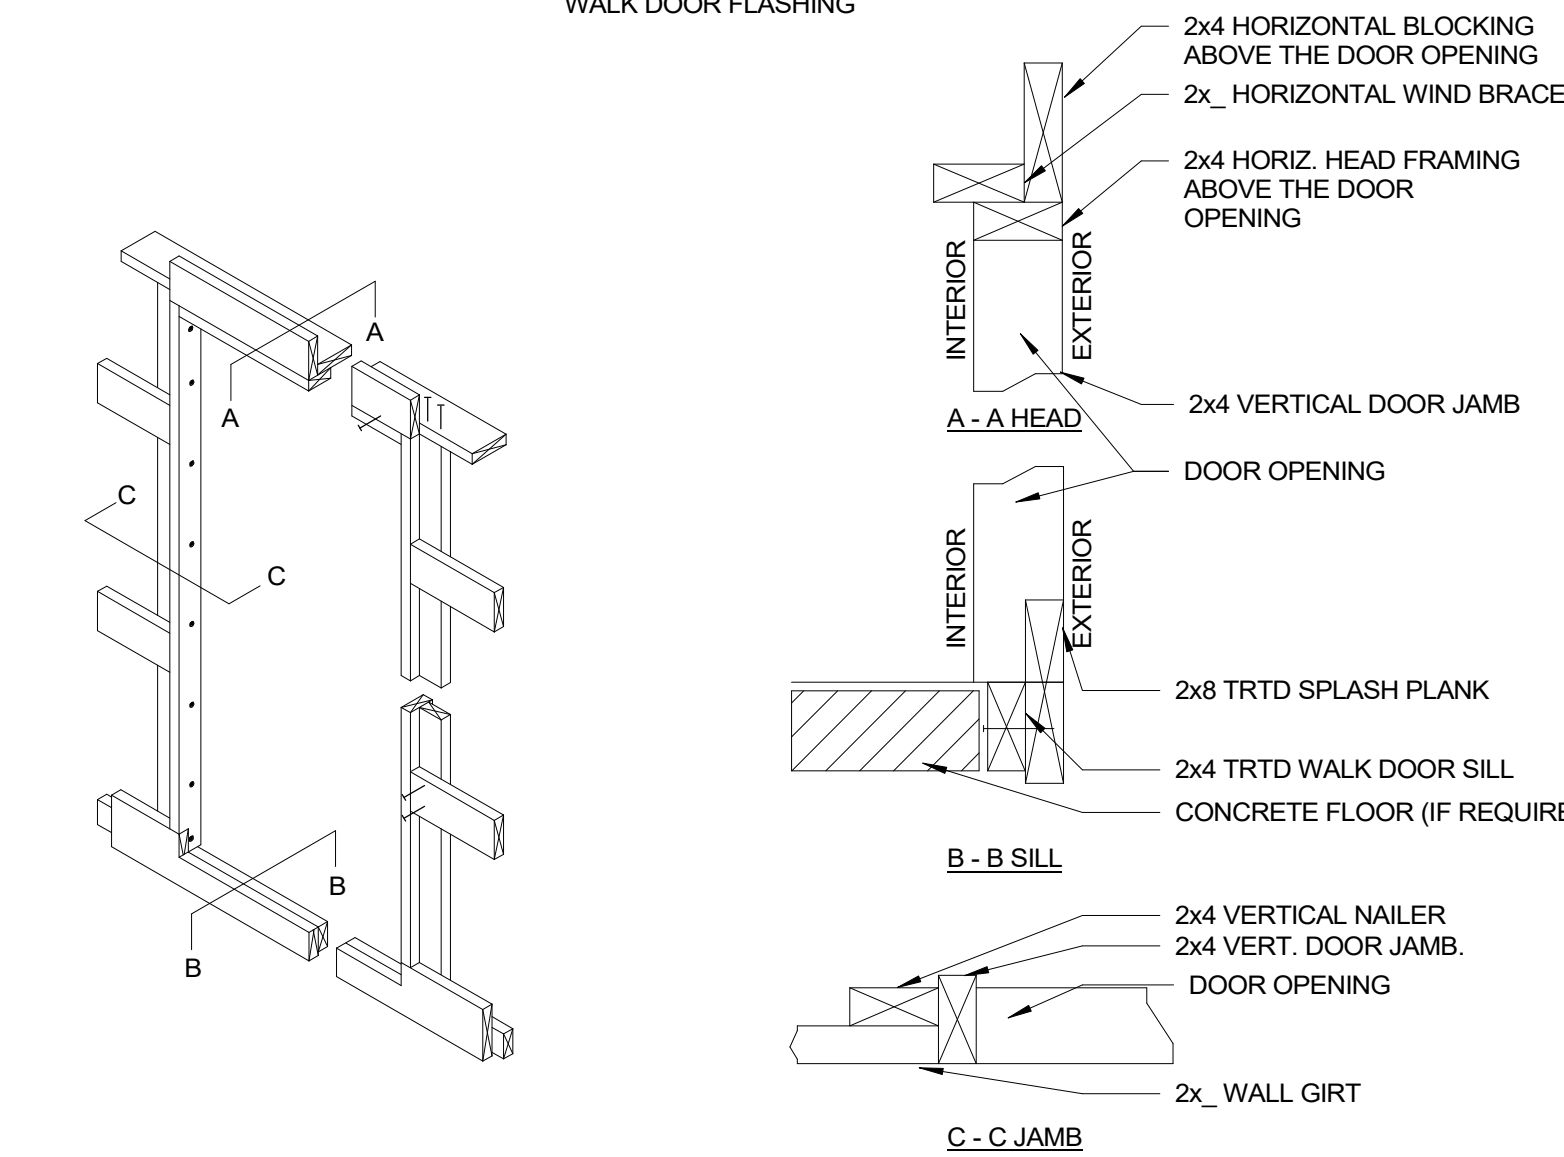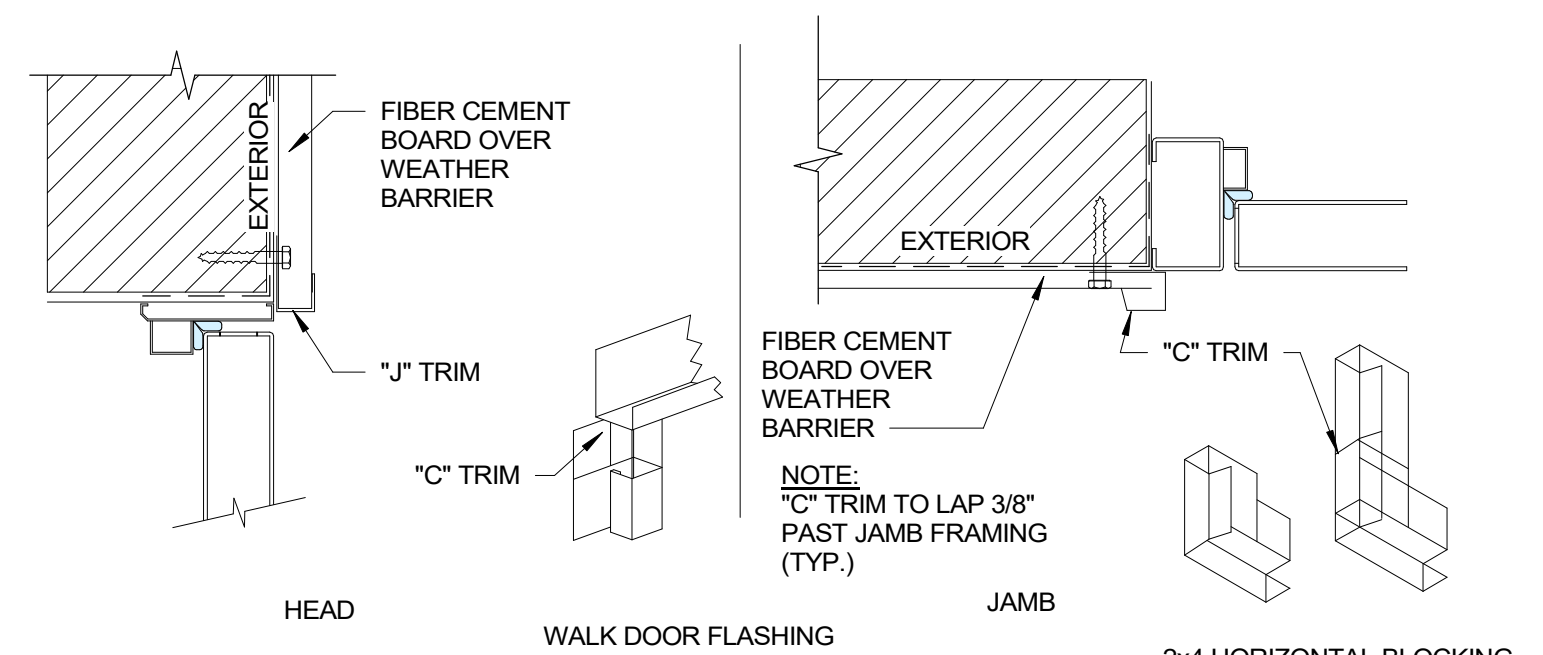


7 WALK DOOR FRAMING DETAIL
1 1/2" = 1'-0"

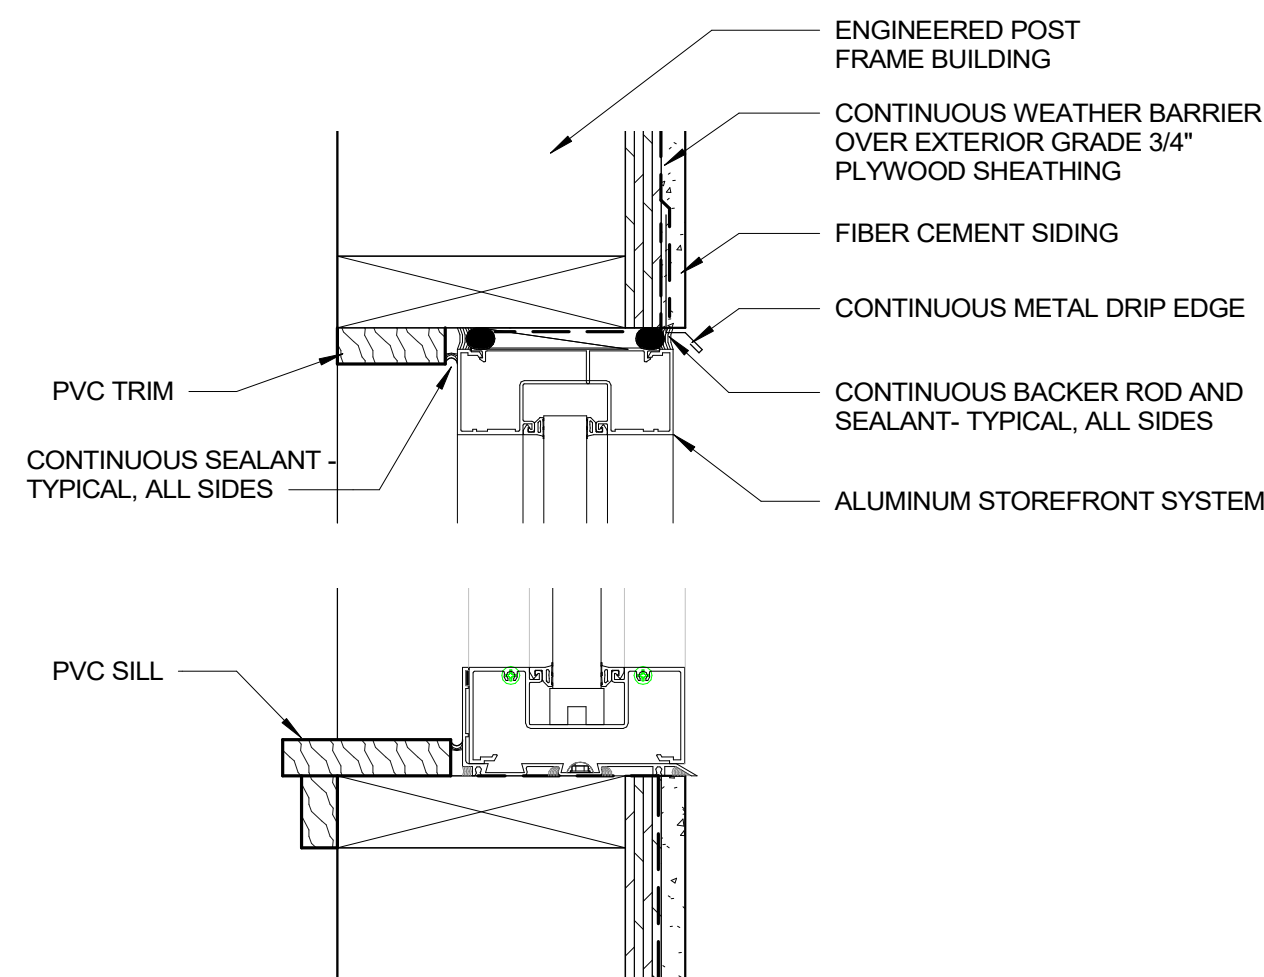


8 WINDOW DETAIL
3" = 1'-0"

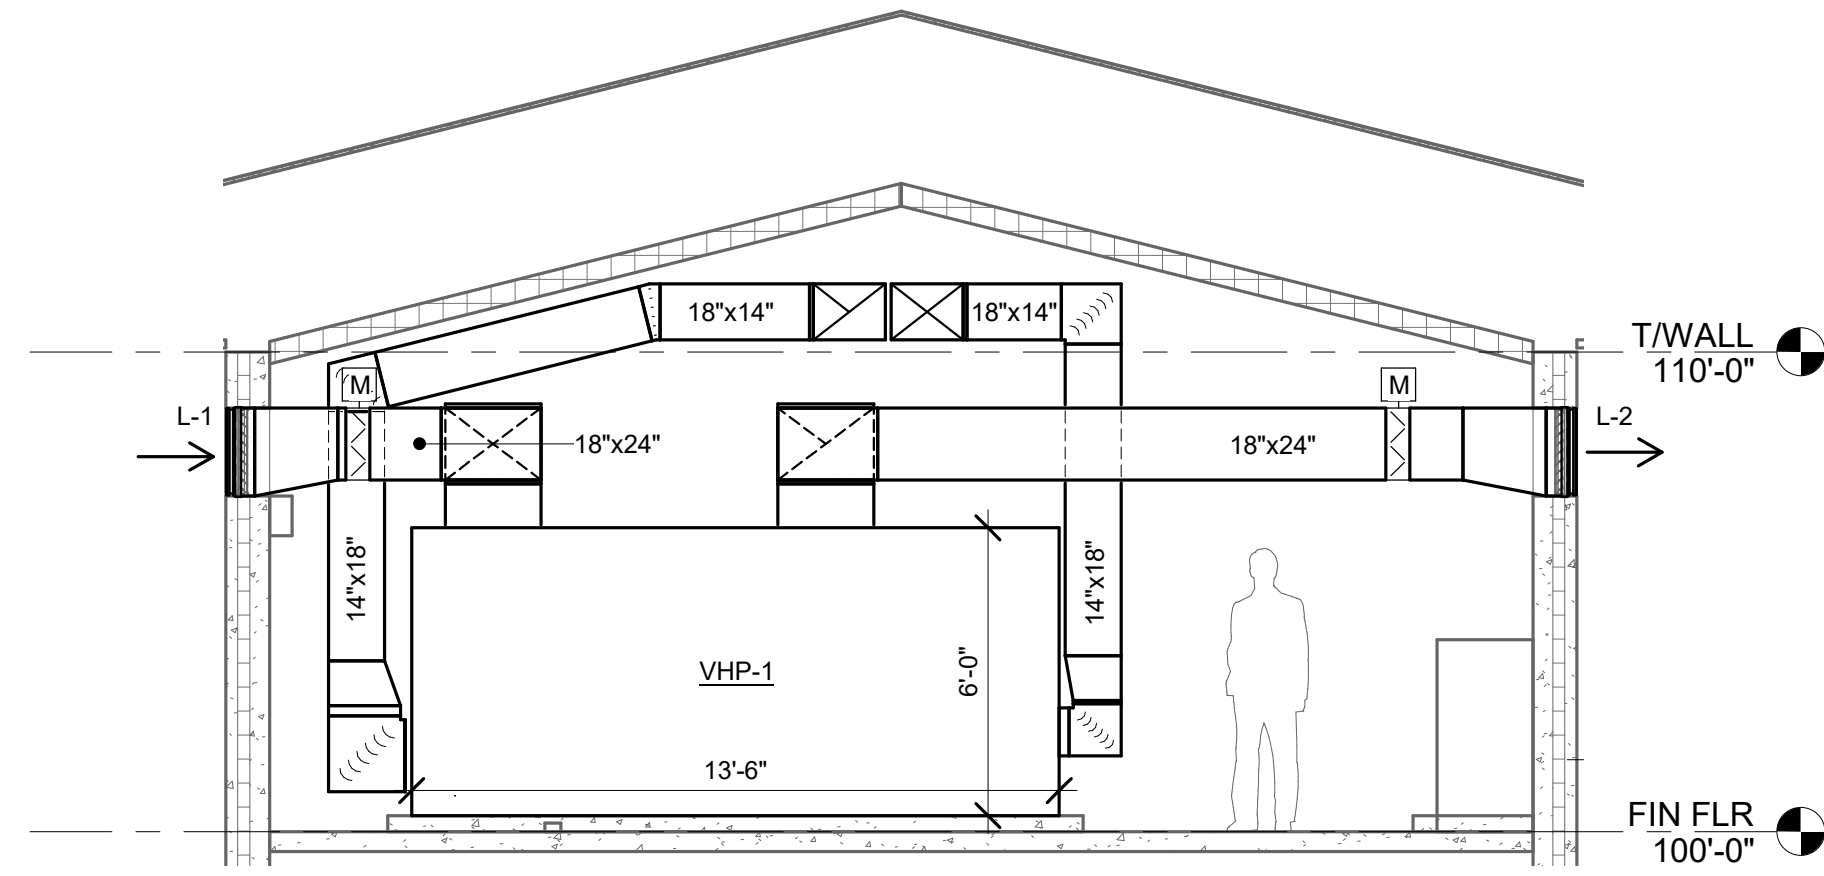


4 UNIT VENTILATOR SECTION
1/4" = 1'-0"

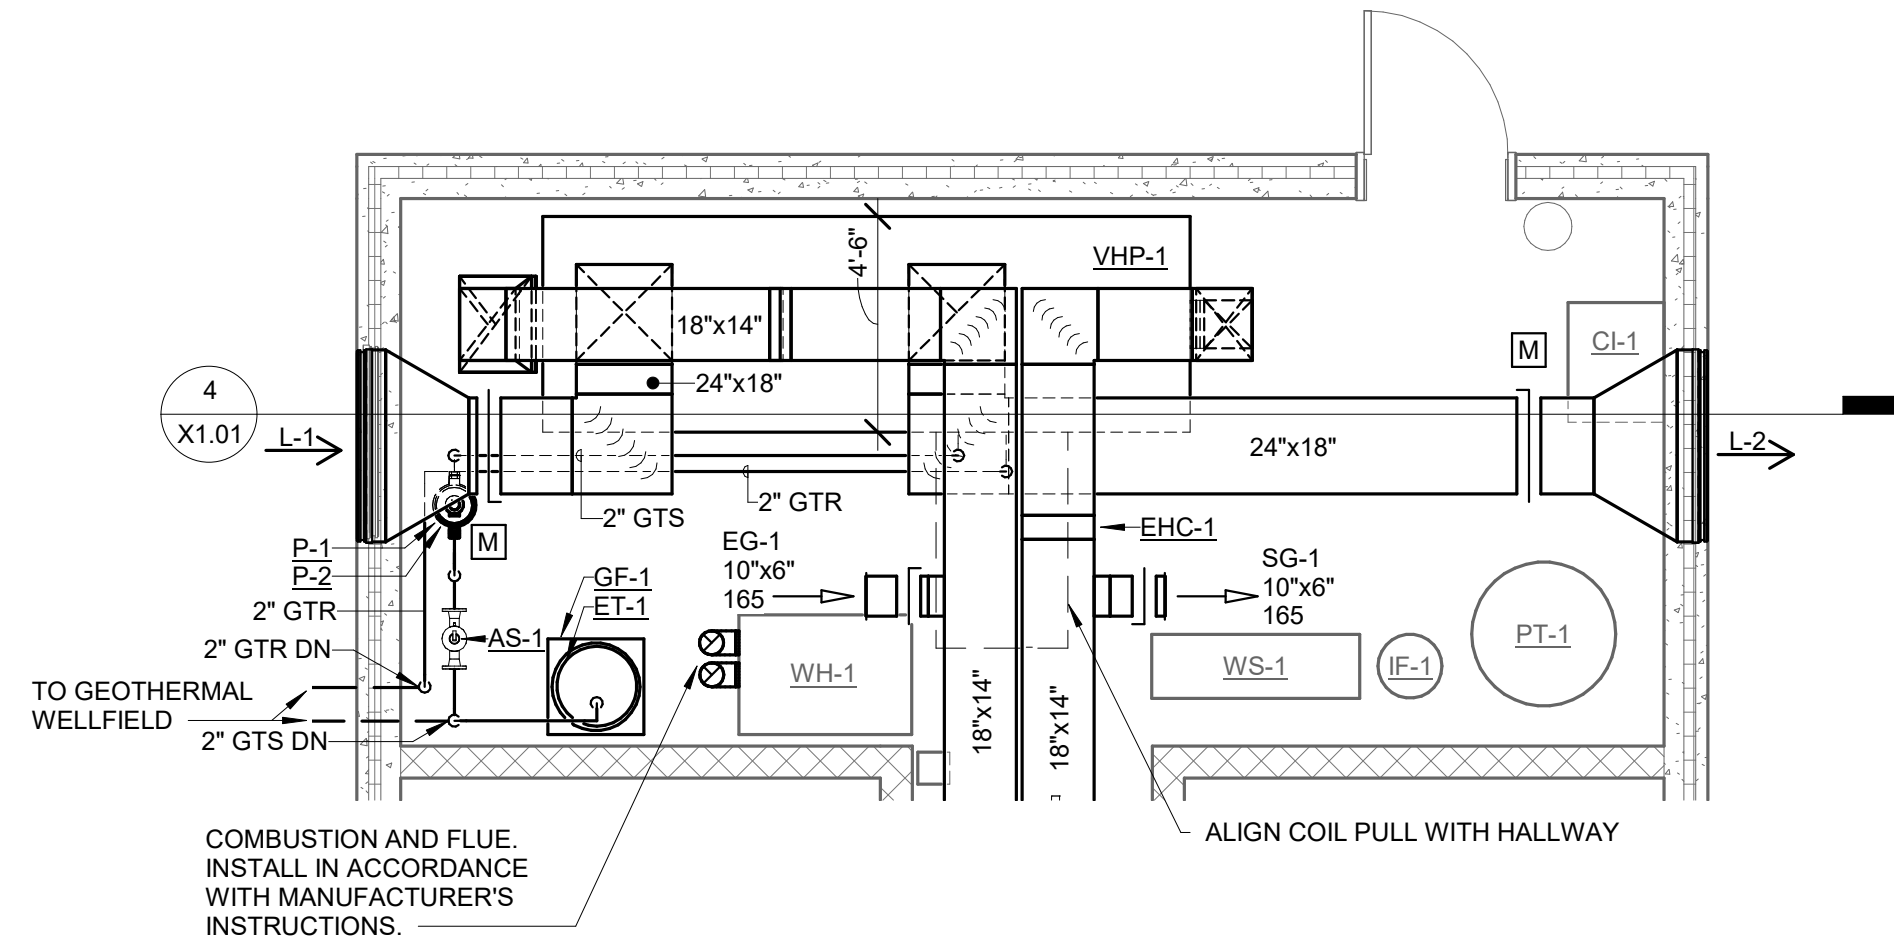


3 ENLARGED MECHANICAL ROOM PLAN
1/4" = 1'-0"

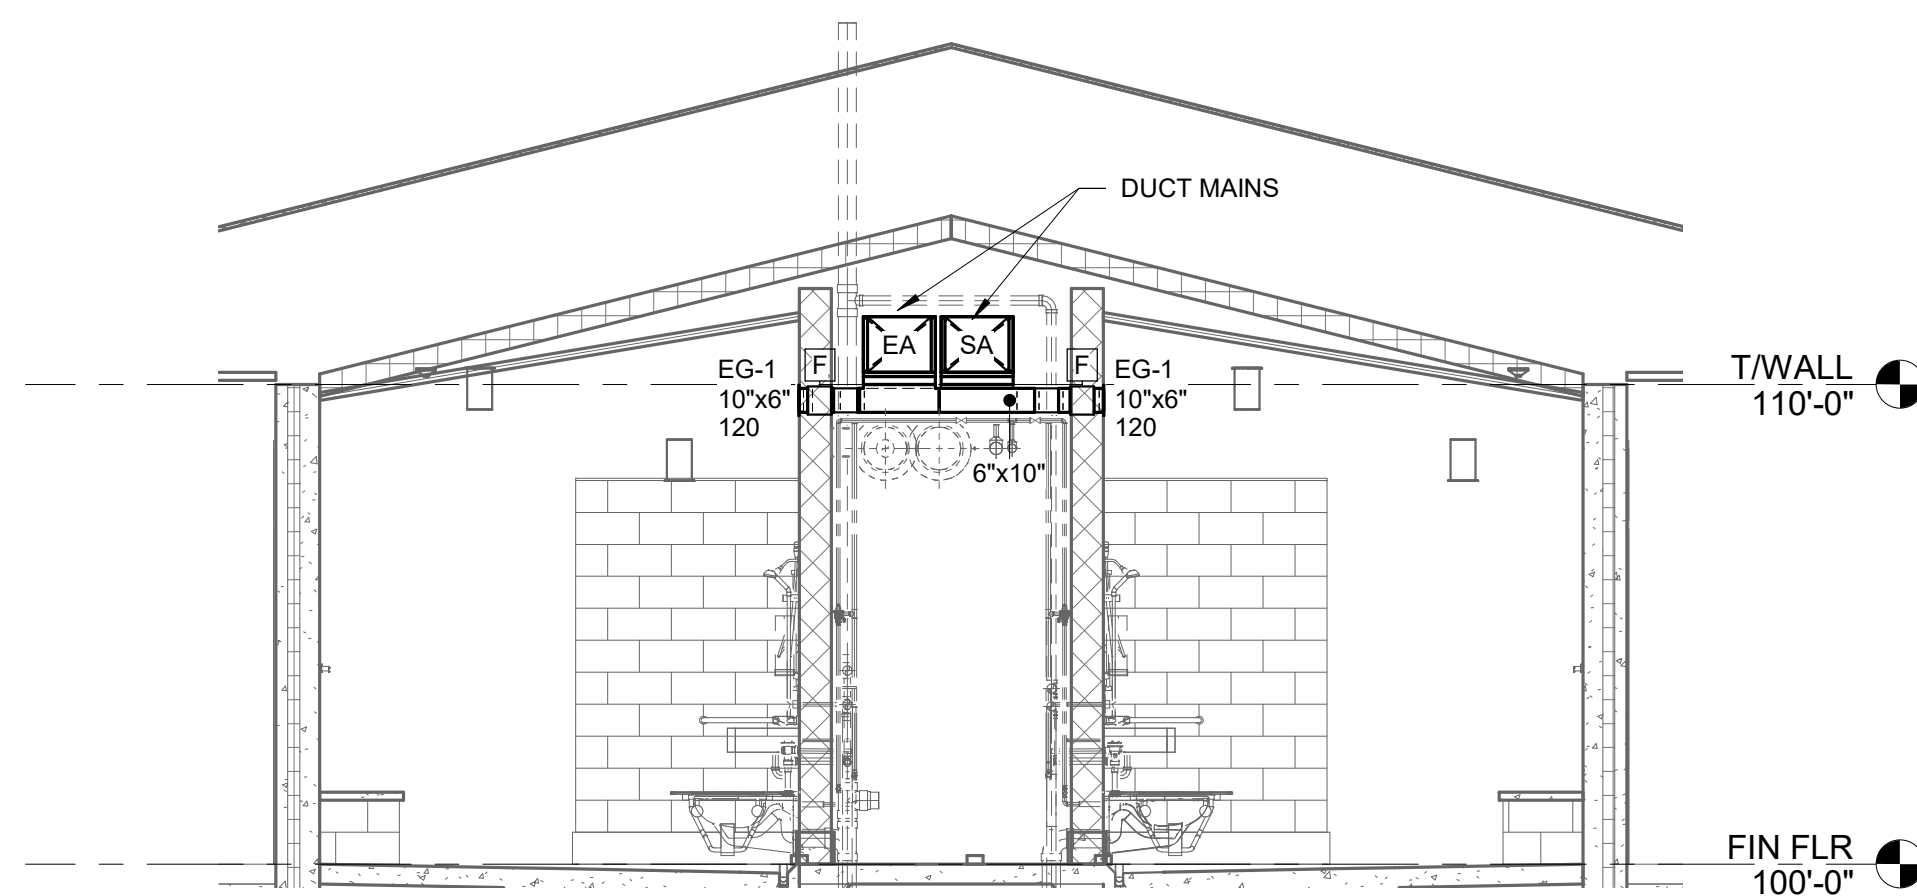


2 CORRIDOR HVAC SECTION
1/4" = 1'-0"

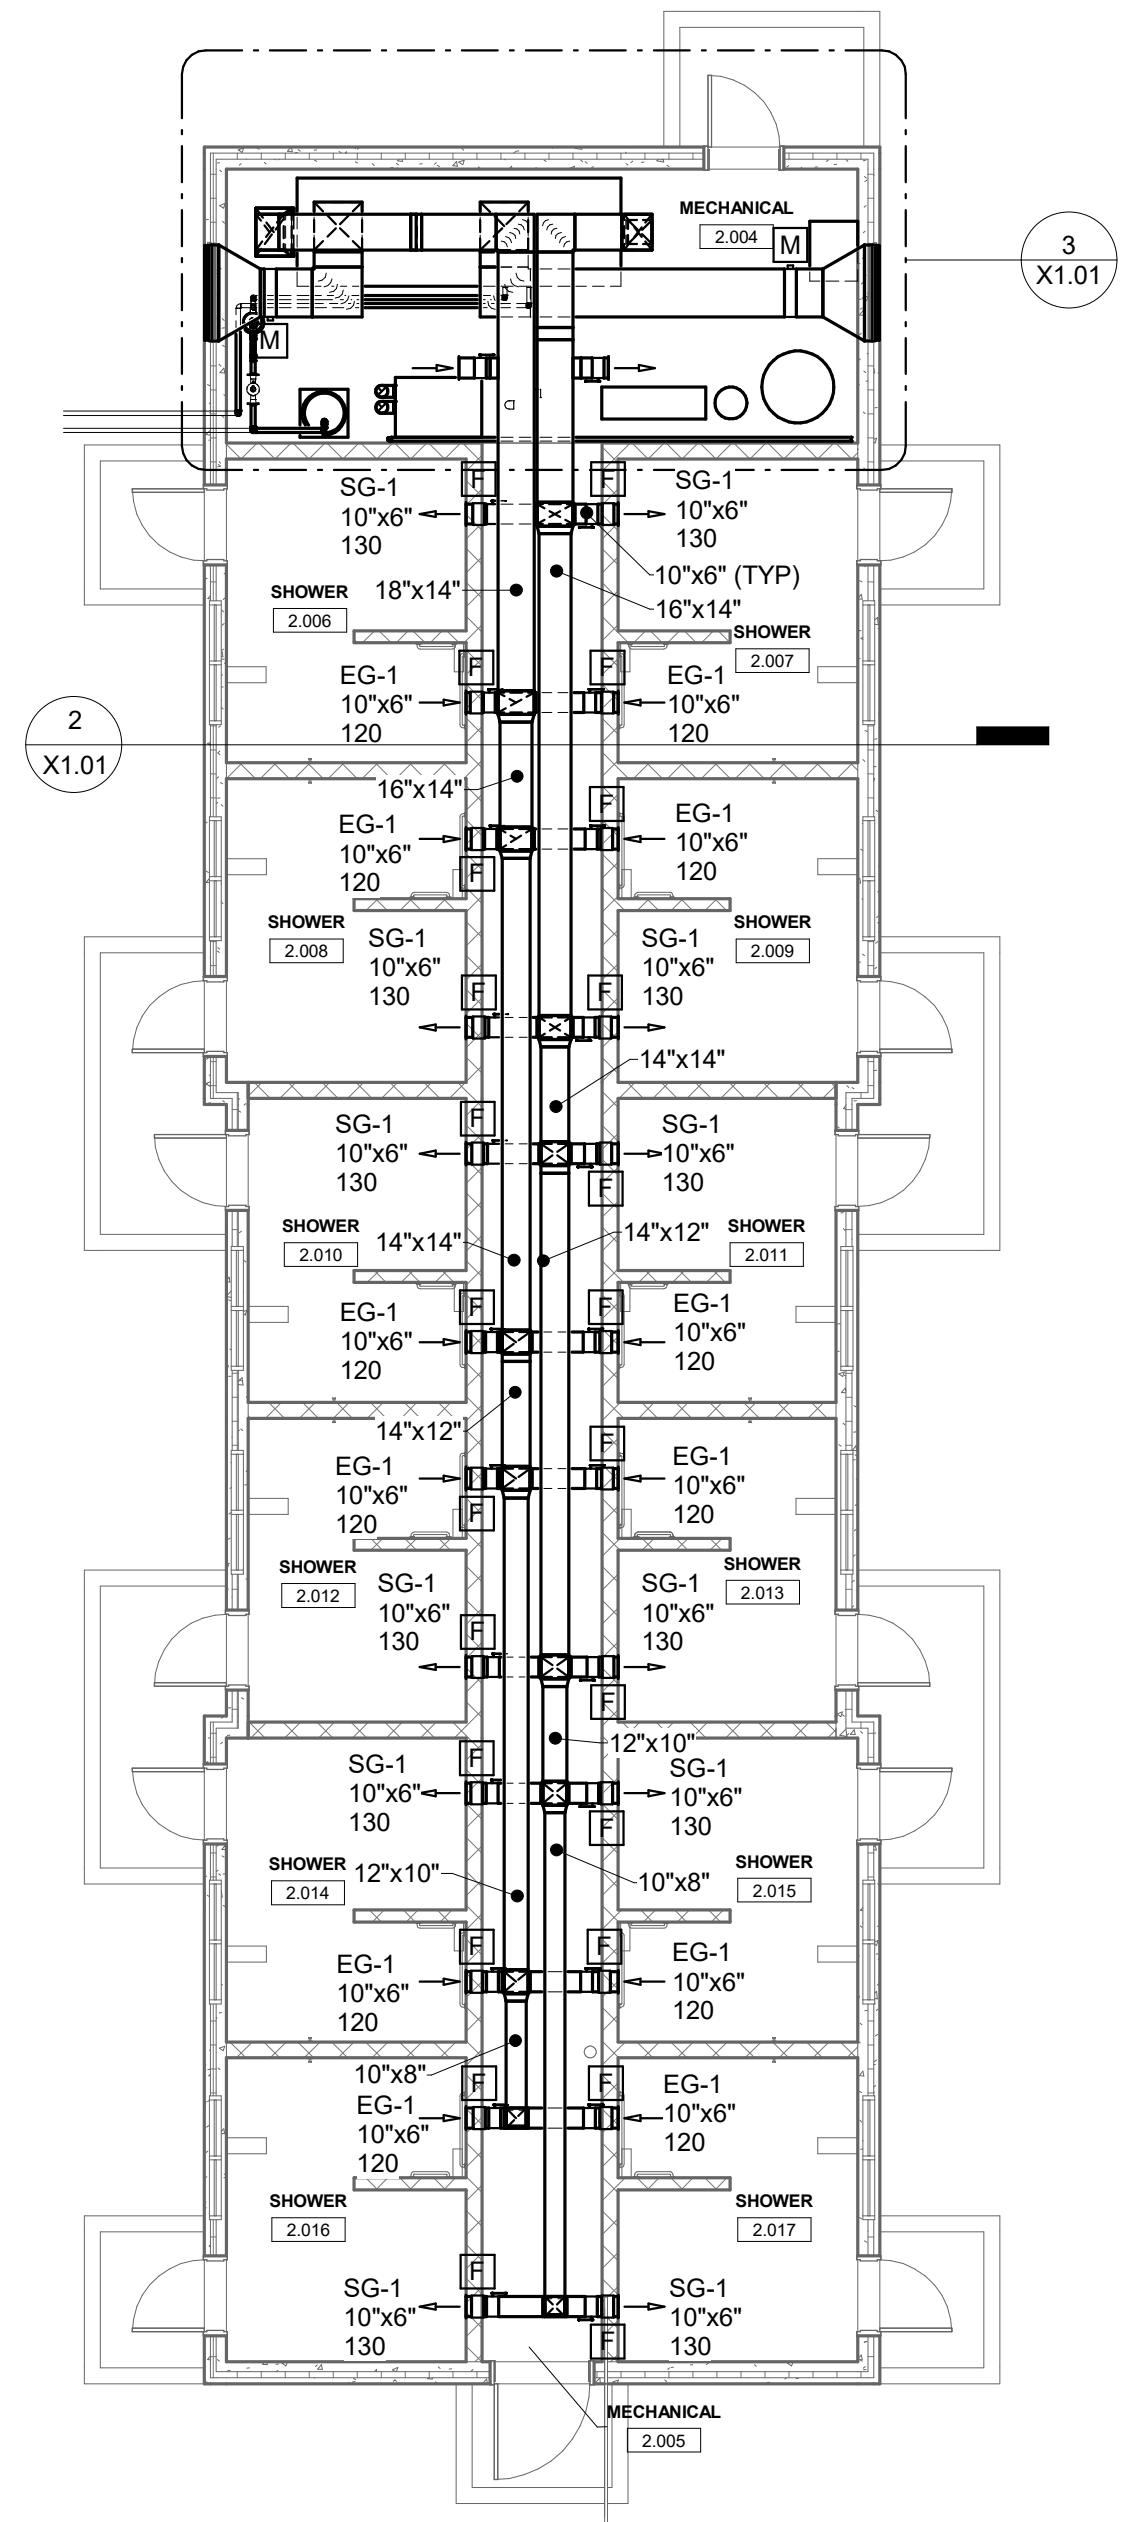


1 SHOWER HOUSE MECHANICAL PLAN
1/8" = 1'-0" 0' 12'




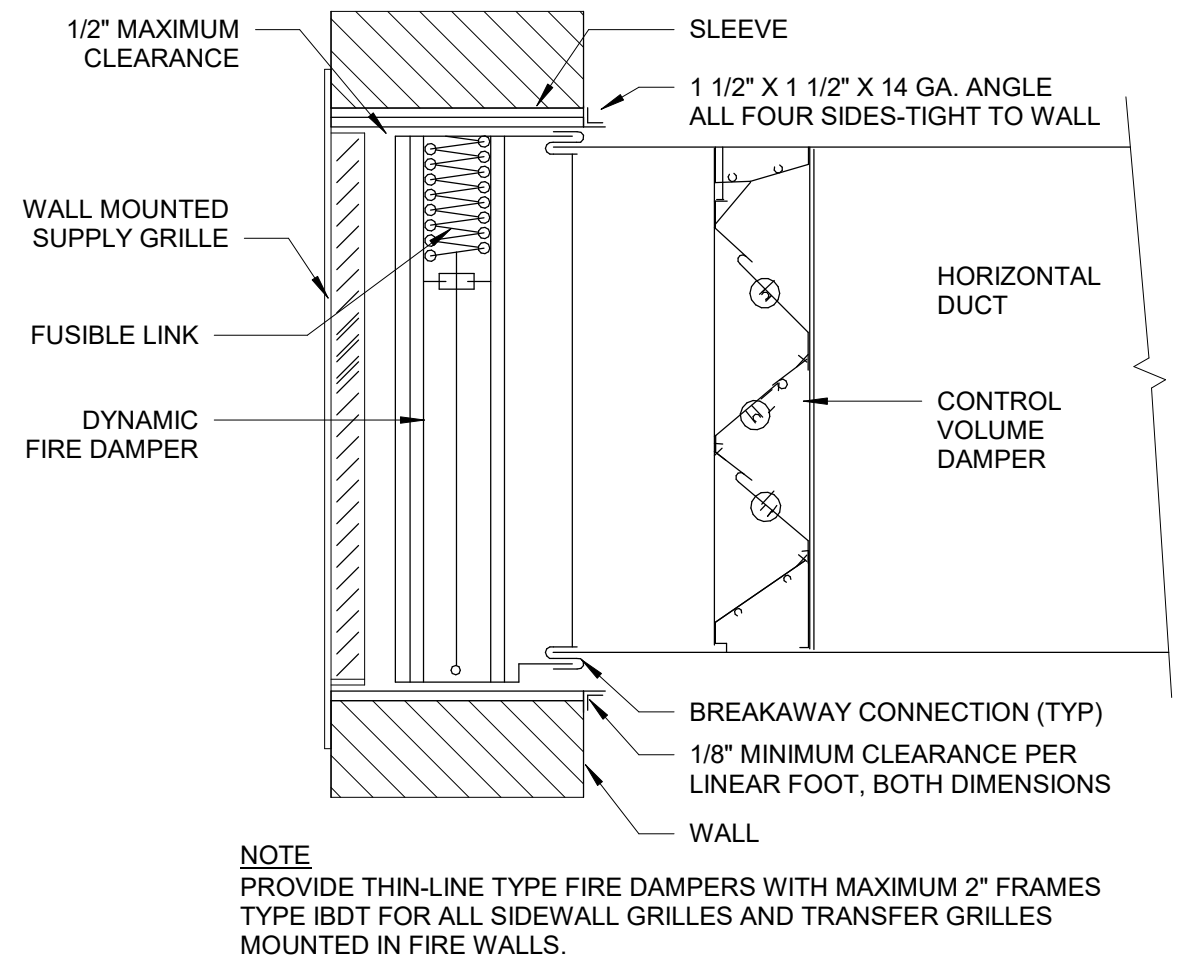


11 TYPICAL SUPPLY GRILLE FIRE AND VOLUME DAMPER DETAIL

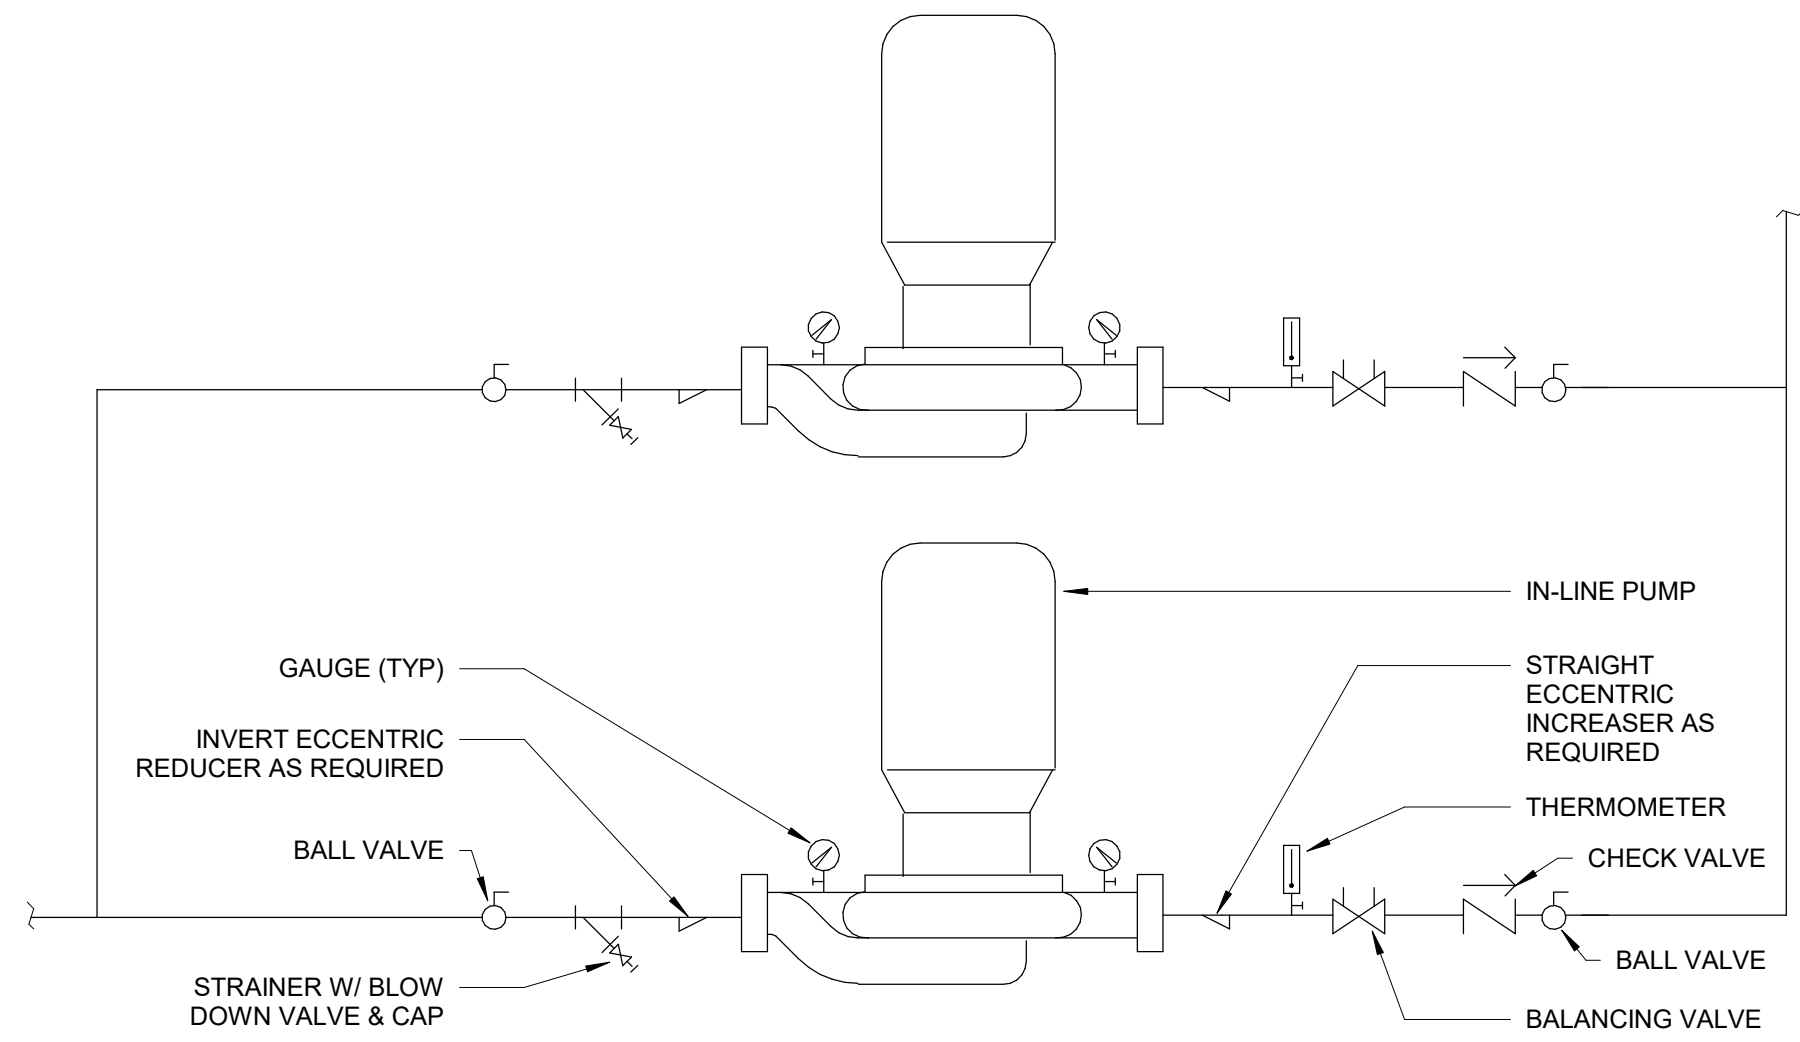


9 PIPING DIAGRAM - IN-LINE PUMP

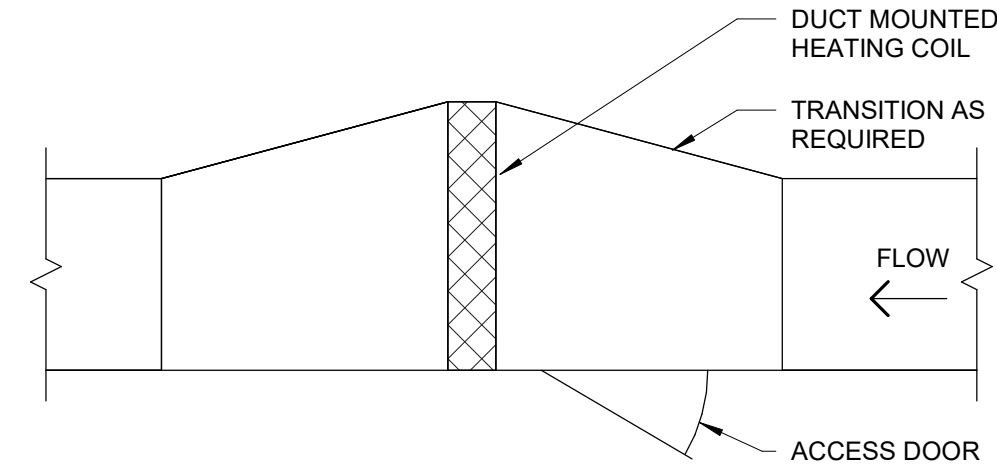


6 DUCT MOUNTED HEATING COIL DETAIL

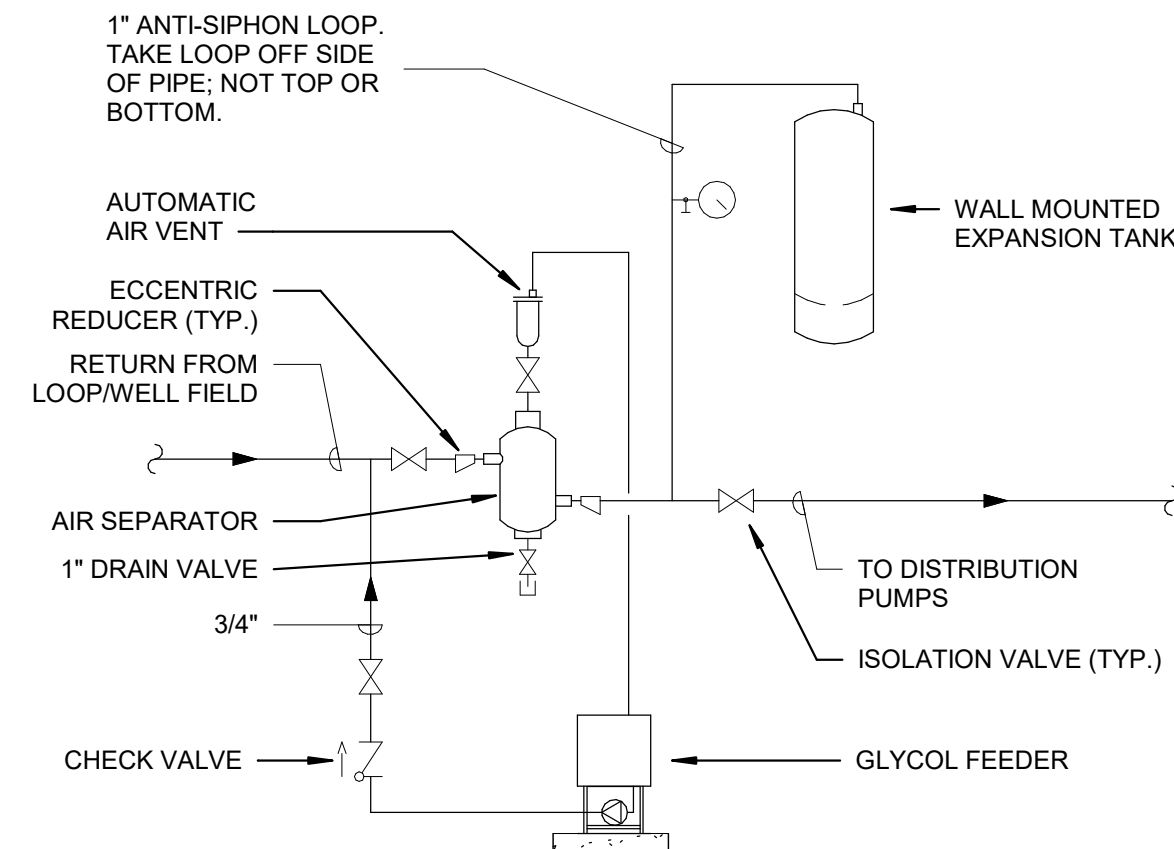


3 AIR SEPARATOR, EXPANSION TANK AND GLYCOL FEEDER DETAIL

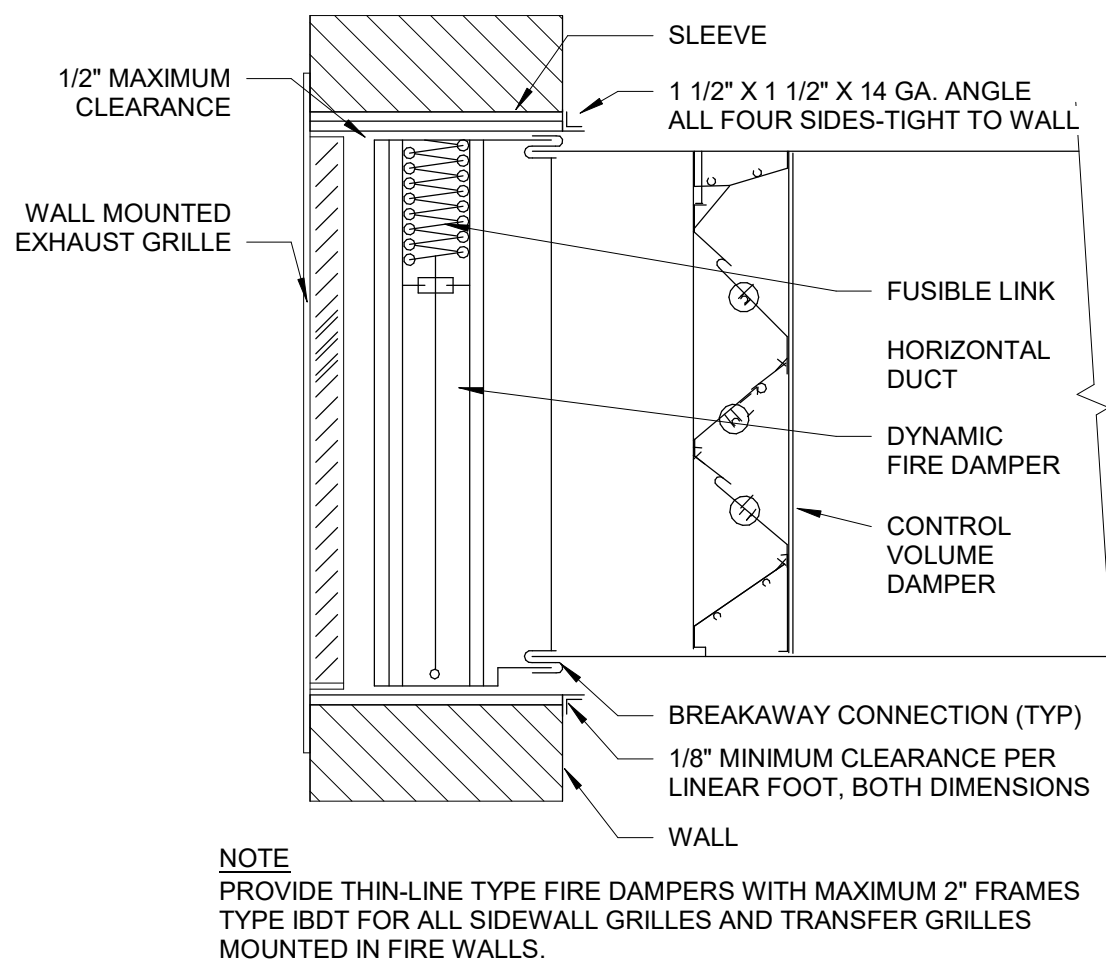


10 TYPICAL EXHAUST GRILLE FIRE DAMPER DETAIL

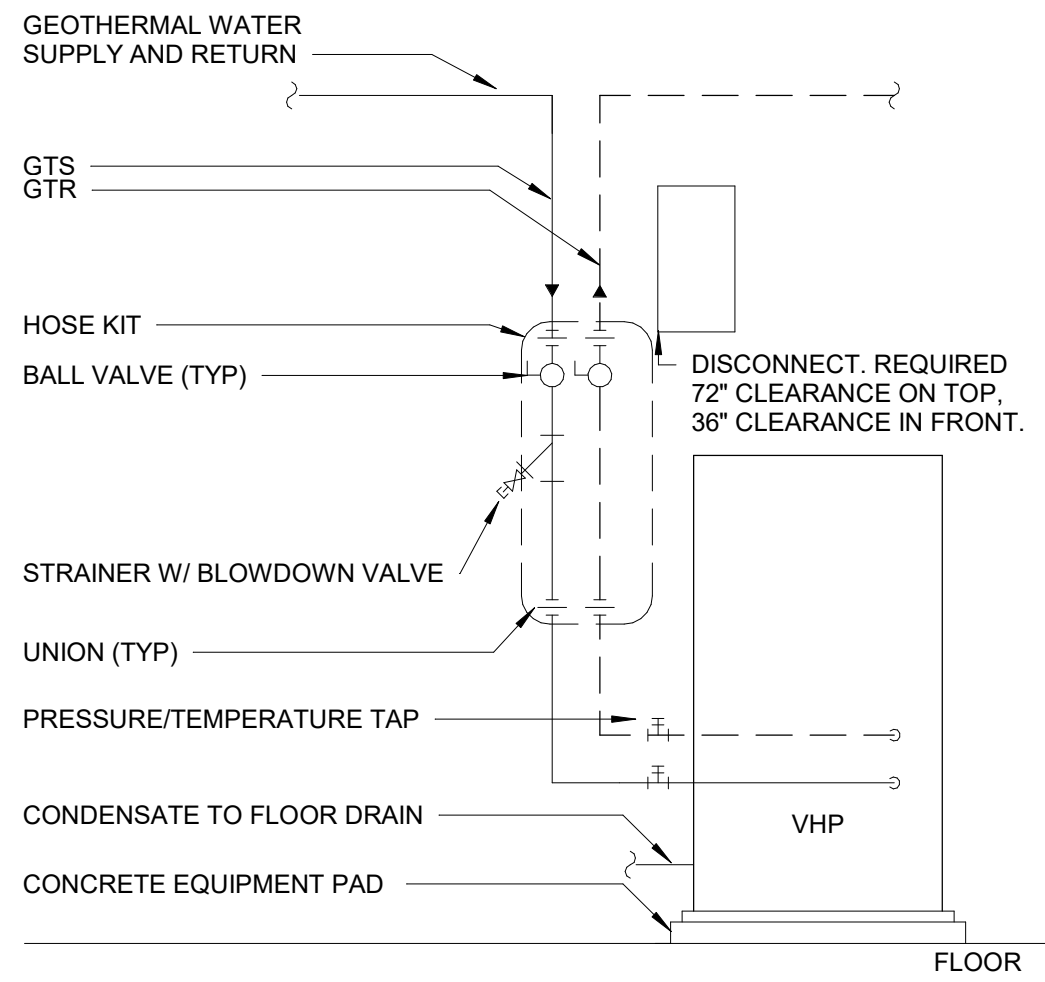

8 HEAT PUMP PIPING DETAIL

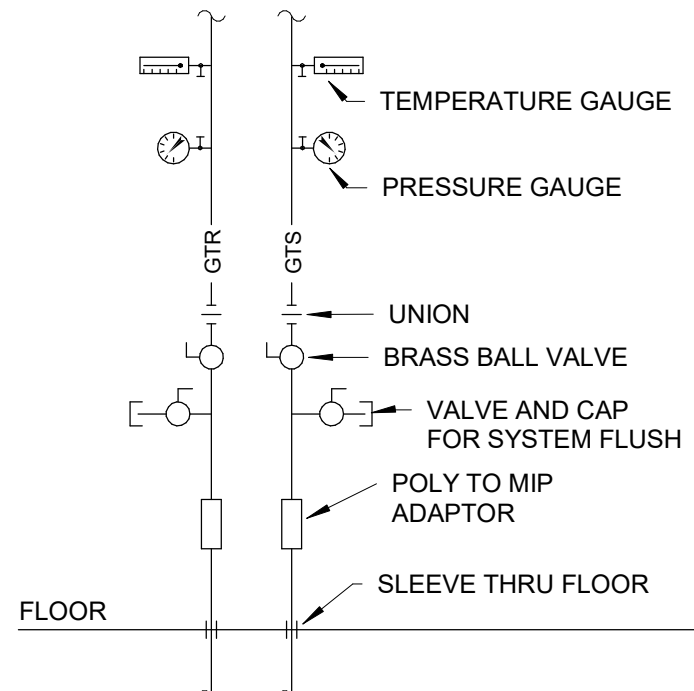


7 GEOTHERMAL LOOP HEADER DETAIL

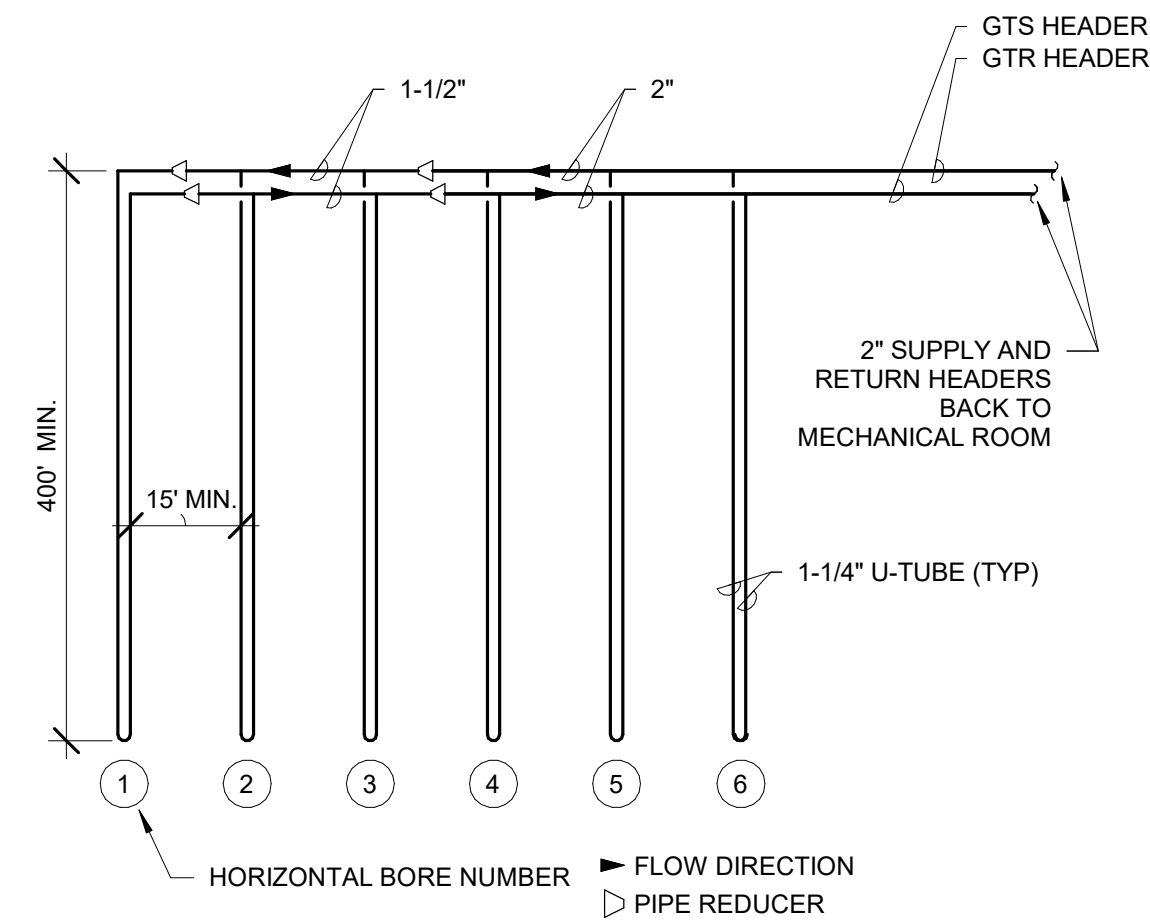


5 HORIZONTAL LOOP/HEADER LAYOUT

CONDENSATE DRAIN PIPE SCHEDULE		
MINIMUM PIPE SIZE	EQUIPMENT CAPACITY	REMARKS
3/4"	UP TO 3 TONS OF REFRIGERATION	
1"	OVER 3 TONS AND UP TO 20 TONS OF REFRIGERATION	
1 1/4"	OVER 20 TONS AND UP TO 90 TONS OF REFRIGERATION	

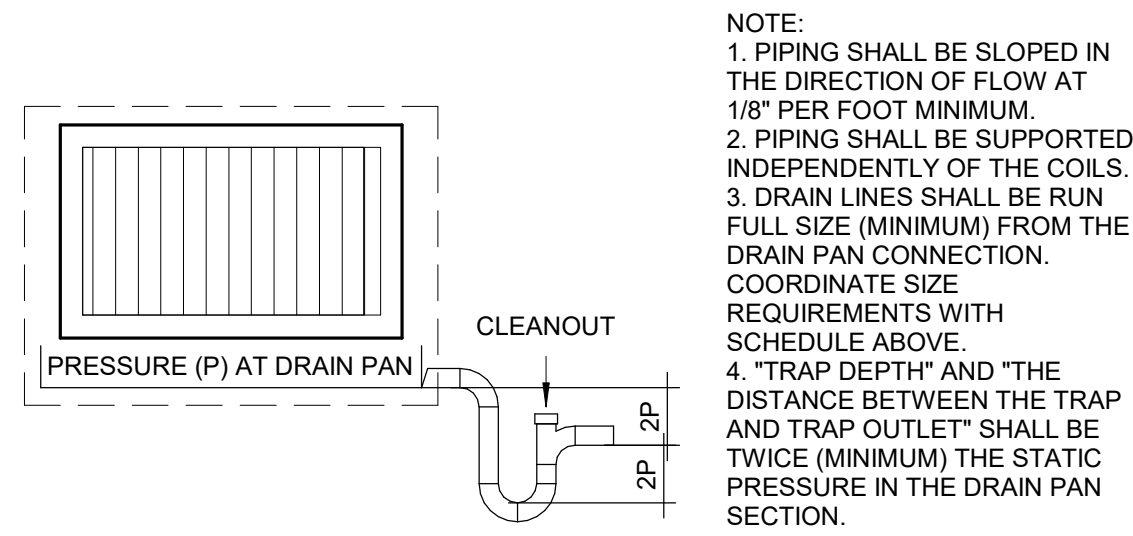


2 DRAIN PAN PIPING DETAIL


HVAC SYMBOLS

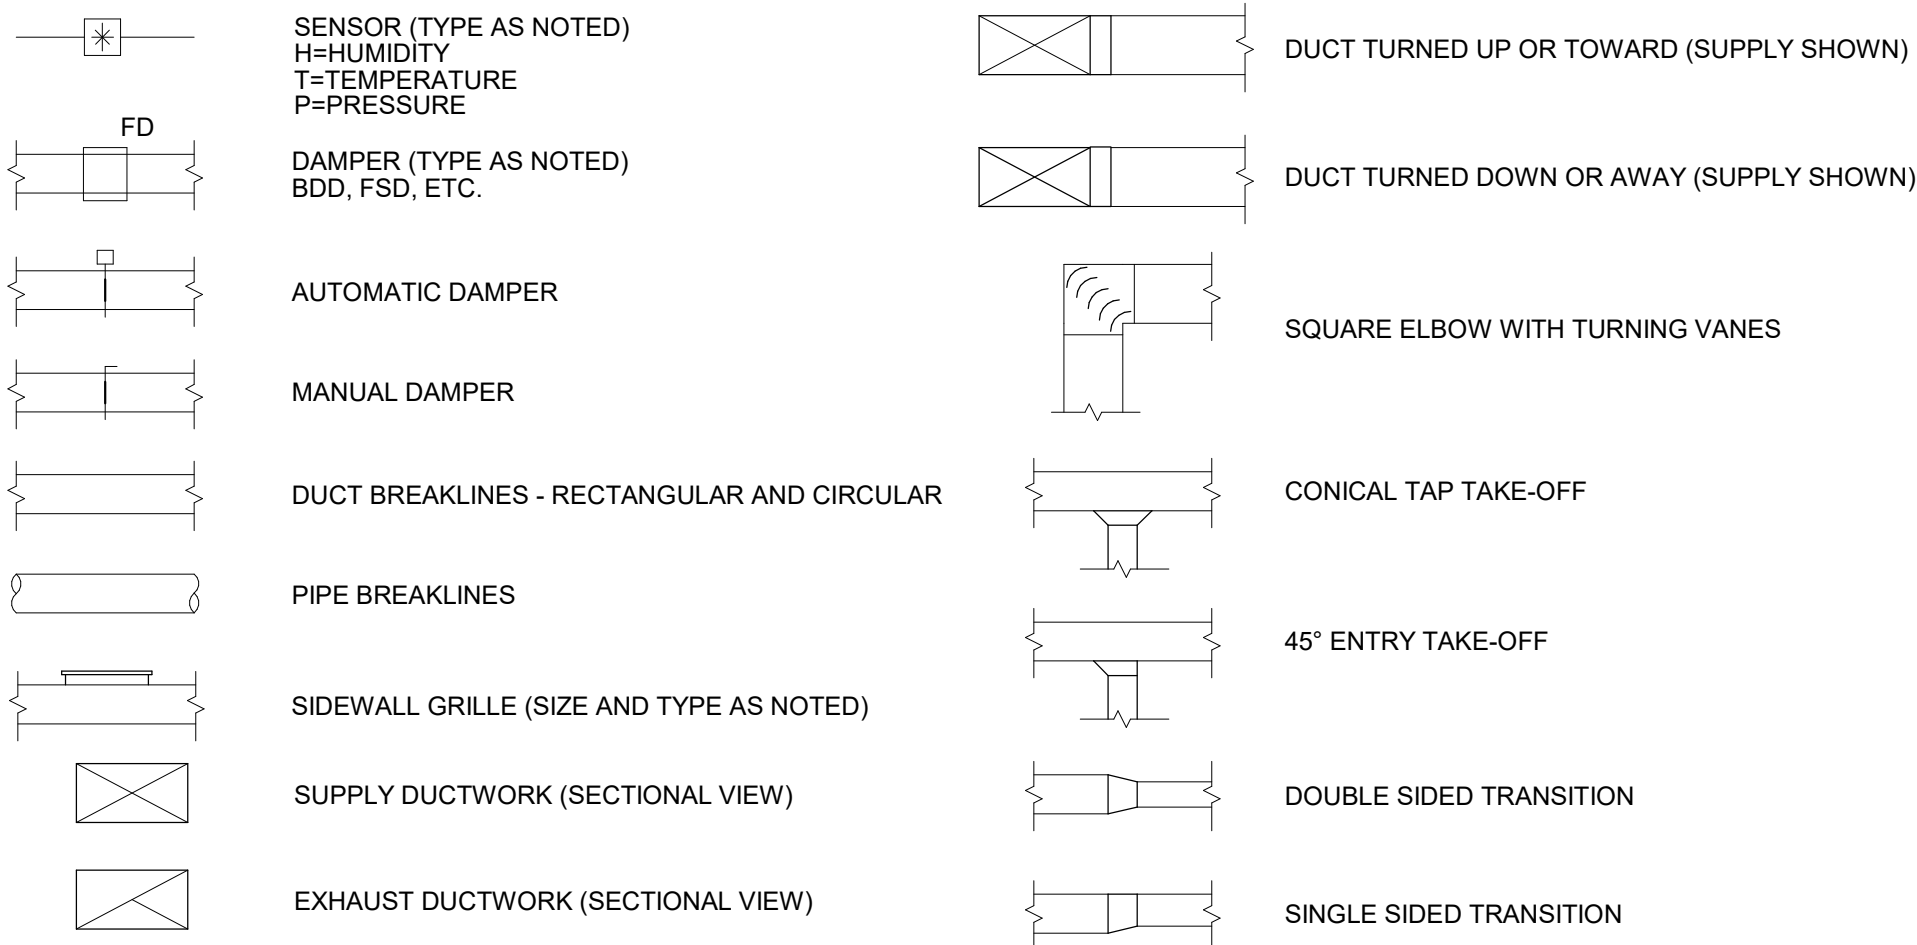



VALVES

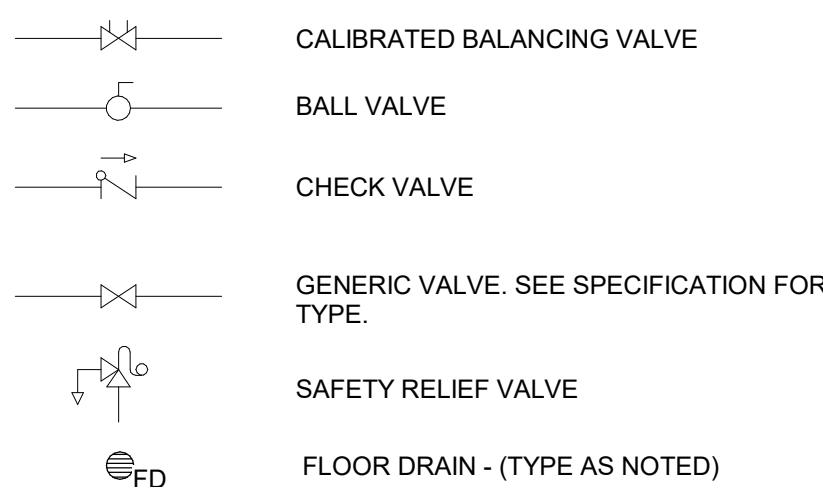


DEVICES

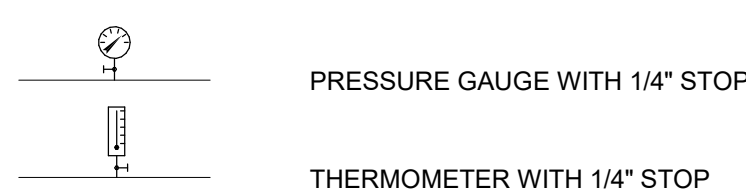

FITTINGS

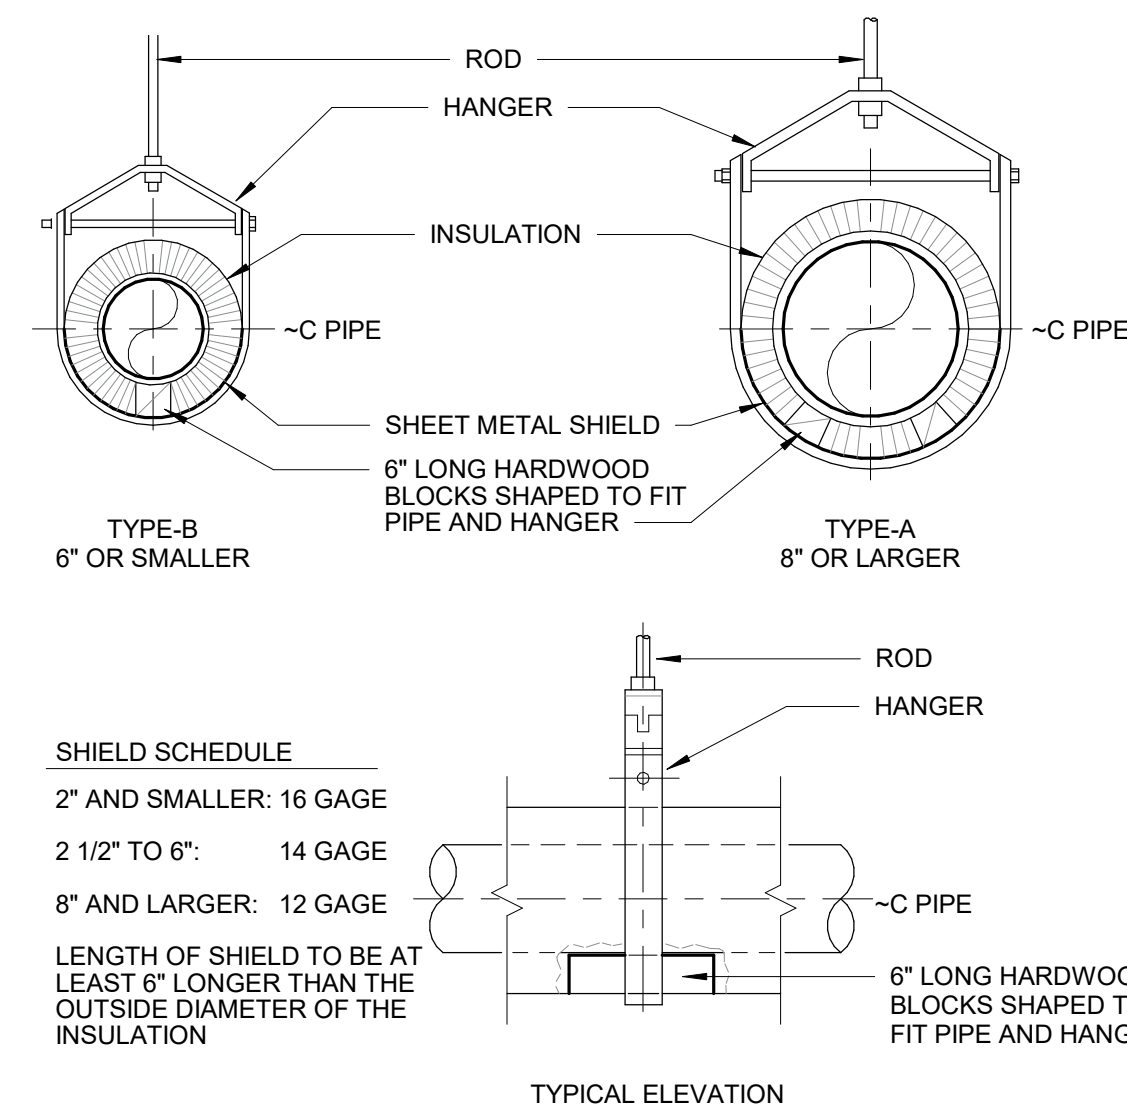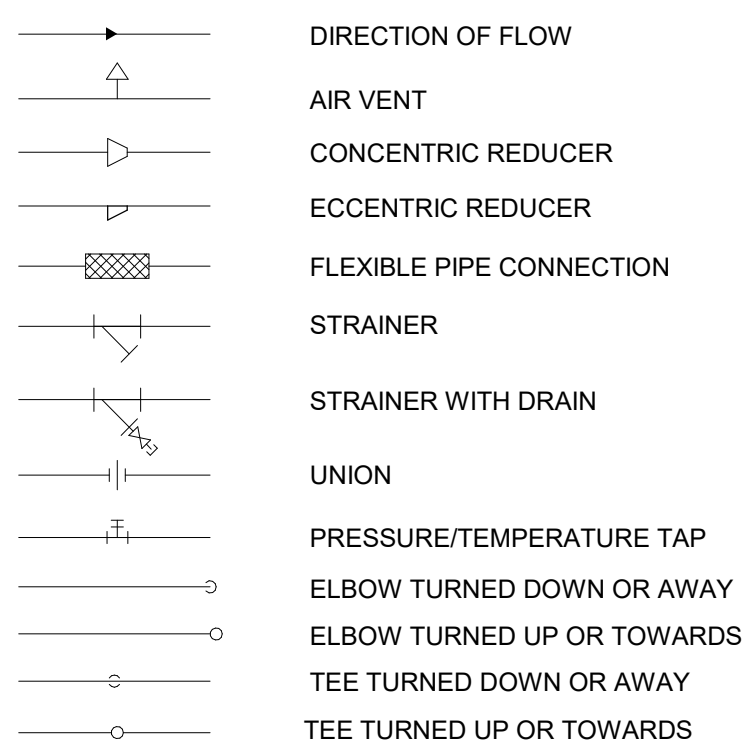

4 INSULATED PIPE HANGER DETAIL

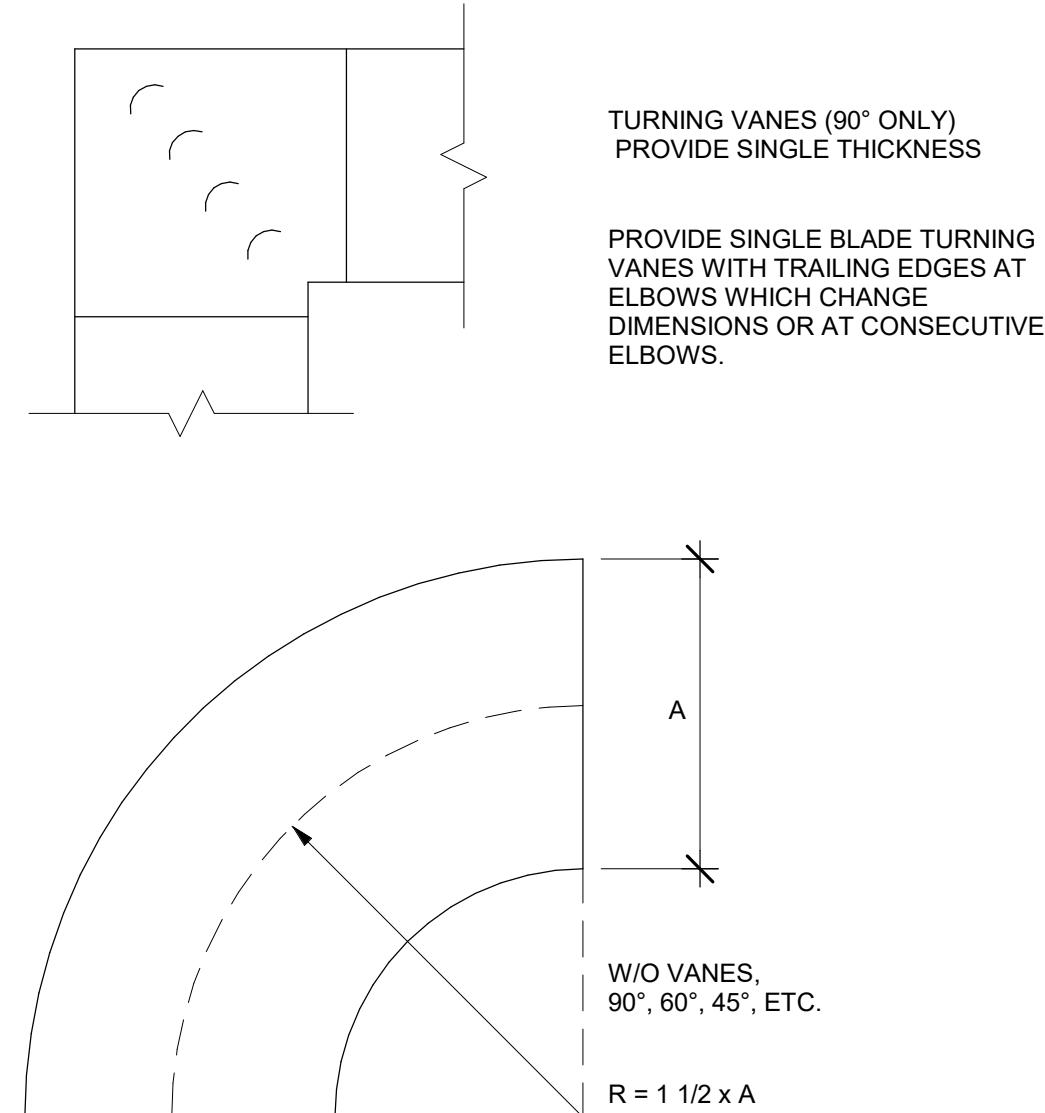

1 ELBOW DETAILS

REMARKS:
1. WITH SENSIBLE ENERGY RECOVERY PLATE WITH BYPASS DAMPER, WATER COOLED HEAT PUMP, AND HOT GAS REHEAT.
2. ALL MOTORS SHALL BE NEMA PREMIUM EFFICIENT.
3. PROVIDE SINGLE POINT ELECTRICAL CONNECTION AND FACTORY MOUNTED DISCONNECT.
4. INTAKE/EXHAUST W/MOTORIZED DAMPERS & FILTERS, COOLING COIL/FILTERS, DAMPERS SHALL BE LOW LEAKAGE
5.VHP-1 COOLING IS BASED ON 90°F EWT, HEATING IS BASED ON 40°F EWT. 30% GLYCOL.
6. EER AND COP VALUE BASED ON ARI STANDARD CONDITIONS.
7. HEAT PUMP SHALL HAVE MODULATING CAPACITY WITH VFD. FANS SHALL BE VARIABLE SPEED ECM MOTORS.
8. ALL ALUMINUM INTERIOR.

PLAN MARK	SUPPLY CFM	GPM	MAX PD	EXTERNAL STATIC PRESSURE	HP	CFM	EXTERNAL STATIC PRESSURE	HP	DB	EAT	WB	DB	LAT	WB	DB	LAT	WB	TOTAL COOLING MBH	SENSIBLE COOLING MBH	EER	DB	EAT	WB	DB	LAT	WB	LAT	DB	TOTAL CAPACITY MBH	COP	MBH	LAT	VOLTS	PHASE	MCA	MOCP	DESIGN BASIS	REMARKS
VHP-1	1600	25 GPM	3.1 RH2O	1.00 in-wg	1.5	1480	1.00 in-wg	1	95 °F	76 °F	86 °F	74 °F	51 °F	51 °F	117.8		61.0	17.9	-10 °F	-11 °F	50 °F	33 °F	70 °F	43.2	4.53	33.2	70 °F	230 V	1	85 A	125 A	XETEX XHS-24-24-BP-CD-HG-HP	VFD BY MANUF.					

ELECTRIC HEATING COIL SCHEDULE

1. PROVIDE WITH BUILT-IN, SNAP-ACTION, DOOR INTERLOCKING DISCONNECT SWITCH WITH MARKED "ON" AND "OFF" POSITIONS.
2. MAXIMUM STATIC PRESSURE DROP SHALL BE 0.10" WC.
3. COORDINATE LEFT OR RIGHT HAND AS REQUIRED FOR TERMINAL BOX CLEARANCE AND ACCESS.
4. INSTALL WITH STRAIGHT DUCT UPSTREAM AND DOWNSTREAM OF HEATER AS REQUIRED BY MANUFACTURER.
5. PROVIDE WITH PROPORTIONAL CONTROL.

PLAN MARK	SERVES	CFM	DUCT SIZE	EAT	LAT	KW	FLA	MOCP	VOLTS	PHASE	DESIGN BASIS	REMARKS
EHC-1	VHP-1	1600	18"x14"	51 °F	87 °F	18.0	75 A	100 A	240 V	1	BRASCH	

DIFFUSERS, REGISTERS, AND GRILLES SCHEDULE

MARK	MATERIAL OF CONSTRUCTION	DESCRIPTION	FACTORY FINISH	DESIGN BASIS	REMARKS
EG-1	ALUMINUM	3/4" SPACING 35° DEF	WHITE	TITUS 350FS	
SG-1	ALUMINUM	3/4" SPACING DBL DEF	WHITE	TITUS 300FS	

LOUVER SCHEDULE

1. PROVIDE WITH BIRD SCREEN
2. COLOR TO BE SELECTED BY ARCHITECT FROM MANUFACTURER'S FULL RANGE OF COLOR OPTIONS.

MARK	FLOW	HEIGHT	WIDTH	DEPTH	MAX PRESSURE DROP (IN. WG)	DESIGN BASIS
L-1	1600	1'-10"	4'-0"	2"	0.05	INDUSTRIAL LOUVER 258
L-2	1480	1'-10"	4'-0"	2"	0.05	INDUSTRIAL LOUVER 258

MECHANICAL PUMP SCHEDULE

1. WELLFIELD PRESSURE DROP ASSUMED TO BE 25 FEET. CONTRACTOR TO VERIFY PRIOR TO ORDERING PUMP.

PLAN MARK	SYSTEM SERVED	TYPE	GPM	HEAD (FT.)	HP	VOLTS	PHASE	RPM	DESIGN BASIS	REMARKS
P-1	GEOTHERMAL	IN-LINE	25 GPM	30.00	0.75	240 V	1	1750	TACO 1915	VFD BY EC
P-2	GEOTHERMAL	IN-LINE	25 GPM	30.00	0.75	240 V	1	1750	TACO 1915	VFD BY EC

AIR/DIRT SEPARATOR

PLAN MARK	SIZE (IN)	CAPACITY (GPM)	MAX PD (FT)	AIR REMOVAL	DESIGN BASIS	REMARKS
AS-1	2"	25	0.4	99%	SPIROTHERM VDN200	REMOVABLE HEAD

MECHANICAL PIPING EXPANSION TANK SCHEDULE

PLAN MARK	SYSTEM SERVED	TYPE	TANK CAPACITY	ACCEPTANCE CAPACITY	DESIGN BASIS	REMARKS
ET-1	GEOTHERMAL	BLADDER	23.0 gal	23.0 gal	TACO CA-90	

GLYCOL FEED SYSTEM SCHEDULE

PLAN MARK	SYSTEM SERVED	CAPACITY	CUT IN PRESSURE RANGE	CUT OUT PRESSURE RANGE	HP	VOLTS	PHASE	DESIGN BASIS	LOCATION	REMARKS
GF-1	GEOTHERMAL	50 gal	10-45 psi	20-60 psi	0.33	120 V	1	NEPTUNE G-50-1	MECHANICAL ROOM	

VENTILATION HEAT PUMP

ELECTRIC HEATING COIL

GEOTHERMAL PLANT LOOP MONITOR AND PUMPS

11 CONTROLS SCHEMATIC

12" = 1'-0"

VENTILATION HEAT PUMP:

RUN CONDITIONS - CONTINUOUS:
THE UNIT SHALL RUN CONTINUOUSLY BASED ON A USER DEFINED SCHEDULE.

SUPPLY FAN:
THE SUPPLY FAN SHALL RUN CONTINUOUSLY, UNLESS SHUTDOWN ON SAFETIES.
OCCUPIED MODE: FAN SHALL OPERATE AT FULL SCHEDULED AIRFLOW
UNOCCUPIED MODE: FAN SHALL OPERATE AT 30% SCHEDULED AIRFLOW

ALARMS SHALL BE PROVIDED AS FOLLOWS:
• SUPPLY FAN FAILURE: COMMANDED ON, BUT THE STATUS IS OFF.
• SUPPLY FAN IN HAND: COMMANDED OFF, BUT THE STATUS IS ON.

EXHAUST FAN:
THE EXHAUST FAN SHALL RUN WHENEVER THE SUPPLY FAN RUNS.
OCCUPIED MODE: FAN SHALL OPERATE AT FULL SCHEDULED AIRFLOW
UNOCCUPIED MODE: FAN SHALL OPERATE AT 30% SCHEDULED AIRFLOW

ALARMS SHALL BE PROVIDED AS FOLLOWS:
• EXHAUST FAN FAILURE: COMMANDED ON, BUT THE STATUS IS OFF.
• EXHAUST FAN IN HAND: COMMANDED OFF, BUT THE STATUS IS ON.

HEATING AND COOLING - VARIABLE COMPRESSOR:
THE CONTROLLER SHALL MODULATE THE COMPRESSOR TO MAINTAIN EXHAUST INTAKE AIR TEMPERATURE SETPOINT. THE COMPRESSOR SHALL RUN SUBJECT TO ITS OWN INTERNAL SAFETIES AND CONTROLS.
• COOLING MODE: 75°F (ADJ.) OCCUPIED / 78°F (ADJ.) UNOCCUPIED RETURN AIR TEMPERATURE
• HEATING MODE: 70°F (ADJ.) OCCUPIED / 67°F (ADJ.) UNOCCUPIED RETURN AIR TEMPERATURE

THE HEATING SHALL BE ENABLED WHENEVER:
• EXHAUST INTAKE AIR TEMPERATURE IS 2°F (ADJ.) LESS THAN SETPOINT
• AND THE FAN STATUS IS ON
• AND THE REVERSING VALVE IS IN HEAT MODE.

THE COOLING SHALL BE ENABLED WHENEVER:
• EXHAUST INTAKE AIR TEMPERATURE IS 2°F (ADJ.) MORE THAN SETPOINT
• AND THE FAN STATUS IS ON
• AND THE REVERSING VALVE IS IN COOL MODE.

ON MODE CHANGE, THE COMPRESSOR SHALL BE DISABLED AND REMAIN OFF UNTIL AFTER THE REVERSING VALVE HAS CHANGED POSITION.

DEHUMIDIFICATION:

THE CONTROLLER SHALL MEASURE THE EXHAUST INTAKE AIR HUMIDITY AND OVERRIDE THE COOLING SEQUENCE WHEN THE EXHAUST INTAKE AIR HUMIDITY IS AT OR ABOVE 80% RH (ADJ.). THE FANS SHALL OPERATE AT FULL AIRFLOW WHEN IN DEHUMIDIFICATION MODE. THE HP DISCHARGE AIR TEMPERATURE SHALL BE MAINTAINED AT 51°F (ADJ.) AND THE HOT GAS REHEAT COIL VALVE SHALL MODULATE TO MAINTAIN EXHAUST INTAKE AIR TEMPERATURE SETPOINT.
DEHUMIDIFICATION SHALL BE ENABLED WHENEVER THE SUPPLY FAN STATUS IS ON.

HGR DISCHARGE AIR TEMPERATURE:
THE CONTROLLER SHALL MONITOR THE HGR DISCHARGE AIR TEMPERATURE.

ALARMS SHALL BE PROVIDED AS FOLLOWS:
• HIGH SUPPLY AIR TEMP: IF THE HGR DISCHARGE AIR TEMPERATURE IS GREATER THAN 120°F (ADJ.).
• LOW SUPPLY AIR TEMP: IF THE HGR DISCHARGE AIR TEMPERATURE IS LESS THAN 45°F (ADJ.).

OUTSIDE AIR TEMPERATURE:
MONITOR THE OUTSIDE AIR TEMPERATURE.

OUTSIDE AIR HUMIDITY:
MONITOR THE OUTSIDE AIR HUMIDITY.

OUTSIDE AIR FILTER DIFFERENTIAL PRESSURE MONITOR:
THE CONTROLLER SHALL MONITOR THE DIFFERENTIAL PRESSURE ACROSS THE FILTER.

ALARMS SHALL BE PROVIDED AS FOLLOWS:
• FILTER CHANGE REQUIRED: FILTER DIFFERENTIAL PRESSURE EXCEEDS A USER DEFINABLE LIMIT (ADJ.).

EXHAUST INTAKE AIR TEMPERATURE:
THE CONTROLLER SHALL MONITOR THE EXHAUST INTAKE AIR TEMPERATURE AND USE AS REQUIRED FOR SETPOINT CONTROL.

ALARMS SHALL BE PROVIDED AS FOLLOWS:
• HIGH EXHAUST INTAKE AIR TEMP: IF THE EXHAUST INTAKE AIR TEMPERATURE IS GREATER THAN 95°F (ADJ.)
• LOW EXHAUST INTAKE AIR TEMP: IF THE EXHAUST INTAKE AIR TEMPERATURE IS LESS THAN 60°F (ADJ.).

EXHAUST INTAKE AIR HUMIDITY:

THE CONTROLLER SHALL MONITOR THE EXHAUST INTAKE AIR HUMIDITY AND USE AS REQUIRED FOR HUMIDITY CONTROL.

ALARMS SHALL BE PROVIDED AS FOLLOWS:
• HIGH EXHAUST INTAKE AIR HUMIDITY: IF THE EXHAUST INTAKE AIR HUMIDITY IS GREATER THAN 70% (ADJ.).
• LOW EXHAUST INTAKE AIR HUMIDITY: IF THE EXHAUST INTAKE AIR HUMIDITY IS LESS THAN 35% (ADJ.).

EXHAUST AIR FILTER DIFFERENTIAL PRESSURE MONITOR:
THE CONTROLLER SHALL MONITOR THE DIFFERENTIAL PRESSURE ACROSS THE FILTER.

ALARMS SHALL BE PROVIDED AS FOLLOWS:
• FILTER CHANGE REQUIRED: FILTER DIFFERENTIAL PRESSURE EXCEEDS A USER DEFINABLE LIMIT (ADJ.).

EXHAUST DISCHARGE AIR TEMPERATURE:
THE CONTROLLER SHALL MONITOR THE EXHAUST DISCHARGE AIR TEMPERATURE.

ENERGY RECOVERY ECONOMIZER:
THE SENSIBLE ENERGY RECOVERY CORE BYPASS DAMPERS SHALL OPEN WHEN THE OUTSIDE AIR TEMPERATURE IS LESS THAN THE EXHAUST INTAKE AIR TEMPERATURE BY A USER DEFINABLE AMOUNT (ADJ.) IN COOLING MODE.
THE SENSIBLE ENERGY RECOVERY CORE BYPASS DAMPERS SHALL OPEN WHEN THE OUTSIDE AIR TEMPERATURE IS GREATER THAN THE EXHAUST INTAKE AIR TEMPERATURE BY A USER DEFINABLE AMOUNT (ADJ.) IN HEATING MODE.

OUTSIDE AIR AND EXHAUST AIR DAMPERS:
THE OUTSIDE AND EXHAUST AIR DAMPERS SHALL CLOSE WHEN THE UNIT IS OFF.

FROST CONTROL:
MODULATE THE OUTSIDE AIR BYPASS DAMPER TO MAINTAIN AN EXHAUST DISCHARGE AIR TEMPERATURE AT OR ABOVE 35°F

ELECTRIC HEATING COIL:

THE CONTROLLER SHALL MEASURE THE EXHAUST INTAKE AIR TEMPERATURE AND MODULATE THE HEATING TO MAINTAIN ITS HEATING SETPOINT SHOULD THE COMPRESSORS NOT MEET THE HEATING DEMAND.

THE ELECTRIC DUCT HEATER SHALL BE ENABLED WHENEVER:
• THE HEAT PUMP IS IN HEATING MODE.
• AND THE EXHAUST INTAKE AIR TEMPERATURE IS BELOW HEATING SETPOINT.
• AND THE FAN IS ON.

SUPPLY AIR TEMPERATURE:

THE CONTROLLER SHALL MONITOR THE SUPPLY AIR TEMPERATURE.

ALARMS SHALL BE PROVIDED AS FOLLOWS:
• HIGH SUPPLY AIR TEMP: IF THE SUPPLY AIR TEMPERATURE IS GREATER THAN 120°F (ADJ.).
• LOW SUPPLY AIR TEMP: IF THE SUPPLY AIR TEMPERATURE IS LESS THAN 40°F (ADJ.).

SUPPLEMENTAL HEATING - HIGH SUPPLY AIR TEMPERATURE LIMIT:
THE CONTROLLER SHALL MEASURE THE SUPPLY AIR TEMPERATURE AND, ON RISING TEMPERATURE, LIMIT THE SUPPLEMENTAL HEATING AS FOLLOWS:
• AS THE SUPPLY AIR TEMPERATURE RISES FROM 90°F TO 120°F (ADJ.), THE CONTROLLER SHALL LIMIT THE HEATING OUTPUT FROM 100% TO 0% (ADJ.).

GEOTHERMAL PLANT LOOP MONITOR AND PUMPS

WATER SOURCE HEAT PUMP LOOP MONITOR - RUN CONDITIONS:
THE LOOP MONITOR SHALL RUN WHENEVER:
• THE BUILDING IS IN OCCUPIED MODE.
• THE VENTILATION HEAT PUMP IS CALLING FOR HEATING OR COOLING.

THE FOLLOWING LOOP WATER CONDITIONS SHALL BE MONITORED:
• FLOW STATUS.
• SUPPLY TEMPERATURE.
• RETURN TEMPERATURE.

ALARMS AND A HEAT PUMP SHUTDOWN SIGNAL SHALL BE GENERATED UPON ANY OF THE FOLLOWING LOOP WATER CONDITIONS:
• NO LOOP FLOW.
• HIGH LOOP WATER SUPPLY TEMP SHUTDOWN: IF THE LOOP WATER SUPPLY TEMPERATURE IS GREATER THAN 92°F (ADJ.).
• LOW LOOP WATER SUPPLY TEMP SHUTDOWN: IF THE LOOP WATER SUPPLY TEMPERATURE IS LESS THAN 38°F (ADJ.).

LOOP WATER PUMP LEAD/LAG OPERATION:
THE TWO LOOP WATER PUMPS SHALL OPERATE IN A LEAD/LAG FASHION.
• THE LEAD PUMP SHALL RUN FIRST.
• ON FAILURE OF THE LEAD PUMP, THE LAG PUMP SHALL RUN AND THE LEAD PUMP SHALL TURN OFF.
• ON LOOP WATER RETURN TEMPERATURE BEING +2°F OUTSIDE OF RANGE, THE LAG PUMP SHALL STAGE ON AND RUN IN UNISON WITH THE LEAD PUMP TO MAINTAIN LOOP WATER RETURN TEMPERATURE SETPOINT.

THE DESIGNATED LEAD PUMP SHALL ROTATE UPON ONE OF THE FOLLOWING CONDITIONS (USER SELECTABLE):

• MANUALLY THROUGH A SOFTWARE SWITCH
• IF PUMP RUNTIME (ADJ.) IS EXCEEDED
• DAILY
• WEEKLY
• MONTHLY

ALARMS SHALL BE PROVIDED AS FOLLOWS FOR EACH PUMP:

• LOOP WATER PUMP
• FAILURE: COMMANDED ON, BUT THE STATUS IS OFF.
• RUNNING IN HAND: COMMANDED OFF, BUT THE STATUS IS ON.
• RUNTIME EXCEEDED: STATUS RUNTIME EXCEEDS A USER DEFINABLE LIMIT.
• VFD FAULT.

BYPASS VALVE:
A MODULATING 3-WAY, BYPASS CONTROL VALVE (FULL SIZED, BUTTERFLY STYLE), SHALL BE PROVIDED IN THE FULL SIZED LOOP FIELD BYPASS. THE VALVE AND PUMPS WILL BE PROGRAMMED TO OPERATE ACCORDING TO THE FOLLOWING SCHEDULE:

LOOP RETURN TEMPERATURE

VALVE POSITION (% OPEN TO BYPASS (ADJ.))

PUMP SPEED (ADJ.)

≤ 40 F

0%

100%

41 TO 50 F

50%

75%

51 TO 70 F

100%

30%

71 TO 79 F

50%

75%

≥ 80 F

0%

100%

CONTACT MARTY PAUP AT CONTROL SYSTEM SPECIALISTS, LC
(712)299-5861
MPAUP@CSSHVAC.COM
ABB CONTROLS (CYLON AUTOMATRIX)

SHIVEHATTERY
ARCHITECTURE+ENGINEERING

222 Third Avenue SE Suite 300 | Cedar Rapids, Iowa 52401
319.364.0227 | fax 319.364.4251 | www.shive-hattery.com
Iowa | Illinois | Indiana | Nebraska | Wisconsin

JOHNSON COUNTY CONSERVATION BOARD


PROJECT NO.: 4217340

ISSUED FOR BID


08/01/2022

SHEET NAME: SHOWER HOUSE MECHANICAL SCHEDULES


SHEET NO.: X1.03

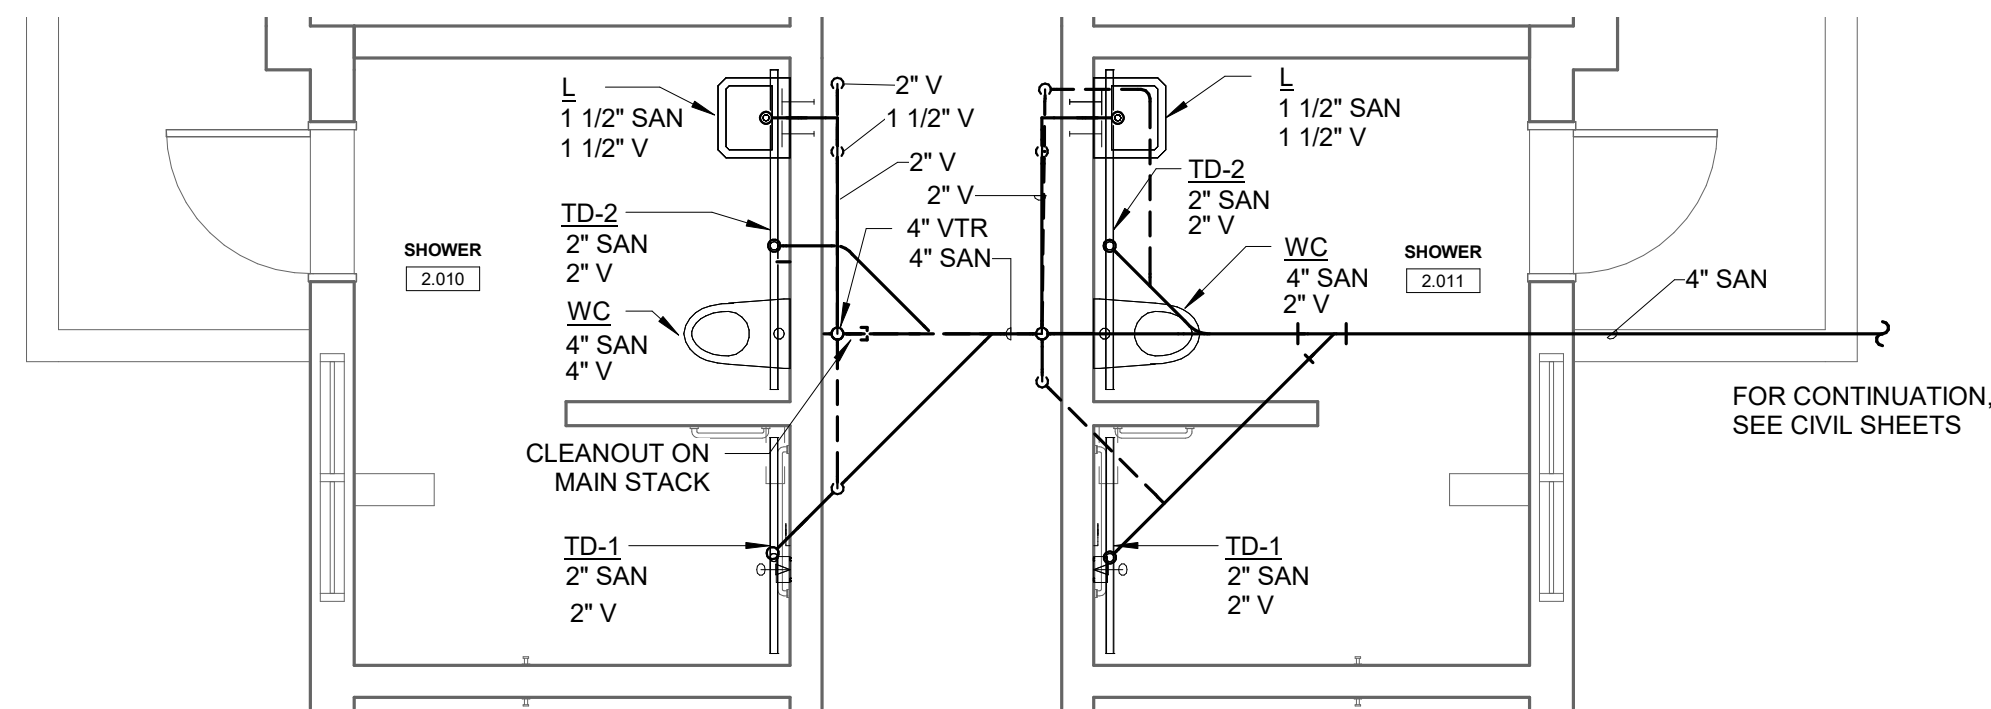


5 TYPICAL RESTROOM LAYOUT
1/4" = 1'-0"

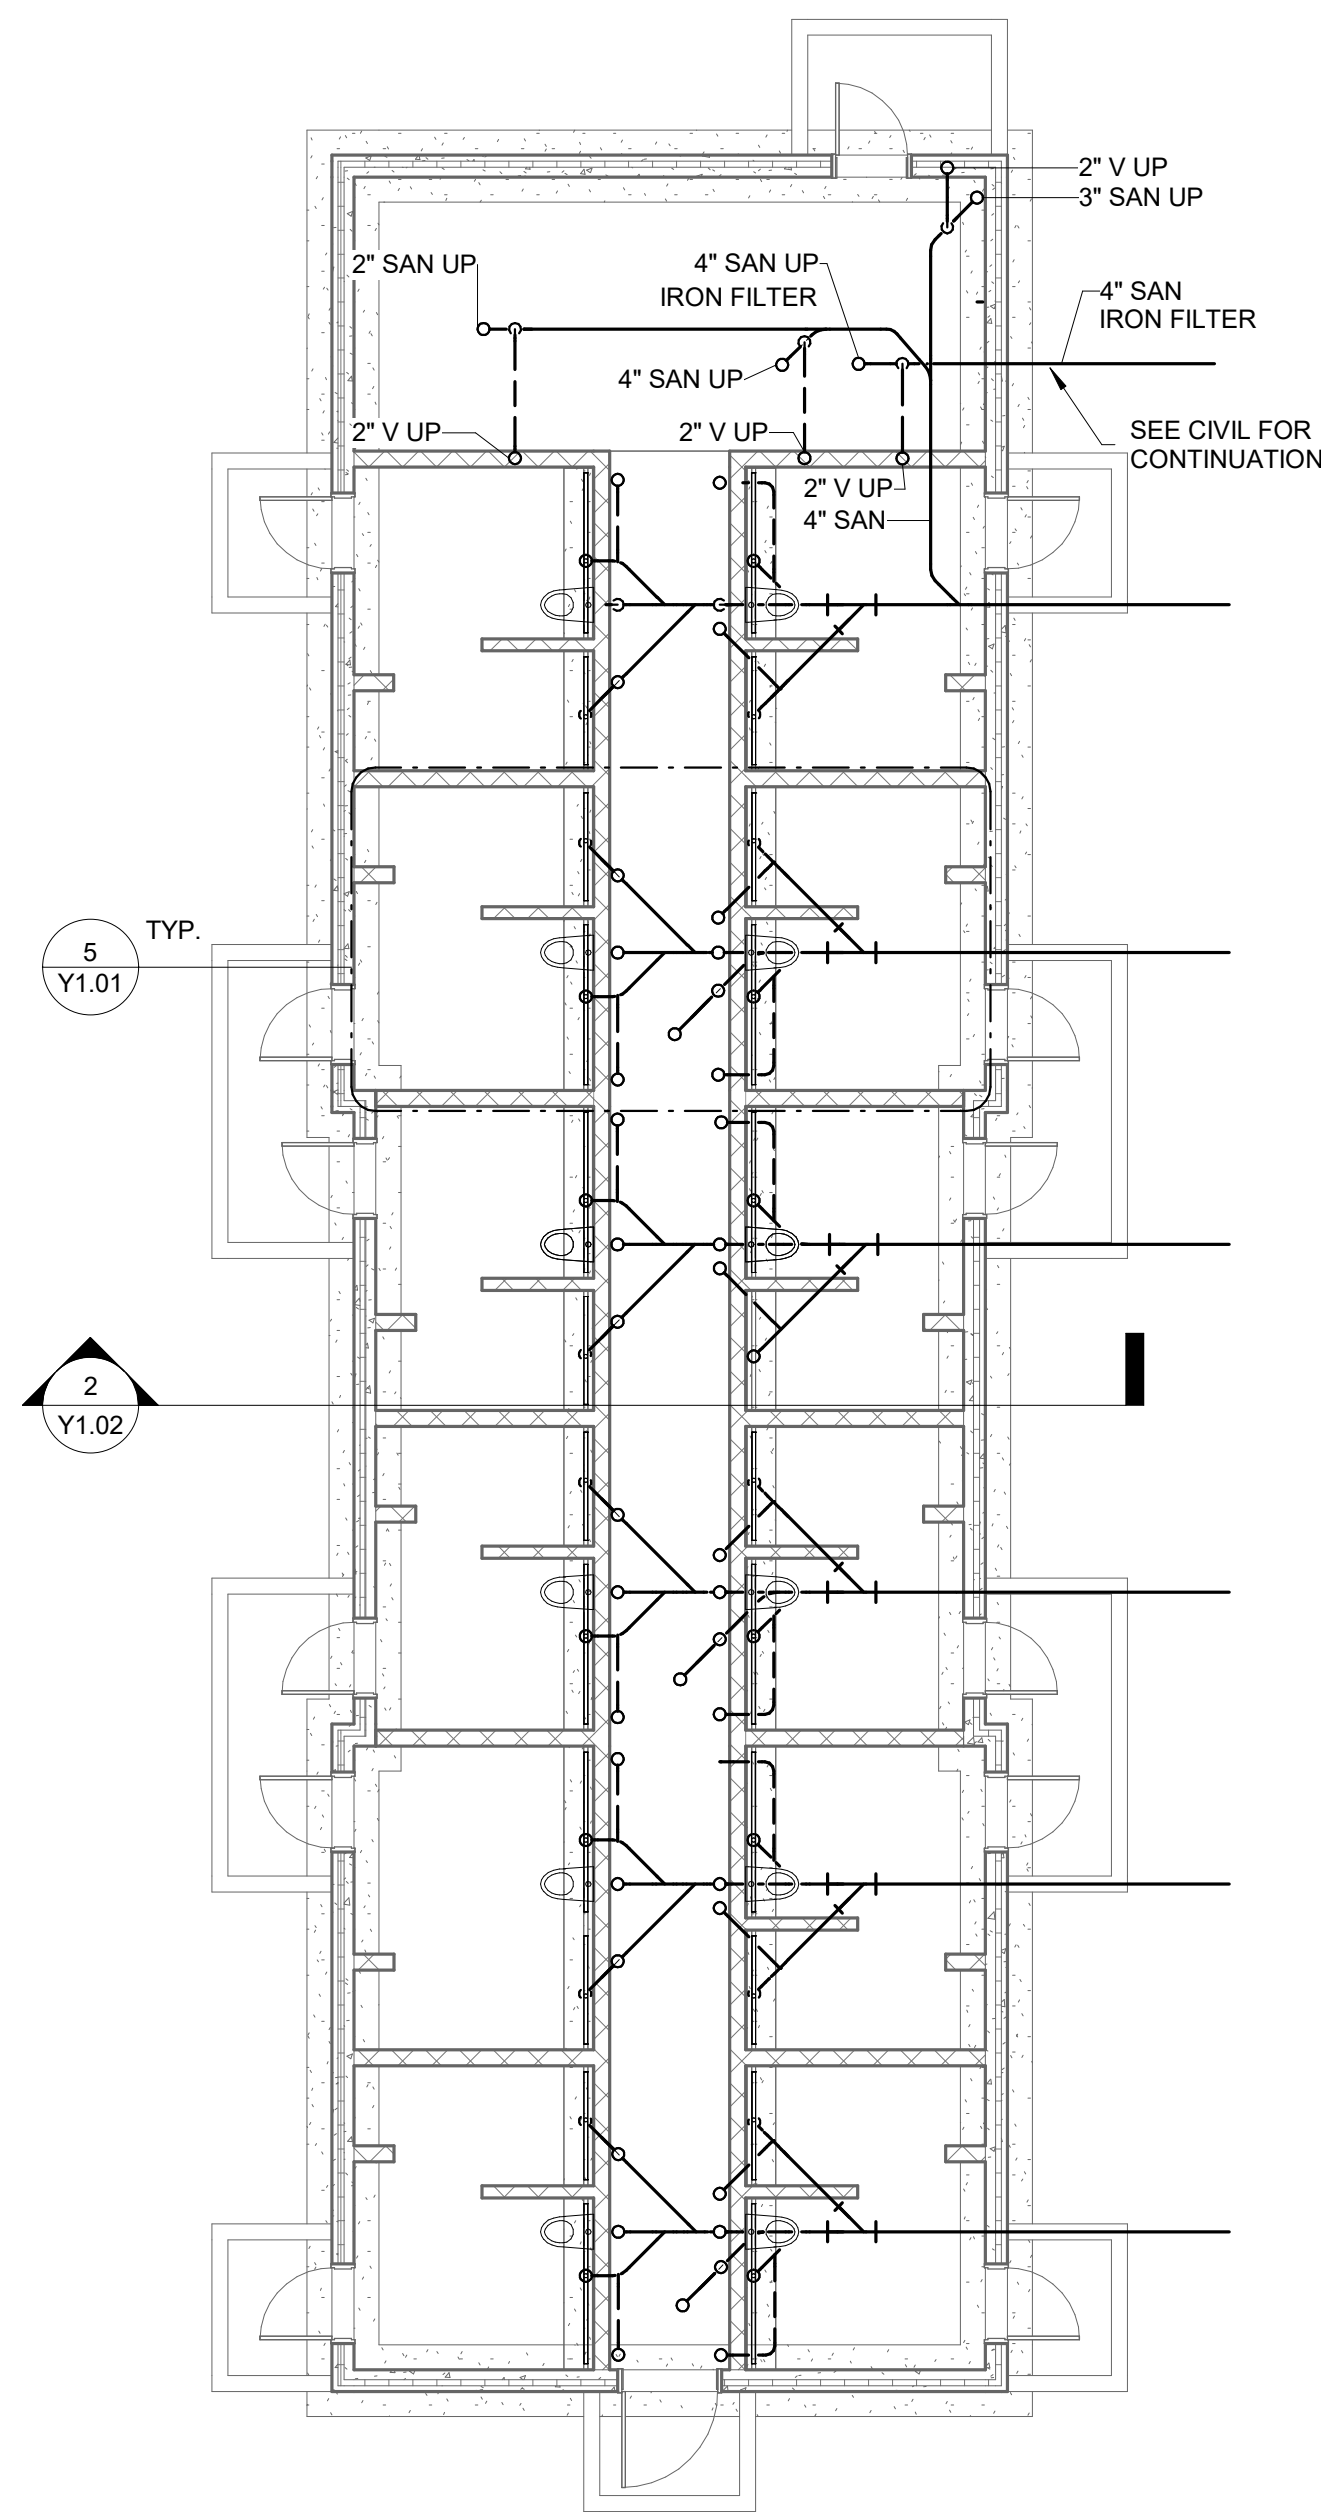


2 SHOWER HOUSE UNDERFLOOR WASTE AND VENT PLAN
1/8" = 1'-0" 0 12'

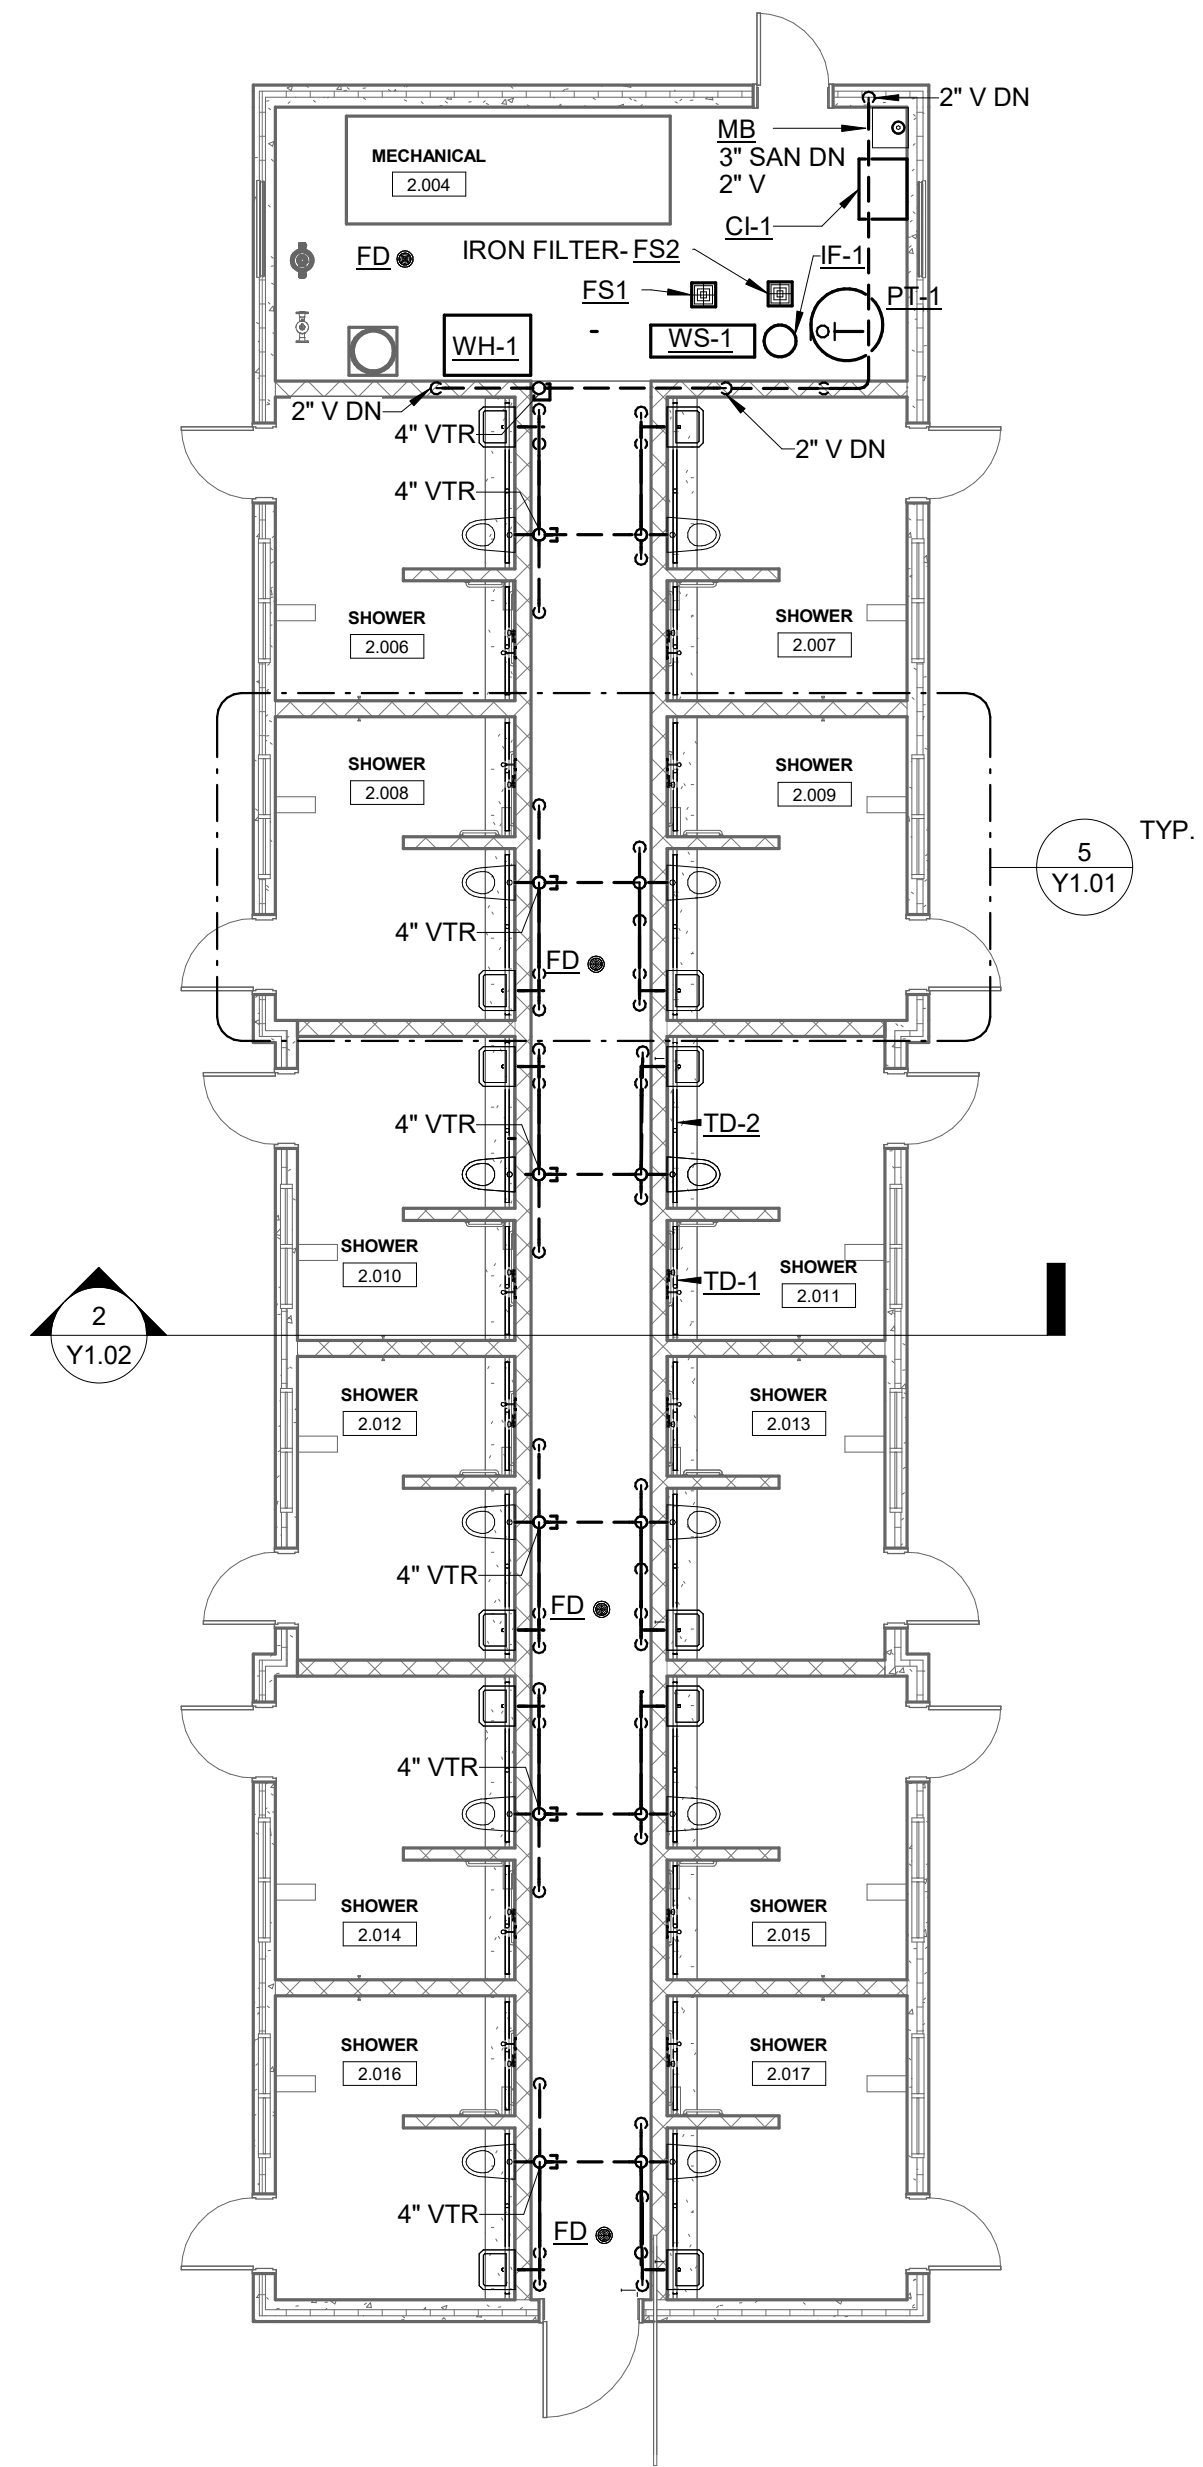



1 SHOWER HOUSE WASTE AND VENT PLAN
1/8" = 1'-0" 0 12'

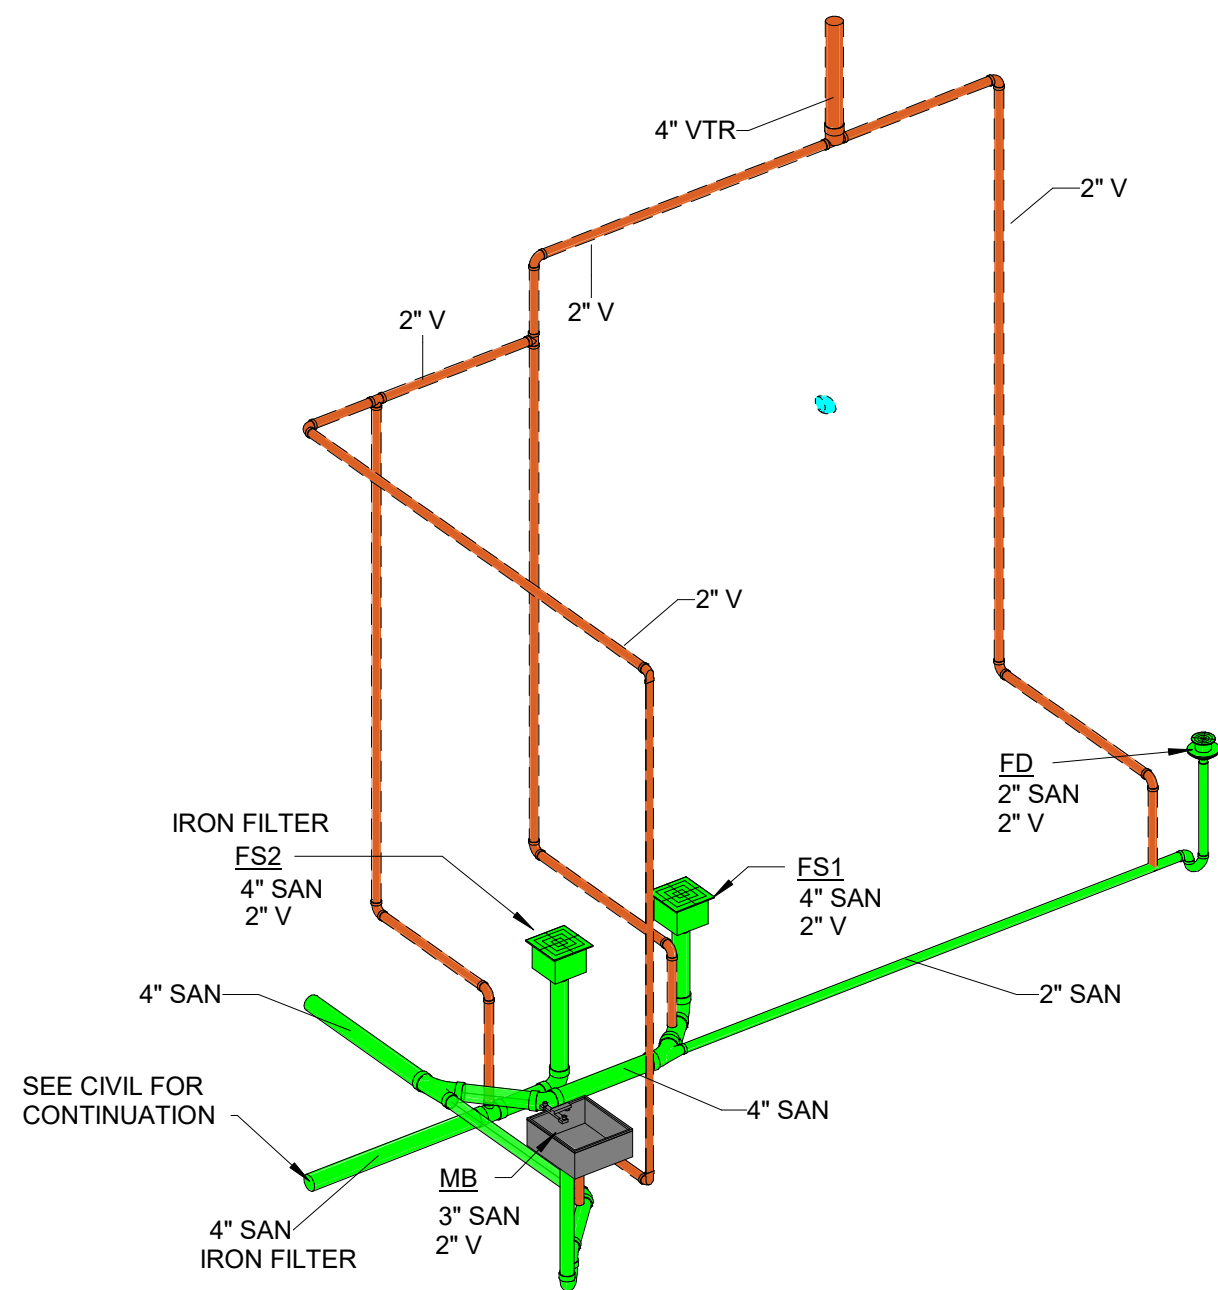


4 MECHANICAL ROOM SANITARY WASTE AND VENT ISOMETRIC

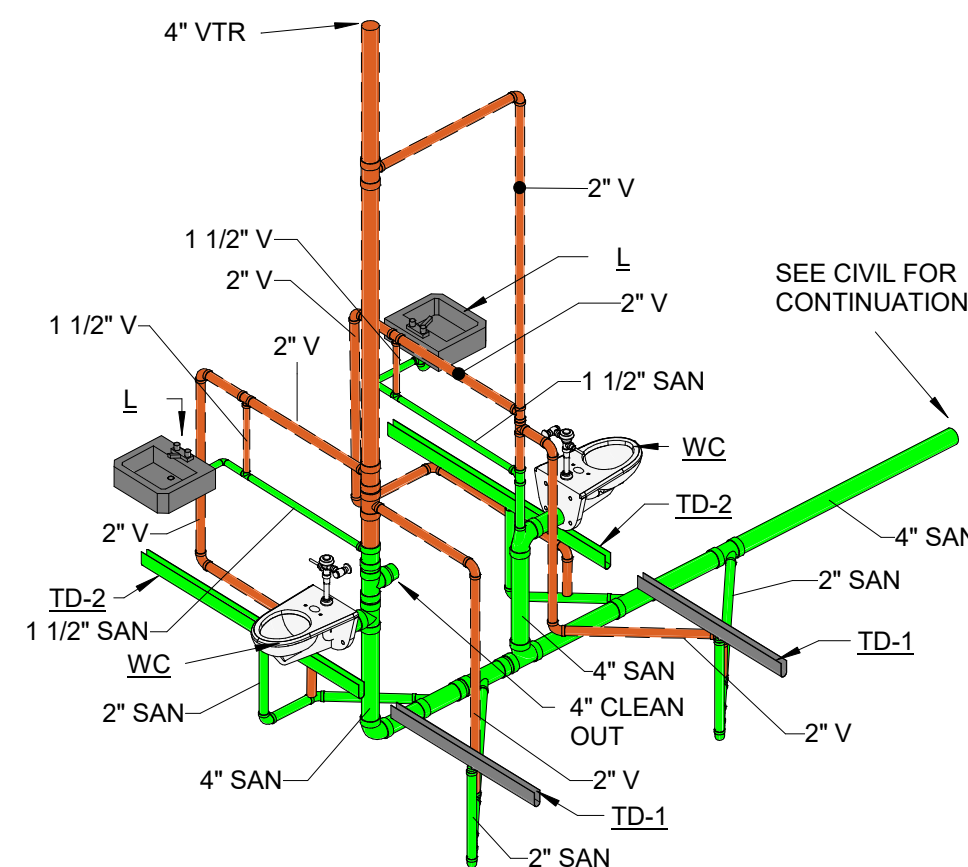


3 TYPICAL RESTROOM SANITARY WASTE AND VENT ISOMETRIC




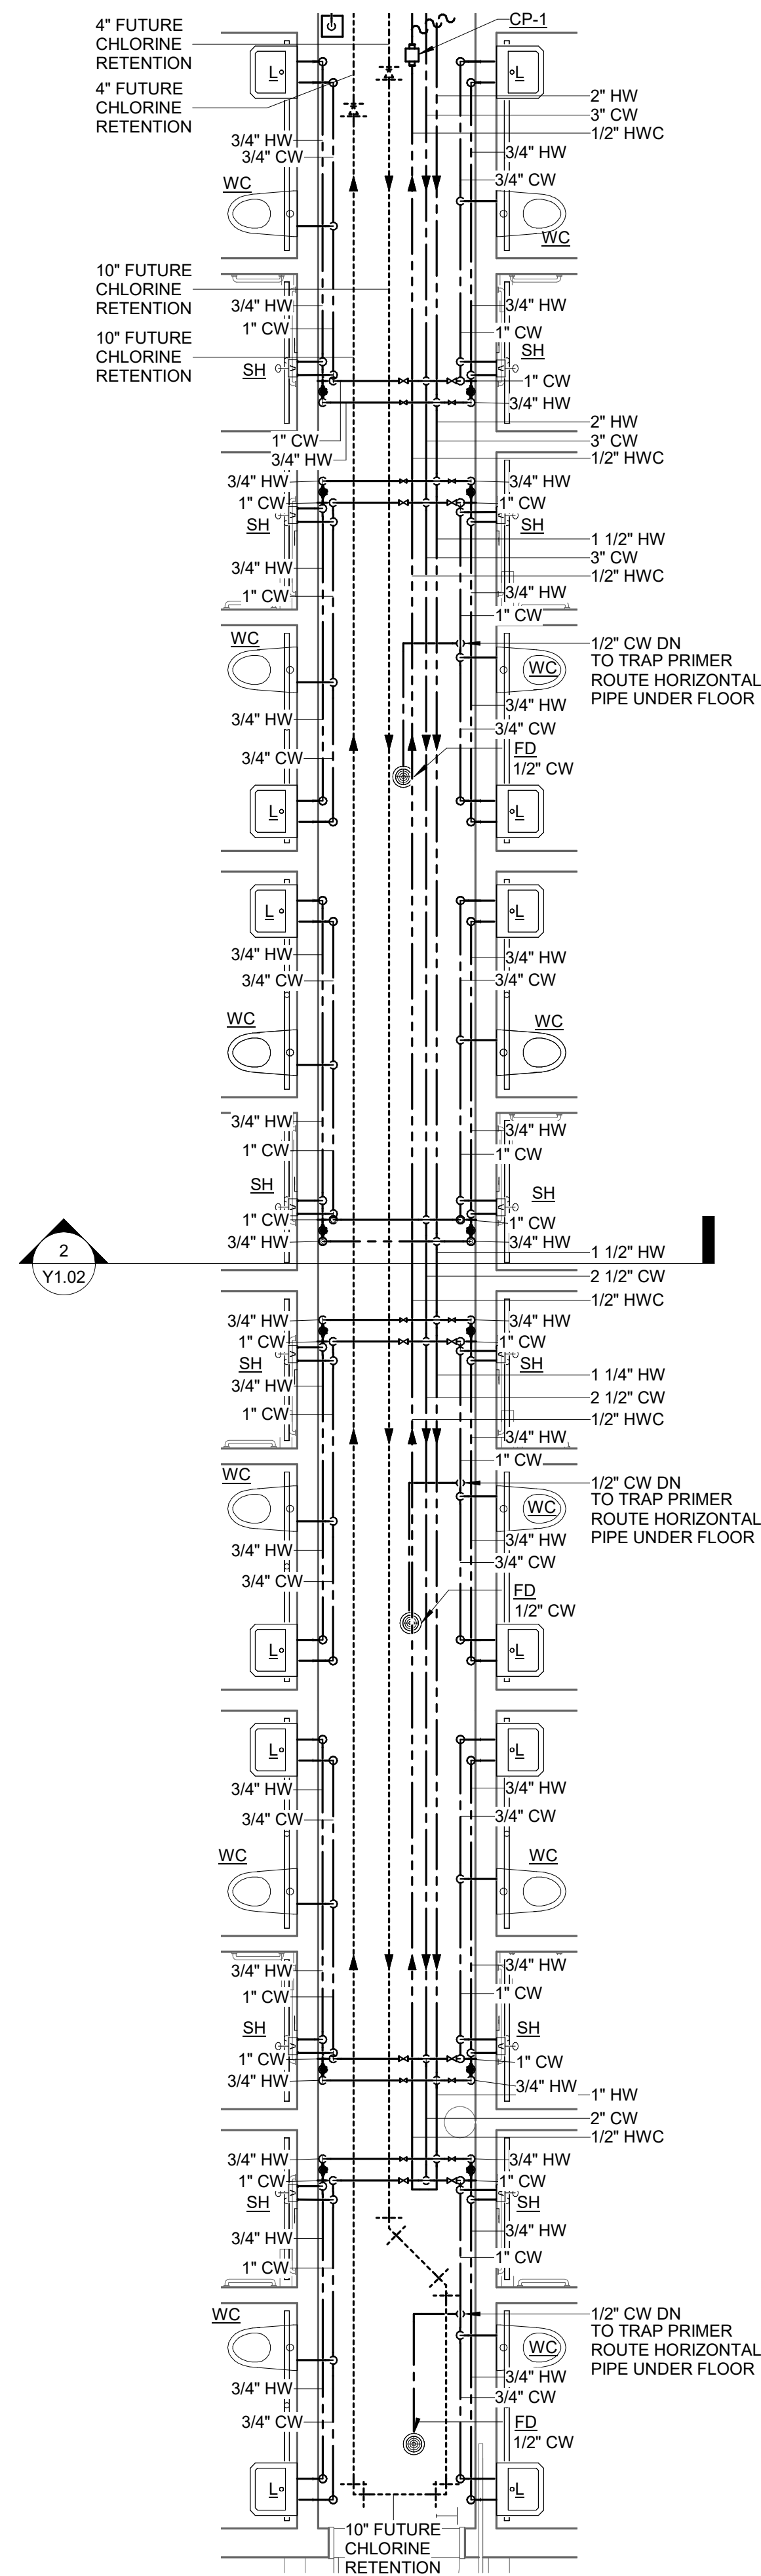


6 ENLARGED DOMESTIC CHASE PLAN
1/4" = 1'-0"

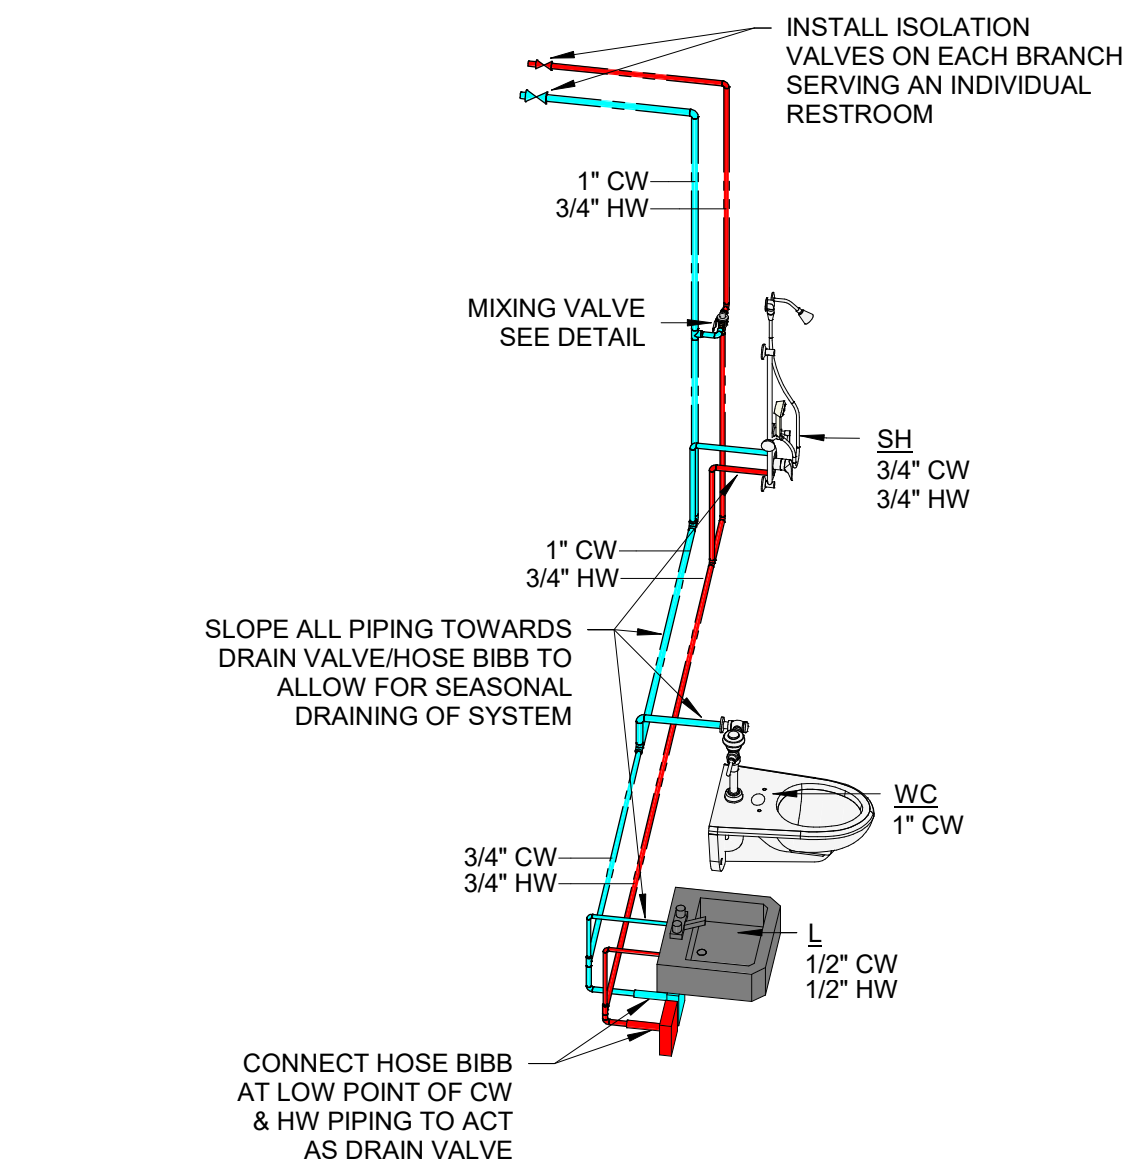


5 TYPICAL RESTROOM DOMESTIC WATER ISOMETRIC

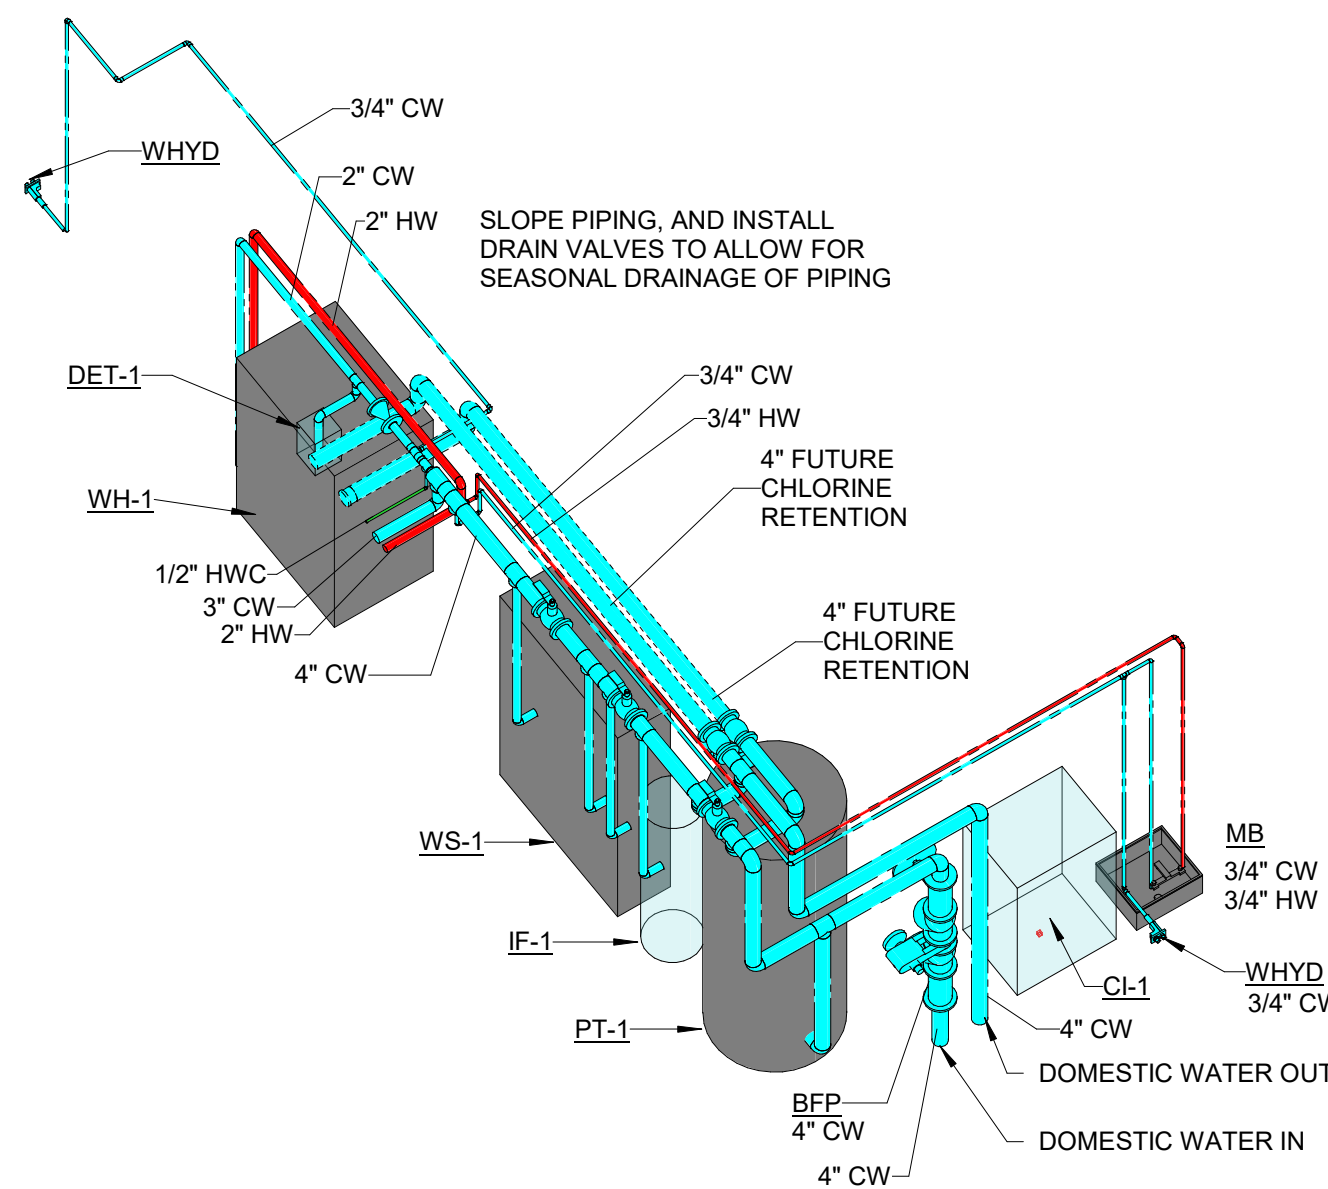


4 MECHANICAL ROOM DOMESTIC WATER ISOMETRIC

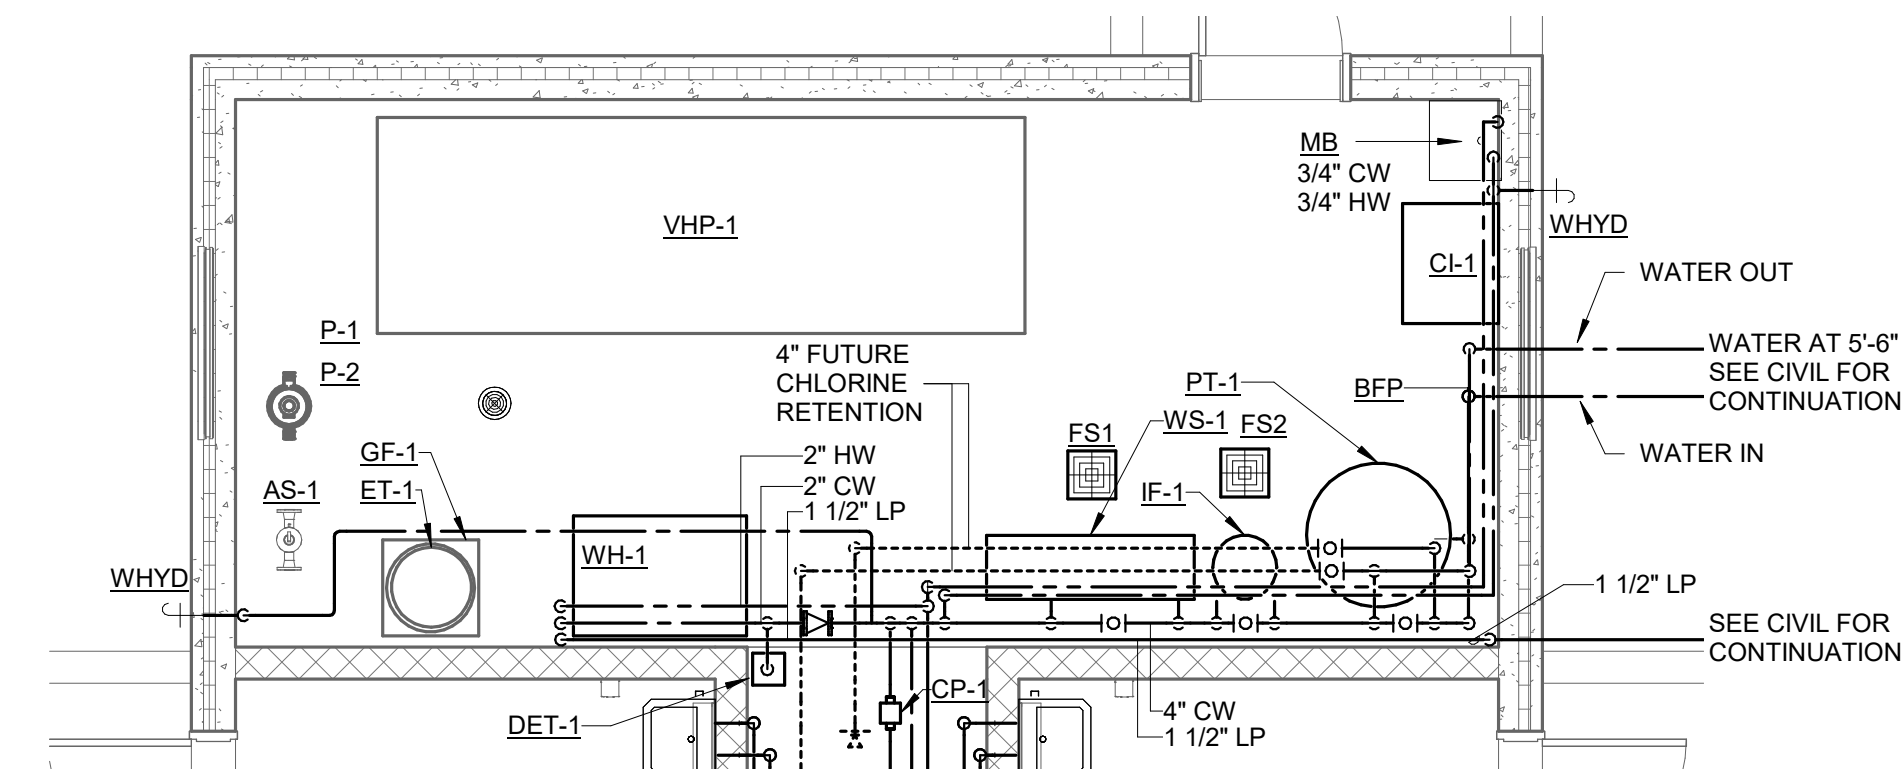

3 ENLARGED MECHANICAL ROOM PLUMBING PLAN
1/4" = 1'-0"

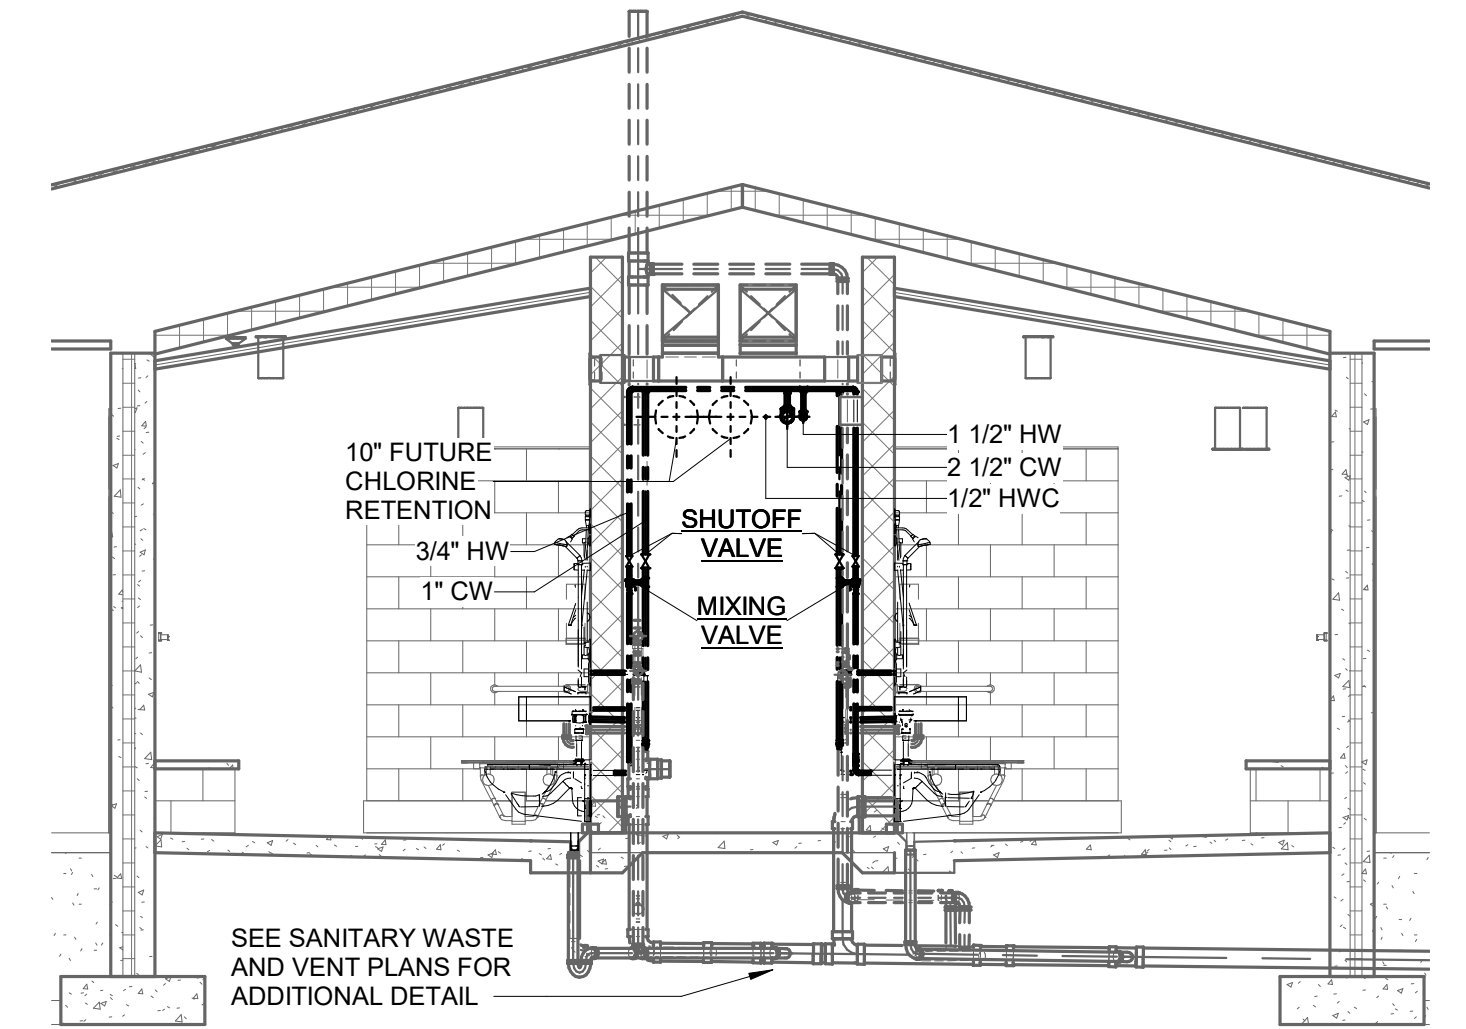

2 PLUMBING CHASE SECTION
1/4" = 1'-0"

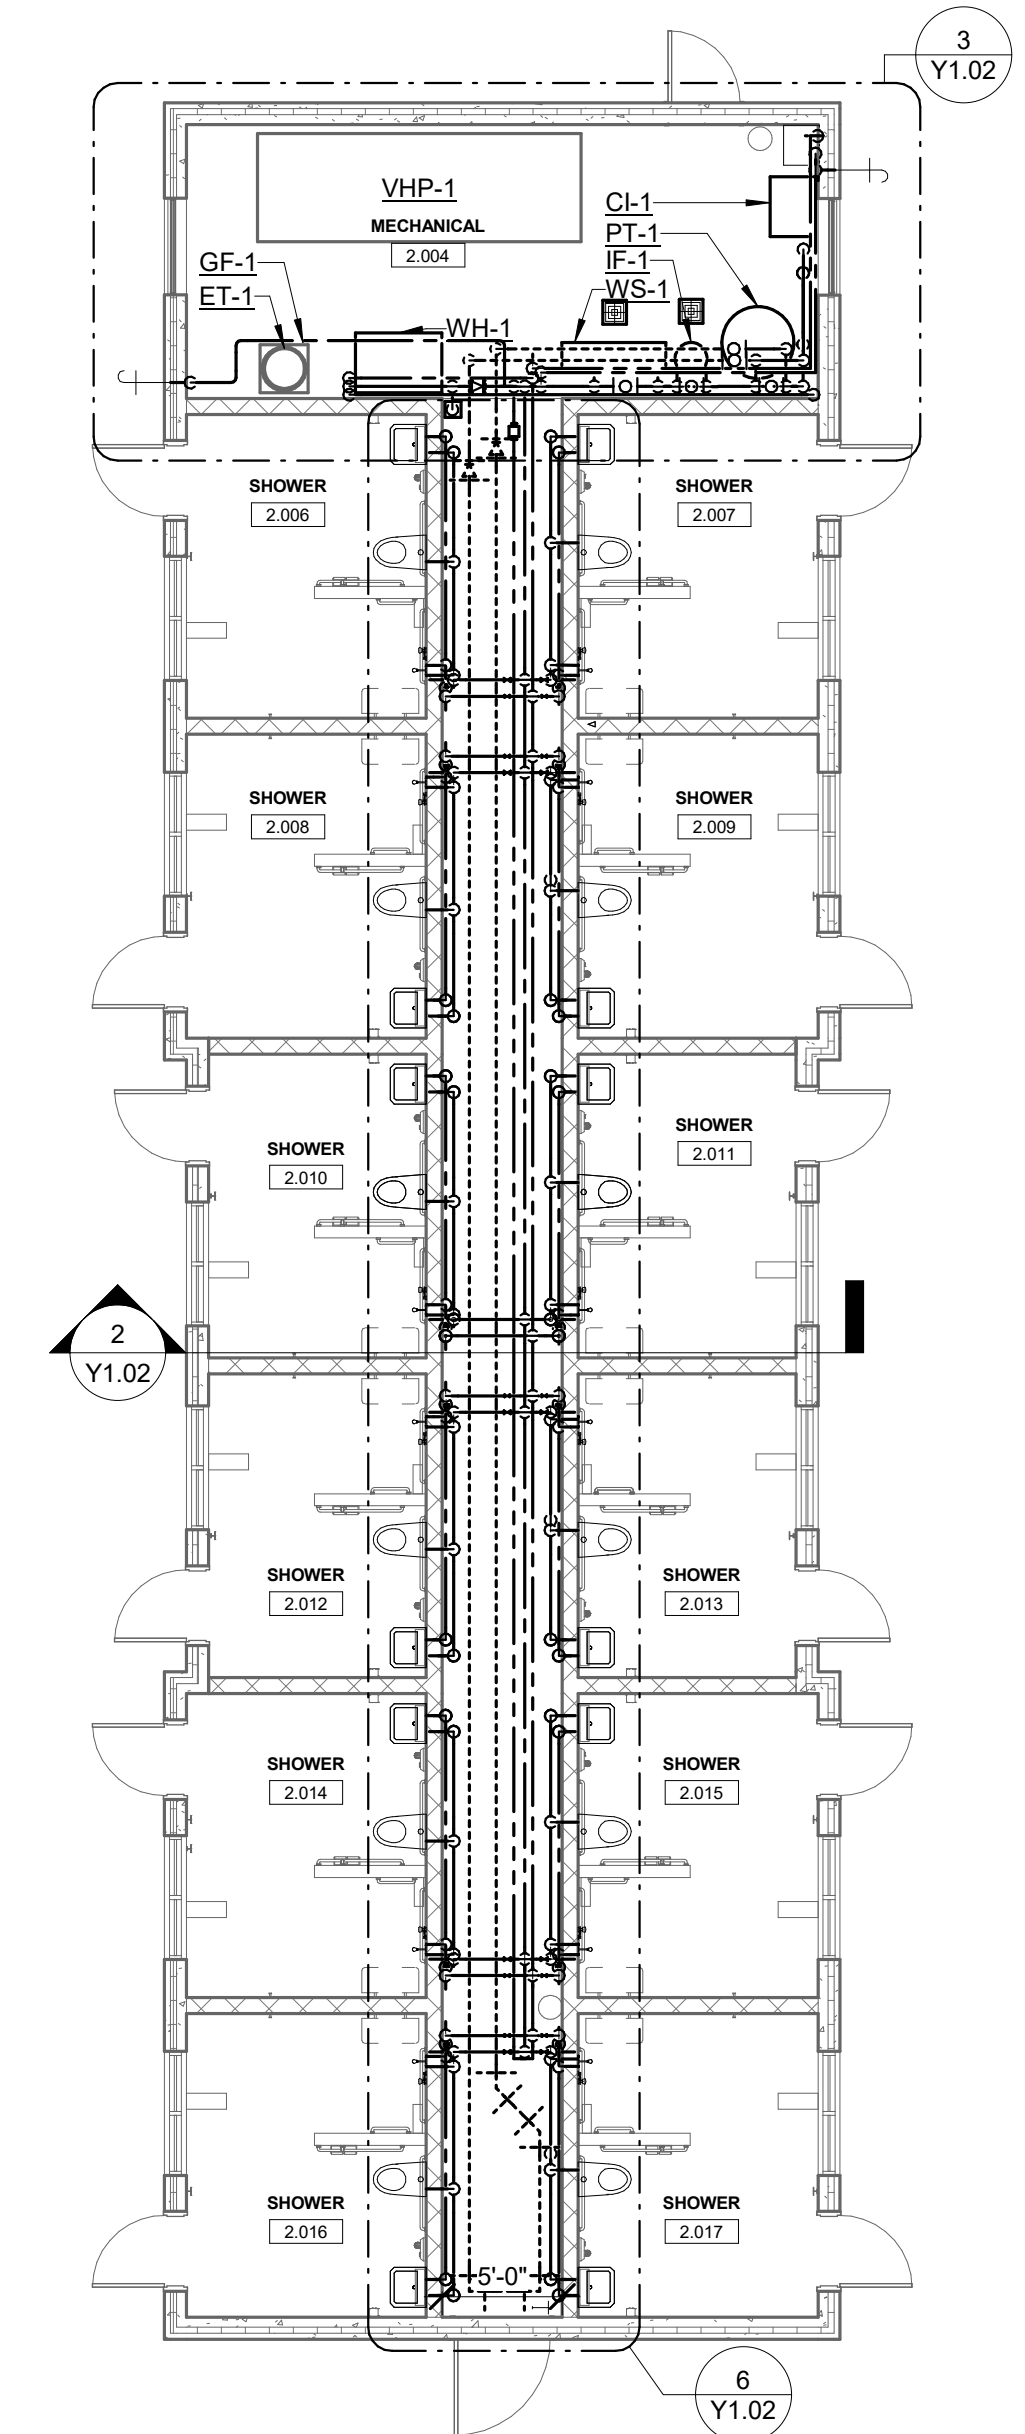

1 SHOWER HOUSE DOMESTIC WATER PLAN
1/8" = 1'-0"

PLUMBING PUMP SCHEDULE											
PLAN MARK	SYSTEM SERVED	TYPE	GPM	HEAD (FT.)	SHUTOFF HEAD (FT.)	MOTOR DATA				DESIGN BASIS	REMARKS
						HP	VOLTS	PHASE	RPM		
CP-1	DOMESTIC HOT WATER	IN-LINE	1.1	5.0	8.1	1/40	120 V	1	3250	TACO IL006-BVS	

PROPANE WATER HEATER SCHEDULE											
PLAN MARK	SYSTEM WATER			PROPANE		THERMAL EFFICIENCY(%)	AMPS	VOLTS	PHASE	DESIGN BASIS	REMARKS
	GPM (MAX)	IN	OUT	BTU INPUT	PRESSURE (INCH WC)						
WH-1	21.9	55 °F	140 °F	1,000,000	2.5-14	93.2	13 A	120 V	1	INTELLIHEAT IQ1000	PROPANE FIRED

DOMESTIC WATER PRESSURE TANK SCHEDULE						
PLAN MARK	SYSTEM SERVED	TYPE	TANK CAPACITY (GAL)	ACCEPTANCE CAPACITY (GAL)	DESIGN BASIS	REMARKS
PT-1	DOMESTIC WATER	DIAPHRAGM	317.0 gal	317.0 gal	AMTROL WX-424	

DOMESTIC HOT WATER EXPANSION TANK SCHEDULE							
MARK	SYSTEM SERVED	TYPE	TANK CAPACITY (GAL)	ACCEPTANCE CAPACITY (GAL)	RELIEF VALVE		DESIGN BASIS
					RELIEF AT (PSI)	FILL AT (PSI)	
DET-1	DOMESTIC WATER	IN-LINE DIAPHRAGM	2.0	0.9	75.00	20.00	AMTROL ST-5C-DD

IRON FILTER SCHEDULE






REMARKS:
1. TO PERMIT THE OBSERVATION OF THE DRAIN FLOW, DO NOT MAKE A DIRECT CONNECTION TO THE DRAIN. PROVIDE AN AIR GAP OF AT LEAST FOUR TIMES THE DIAMETER OF THE DRAIN PIPE OR CONFORM TO LOCAL SANITATION CODES.
2. SYSTEM USES FRP TANKS WHICH MUST NOT BE SUBJECTED TO VACUUM. INSTALL SIPHON BREAK ON DRAIN LINE. INSTALL VACUUM BREAKER ON INLET PIPING IF THE SERVICE LINE IS SUBJECT TO A VACUUM.



MARK	FLOW RATES				DRAIN FLOW (GPM)	DESIGN BASIS	REMARKS
	CONTINUOUS		PEAK				
	GPM	WPD (PSI)	GPM	WPD (PSI)			
IF-1	24	8.00	36	13.00	30	CULLIGAN HE DF-21	XXX

WATER SOFTENER SCHEDULE						
1. TO PERMIT THE OBSERVATION OF THE DRAIN FLOW, DO NOT MAKE A DIRECT CONNECTION TO THE DRAIN. PROVIDE AN AIR GAP OF AT LEAST FOUR TIMES THE DIAMETER OF THE DRAIN PIPE OR CONFORM TO LOCAL SANITATION CODES. 2. SYSTEM USES FRP TANKS WHICH MUST NOT BE SUBJECTED TO VACUUM. INSTALL SIPHON BREAK ON DRAIN LINE. INSTALL VACUUM BREAKER ON INLET PIPING IF THE SERVICE LINE IS SUBJECT TO A VACUUM.						
PLAN MARK	UNIT PER TANK			DRAIN FLOW (GPM)	DESIGN BASIS	REMARKS
	MAX. CAPACITY KGR @ SALT DOSAGE	RESIN VOLUME	CONTINUOUS FLOW @ 15 PSI DROP			
WS-1	60 @ 30	2.1 ft³	25.1 GPM	31.5 GPM	CULLIGAN HET-060	


CHLORINE INJECTION SCHEDULE							
MARK	FLOW RATES				MAX WORKING PRESSURE (PSI)	DESIGN BASIS	REMARKS
	CONTINUOUS		PEAK				
	GPM	WPD (FT)	GPM	WPD (FT)			
CI-1	--	--	--	--	--	--	FUTURE EQUIPMENT NOT IN CONTRACT

PLUMBING FIXTURE AND ROUGH-IN SCHEDULE						
MARK	DESCRIPTION	FIXTURE ROUGH-IN PIPE SIZE				SPECIFICATION
		CW	HW	WASTE	VENT	
FS1	FLOOR SINK	N/A	N/A	4	2	4" ZURN Z-1901 SERIES, 12"x12"x8" DEEP, CAST IRON, MEMBRANE CLAMP, BOTTOM CAULK, OUTLET, PROVIDE WHITE ACID RESISTING ENAMEL GRATE, INTERIOR, AND DOME STRAINER. REMOVE PORTION OF GRATES OR PROVIDE PARTIAL GRATES AS REQUIRED TO ACCOMMODATE FINAL LOCATION OF PIPING DISCHARGING OVER DRAINS. SET TOP FLUSH WITH FINISHED FLOOR. PROVIDE DEEP SEAL P-TRAP
FS2	FLOOR SINK	N/A	N/A	4	2	4" ZURN Z-1901 SERIES, 12"x12"x8" DEEP, CAST IRON, MEMBRANE CLAMP, BOTTOM CAULK OUTLET, PROVIDE WHITE ACID RESISTING ENAMEL GRATE, INTERIOR, AND DOME STRAINER. REMOVE PORTION OF GRATES OR PROVIDE PARTIAL GRATES AS REQUIRED TO ACCOMMODATE FINAL LOCATION OF PIPING DISCHARGING OVER DRAINS. SET TOP 1" ABOVE FINISHED FLOOR. PROVIDE DEEP SEAL P-TRAP
WHYD	WALL HYDRANT	3/4"	N/A	N/A	N/A	WOODFORD MODEL 65, AUTOMATIC DRAINING, FREEZELESS WALL HYDRANT, VACUUM BREAKER, 3/4" HOSE THREAD OUTLET, FITS ONE STANDARD BRICK COURSE, CHROME PLATED, STAINLESS STEEL OPERATING STEM, 3/4" INLET, LENGTH AS REQUIRED TO PLACE STOP VALVE ON WARM SIDE OF EXTERIOR WALL, INSULATION, FURNISH LOOSE KEY WITH EACH HYDRANT. MOUNT HORIZONTALLY AT 18" ABOVE FINISHED GRADE. COORDINATE EXACT HEIGHT WITH BRICK COURSING
WC	WALL HUNG ADA WATER CLOSET, MANUAL FLUSHOMETER	1"	N/A	4"	2"	WALL HUNG, FLUSH VALVE, ADA WATER CLOSET (KOHLER K4325-0), 1.28 GPF, WHITE VITREOUS CHINA, WITH CHAIR CARRIER, TOP OF RIM AT 17" AFF, PROVIDE HEAVY DUTY OPEN FRONT SEAT, LESS COVER (BEMIS 1955SSCT), PROVIDE MANUAL 1.28 GPF WATER CLOSET FLUSHOMETER (SLOAN 111-1.28).
L	WALL HUNG ADA LAVATORY	1/2"	1/2"	1 1/2"	1 1/2"	WALL HUNG ADA LAVATORY (KOHLER K2005-0) 3 FAUCET HOLES ON 4" CENTERS, MANUAL FAUCET (DELTA 2529LF-HDF), TRIM PLATE, AND GRID DRAIN, PROVIDE WITH TMV SET TO DELIVER A MIXED HOT WATER TEMPERATURE OF 105°F. PROVIDE WITH OFFSET TALPEICE, TRAP, ANGLE STOPS AND TRUBRO LAV GUARD 2.
SH	ADA SHOWER WITH HAND WAND AND SELECTOR	1/2"	1/2"	NA	NA	DELTA FAUCET MODEL NO. T13H332, DUAL SHOWER UNIT, PRESSURE BALANCE, SINGLE LEVER MIXING VALVE WITH INTEGRAL STOPS, REQUIRES R10000-UJWS ROUGH-IN VALVE BODY, DIVERTER VALVE, STAINLESS STEEL GRAB BAR WITH HANDSHOWER AND 69" LONG HOSE, 1.5 GPM SHOWERHEAD, ARM AND FLANGE, VALVE SET TO DELIVER A MAXIMUM HOT WATER TEMPERATURE OF 110°F.
MB	MOLDED STONE MOP BASIN	3/4"	3/4"	3"	2"	MOLDED STONE MOP BASIN (FIAT MSB2424) WITH INTEGRAL 3" DRAIN AND GRID, PROVIDE WITH WALL MOUNTED FAUCET WITH MOP HOOK AND WALL BRACE WITH EXPOSED PIPE CONNECTION (CHICAGO FAUCETS 835-RCF), PROVIDE WITH CORNER BUMPERS, STAINLESS STEEL SPLASH GUARDS, AND TOOL CLIPS FOR CORNER INSTALLATION.
BFP	BACKFLOW PREVENTOR	4"	N/A	N/A	N/A	WATTS, 994 SERIES, FULL LINE SIZE, REDUCED PRESSURE PRINCIPLE BACKFLOW PREVENTER, LIGHTWEIGHT STAINLESS STEEL BODY, STAINLESS STEEL RELIEF VALVE, TWO INDEPENDENTLY OPERATING CHECK VALVES SEPARATED BY A RELIEF VALVE, BALL VALVE TEST COCKS, ASSE STANDARD 1013, CSA B84.5 COMPLIANT. PROVIDE WATTS DRAIN CONNECTION WITH AIR GAP. PROVIDE WATTS FLOOD PROTECTION AUTOMATIC SHUTDOWN VALVE AND CONTROLS.
HB	KEY OPERATED HOSE BIBB	3/4"	N/A	N/A	N/A	WALL MOUNTED HOSE BIBB WITH HALF-TURN LOOSE KEY HANDLE (WOODFORD 40HT), ASSE 1011 34HF VACUUM BREAKER, POLISHED CHROME, ADJUSTABLE WALL FLANGE
TD-1	2" POLYMER TRENCH DRAIN	N/A	N/A	2"	SEE PLANS	2 1/2" WIDE, 54" LENGTH, HIGH DENSITY POLYETHYLENE TRENCH DRAIN SYSTEM WITH OPTIONAL BOTTOM/SIDE/END OUTLET. PROVIDE WITH REMOVABLE DECORATIVE GRATE (ZURN Z880)
TD-2	2" POLYMER TRENCH DRAIN	N/A	N/A	2"	SEE PLANS	2 1/2" WIDE, 80" LENGTH, HIGH DENSITY POLYETHYLENE TRENCH DRAIN SYSTEM WITH OPTIONAL BOTTOM/SIDE/END OUTLET. PROVIDE WITH REMOVABLE DECORATIVE GRATE (ZURN Z880)
FD	ROUND FLOOR DRAIN	N/A	N/A	2"	SEE PLANS	FLOOR DRAIN, ADJUSTABLE HEIGHT, 8" ROUND STRAINER, CAST IRON BODY AND POLISHED NICKEL BRONZE STRAINER (ZURN Z415B), PROVIDE WITH TRAP PRIMER CONNECTION WHERE SHOWN.

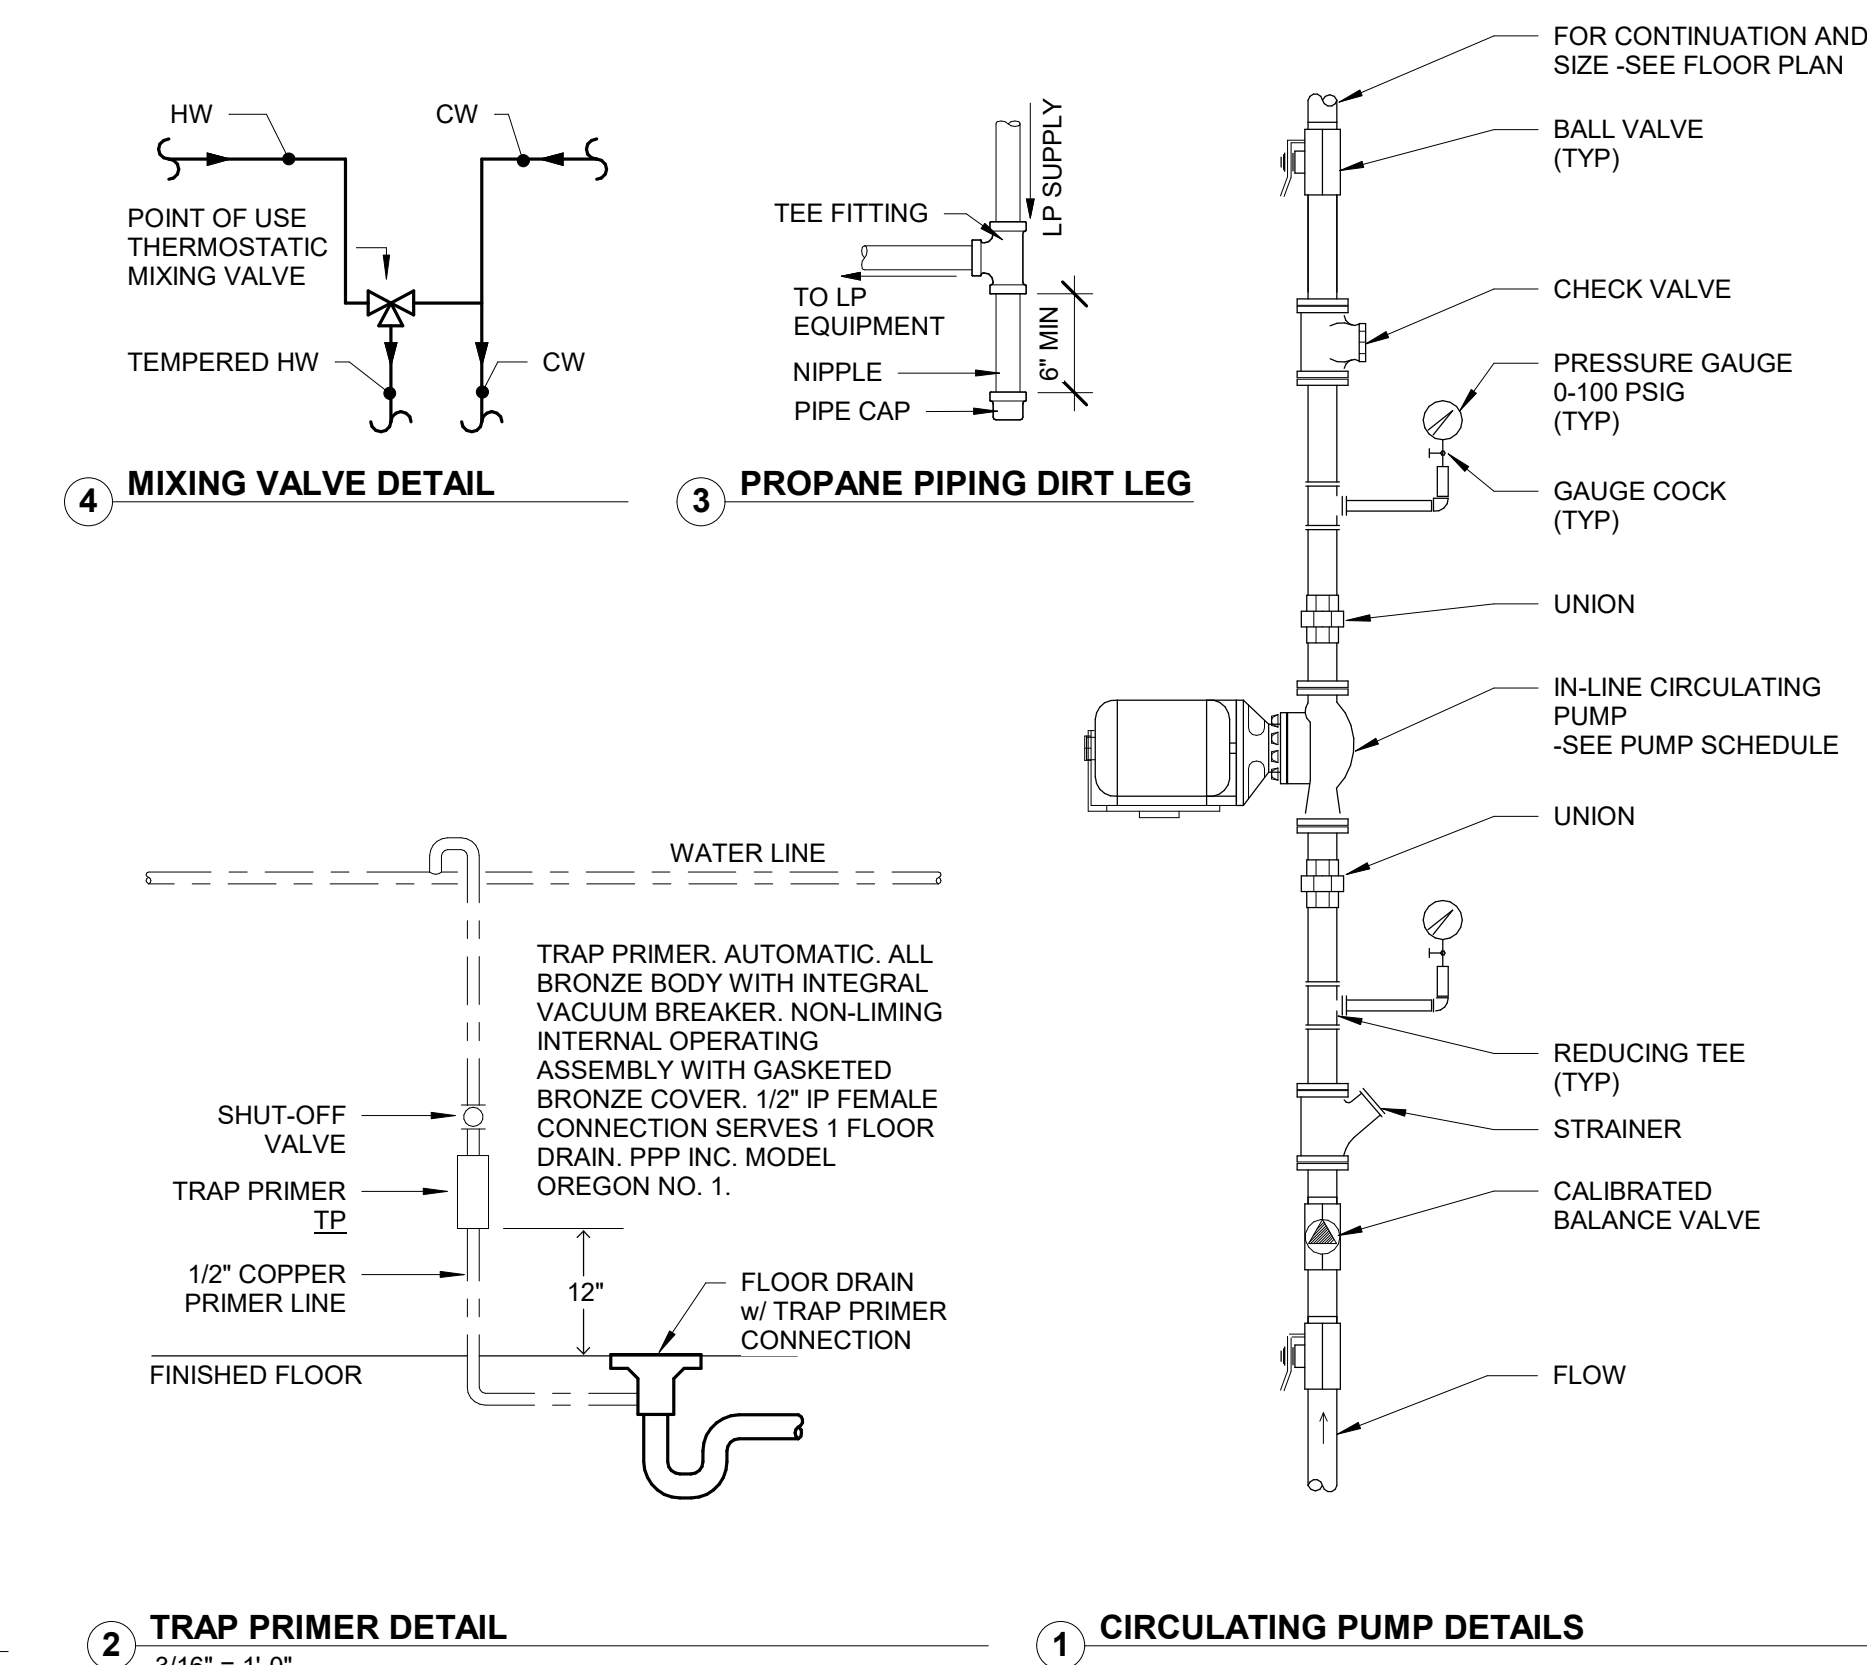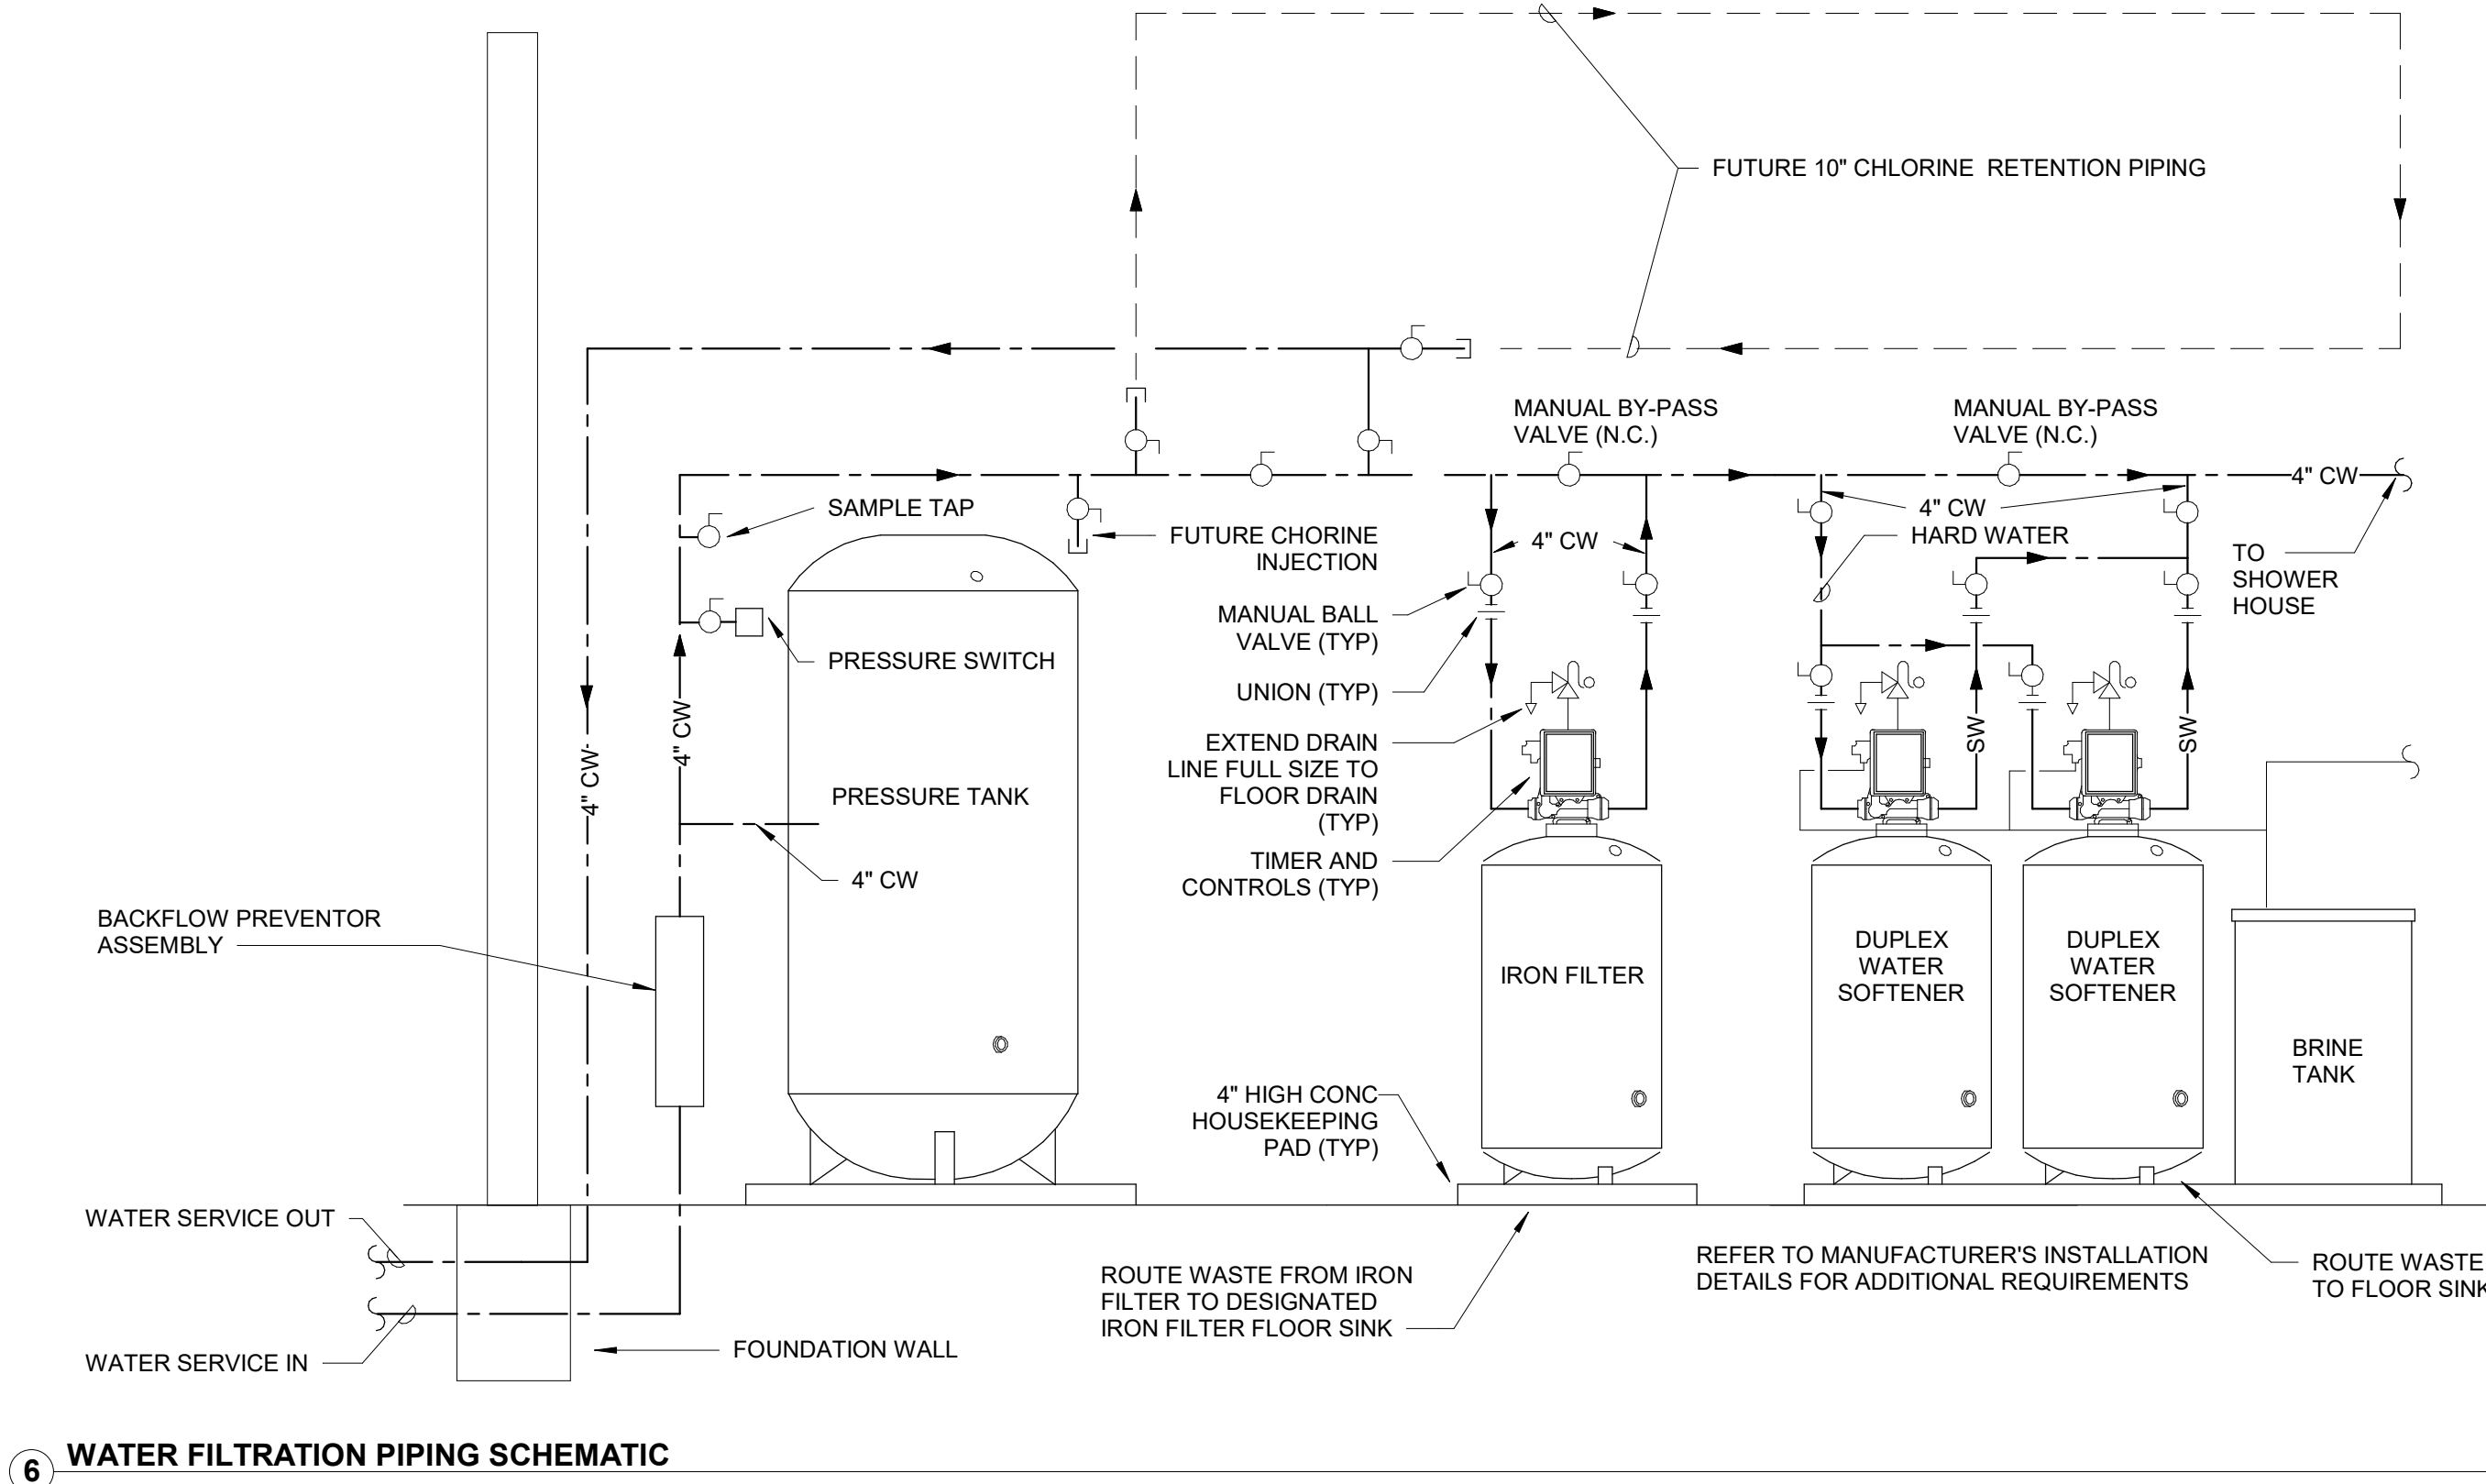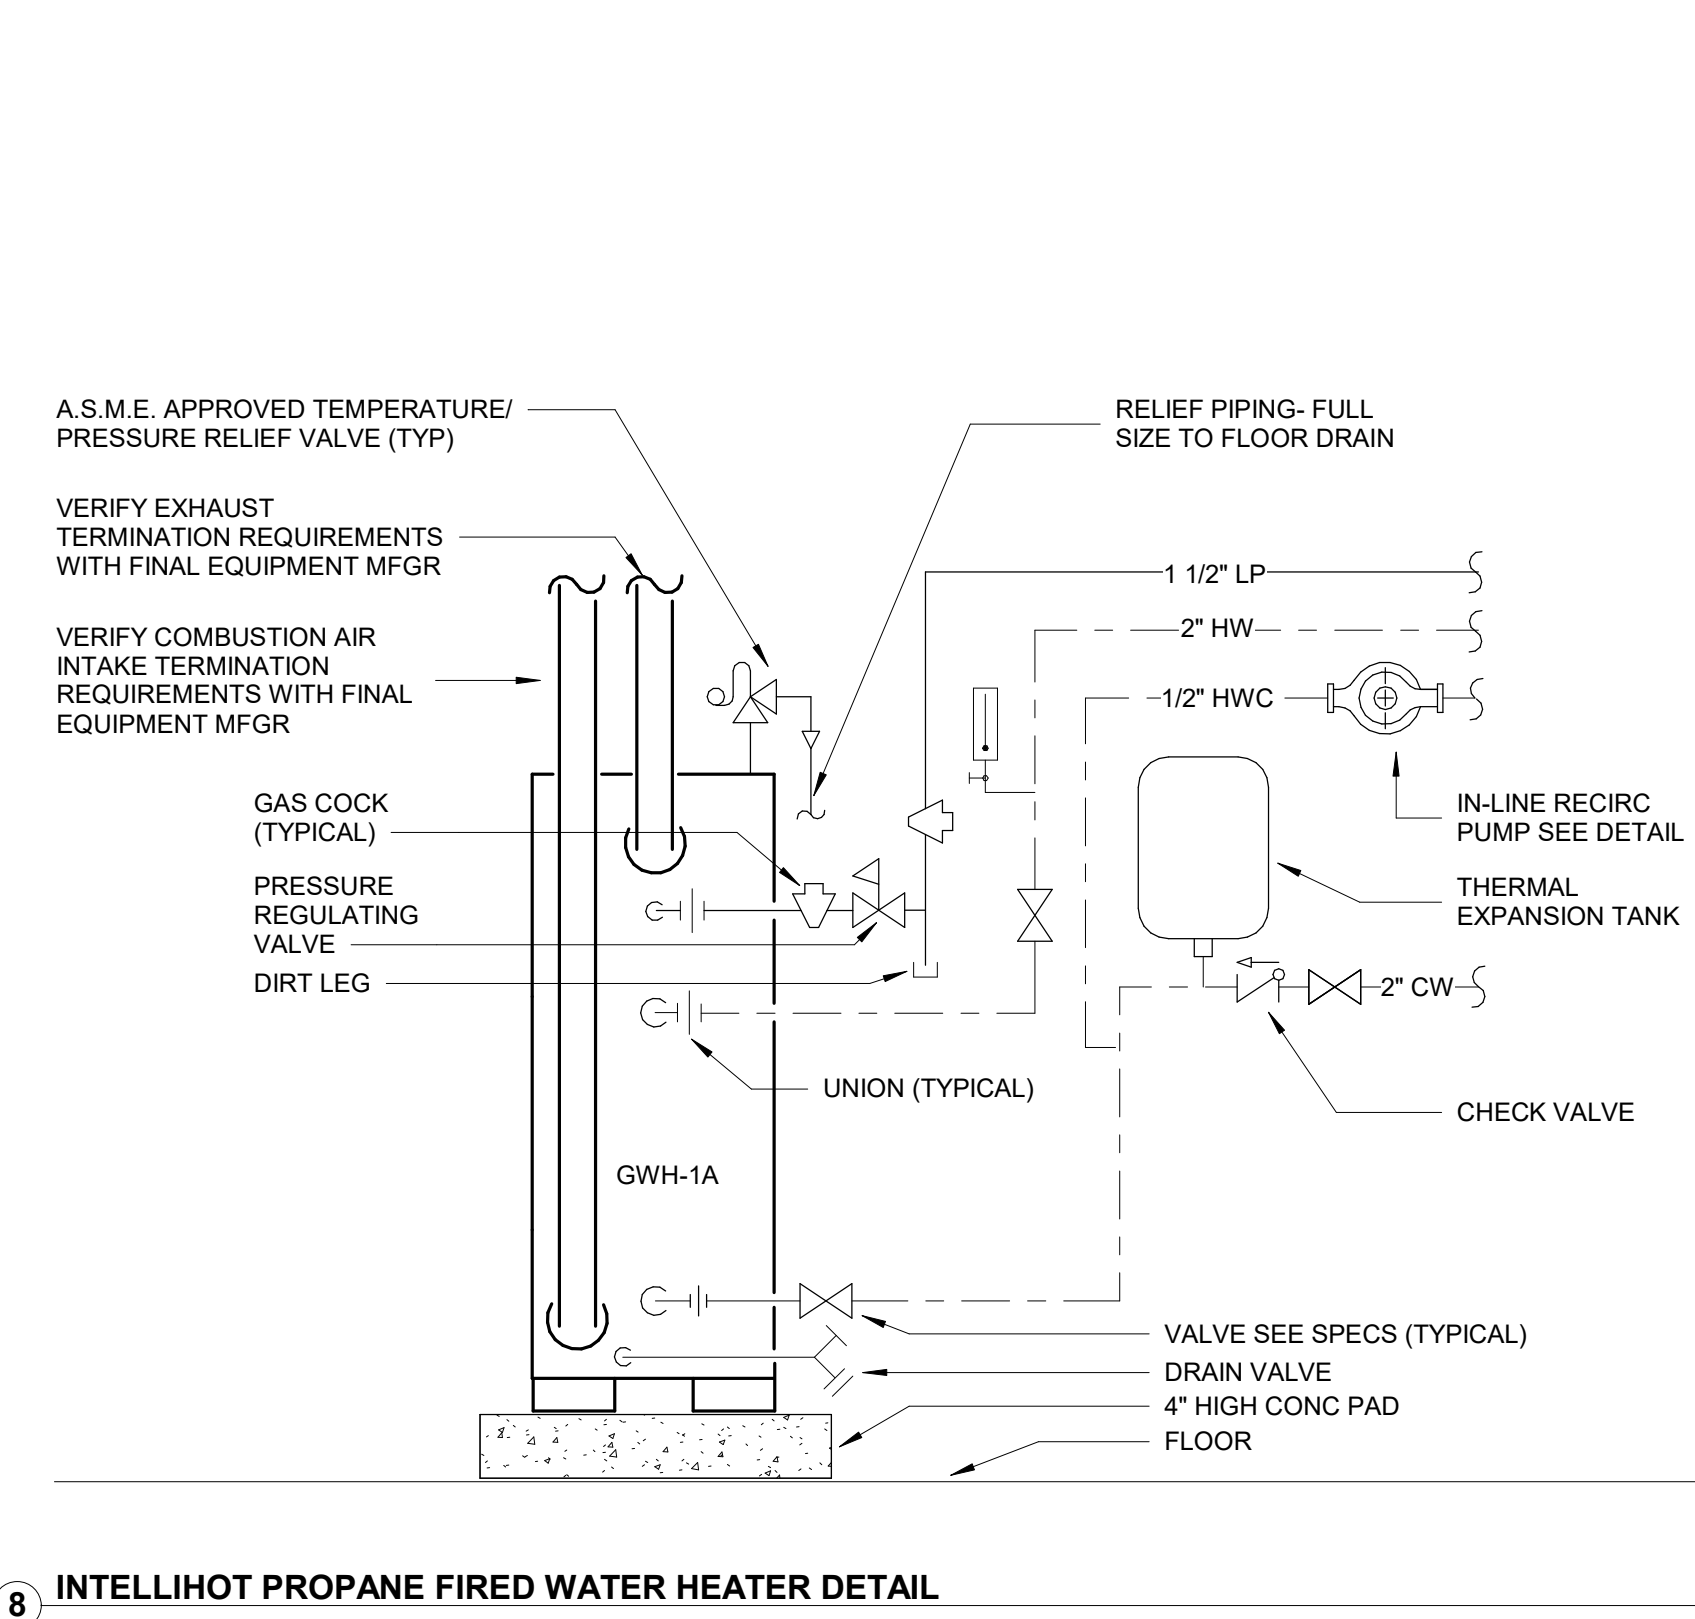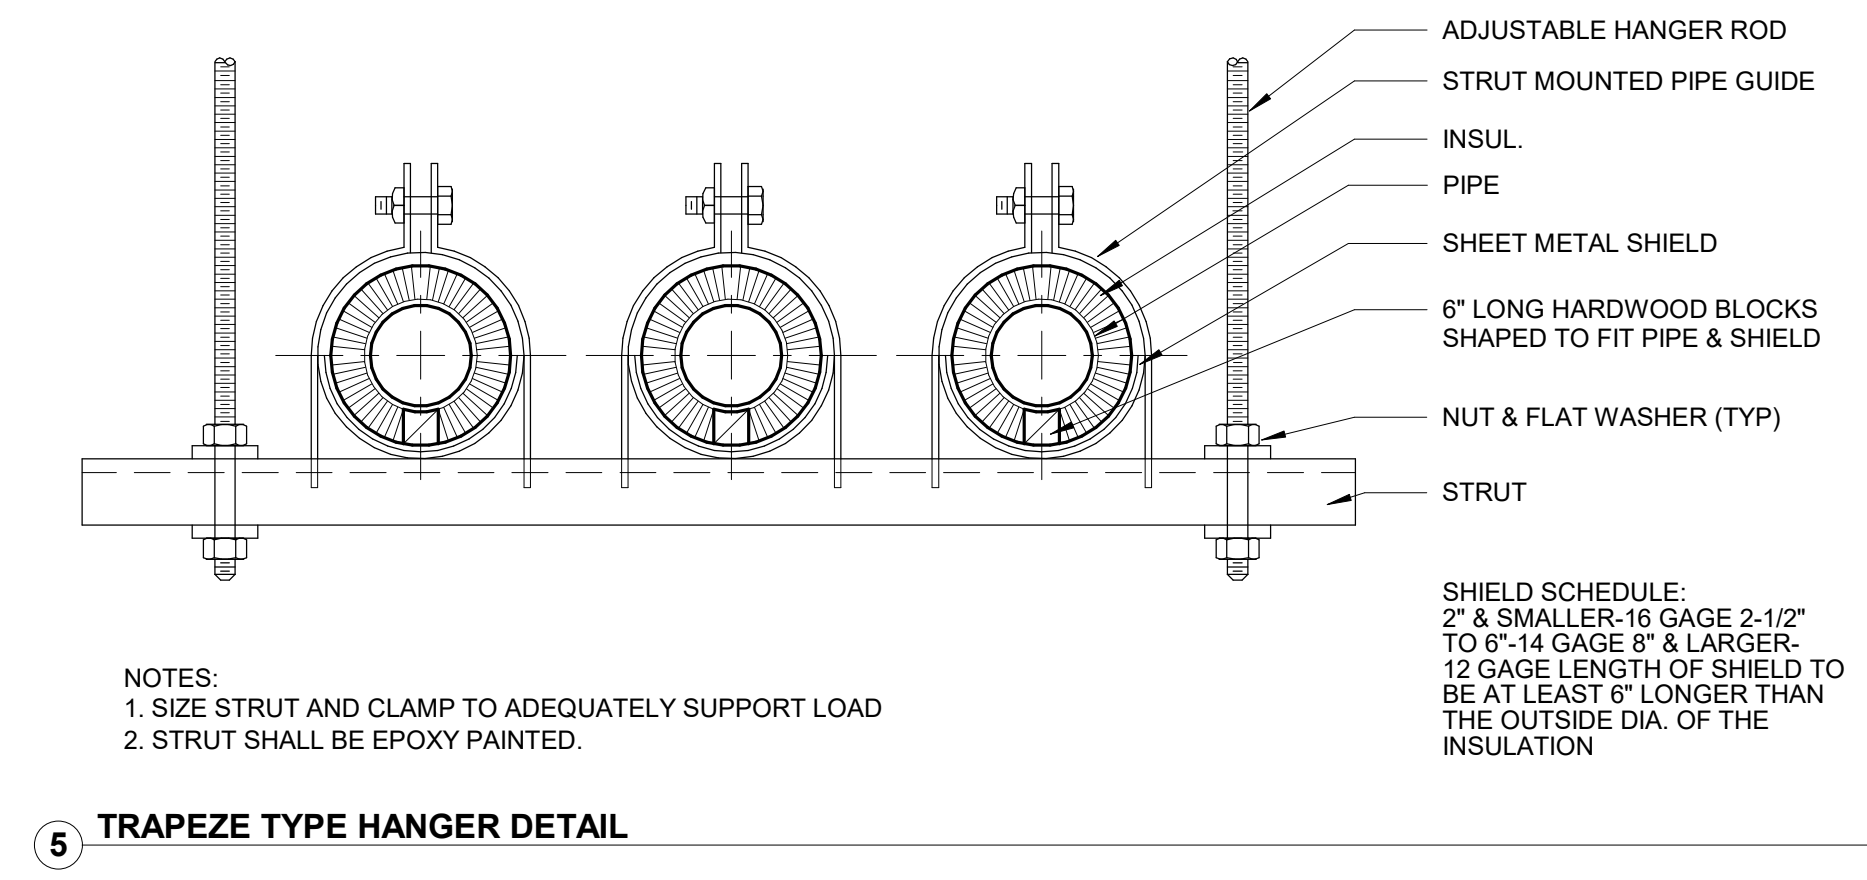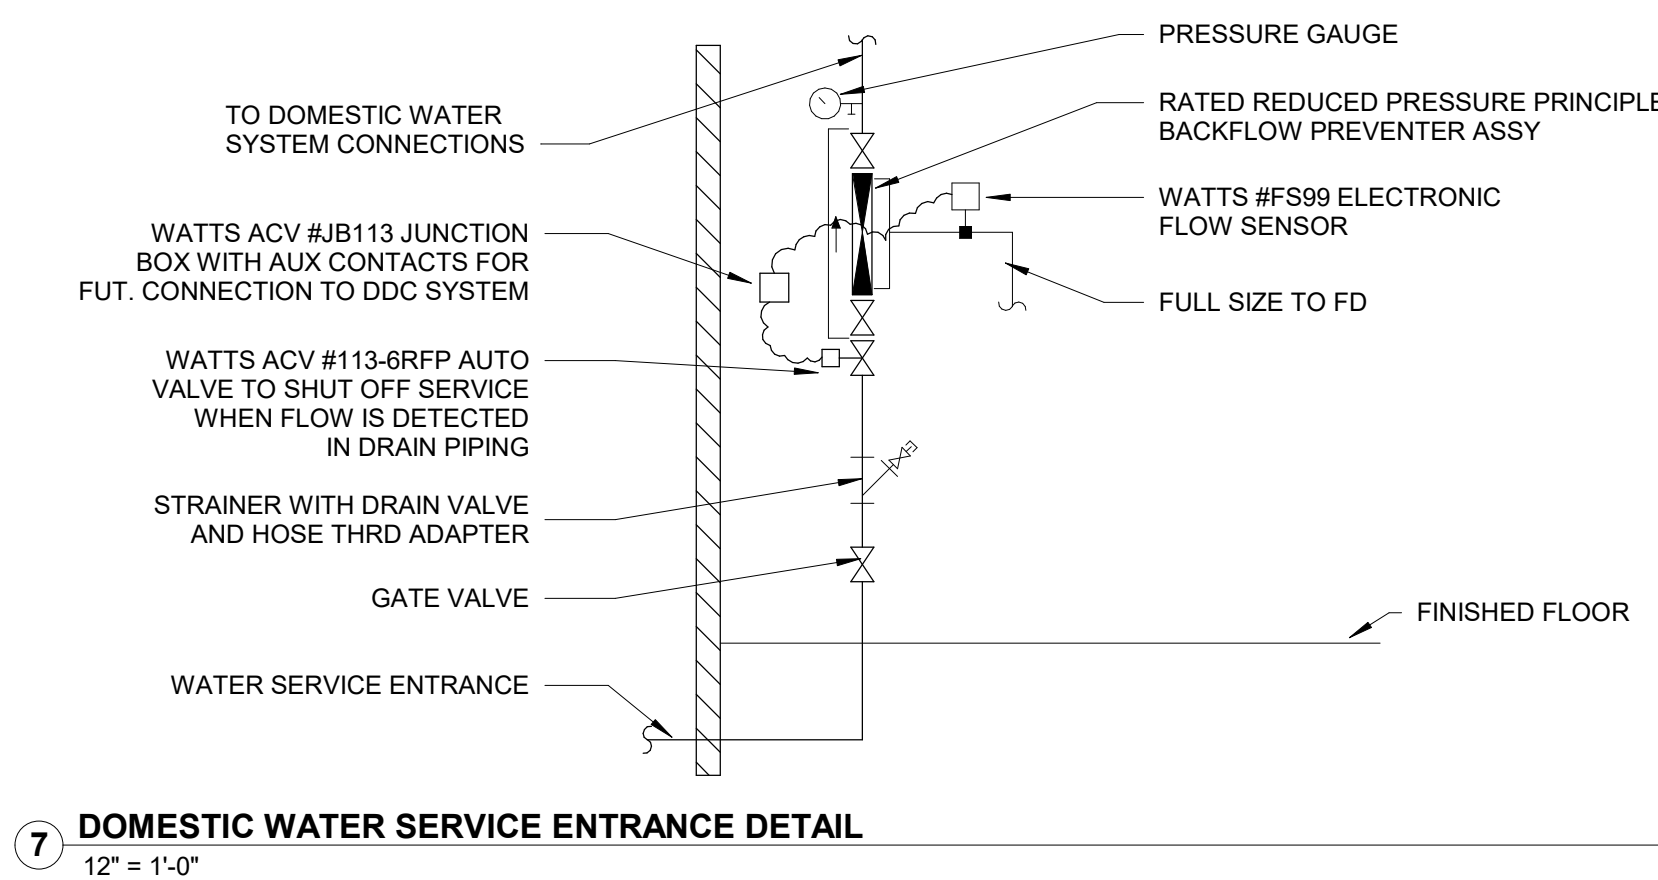


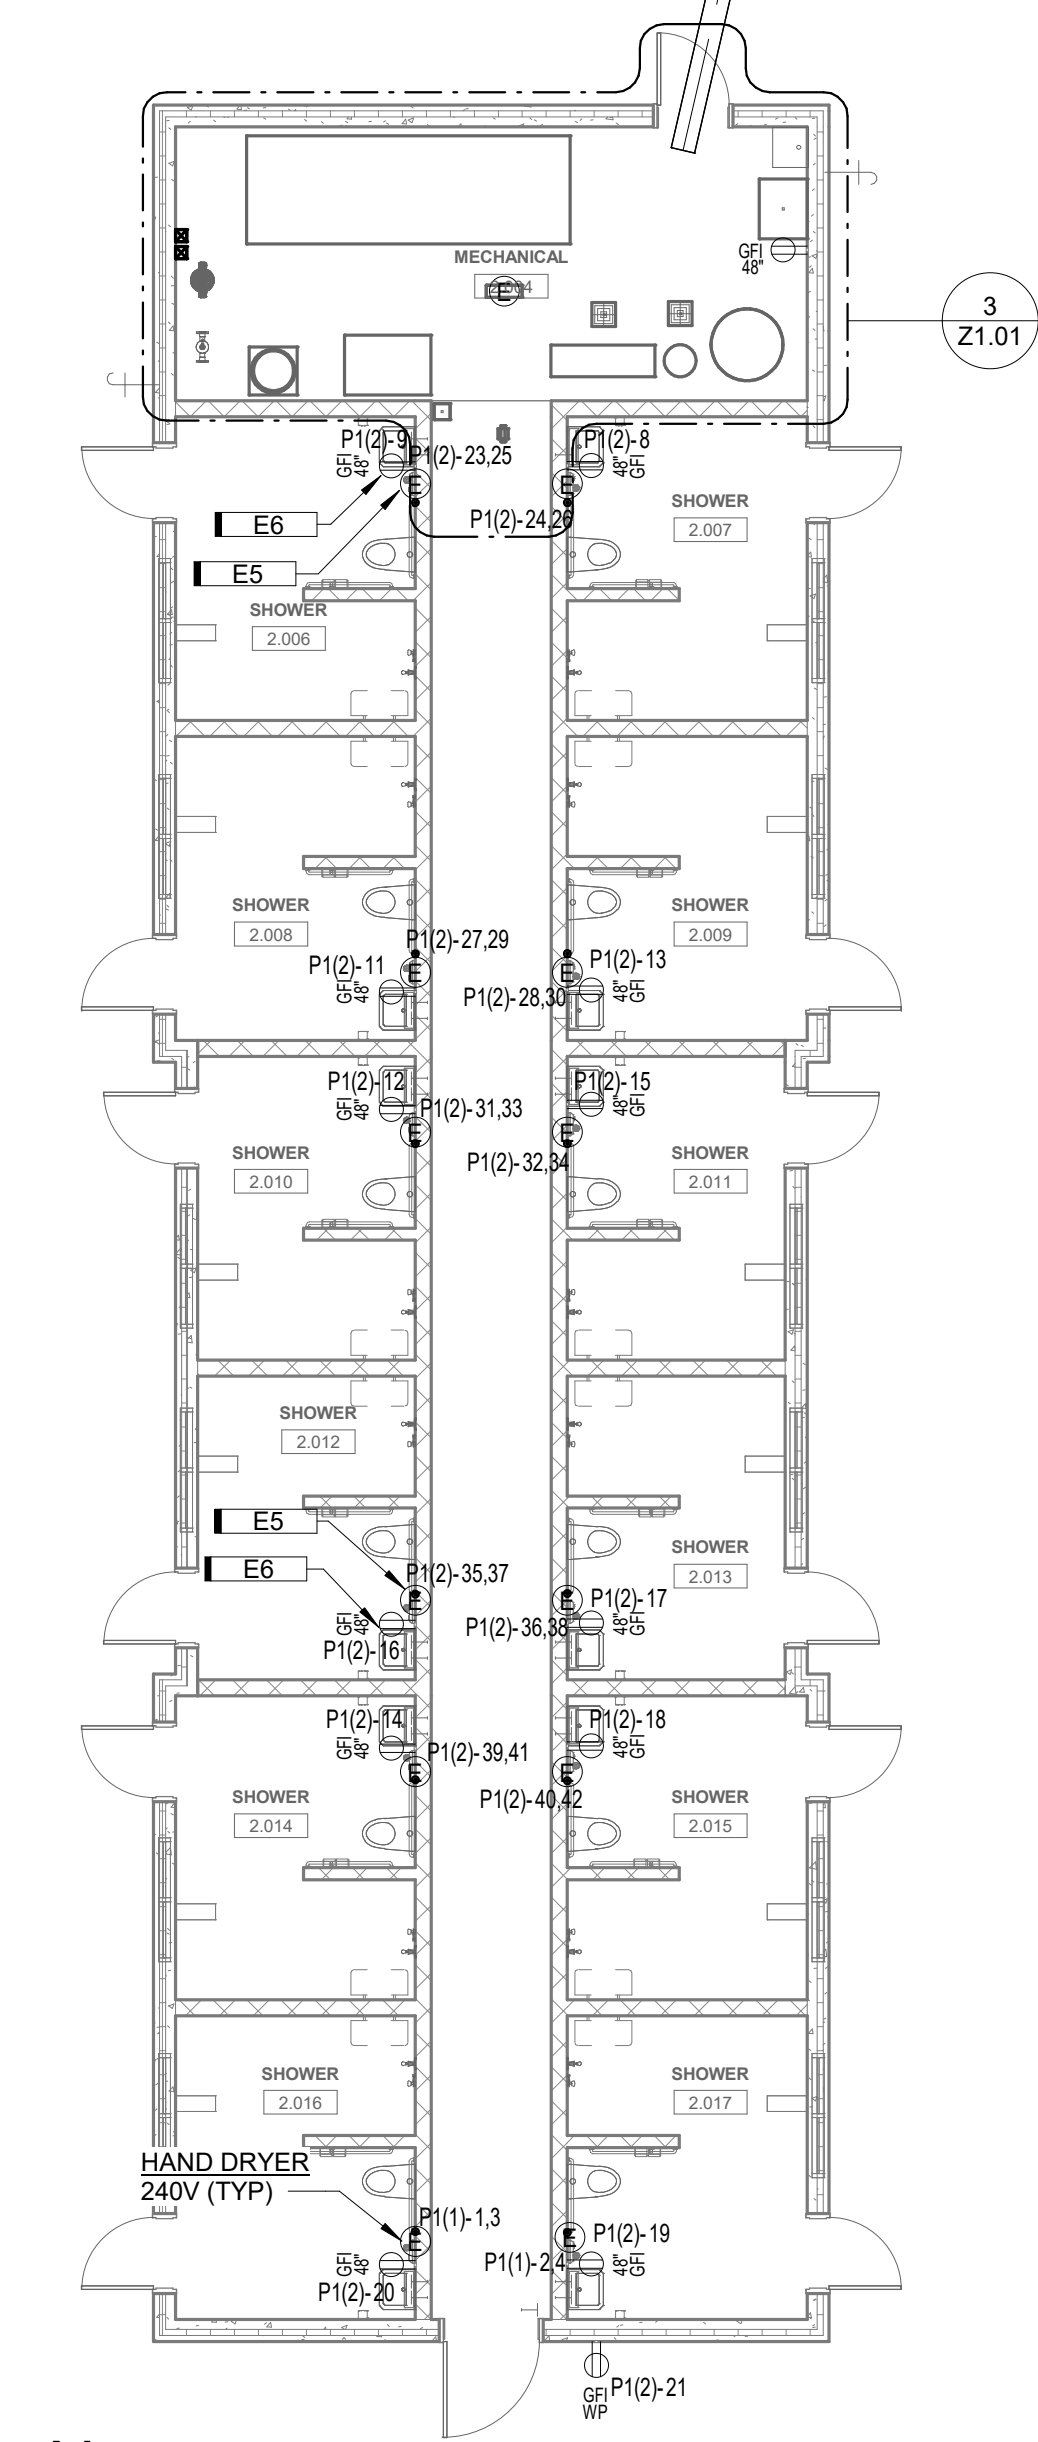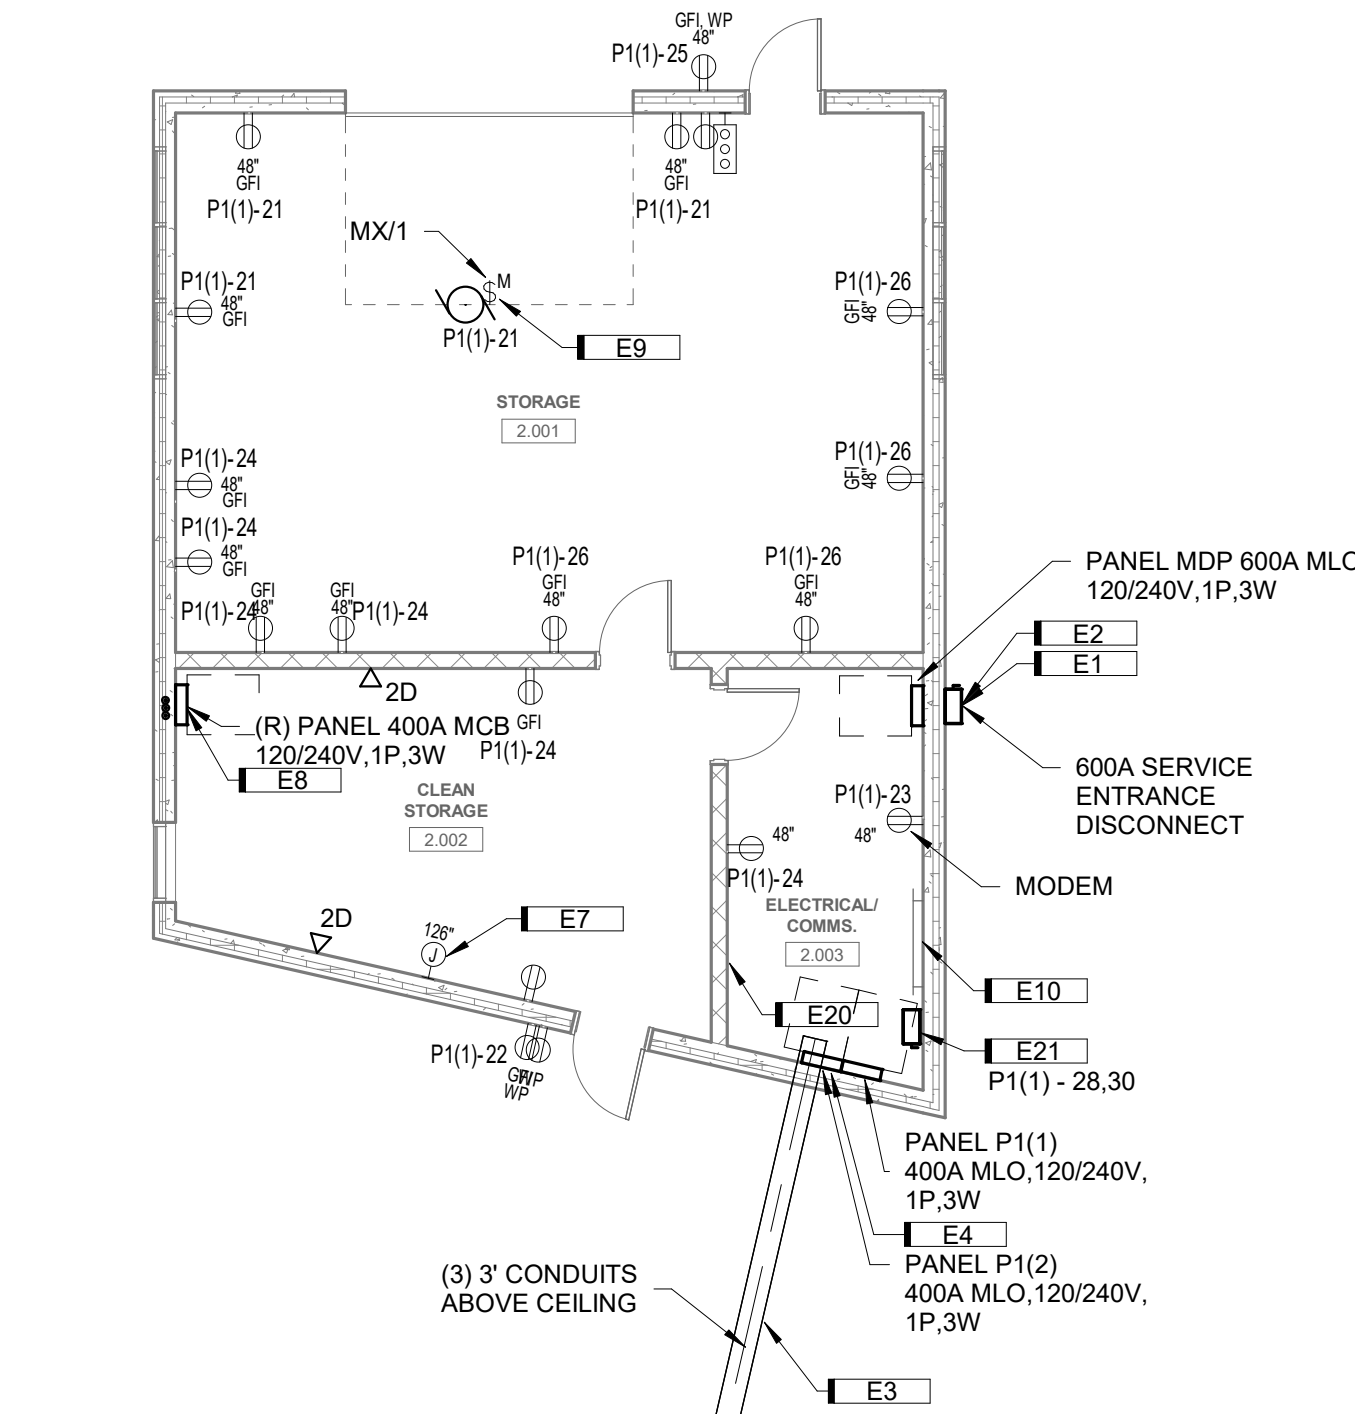


1 SHOWER HOUSE POWER PLAN
1/8" = 1'-0"

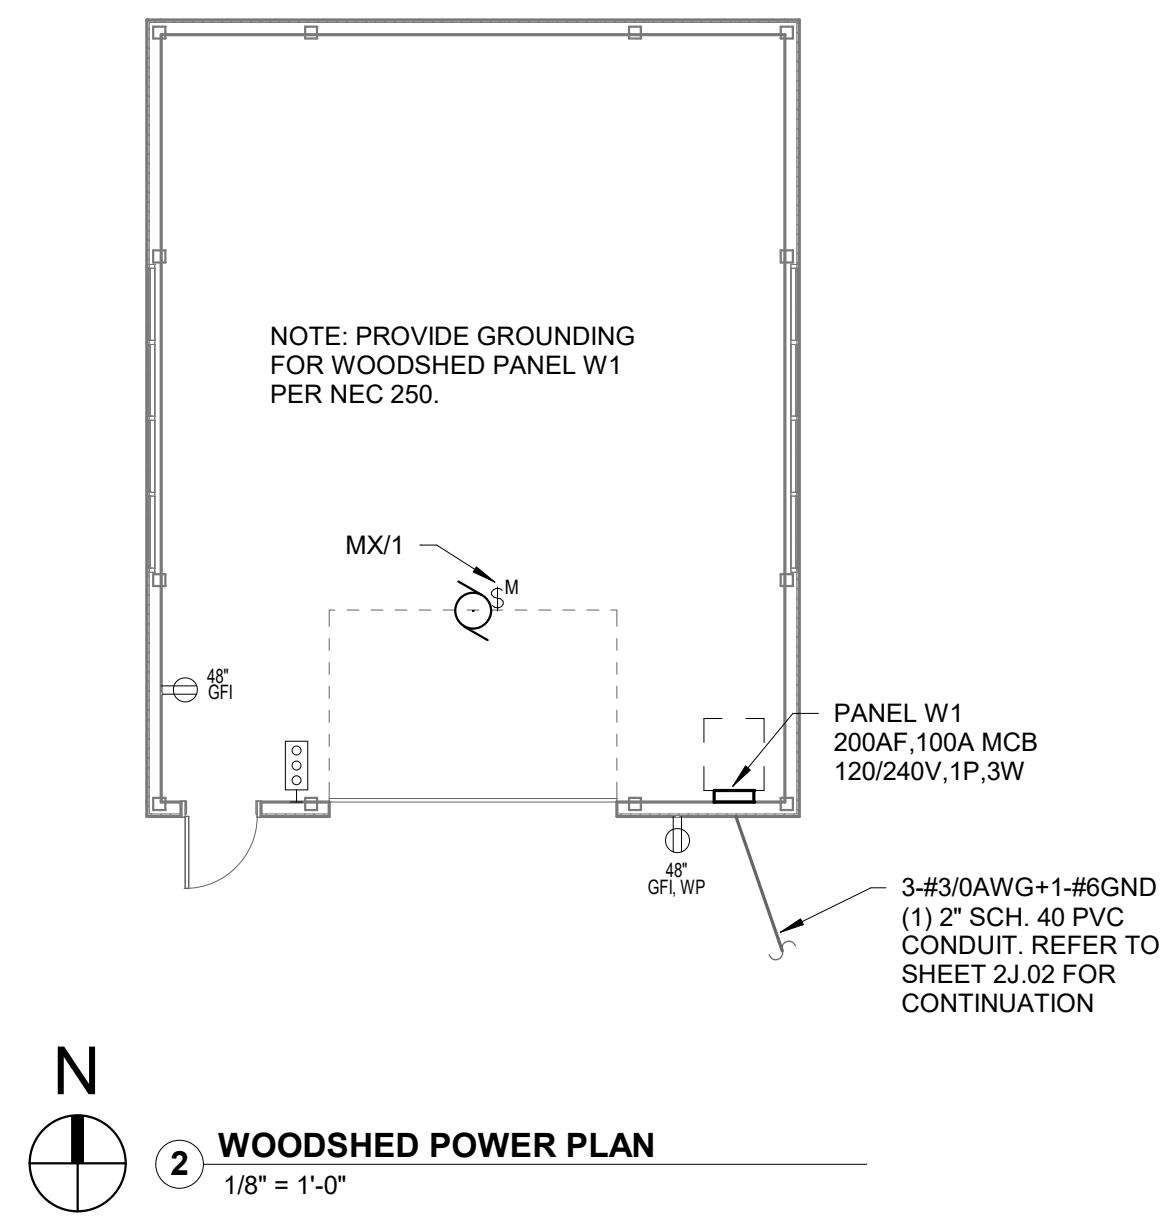

2 WOODSHED POWER PLAN
1/8" = 1'-0"

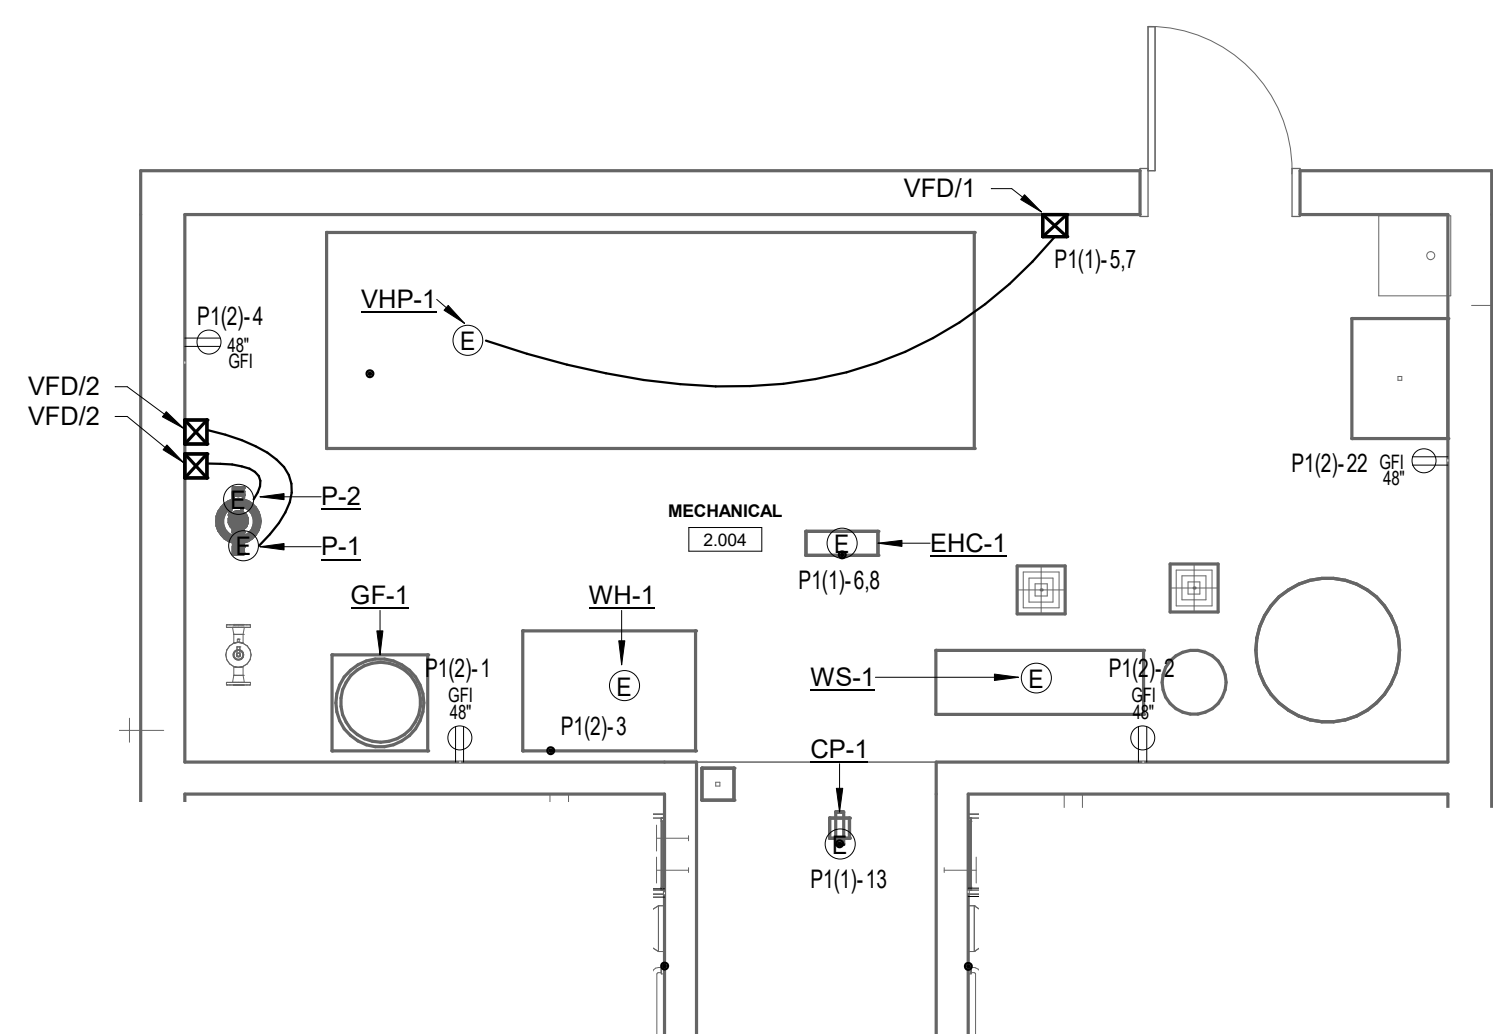


3 ENLARGED MECHANICAL ROOM PLAN
1/4" = 1'-0"

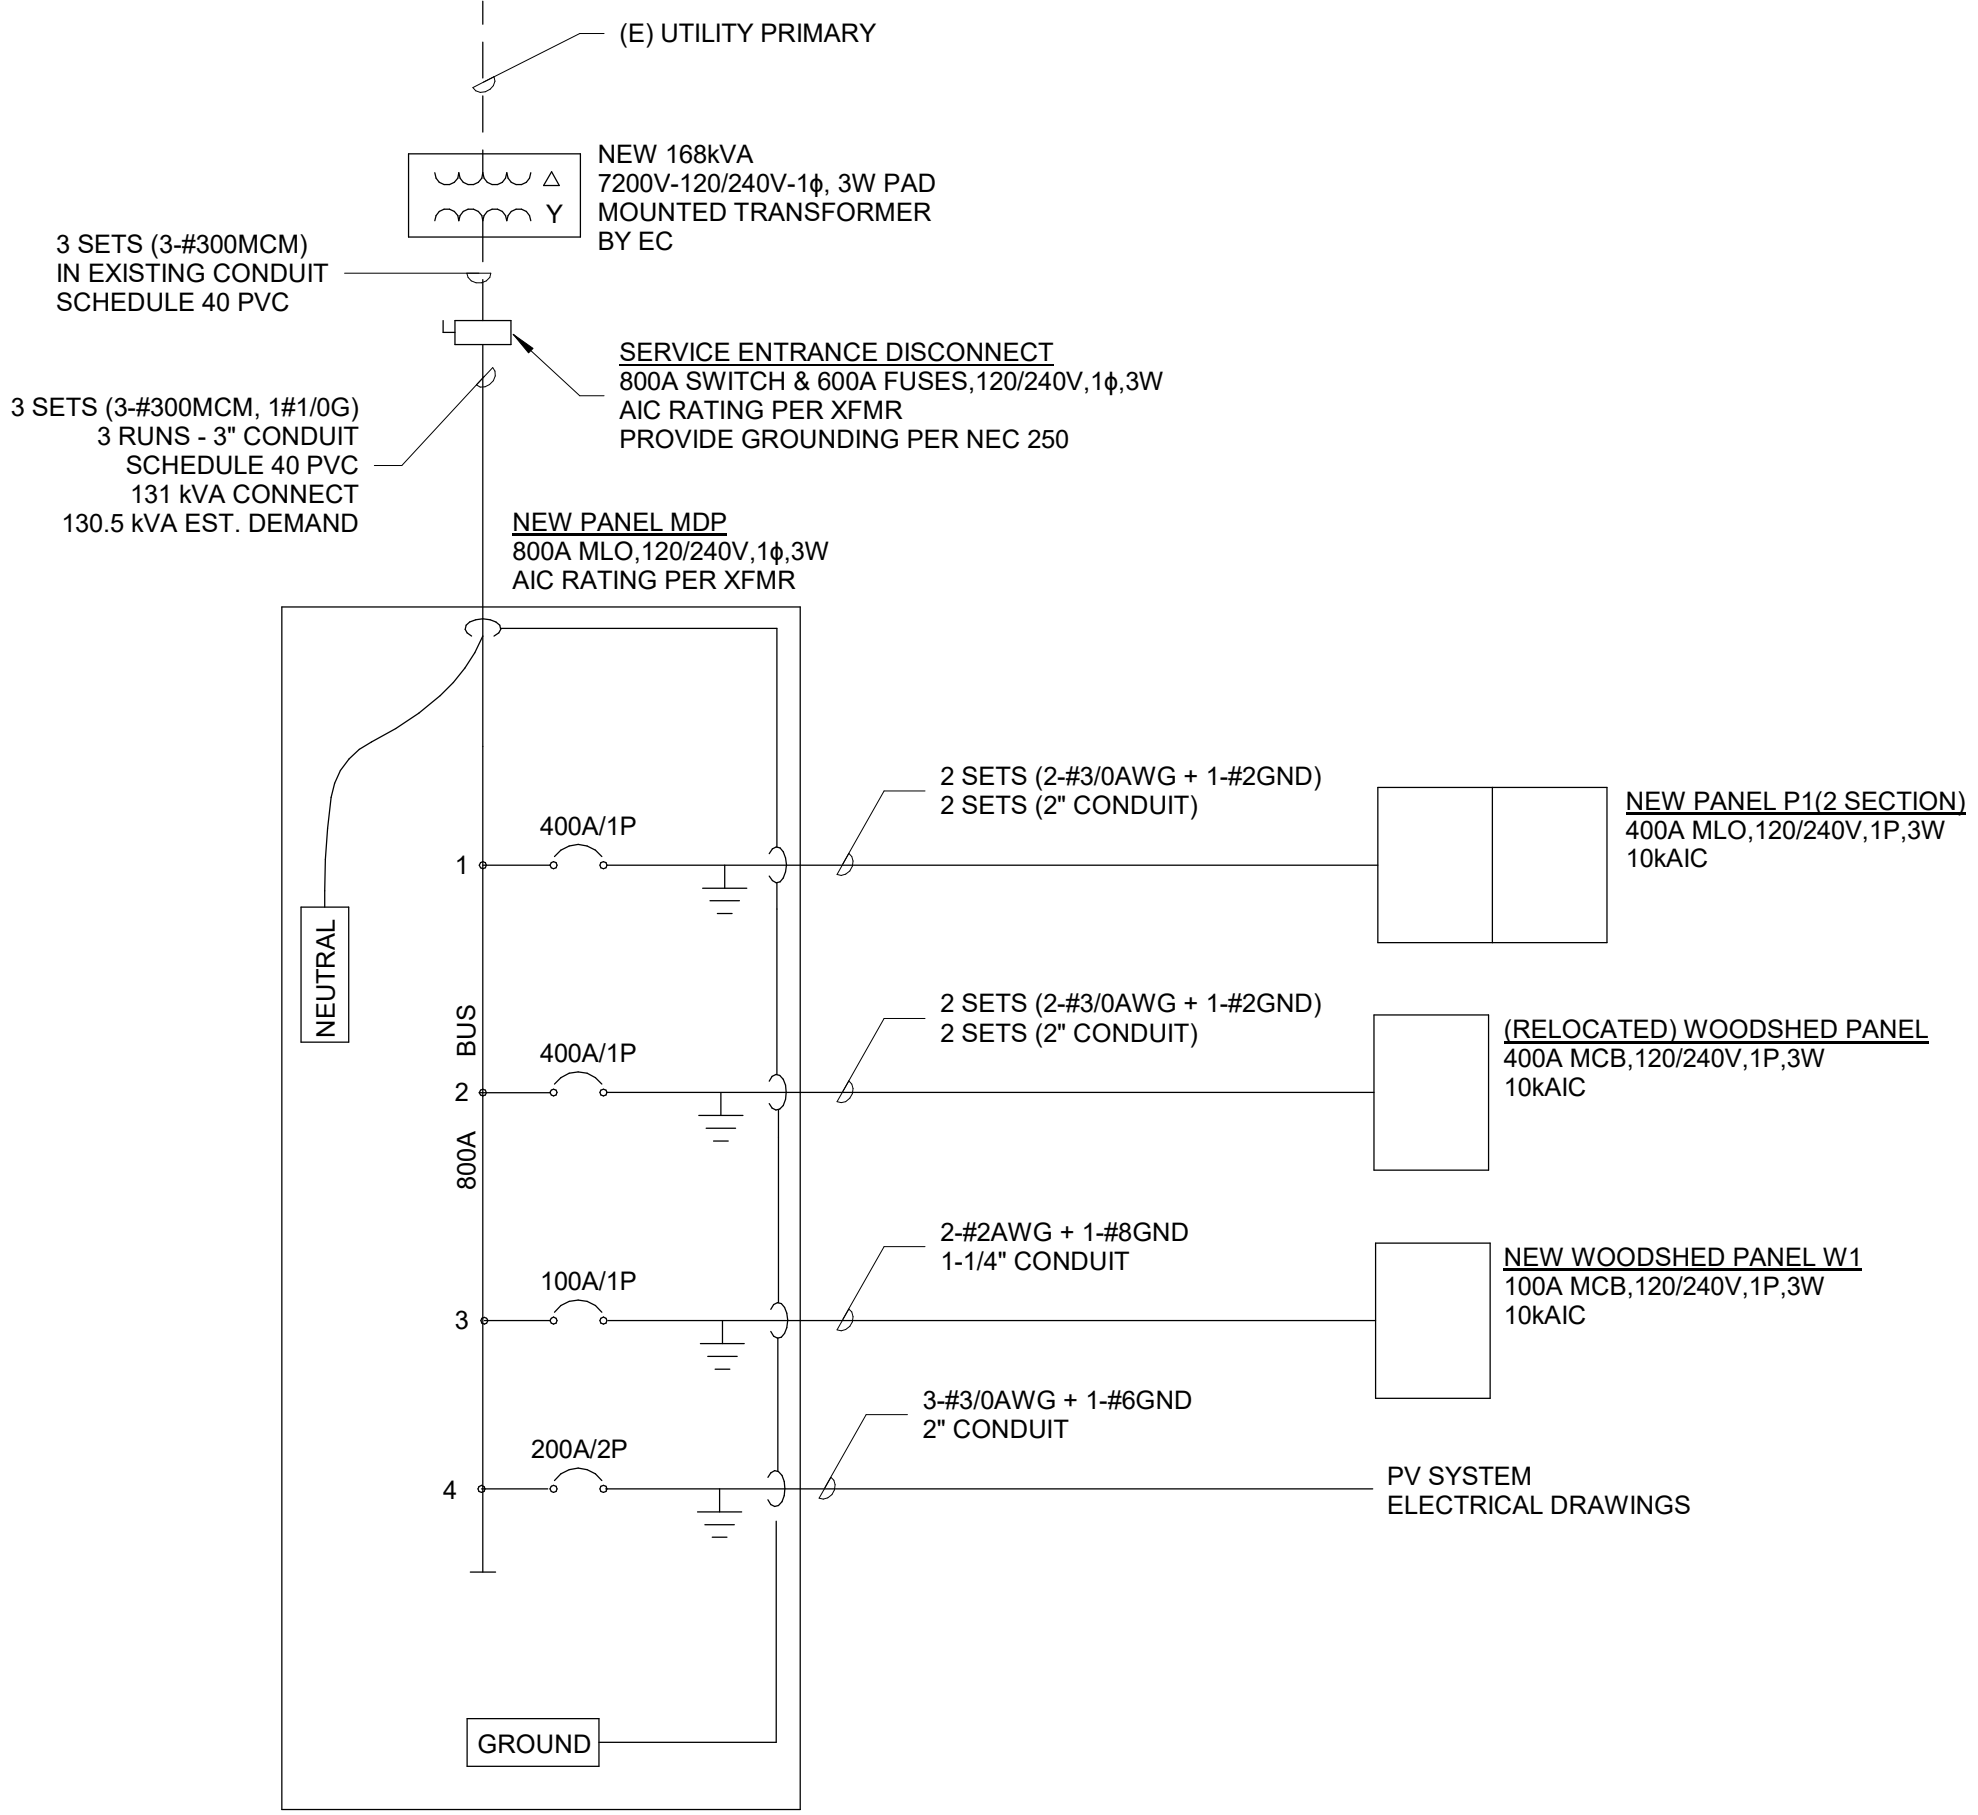

4 ONLINE DIAGRAM
12" = 1'-0"

- ELECTRICAL KEYNOTES**
- E1 DISCONNECT SHALL BE RATED NEMA 3R AND RATED AS SERVICE ENTRANCE EQUIPMENT. BOND THE NEUTRAL AND GROUND INSIDE OF DISCONNECT AND DERIVE GROUNDING CONDUCTOR AND EXTEND TO GROUND RODS.
 - E2 SERVICE ENTRANCE CONDUITS TO BE PLACED TO LINE UP WITH PRECAST PANEL HOLES DESIGNATED FOR (2) 2-1/2" EMT CONDUIT
 - E3 SUPPLY FEED FOR ELECTRICAL PANEL P1 VIA DUCT BANK ABOVE CEILING TO MECHANICAL ROOM 2.004
 - E4 COORDINATE EXACT PLACEMENT OF PANELS P1(SECT 1) & PANEL P1(SECT 2) WITH PLUMBING PIPING TO ENSURE CODE COMPLIANT INSTALLATION.
 - E5 EXTEND DEDICATED 240V CIRCUIT FOR HAND DRYER. PUNCH 3/4" CONDUIT THROUGH CMU WALL SEPARATING THE RESTROOM AND CHASE. COORDINATE HOLE LOCATION WITH MOUNTING HEIGHT AND LOCATION OF HAND DRYER PRIOR TO INSTALLATION. TYPICAL 12 SHOWER ROOMS.
 - E6 EXTEND DEDICATED 120V CIRCUIT FOR GFI DUPLEX RECEPTACLE. PUNCH 3/4" CONDUIT THROUGH CMU WALL SEPARATING THE SHOWER ROOM AND CHASE. COORDINATE HOLE LOCATION WITH MOUNTING HEIGHT AND LOCATION OF RECEPTACLE PRIOR TO INSTALLATION. TYPICAL 12 SHOWER ROOMS.
 - E7 LOCATE JUNCTION BOX ABOVE CEILING WITH CAPPED 120V CIRCUIT FROM PANEL MDP. THIS CIRCUIT WILL FEED KIOSK AND/OR VIDEO BOARD IN BREEZE DURING CONSTRUCTION.
 - E8 (R) PANEL IS RELOCATED 400A PANEL FROM DEMOLISHED TEMPORARY ELECTRICAL RACK. MAINTAIN PANEL AND ALL BREAKERS FOR RELOCATION TO INTERIOR SPACE AS SHOWN.
 - E9 PROVIDE FRACTIONAL HORSEPOWER MOTOR SWITCH WITH MELTING ALLOY AS SAFETY DISCONNECT FOR GARAGE DOOR OPENER
 - E10 IT IS INTENDED THAT ELECTRICAL/COMMS ROOM 2.003 BECOMES THE MAIN DISTRIBUTION POINT FOR FIBER OPTIC CABLING IN THE CAMPGROUND. REFER TO SHEET M1.02 FOR ADDITIONAL ROUTING AND SYSTEM AND INTERCONNECTION DETAILS.
 - E20 PROVIDE 4' X 8' PLYWOOD FOR COMMUNICATION.
 - E21 RELOCATED WELL PUMP VFD CONTROLLER. FRANKLIN ELECTRIC SDCP-SUB1523. CIRCUIT WITH 2#2, 1#4GND IN 1-1/2" CC BETWEEN PANEL AND RELOCATED VFD. EXTEND 2#6, 1#6GND, 1-1/4" ON SHEET M1.02 TO PREVIOUS WELL PUMP HOUSE FOLLOWING THE WATER LINE INDICATED ON SHEET M1.01.

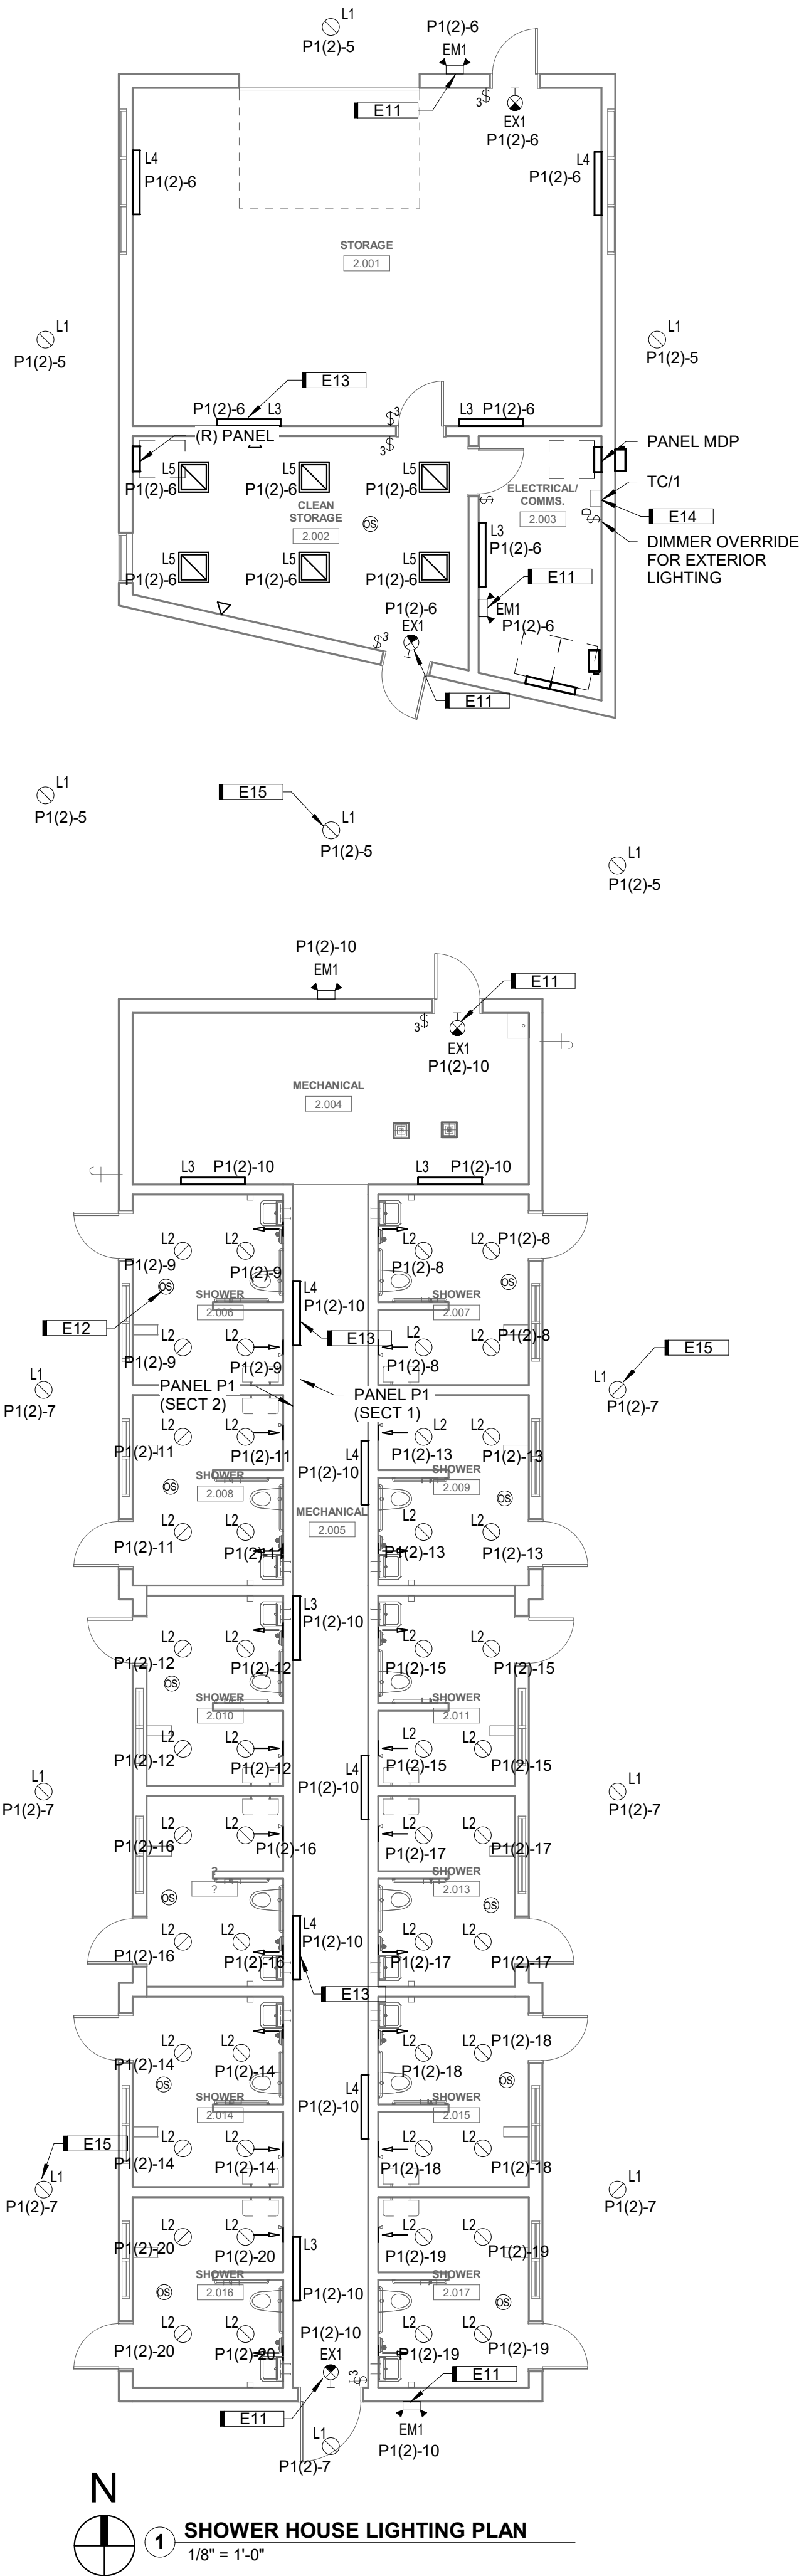

BRANCH PANEL NAME	VOLTAGE		PHASE	WIRE	BUS SIZE	MAIN OCP	AIC RATING				
W1	120/240		1	3	200 A	100 A	10,000 AMPS				
	CODE: L=LIGHTING, R=RECEPTACLES, M=MOTORS, K=KITCHEN						MOUNTING: SURFACE				
ROOM: WOOD SHED 2.018							ENCLOSURE: NEMA 1				
FED... MDP							FEED: BOTTOM				
LOAD	CODE	POLE	BKR	CKT #	A KVA	B KVA	CKT #	BKR	POLE	CODE	LOAD
GARAGE DOOR	1	20 A	1		0.8 / 0.2		2	20 A	1		EXTERIOR RECEPTACLE
INTERIOR RECEPTACLE	1	20 A	3			0.2 / 0.2	4	20 A	1		LITES
SPARE 60A 2P BREAKER	--	1	60 A	5	0.0 / 0.0		6	--	1	--	SPACE
SPARE 60A 20 BREAKER	1	60 A	7			0.0 / 0.0	8	--	1	--	SPACE
SPACE	1	--	9		0.0 / 0.0		10	--	1	--	SPACE
SPACE	--	1	--	11		0.0 / 0.0	12	--	1	--	SPACE
TOTAL LOAD:					993 VA	389 VA					
TOTAL AMPS:					8 A	3 A					
Load Classification	Connected Load (VA)	Demand Factor	Estimated Demand (VA)	PANEL TOTALS							
LITES	219 VA	125.00%	274 VA	TOTAL CONN. LOAD: 1380 VA							
Motor	828 VA	95.00%	787 VA	TOTAL EST. DEMAND: 1393 VA							
RCPT	360 VA	100.00%	360 VA	TOTAL CONN. CURRENT: 6 A							
				TOTAL EST. DEMAND... 6 A							
Notes:											
LOCATED IN WOODSHED ADJACENT TO NEW SHOWER HOUSE											


















BRANCH PANEL NAME	VOLTAGE		PHASE	WIRE	BUS SIZE	MAIN OCP	AIC RATING				
(R) PANEL	120/240		1	3	400 A	MLO	10,000 AMPS				
	CODE: L=LIGHTING, R=RECEPTACLES, M=MOTORS, K=KITCHEN						MOUNTING: SURFACE				
	ROOM: CLEAN STORAGE 2.002						ENCLOSURE: NEMA 1				
FED... MDP						FEED: TOP					
LOAD	CODE	POLE	BKR	CKT #	A KVA	B KVA	CKT #	BKR	POLE	CODE	LOAD
SITES 47,48	-	2	150 A	1	4.8 / 8.6		2	150 A	2	-	SITES 49, 51
-	-	1	-	3		4.8 / 8.6	4	-	-	-	-
SITES 50,52,54	-	2	150 A	5	11.5 / 11.5		6	150 A	2	-	SITES 53,55,56
-	-	1	-	7		11.5 / 11.5	8	-	-	-	-
SPACE	-	1	-	9	0.0 / 0.0		10	-	1	-	SPACE
SPACE	-	1	-	11		0.0 / 0.0	12	-	1	-	SPACE
TOTAL LOAD:					36480 VA	36480 VA					
TOTAL AMPS:					304 A	304 A					
Load Classification	Connected Load (VA)	Demand Factor	Estimated Demand (VA)	PANEL TOTALS							
Power	72960 VA	100.00%	72960 VA	TOTAL CONN. LOAD: 72960 VA							
				TOTAL EST. DEMAND: 72960 VA							
				TOTAL CONN. CURRENT: 304 A							
				TOTAL EST. DEMAND... 304 A							
Notes:											
REFER TO CIRCUIT DATA IN TABLE BELOW FOR REFEEDING CAMPGROUND SITES											


CIRCUITS TO FEED HANDHOLE AT DEMOLISHED WOODSHED

CAMPGROUND CIRCUIT	DERATED CIRCUIT LOAD EXISTING	EXISTING WIRE SIZE (AT WOODSHED	WIRE SIZE (FROM SHOWER HOUSE)	CONDUIT SIZE
SITES 47,48	19,200VA	#2/0 ALUMINUM	#3/0 ALUMINUM	2-1/2"
SITES 50,52,54	28,800VA	#4/0 ALUMINUM	#4/0 ALUMINUM	2-1/2"
SITES 51,49	19,200VA	#2/0 ALUMINUM	#3/0 ALUMINUM	2-1/2"
SITES 53,55,57	28,800VA	#2/0 ALUMINUM	#4/0 ALUMINUM	2-1/2"

BRANCH PANEL NAME	VOLTAGE		PHASE		WIRE		BUS SIZE		MAIN OCP		AIC RATING	
P1(1)	120/240		1	3	400 A		MLO		10,000 AMPS			
	CODE: L=LIGHTING, R=RECEPTACLES, M=MOTORS, K=KITCHEN								MOUNTING: SURFACE			
	ROOM: ELECTRICAL/ COMMS....								ENCLOSURE: NEMA 1			
FED... MDP								FEED: TOP				
LOAD	CODE	POLE	BKR	CKT #	A KVA	B KVA	CKT #	BKR	POLE	CODE	LOAD	
SHOWER 2.016 HAND DRYER	--	2	20 A	1	0.5 / 0.5		2	20 A	2	--	SHOWER 2.017 HAND DRYER	
--	--	--	--	3		0.5 / 0.5	4	--	--	--	--	
VHP-1	--	2	125 A	5	6.7 / 9.0		6	100 A	2	--	EHC-1	
--	--	--	--	7		6.7 / 9.0	8	--	--	--	--	
P-1	--	2	20 A	9	1.0 / 1.0		10	20 A	2	--	P-2	
--	--	--	--	11		1.0 / 1.0	12	--	--	--	--	
CP-1	--	1	20 A	13	0.7 / 0.0		14	20 A	1	--	SPARE	
SPARE	--	1	20 A	15		0.0 / 0.0	16	20 A	2	--	SPARE	
SPARE	--	2	20 A	17	0.0 / 0.0		18	--	--	--	--	
--	--	--	--	19		0.0 / 0.0	20	20 A	1	--	SPARE	
STORAGE 2.001 RCPTS	--	1	20 A	21	1.1 / 0.2		22	20 A	1	--	BREEZEWAY EXTERIOR RCPT	
MODEM RECEPTACLE	--	1	20 A	23		0.2 / 1.1	24	20 A	1	--	STORAGE 2.001 RCPTS	
NORTH EXTERIOR RCPT	--	1	20 A	25	0.2 / 0.7		26	20 A	1	--	STORAGE 2.001 RCPTS	
FUTURE KIOSK	--	1	--	27		0.0 / 0.0	28	80 A	2	--	WELL PUMP - 7.5HP	
SPACE	--	1	--	29	0.0 / 0.0		30	--	--	--	--	
TOTAL LOAD:					21414 VA	19766 VA						
TOTAL AMPS:					178 A	165 A						
Load Classification		Connected Load (VA)		Demand Factor		Estimated Demand (VA)		PANEL TOTALS				
Motor		7128 VA		95.00%		6772 VA		TOTAL CONN. LOAD: 41179 VA				
RCPT		2880 VA		100.00%		2880 VA		TOTAL EST. DEMAND: 40823 VA				
SPEC		31440 VA		100.00%		31440 VA		TOTAL CONN. CURRENT: 172 A				
								TOTAL EST. DEMAND... 170 A				
Notes:												
SUB FEED LUGS TO PANEL P1(2)												

BRANCH PANEL NAME		VOLTAGE		PHASE		WIRE		BUS SIZE		MAIN OCP		AIC RATING	
P1(2)		120/240		1		3		400 A		MLO		10,000 AMPS	
		CODE: L=LIGHTING, R=RECEPTACLES, M=MOTORS, K=KITCHEN										MOUNTING: SURFACE	
ROOM: ELECTRICAL/ COMMS....												ENCLOSURE: NEMA 1	
FED... MDP												FEED: TOP	
LOAD	CODE	POLE	BKR	CKT #	A KVA	B KVA	CKT #	BKR	POLE	CODE	LOAD		
GF-1		1	20 A	1	0.2 / 0.2		2	20 A	1		WF-1		
WH-1		1	20 A	3		1.6 / 0.2	4	20 A	1		MECHANICAL 2.004 RCPT		
EXTERIOR LITES		1	20 A	5	0.1 / 0.6		6	20 A	1		LITES STORAGE 2.001		
EXTERIOR LITES		1	20 A	7		0.1 / 0.2	8	20 A	1		LITES SHOWER 2.007		
LITES SHOWER 2.006		1	20 A	9	0.2 / 0.4		10	20 A	1		LITES MECHANICAL 2.005		
LITES SHOWER 2.008		1	20 A	11		0.2 / 0.2	12	20 A	1		LITES SHOWER 2.010		
LITES SHOWER 2.009		1	20 A	13	0.2 / 0.2		14	20 A	1		LITES SHOWER 2.014		
LITES SHOWER 2.011		1	20 A	15		0.2 / 0.2	16	20 A	1		LITES SHOWER 2.012		
LITES SHOWER 2.013		1	20 A	17	0.2 / 0.2		18	20 A	1		LITES SHOWER 2.015		
LITES SHOWER 2.017		1	20 A	19		0.2 / 0.2	20	20 A	1		LITES SHOWER 2.016		
SOUTH EXTERIOR RCPT		1	20 A	21	0.2 / 0.2		22	20 A	1		RCPT MECHANICAL 2.004		
SHOWER 2.006 HAND DRYER		2	20 A	23		0.5 / 0.5	24	20 A	2		SHOWER 2.007 HAND DRYER		
--	--	--	--	25	0.5 / 0.5		26	--	--	--	--		
SHOWER 2.008 HAND DRYER		2	20 A	27		0.5 / 0.5	28	20 A	2		SHOWER 2.009 HAND DRYER		
--	--	--	--	29	0.5 / 0.5		30	--	--	--	--		
SHOWER 2.010 HAND DRYER		2	20 A	31		0.5 / 0.5	32	20 A	2		SHOWER 2.011 HAND DRYER		
--	--	--	--	33	0.5 / 0.5		34	--	--	--	--		
SHOWER 2.012 HAND DRYER		2	20 A	35		0.5 / 0.5	36	20 A	2		SHOWER 2.013 HAND DRYER		
--	--	--	--	37	0.5 / 0.5		38	--	--	--	--		
SHOWER 2.014 HAND DRYER		2	20 A	39		0.5 / 0.5	40	20 A	2		SHOWER 2.015 HAND DRYER		
--	--	--	--	41	0.5 / 0.5		42	--	--	--	--		
TOTAL LOAD:					7839 VA	8367 VA							
TOTAL AMPS:					65 A	70 A							
Load Classification		Connected Load (VA)		Demand Factor		Estimated Demand (VA)		PANEL TOTALS					
Heating		1560 VA		100.00%		1560 VA		TOTAL CONN. LOAD: 16204 VA					
LITES		1990 VA		125.00%		2488 VA		TOTAL EST. DEMAND: 16211 VA					
Motor		9840 VA		95.00%		9348 VA		TOTAL CONN. CURRENT: 68 A					
RCPT		3060 VA		100.00%		3060 VA		TOTAL EST. DEMAND... 68 A					
Notes:													

POWER MATERIAL LIST		
THE SYMBOLS AND THE MATERIAL LIST ARE FOR THE CONVENIENCE OF THE CONTRACTOR. EACH CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFICATION OF QUANTITIES AND SHALL FURNISH ALL MATERIAL REQUIRED, WHETHER SPECIFIED OR NOT, TO PRODUCE A SATISFACTORY WORKING SYSTEM.		
CATALOG NUMBERS SHALL NOT BE CONSIDERED COMLETE BUT ARE GIVEN ONLY TO AID THE CONTRACTOR IN THE SEARCH FOR MATERIAL. NO MATERIAL ORDERED BY MANUFACTURER AND CATALOG NUMBER ONLY. EACH CONTRACTOR SHALL FIRST READ THE COMPLETE DESCRIPTION OF THE MATERIAL ON THESE DRAWINGS AND SPECIFICATIONS. THE FIRST MANUFACTURER LISTED IS THE BASIS OF DESIGN. "STANDARD COLOR" INDICATED FACTORY FINISH AVAILABLE AT NO ADDITIONAL CHARGE.		
SYMBOL	DESCRIPTION	APPROVED MANUFACTURER
	ALL TOGGLE SWITCH, RECEPTACLE, OUTLET AND COVERPLATE COLORS SHALL BE STANDARD WHITE COLOR, UNLESS NOTED OTHERWISE	HUBBELL PASS & SEYMOUR LEVITON COOPER
	ALL TOGGLE SWITCHES, RECEPTACLES, AND OUTLETS SHALL BE COMPLETE WITH NYLON COVERPLATES IN FINISHED SPACES WHERE WALLS ARE FINISHED, STAINLESS STEEL COVERPLATES IN UNFINISHED SPACES FOR FLUSH BOXES, AND GALVANIZED STEEL COVERPLATES IN UNFINISHED SPACES FOR SURFACE MOUNTED BOXES. WHERE SEVERAL DEVICES ARE GANGED TOGETHER, THE COVERPLATE SHALL BE A SINGLE GANGED STYLE FOR THE NUMBER OF DEVICES USED.	HUBBELL PASS & SEYMOUR LEVITON COOPER
	SURGE PROTECTIVE DEVICE (TVSS), ANSI CATEGORY 1 & 2 FOR 480Y/277V SERVICE. PEAK SURGE CURRENT OF 300 KA PER PHASE AND 150 KA PER MODE, UL 1449-3RD EDITION LISTED, 7 MODES OF PROTECTION, AUDIBLE ALARM, SURGE COUNTER, LED INDICATORS FOR EACH PHASE, NEMA 4 ENCLOSURE. SEE SPECIFICATIONS FOR ADDITIONAL REQUIREMENTS.	INNOVATIVE TECHNOLOGY PTX300-3Y201-SD LIEBERT CURRENT TECHNOLOGY
	168kVA; PRIMARY: 7200V; SECONDARY: 120/240V, 1P, 3W; 2 @ 2.5%; 115 DEGREE TEMP RISE; COPPER WINDINGS, LIQUID FILLED, PAD MOUNTED, >98% EFFICIENT	SQUARE D CLASS 7230 EATON
	DISTRIBUTION PANELBOARD, SERVICE ENTRANCE RATED, SURFACE MOUNTED, 120/240V 1-PHASE, 3-WIRE, AIC RATING PER TRANSFORMER SPECIFICATION 600A MAIN CIRCUIT BREAKER, COPPER BUS, GROUND BUS, LOCKING FRONT DOOR, FULLY RATED BREAKERS, UL LISTED, NEMA 1.	SQUARE D NQ EATON
	BRANCH PANELBOARD (2 SECTIONS), 20" WIDE SURFACE MOUNTED, 120/240V, 1 PHASE, 3 WIRE, 400A MLO (SECTION 1), 400A MLO (SECTION 2) COPPER BUS, GROUND BUS, BOLT-ON BREAKERS, FEED THRU LUGS, FULLY RATED BREAKERS, UL LISTED.	SQUARE D NQ EATON
	LOAD CENTER, 20" WIDE SURFACE MOUNTED, 120/240V, 1 PHASE, 3 WIRE, 200A FRAME, 100A MAIN CIRCUIT BREAKER, COPPER BUS, GROUND BUS, BOLT-ON BREAKERS, FULLY RATED BREAKERS, UL LISTED. FURNISH WITH (1) 60A, 2P BREAKER, (5) 20A, 1P BREAKERS	SQUARE D NQ EATON
	EXISTING BRANCH PANELBOARD FROM WOODSHED, 20" WIDE SURFACE MOUNTED, 120/240V, 1 PHASE, 3 WIRE, 400A MAIN CIRCUIT BREAKER, COPPER BUS, GROUND BUS, BOLT-ON BREAKERS, FULLY RATED BREAKERS, UL LISTED.	REUSE EXISTING
 DS/1	HEAVY DUTY NON-FUSIBLE DISCONNECT SWITCH, MINIMUM 240V, 600A/2P, NEMA 3R ENCLOSURE, UL LISTED. SHALL BE RATED FOR USE AS SERVICE ENTRANCE EQUIPMENT.	SQUARE D EATON
 VFD/2	VARIABLE FREQUENCY DRIVE WITH HAND-OFF-AUTO OVERRIDE, OVER CRRRENT PROTECTION, ANALOG AND DIGITAL I/O, MICROPROCESSOR CONTROLLED, >90% EFFICIENCY, RATER FOR 1HP PUMP	SQUARE D ATV61 EATON
	EQUIPMENT CONNECTION, SIZE PER NEC. COORDINATE WITH CONTRACTOR FURNISHING EQUIPMENT.	SIZE PER NEC
	MANUAL MOTOR STARTER SWITCH WITH MELTING ALLOY TYPE THERMAL OVERLOAD RELAY, TOGGLE OPERATOR, SINGLE POLE, RATED 1HP MAXIMUM AT 120 VOLT, NEMA 1 ENCLOSURE, W/ HANDLE GUARD,LOCK-OFF, UL LISTED.	SQUARE D CLASS 2010 TYPE FG5 EATON
	OVERHEAD DOOR 3-BUTTON UP/DOWN/STOP MANUAL CONTROL. INSTALLED BY EC.	FURNISHED BY GC
 # #"	DUPLEX RECEPTACLE, 20 AMP, 125 VOLT, 3-WIRE GROUNDING TYPE, INDUSTRIAL SPECIFICATION GRADE, STRAIGHT BLADE, NEMA 5-20R, NYLON FACE, SIDE AND BACK WIRED, UL LISTED. COORDINATE ROUGH-IN WITH MILLWORK. # #" = MOUNTING HEIGHT	LEVITON 5362-GY HUBBELL PASS & SEYMOUR COOPER
 GFI	DUPLEX RECEPTACLE, GROUND FAULT CIRCUIT INTERRUPTING (GFCI), DECORA STYLE, 20 AMP, 125 VOLT, 3-WIRE GROUNDING TYPE, INDUSTRIAL SPECIFICATION GRADE, STRAIGHT BLADE, NEMA 5-20R, NYLON FACE, SIDE AND BACK WIRED, TEST AND RESET BUTTONS IN FACE, LOCKOUT ACTION TO PREVENT USE IF GFCI CIRCUIT IS NOT FUNCTIONING, UL LISTED. COORDINATE ROUGH-IN WITH MILLWORK. "AC" DENOTES ABOVE COUNTER.	LEVITON 7899-G HUBBELL PASS & SEYMOUR COOPER
 WP, GFI	DUPLEX RECEPTACLE, GROUND FAULT CIRCUIT INTERRUPTING (GFCI), DECORA STYLE, 20 AMP, 125 VOLT, 3-WIRE GROUNDING TYPE, INDUSTRIAL SPECIFICATION GRADE, STRAIGHT BLADE, NEMA 5-20R, NYLON FACE, SIDE AND BACK WIRED, TEST AND RESET BUTTONS IN FACE, LOCKOUT ACTION TO PREVENT USE IF GFCI CIRCUIT IS NOT FUNCTIONING, UL LISTED. PROVIDE WITH CAST ALUMINUM WET LOCATION WHILE-IN-USE BUBBLE COVER.	LEVITON 7899-G HUBBELL PASS & SEYMOUR COOPER HUBBELL WP26M (COVER)
 VFD/1	VARIABLE FREQUENCY DRIVE WITH HAND-OFF-AUTO OVERRIDE, OVER CRRRENT PROTECTION, ANALOG AND DIGITAL I/O, MICROPROCESSOR CONTROLLED, >90% EFFICIENCY	SQUARE D ATV61 EATON

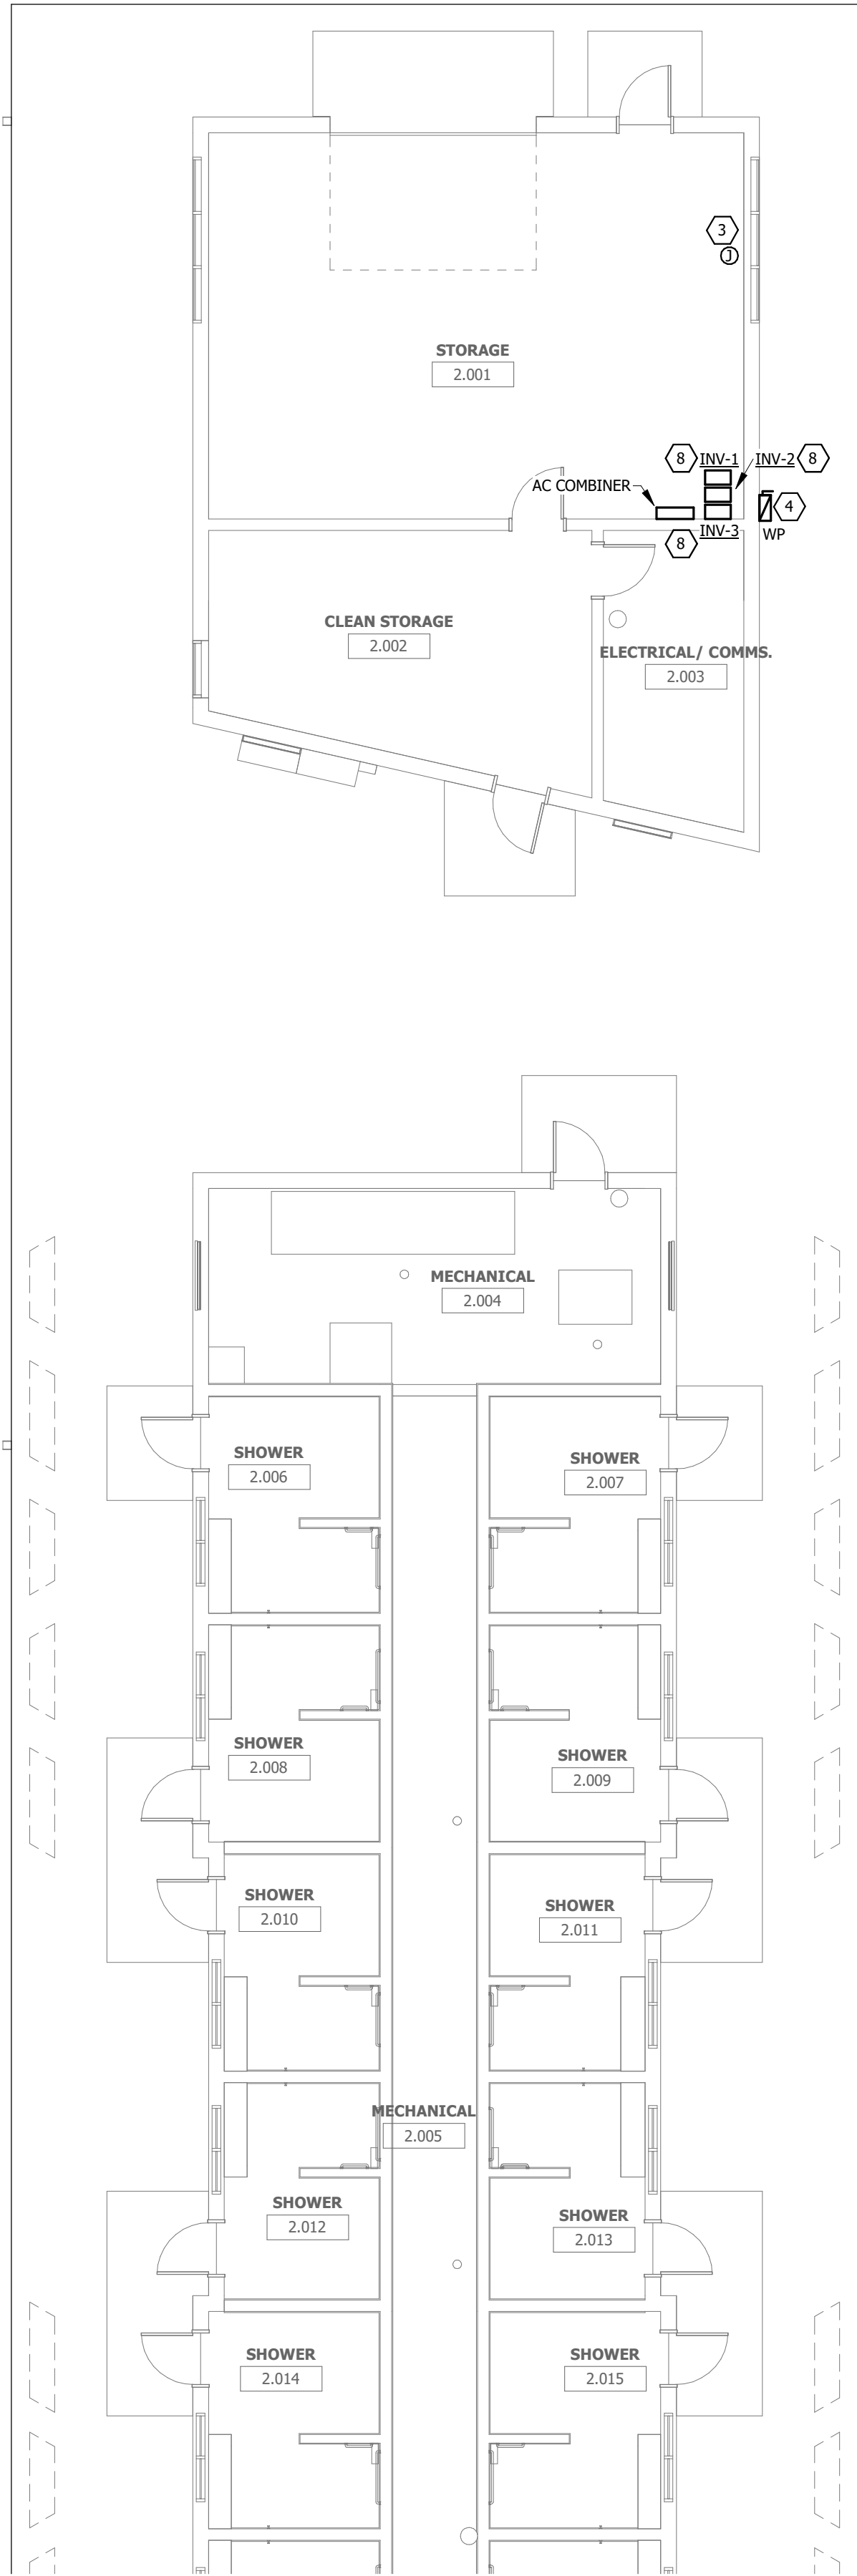

1 SHOWER HOUSE ELECTRICAL PLAN
1/8" = 1'-0"

MODUS

214 EAST FOURTH
WATERLOO, IOWA

319

235 0650 TEL
235 0644 FAX

130 EAST 3RD STREET STE.
DES MOINES, IOWA

515

251 7280 TEL
251 7349 FAX

118 EAST COLLEGE ST. STE.
IOWA CITY, IOWA

319

248 4600 TEL
248 0141 FAX

MODUS-ENG.COM

2 SHOWER HOUSE ROOF PLAN
1/8" = 1'-0"

GENERAL NOTES:

- MAINTAIN SERVICE CLEARANCE AROUND ALL MECHANICAL & ELECTRICAL EQUIPMENT. DO NOT ROUTE PIPING OR CONDUIT IN CLEARANCE SPACE.
- SURFACE RACEWAY SHALL NOT BE USED IN ANY FINISHED AREAS WITHOUT PRIOR APPROVAL FROM THE ENGINEER.
- PROVIDE AND INSTALL ALL ELECTRICAL CONTROL AND DISCONNECTING MEANS FOR ALL PHOTOVOLTAIC EQUIPMENT. COORDINATE AND VERIFY REQUIREMENTS WITH SCHEDULES AND SHOP DRAWINGS.
- MAINTAIN ALL SERVICE CLEARANCES REQUIRED BY THE UTILITY AND NEC. COORDINATE INSTALLATION WITH OWNER REQUIREMENTS PRIOR TO ROUGH-IN.
- INSTALL CONDUCTORS AS PER MANUFACTURER'S RECOMMENDATIONS.
- GROUND PV SYSTEM PER NEC 690.

REFERENCED NOTES:

- PROVIDE (1) POWER OPTIMIZER PER EVERY (2) MODULES. THE INVERTER AND OPTIMIZERS SHALL BE EQUIPPED WITH A RAPID SHUTDOWN FEATURE THAT CONFORMS TO NEC 690.12. THE OUTPUT VOLTAGE OF THE POWER OPTIMIZERS ARE REGULATED BY THE INVERTER. THEY ARE NOT IMPACTED BY THE NUMBER OF MODULES IN THE STRING. THE CONTINUOUS CURRENT OF A SINGLE STRING IS EQUAL TO THE MAXIMUM OUTPUT CURRENT OF THE OPTIMIZER.
- ROUTE ALL DC WIRING FROM PV COMBINERS TO JUNCTION BOX LOCATED ON ROOF. CONDUIT FROM JUNCTION BOX TO BE ROUTED TO PV INVERTER(S) IN STORAGE 2.001.
- CONDUIT TO PENETRATE ROOF. ROUTE ALL CONDUIT TIGHT TO STRUCTURE. SEE ROOF PENETRATION DETAIL.
- COORDINATE EXACT LOCATION OF UTILITY PV DISCONNECT WITH OWNER/ AHJ PRIOR TO ROUGH-IN. AT LOCATION OF PV UTILITY DISCONNECT SHALL BE A PERMANENT PLAQUE READING "INTERCONNECTION DISCONNECT SWITCH". DISCONNECT SHALL NOT OPEN THE NEUTRAL. COORDINATE ALL UTILITY REQUIREMENTS WITH UTILITY PRIOR TO ROUGH-IN.
- RACKING SYSTEM TO BE IRONRIDGE XR RAIL FAMILY OR SIMILAR. INSTALL RACKING SYSTEM BASED ON MANUFACTURER'S INSTRUCTIONS. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION. COORDINATE MOUNTING TYPE WITH ROOFING CONTRACTOR PRIOR TO ROUGH-IN.
- PROVIDE A JUNCTION BOX FOR EVERY STRING OF 12 PANELS. ROUTE CONDUIT TO PV COMBINER CABINETS.
- PV COMBINER CABINET. 600V RATED. 3 CIRCUITS FUSED AT 15AMPS. NEMA 34 UL 1731 LISTED. MIDNITE SOLAR #MNPV3(HV) OR APPROVED EQUAL. PROVIDE WEATHER PROOF DISCONNECT AT EACH COMBINER. COORDINATE EXACT LOCATION AND FEEDER ROUTE WITH DESIGN TEAM PRIOR TO INSTALL.
- THE CONTRACTOR SHALL PROVIDE A 1" CONDUIT FOR PV SYSTEM MONITORING FROM PV INVERTER LOCATION TO TELECOM ROOM. COORDINATE ROUTING WITH ALL EXISTING UTILITIES AND FIRE WALLS. THE CONTRACTOR SHALL PROVIDE AND INSTALL THE NEW ETHERNET CABLE, OR EQUIVALENT, PER MANUFACTURER'S SPECIFICATION. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.

4 SHOWER HOUSE PV-WHIP MODULE
No Scale

5 CONDUIT ROOF PENETRATION - SHOWER HOUSE
No Scale

SYSTEM CALCULATIONS
NUMBER OF PANELS: 108
PANEL POWER CLASSIFICATION (Pmax): 385W
MODULE EFFICIENCY (%): 19.3%
VOLTAGE AT MAXIMUM POWER POINT (Vmp): 36.93V
CURRENT AT MAXIMUM POWER POINT (Imp): 10.42A
OPEN CIRCUIT VOLTAGE (Voc): 45.03V
SHORT CIRCUIT CURRENT (Isc): 10.97A
LOAD RATIO: 1.22
SYSTEM POWER CLASSIFICATION (AC): 34.2 kW
SYSTEM POWER CLASSIFICATION (DC): 41.58 kW

3 SHOWER HOUSE ELECTRICAL ONE-LINE DIAGRAM
No Scale

ELECTRICAL SYMBOLS LIST

NOTE: NOT ALL SYMBOLS SHOWN MAY BE REQUIRED FOR THIS PROJECT

WIRING DEVICES

① JUNCTION BOX

EQUIPMENT WIRING

DISCONNECTING MEANS

WP WEATHERPROOF DISCONNECTING MEANS

DISTRIBUTION

SURFACE MOUNT PANEL

INVERTER

MISCELLANEOUS

EX EXISTING - TO REMAIN

EXR EXISTING - TO BE RELOCATED

ER EXISTING - TO BE REMOVED

CONDUIT

UNDER GROUND CONDUIT

POINT OF NEW CONNECTION

WP WEATHERPROOF

GENERAL NOTES:

- ELECTRICAL POWER OUTAGES, IF REQUIRED, SHOULD BE STRATEGICALLY MINIMIZED AND SCHEDULED CLOSELY WITH OWNER. CHANGEOVERS COULD BE REQUIRED TO OCCUR AT ANY HOUR.
- MAINTAIN ALL SERVICE CLEARANCES REQUIRED BY THE UTILITY AND NEC. COORDINATE INSTALLATION WITH UTILITY REQUIREMENTS PRIOR TO ROUGH-IN.
- INSTALL ALL CONDUCTORS AS PER MANUFACTURER'S RECOMMENDATIONS.

COPPER CONDUCTOR AND CONDUIT SIZING CHART - DC VOLTAGE

	CONDUCTORS (THWN-2)			CONDUIT		PARALLEL RUNS
	PHASE	NEUTRAL	GROUND	EMT	SCH 40	
A	(2) #10 AWG	-	#10 AWG	2"	3/4"	1
B	(2) #8 AWG	-	#10 AWG	2"	1	

COPPER CONDUCTOR AND CONDUIT SIZING CHART - AC VOLTAGE

	CONDUCTORS (THWN-2)			CONDUIT		PARALLEL RUNS
	PHASE	NEUTRAL	GROUND	EMT	SCH 40	
60/2	(2) #6 AWG	#6 AWG	#10 AWG	3/4"	3/4"	1
200/2	(2) 3/0 AWG	3/0 AWG	#6 AWG	2"	2"	1

SHIVEHATTERY ARCHITECTURE + ENGINEERING
316 Second Street SE Suite 500 | Cedar Rapids, Iowa 52401
319.364.0227 | fax 319.364.4251 | www.shive-hattery.com
Iowa | Illinois | Indiana | Missouri

JOHNSON COUNTY CONSERVATION BOARD

PROJECT NO.: 4217340

ISSUED FOR BID

08/01/2022

SHEET NAME: SHOWER HOUSE ELECTRICAL PV PLAN

SHEET NO.: Z1.04

GENERAL NOTES:

- A. REFER TO THE SEPTIC DRAWINGS FOR ADDITIONAL ELECTRICAL AND SITE COORDINATION.
- B. REFER TO SHEET MS1.09 FOR OVERALL SITE PLAN AND ARRAY LOCATION.
- C. MAINTAIN SERVICE CLEARANCE AROUND ALL MECHANICAL & ELECTRICAL EQUIPMENT. DO NOT ROUTE PIPING OR CONDUIT IN CLEARANCE SPACE.
- D. PROVIDE AND INSTALL ALL ELECTRICAL CONTROL AND DISCONNECTING MEANS FOR ALL PHOTOVOLTAIC EQUIPMENT. COORDINATE AND VERIFY REQUIREMENTS WITH SCHEDULES AND SHOP DRAWINGS.
- E. MAINTAIN ALL SERVICE CLEARANCES REQUIRED BY THE UTILITY AND NEC. COORDINATE INSTALLATION WITH OWNER REQUIREMENTS PRIOR TO ROUGH-IN.
- F. INSTALL CONDUCTORS AS PER MANUFACTURER'S RECOMMENDATIONS.
- G. GROUND PV SYSTEM PER NEC 690.

REFERENCED NOTES:

- (NOT ALL NOTES MAY BE APPLICABLE TO THIS SHEET)
1. PROVIDE (1) POWER OPTIMIZER PER EVERY (2) MODULES. THE INVERTER AND OPTIMIZERS SHALL BE EQUIPPED WITH A RAPID SHUTDOWN FEATURE THAT CONFORMS TO NEC 690.12. THE OUTPUT VOLTAGE OF THE POWER OPTIMIZERS ARE REGULATED BY THE INVERTER. THEY ARE NOT IMPACTED BY THE NUMBER OF MODULES IN THE STRING. THE CONTINUOUS CURRENT OF A SINGLE STRING IS EQUAL TO THE MAXIMUM OUTPUT CURRENT OF THE OPTIMIZER.
2. COORDINATE EXACT LOCATION OF UTILITY PV DISCONNECT WITH OWNER/AHJ PRIOR TO ROUGH-IN. AT LOCATION OF PV UTILITY DISCONNECT SHALL BE A PERMANENT PLAQUE READING "INTERCONNECTION DISCONNECT SWITCH". DISCONNECT SHALL NOT OPEN THE NEUTRAL. COORDINATE ALL UTILITY REQUIREMENTS WITH UTILITY PRIOR TO ROUGH-IN.
3. CONDUIT FROM AC COMBINER TO PV DISCONNECT SHALL BE BORED CONDUIT TYPE. BORING LOCATION SHOWN SCHEMATICALLY ONLY. COORDINATE EXACT LOCATION CLOSELY WITH EXISTING UNDERGROUND LINES AND SEPTIC SYSTEM. REFER TO ONE-LINE FOR ADDITIONAL DETAILS.
4. REFER TO PILE DRIVEN PV ARRAY DETAILS ON SHEET Z1.06 AND SPECIFICATIONS FOR ADDITIONAL DETAILS ON RACKING SYSTEM. ADJUST RACKING MATERIAL TO FIT PV MODULE SPACING AS INDICATED ON THIS DRAWING. MODULES SHALL BE RACKED WITH 30 DEGREE TILT.
5. PROVIDE STRINGS OF 12 PANELS WITH PARALLEL CONNECTIONS TO INVERTER. ROUTE ALL DC WIRING FROM SOLAR ARRAY PANELS ALONG RACKING AND DOWN POST TO INVERTER AT GROUND LEVEL.
6. CONDUIT FROM INVERTERS TO AC COMBINER SHALL BE TRENCHED CONDUIT TYPE.
7. ROUTE (2) #8 AWG WIRE & (1) #12 AWG GROUND IN A 1" CONDUIT FROM A 20A/1P BREAKER IN THE SEPTIC SYSTEM LOAD CENTER TO THE PV SYSTEM FOR CONVERTING ETHERNET TO FIBER. REFER TO THE UNISTRUT DETAIL (THIS SHEET) AND THE 'MS' DRAWINGS FOR ADDITIONAL INFORMATION.
8. CONTRACTOR SHALL ROUTE AN ADDITIONAL 1" CONDUIT AND PROVIDE FIBER OPTIC CABLE FOR THE PV WEB BASED MONITORING SYSTEM. STRUCTURED CABLING CONTRACTOR SHALL PROVIDE OS2 SINGLE MODE 2-STRAND FIBER MATCHING THE SAME MANUFACTURER AND CABLE TYPE BEING PROVIDED FOR THE LARGER 48-STRAND PULL. REFER TO THIS SHEET FOR ETHERNET TO FIBER CONVERSION. REFER TO SHEET MS1.10 FOR FIBER SPLICE LOCATION AND DETAILS.

ELECTRICAL SYMBOLS LIST

NOTE: NOT ALL SYMBOLS SHOWN MAY BE REQUIRED FOR THIS PROJECT

WIRING DEVICES

① JUNCTION BOX

DISCONNECTING MEANS

WP WEATHERPROOF DISCONNECTING MEANS

DISTRIBUTION

UNISTRUT MOUNT PANEL

INVERTER

EX EXISTING - TO REMAIN

EXR EXISTING - TO BE RELOCATED


ER EXISTING - TO BE REMOVED

CONDUIT


UNDER GROUND CONDUIT

POINT OF NEW CONNECTION


WP WEATHERPROOF

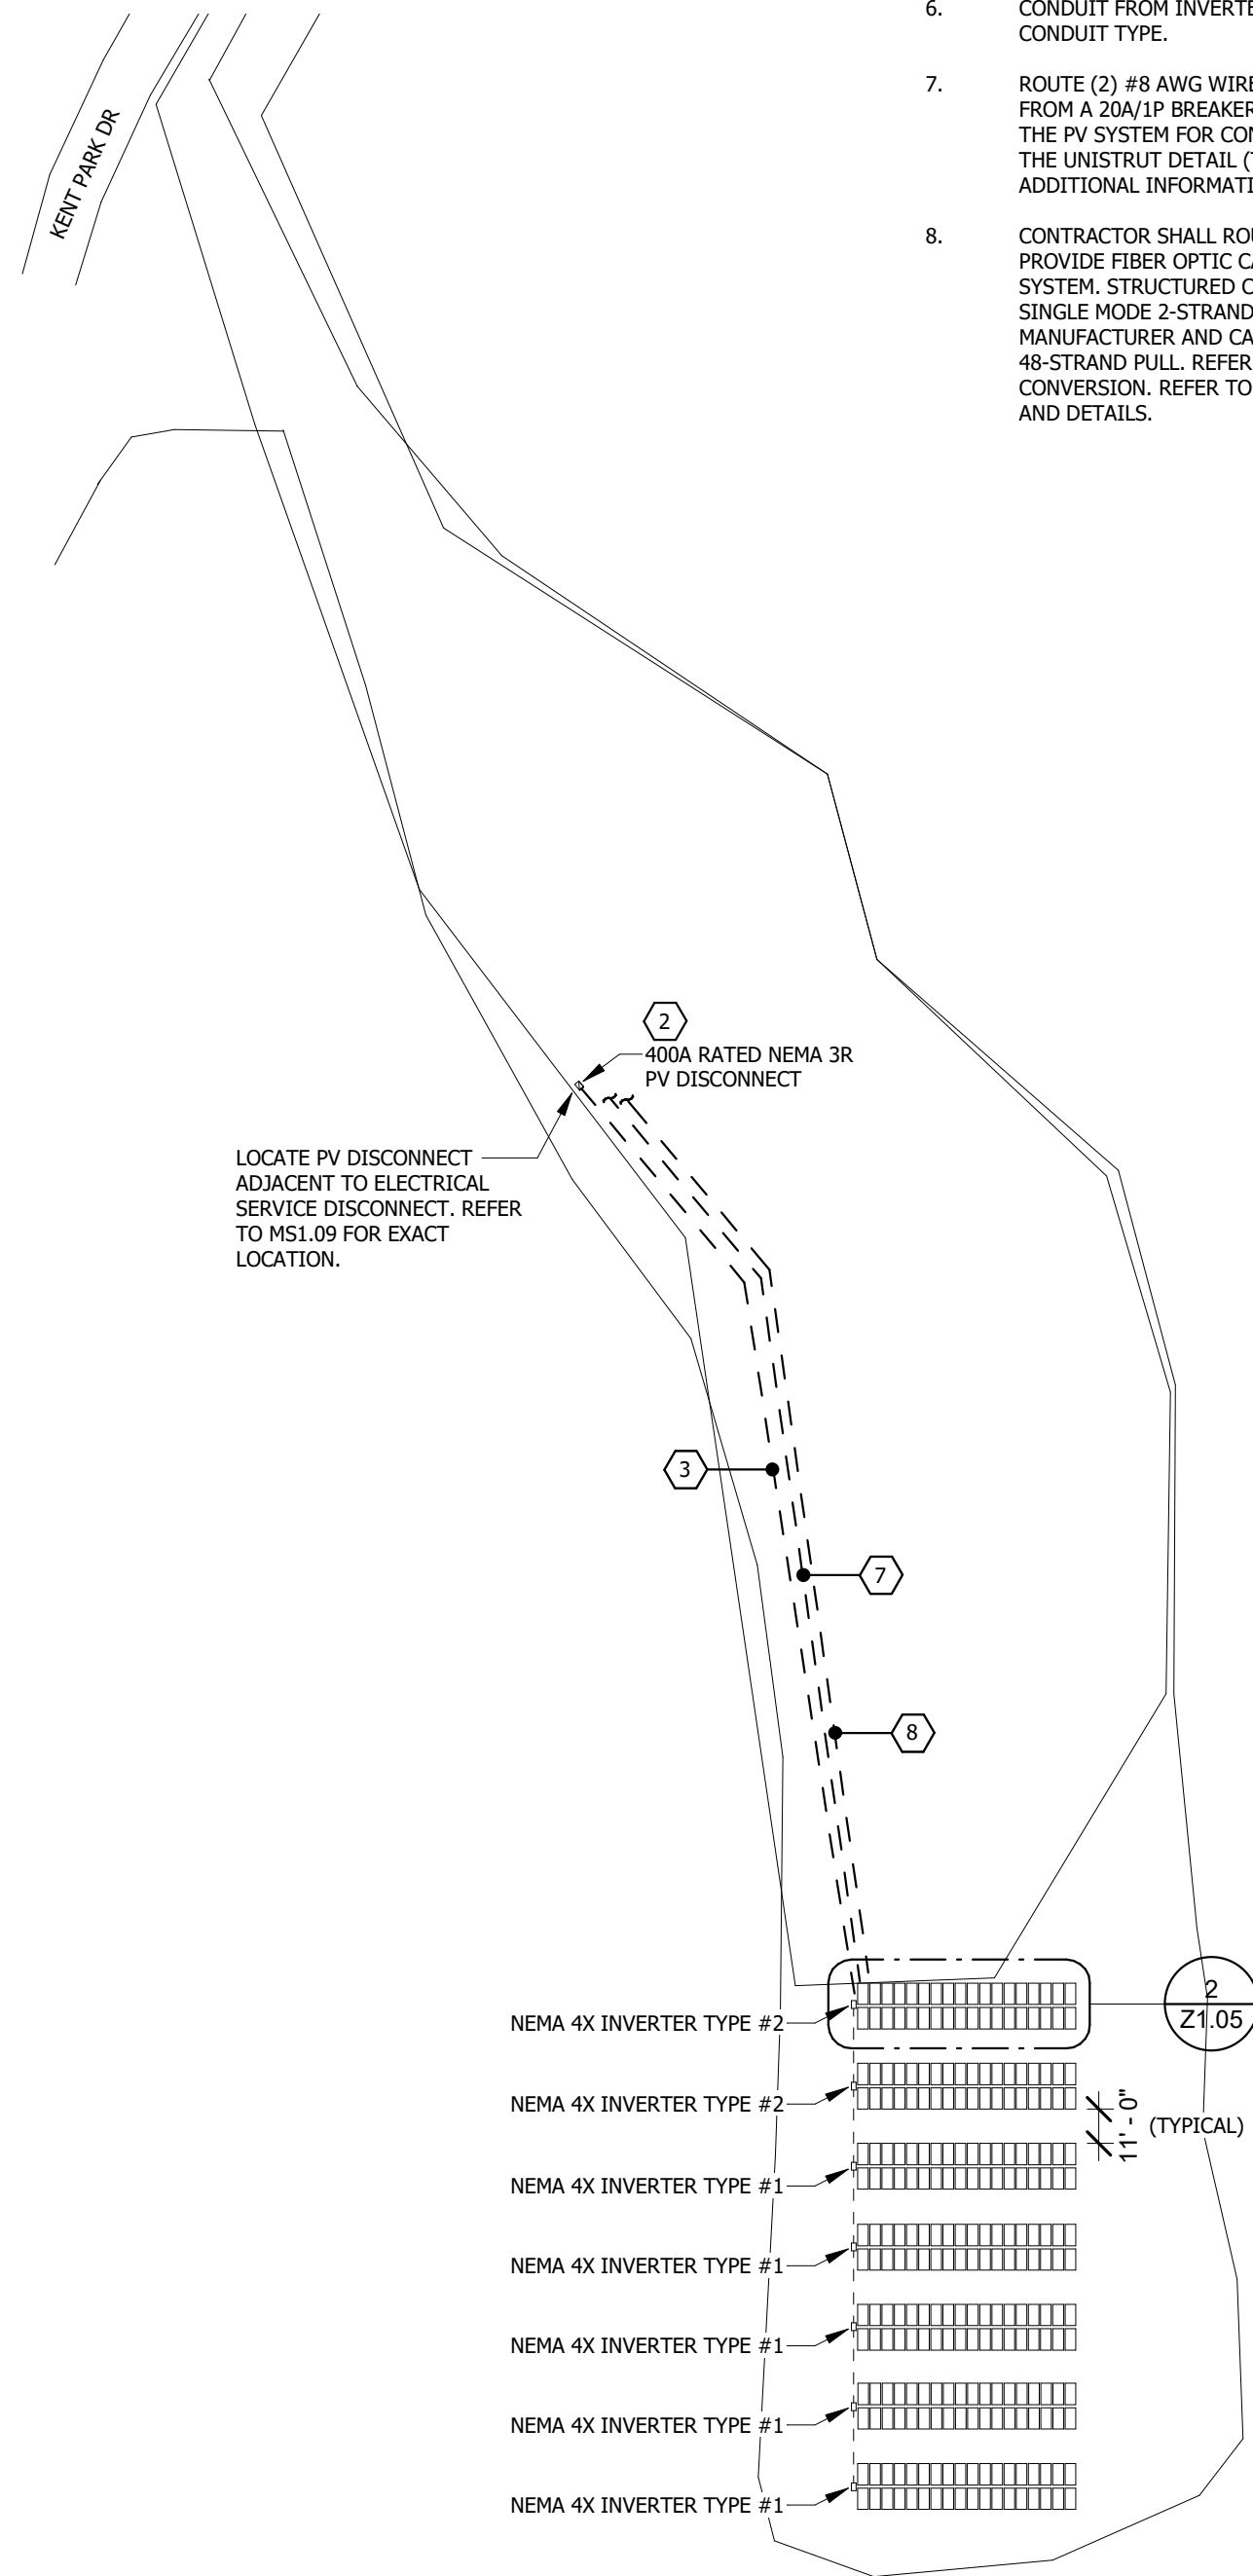


1 SEPTIC PV SITE PLAN - ELECTRICAL
1" = 60'-0"

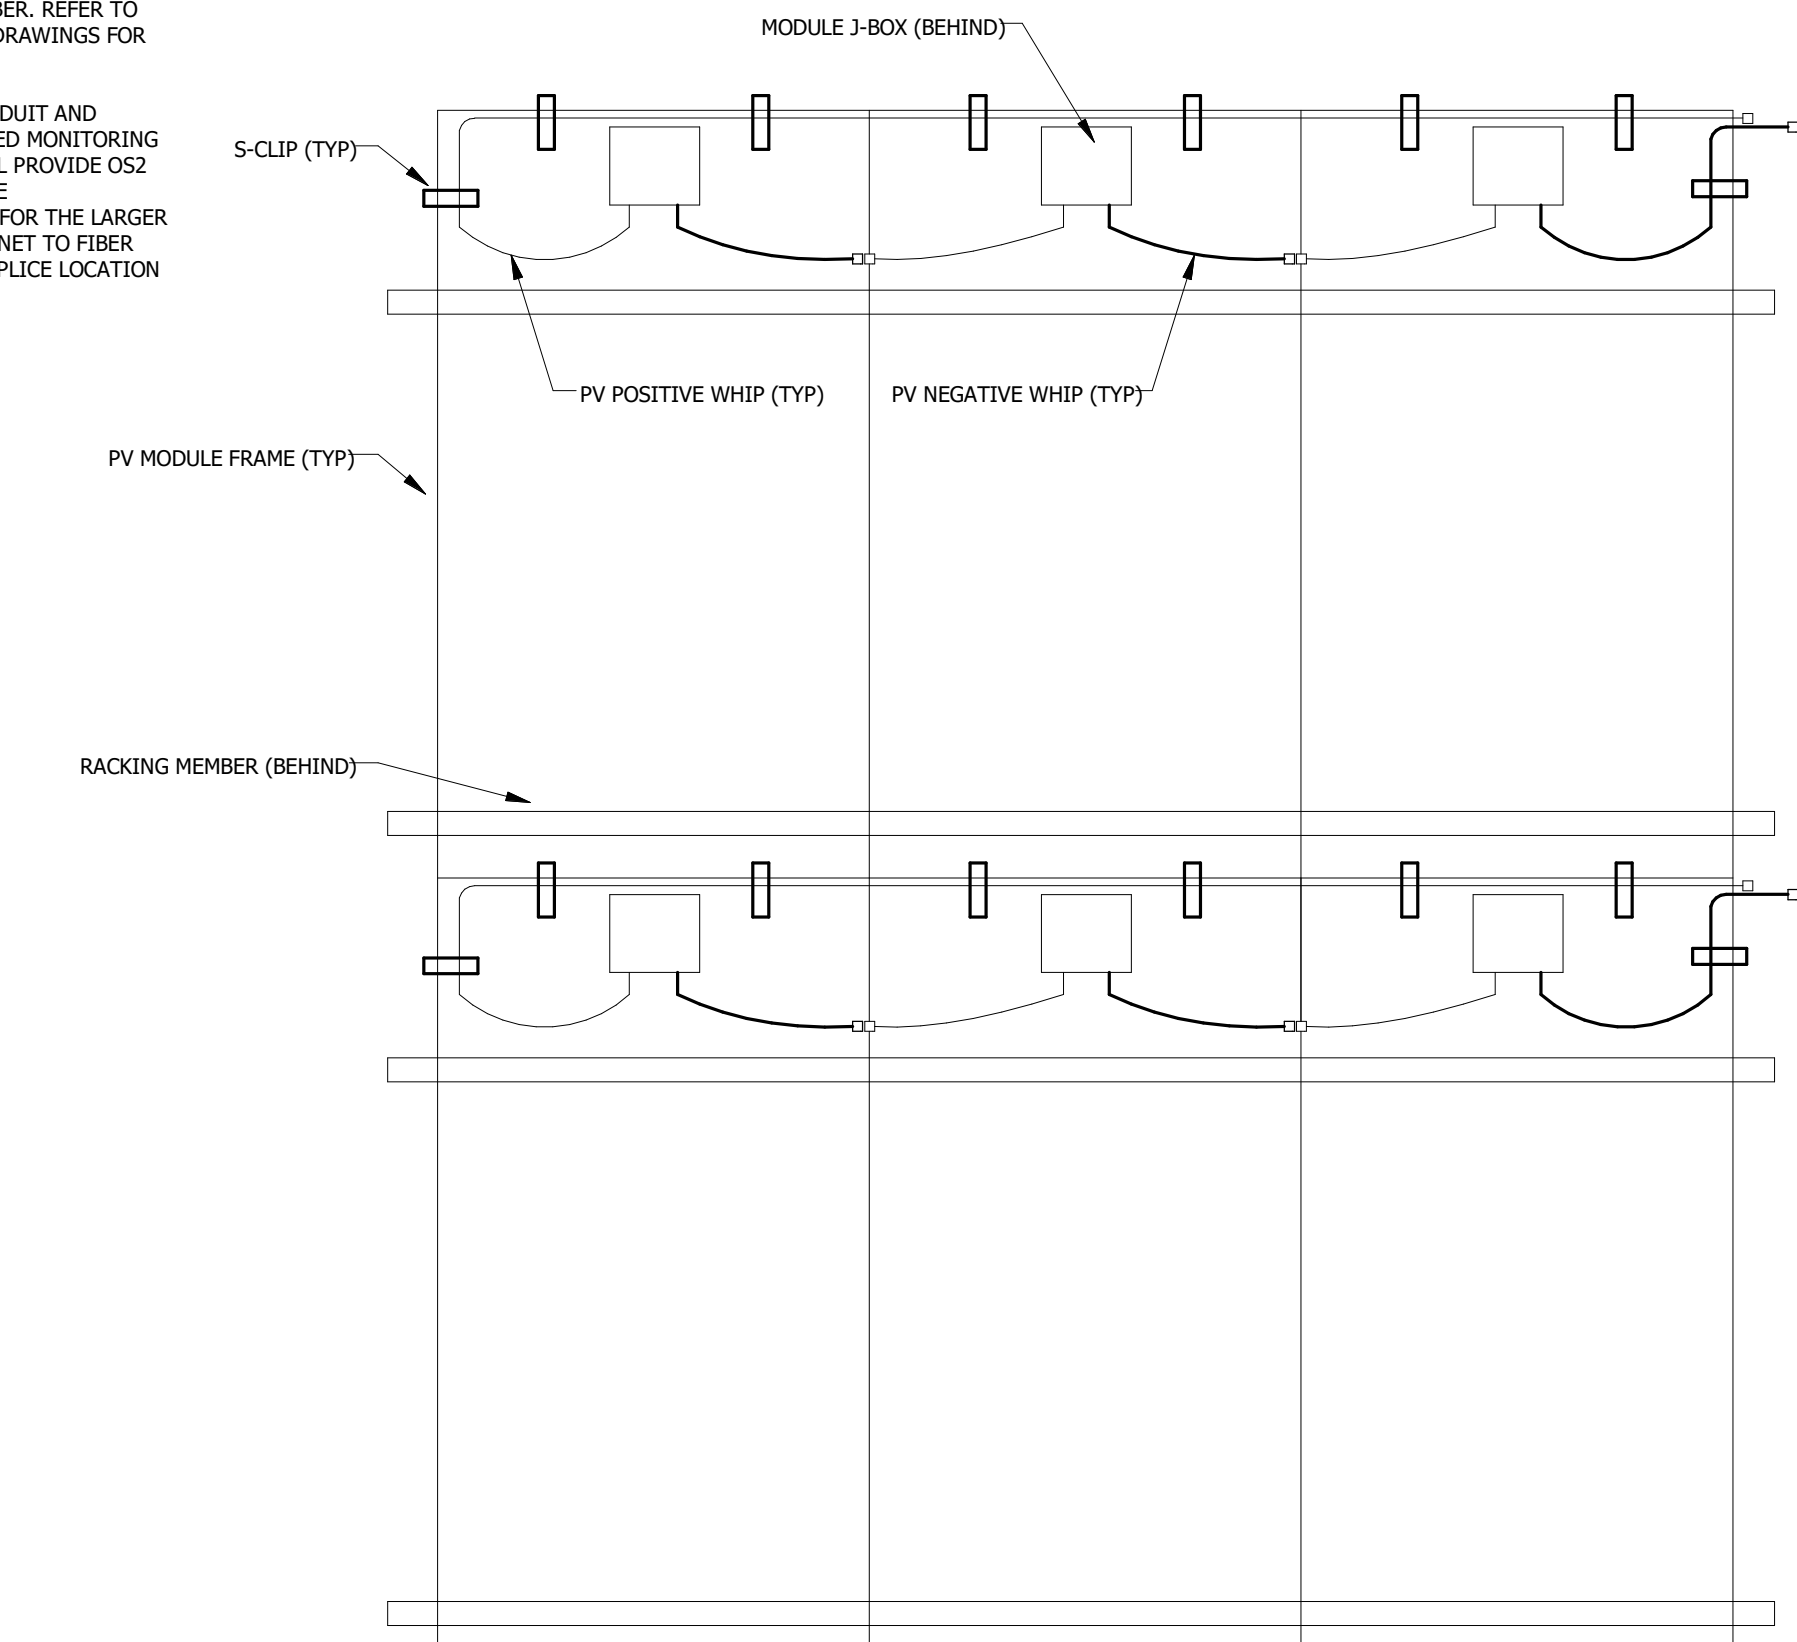

3 SEPTIC PV-WHIP MODULE
No Scale

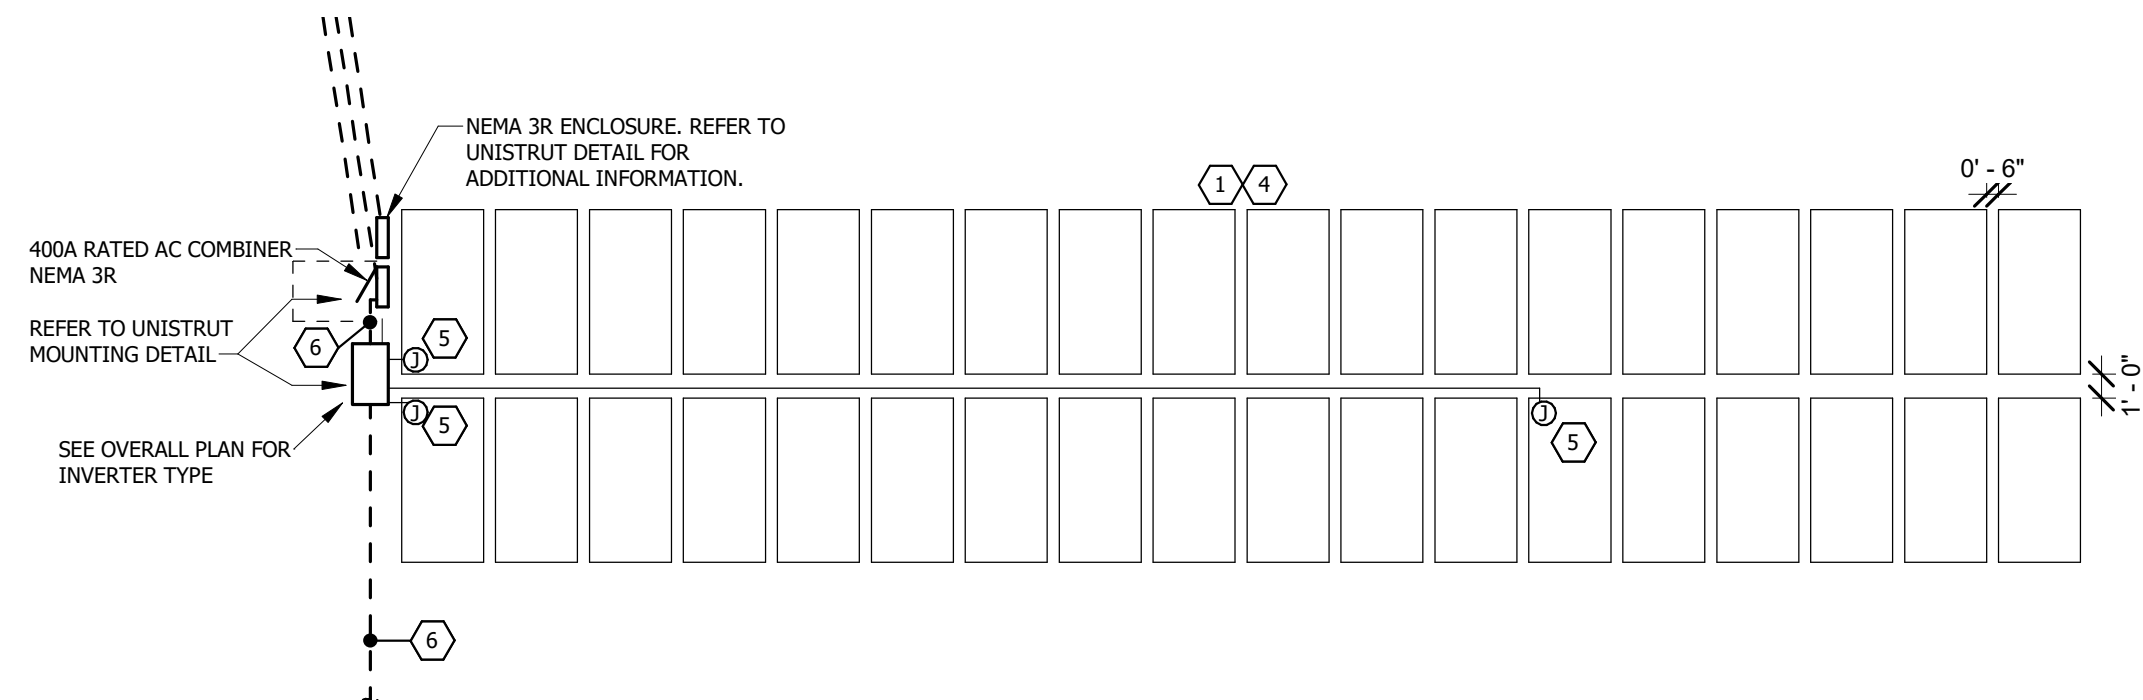

2 PV ARRAY RACKING (TYPICAL)
1/8" = 1'-0"

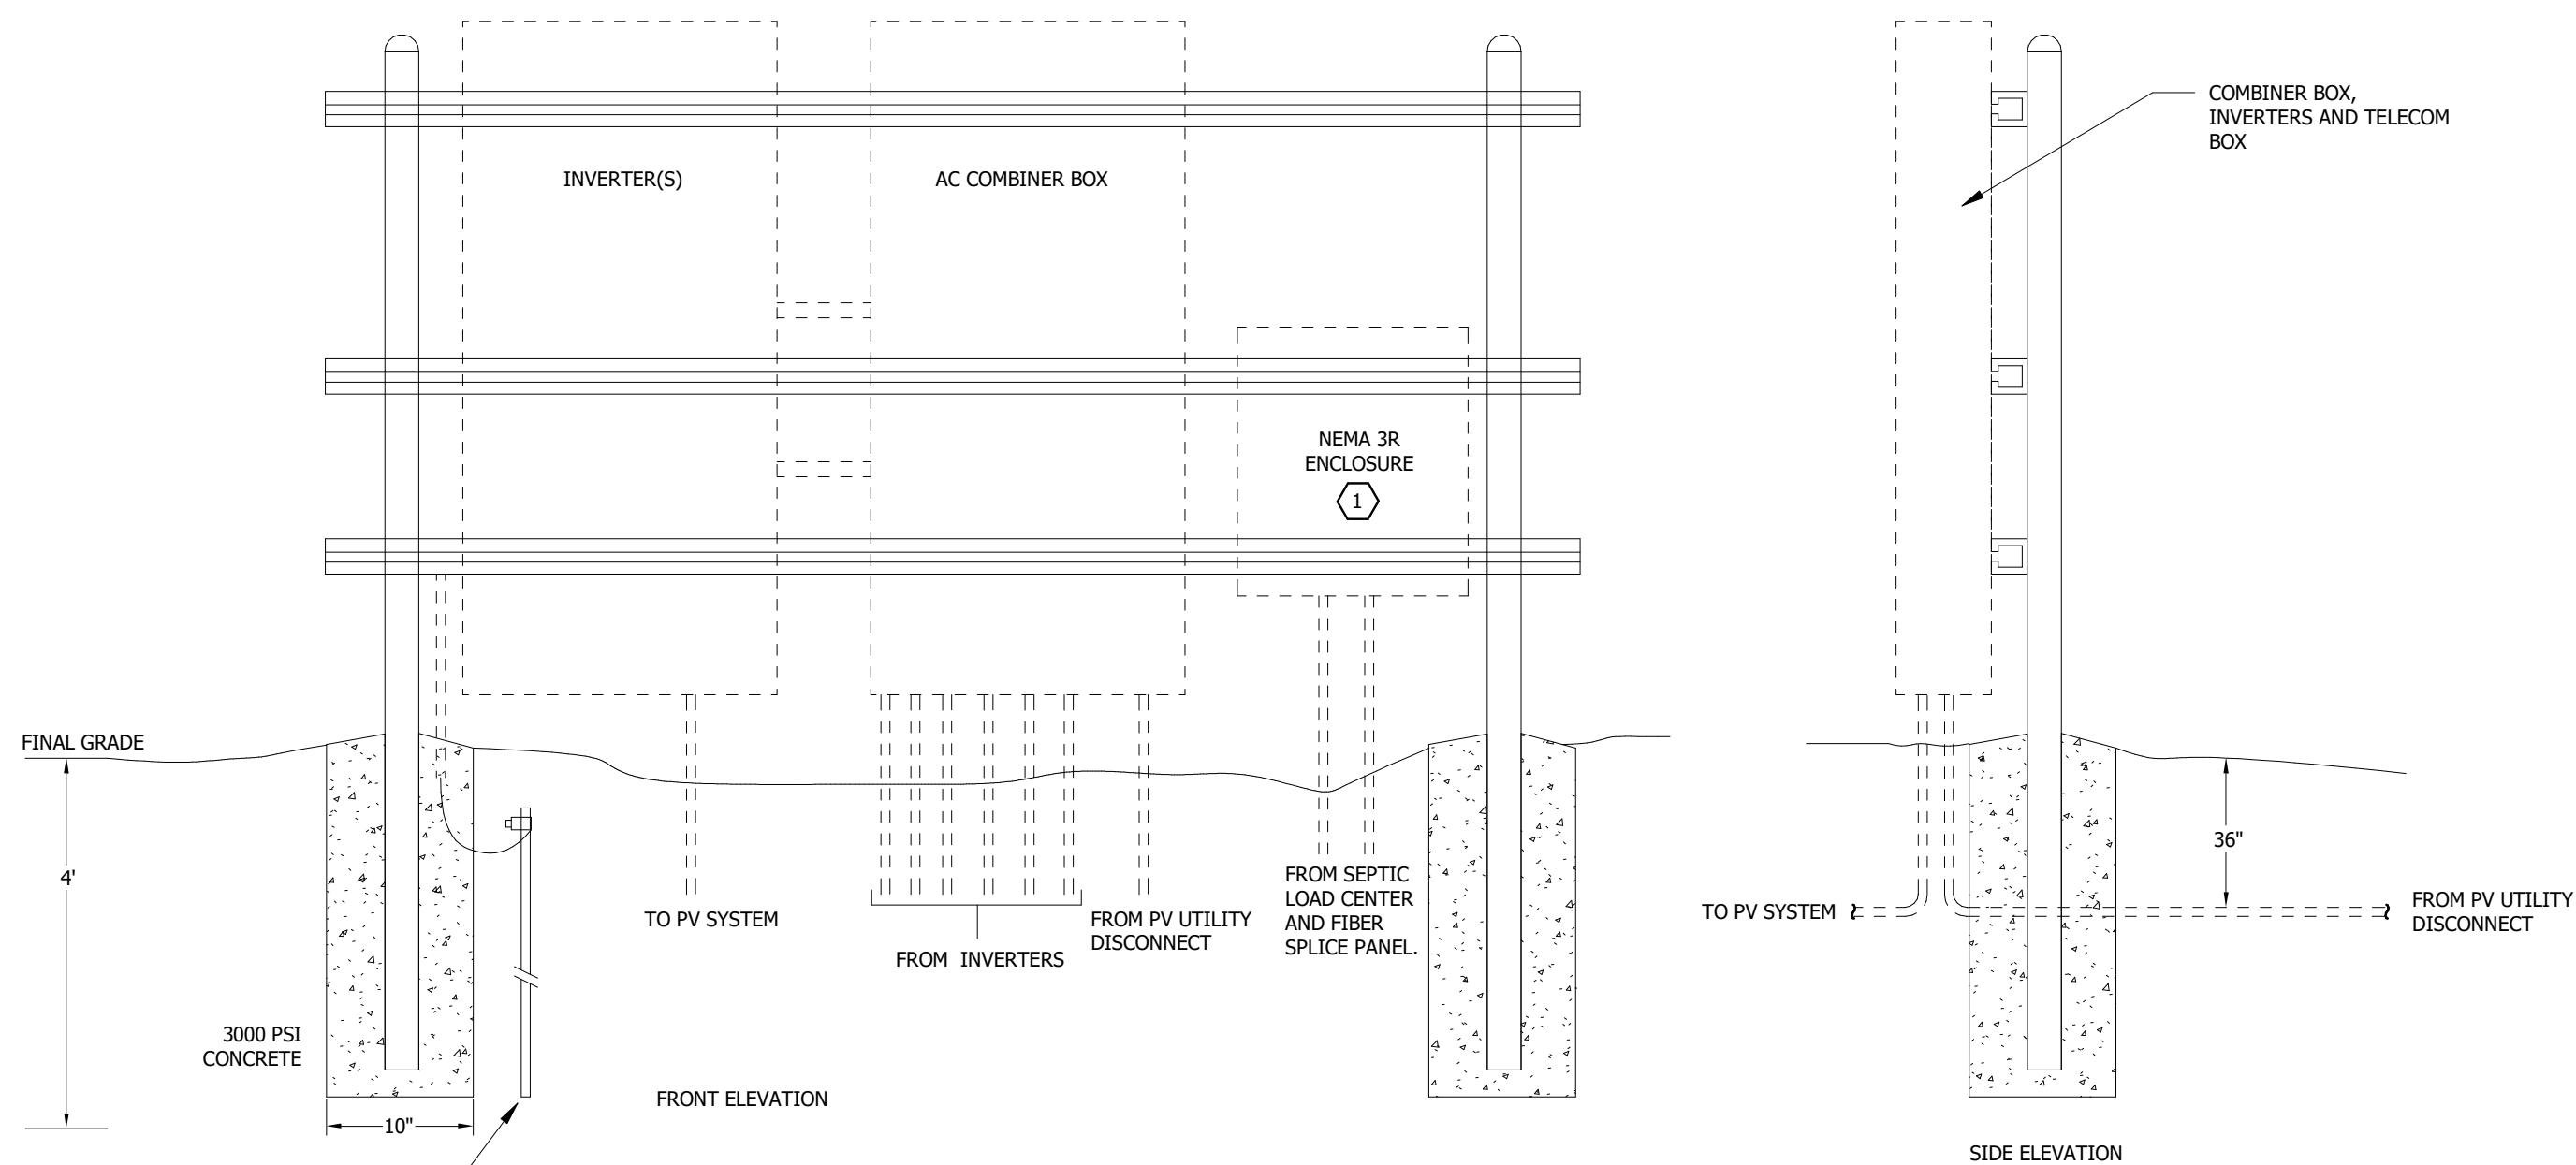


GENERAL NOTES:

- A. PROVIDE ALL NECESSARY COMPONENTS FOR A COMPLETE AND WORKING UNISTRUT SYSTEM.
- B. ALL GROUNDINGS SHALL FOR PV SHALL MEET NEC 690. REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION.

REFERENCE NOTES:

1. CONTRACTOR SHALL PROVIDE A 12"x10"x5" NEMA 3R ENCLOSURE (LCOM NB121005-10F OR SIMILAR) WITH A 120V POWER CONNECTION FOR INTEGRAL DUPLEX RECEPTACLE AND THERMOSTAT CONTROLLED COOLING SYSTEM FOR HOUSING AN ETHERNET TO FIBER CONVERTER. CONTRACTOR SHALL PROVIDE A TEMPERATURE HARDENED COPPER TO FIBER CONVERTER EQUIVALENT TO BLACK BOX LMC270A-SM-20K-SC AND POWER SUPPLY.

4 UNISTRUT TERMINATION & CABINET MOUNT DETAIL
No Scale

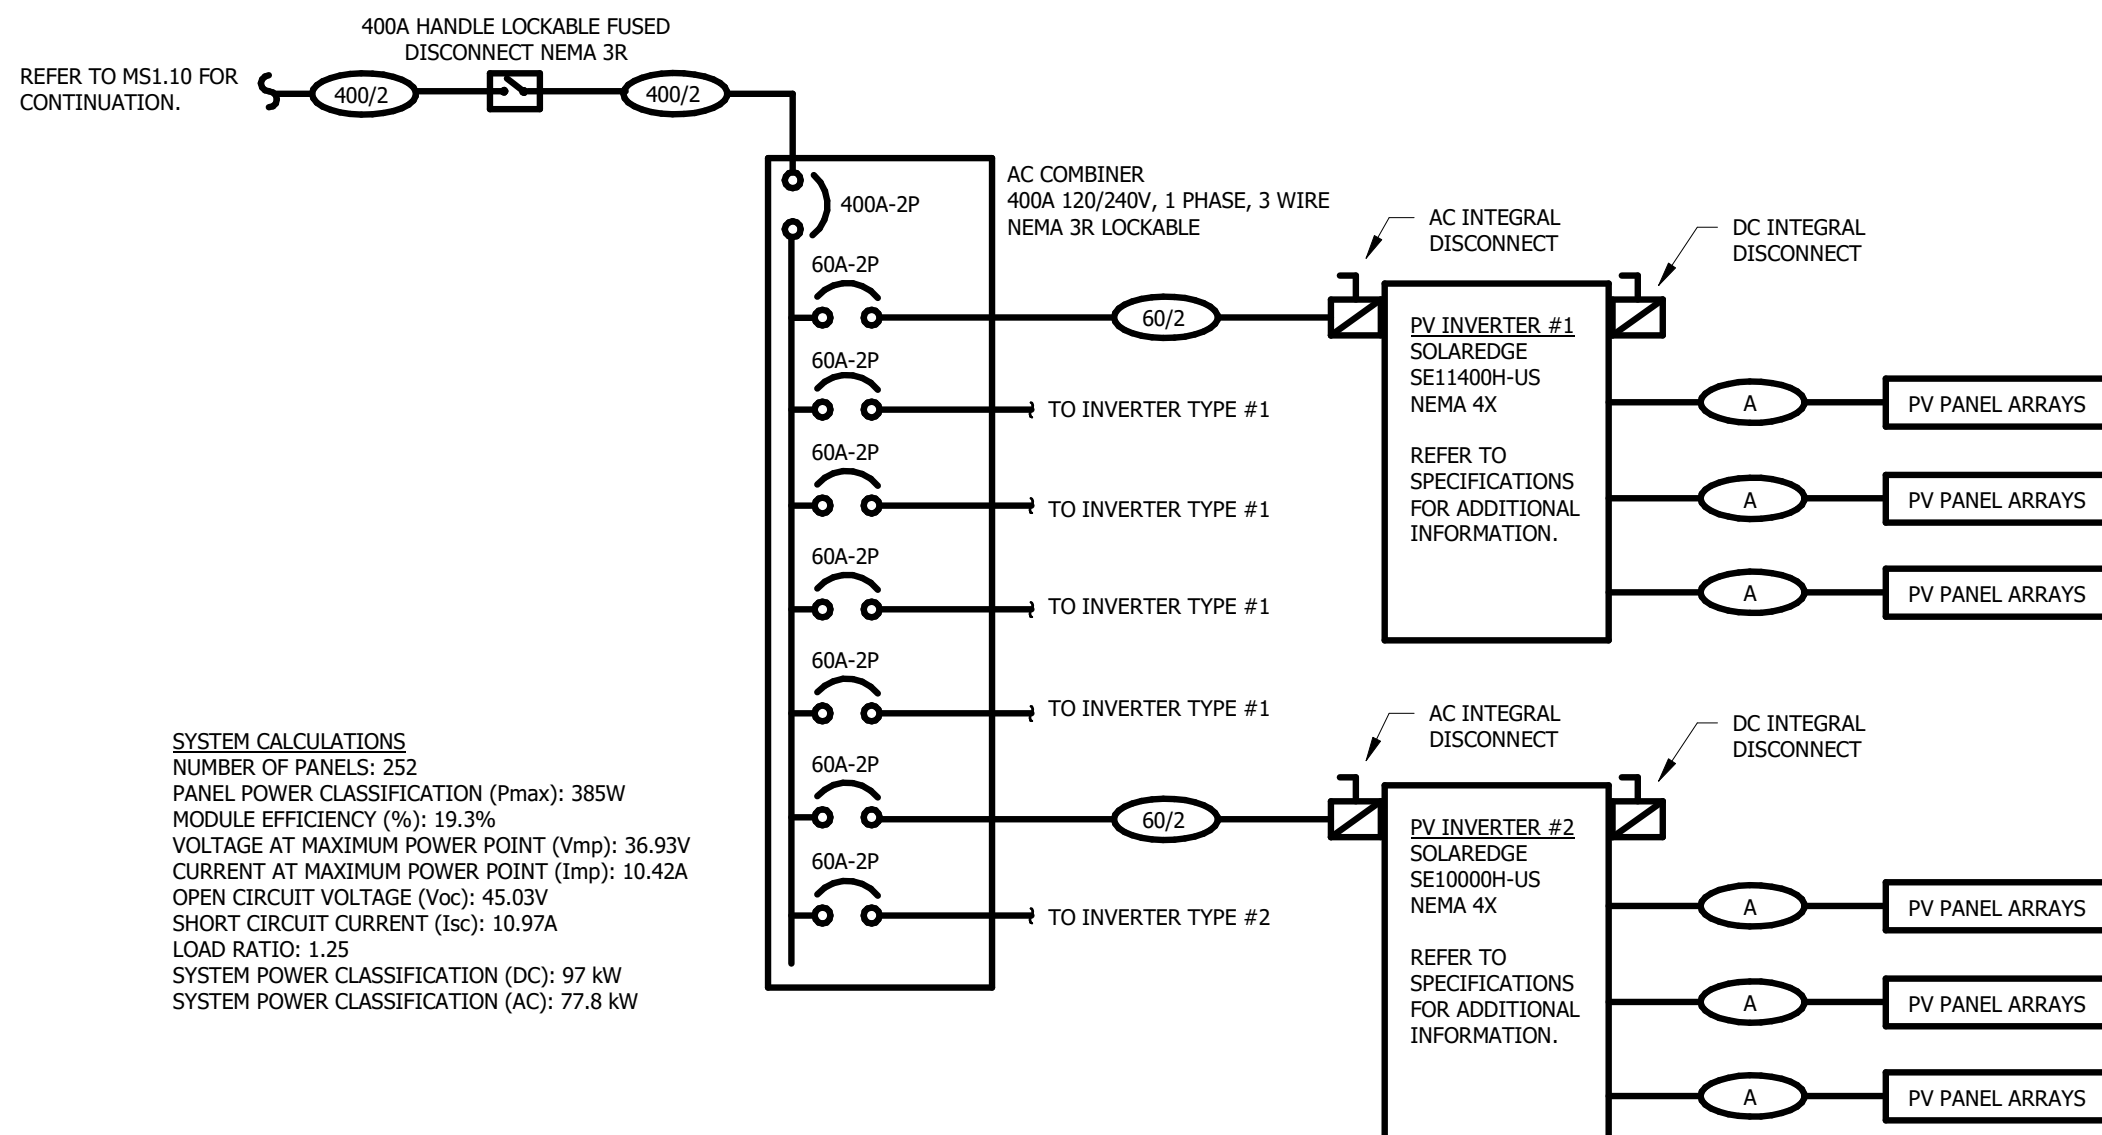

5 SEPTIC ELECTRICAL ONE-LINE DIAGRAM
No Scale

COPPER CONDUCTOR AND CONDUIT SIZING CHART - DC VOLTAGE

	CONDUCTORS (THWN-2)			CONDUIT		PARALLEL RUNS
	PHASE	NEUTRAL	GROUND	EMT	SCH 40	
A	(2) #10 AWG	-	#10 AWG	2"	2"	1

COPPER CONDUCTOR AND CONDUIT SIZING CHART - AC VOLTAGE

	CONDUCTORS (THWN-2)			CONDUIT		PARALLEL RUNS
	PHASE	NEUTRAL	GROUND	EMT	SCH 40	
60/2	(2) #6 AWG	#6 AWG	#10 AWG	3/4"	3/4"	1
400/2	(2) 3/0 AWG	3/0 AWG	#3 AWG	2"	2"	2

GENERAL NOTES:



- A. ELECTRICAL POWER OUTAGES, IF REQUIRED, SHOULD BE STRATEGICALLY MINIMIZED AND SCHEDULED CLOSELY WITH OWNER. CHANGEOVERS COULD BE REQUIRED TO OCCUR AT ANY HOUR.
- B. MAINTAIN ALL SERVICE CLEARANCES REQUIRED BY THE UTILITY AND NEC. COORDINATE INSTALLATION WITH UTILITY REQUIREMENTS PRIOR TO ROUGH-IN.
- C. INSTALL ALL CONDUCTORS AS PER MANUFACTURER'S RECOMMENDATIONS.

214 EAST FOURTH
WATERLOO, IOWA 319 235 0650 TEL
235 0644 FAX




130 EAST 3RD STREET STE.
DES MOINES, IOWA 515 251 7280 TEL
251 7349 FAX

118 EAST COLLEGE ST. STE.
IOWA CITY, IOWA 319 248 4600 TEL
248 0141 FAX

MODUS-ENG.COM

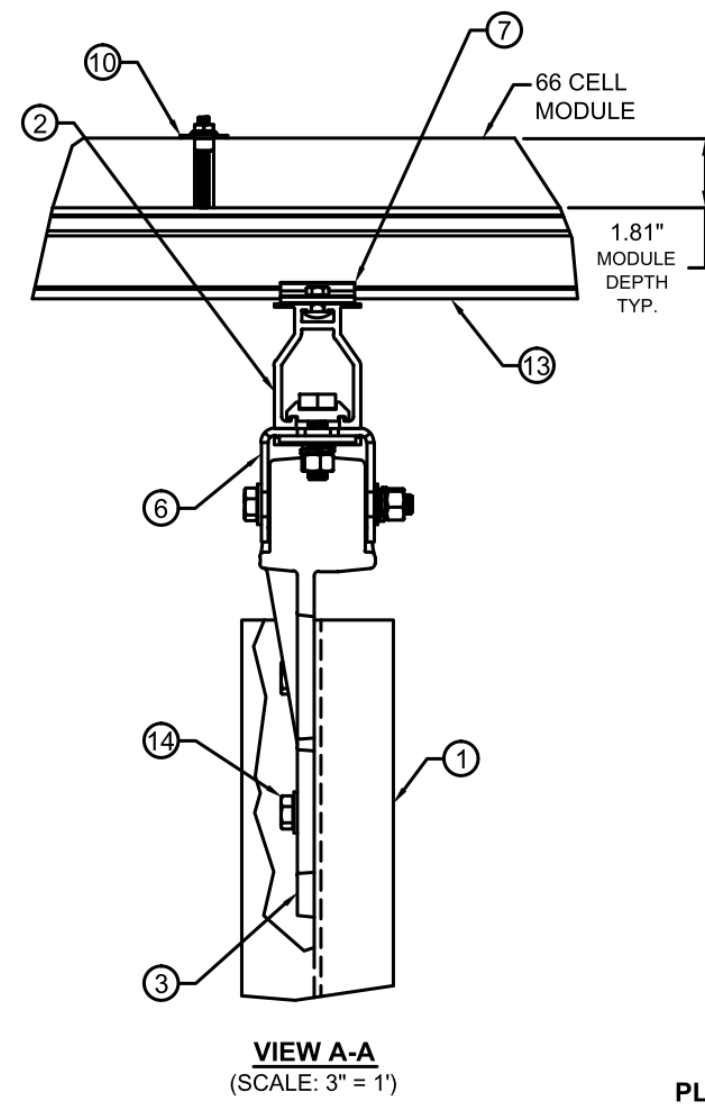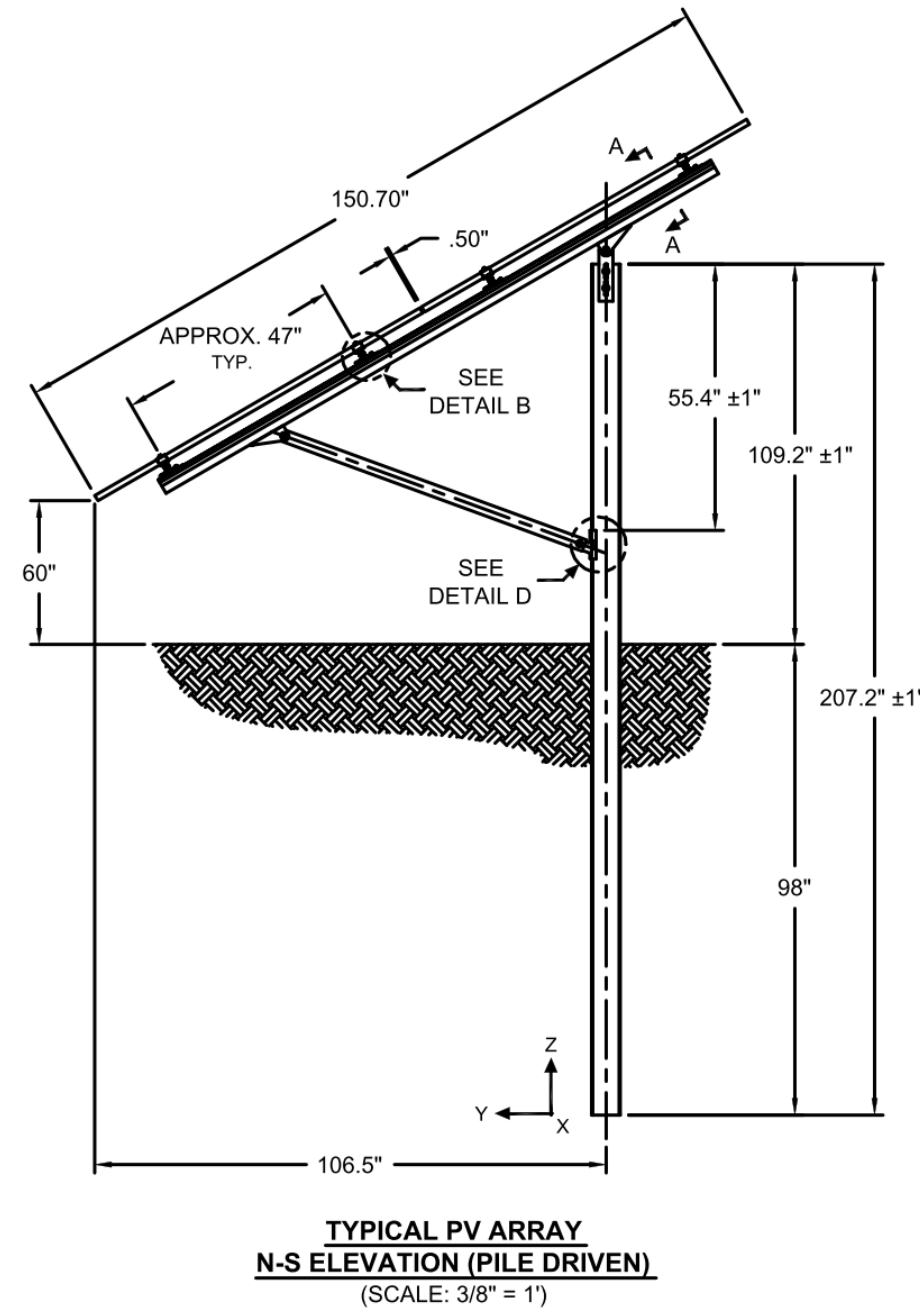

PLEASE NOTE:
VIEW A-A SHOWN @ 0° FOR
RACKING CLARITY AND
DETAILS A-D ARE SHOWN @ 30°

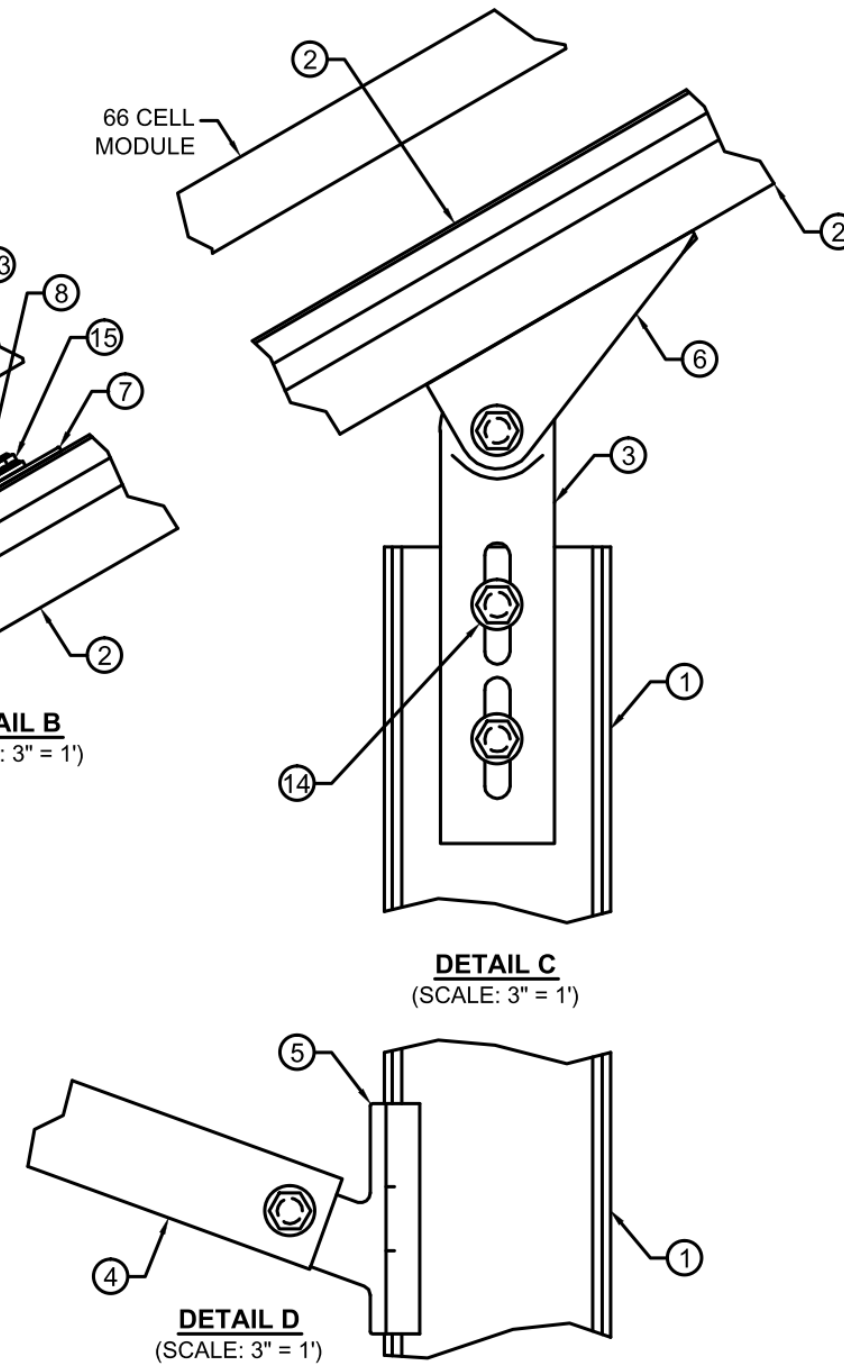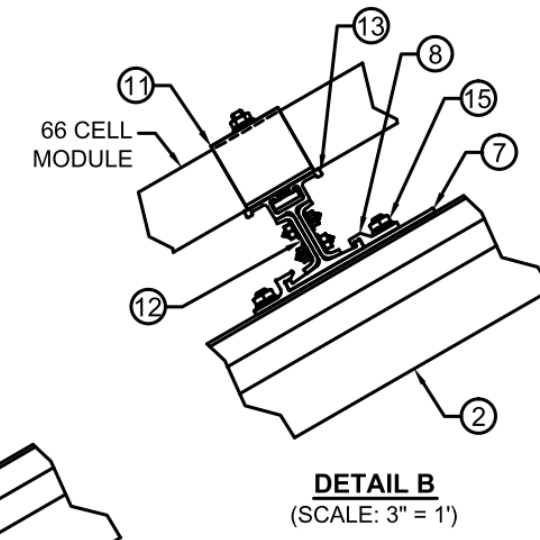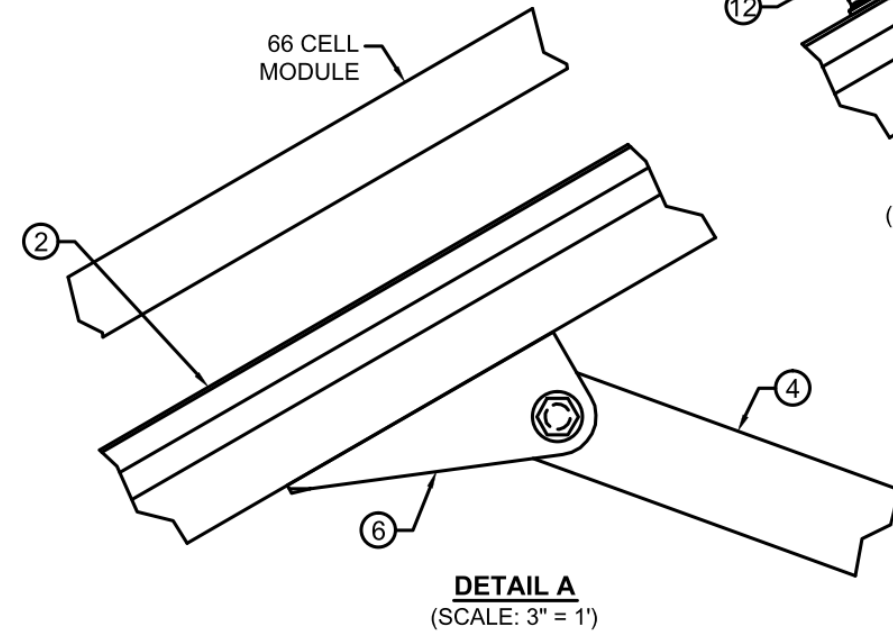

BILL OF MATERIALS			
SYM	DESCRIPTION	MATERIAL	FINISH
1	I-BEAM	50ksi STEEL	HDG
2	STRONGBACK	ALUMINUM	N/A
3	STRONGBACK ATTACHMENT	A36 STEEL	HDG
4	STRUT	ALUMINUM	N/A
5	STRUT ARM ATTACHMENT	A36 STEEL	HDG
6	SLIDE ATTACHMENT	ALUMINUM	N/A
7	RAIL BRACKET	ALUMINUM	N/A
8	RAIL CLAMP	ALUMINUM	N/A
10	MODULE MID-CLAMP ASSY.	STAINLESS	N/A
11	MODULE END-CLAMP ASSY.	STAINLESS	N/A
12	SPLICE PLATE	ALUMINUM	N/A
13	UD RAIL	ALUMINUM	N/A
14	1/2" x 13x1-1/2"	GRD 5	HDG
15	5/16" HARDWARE	GRD 5	HDG

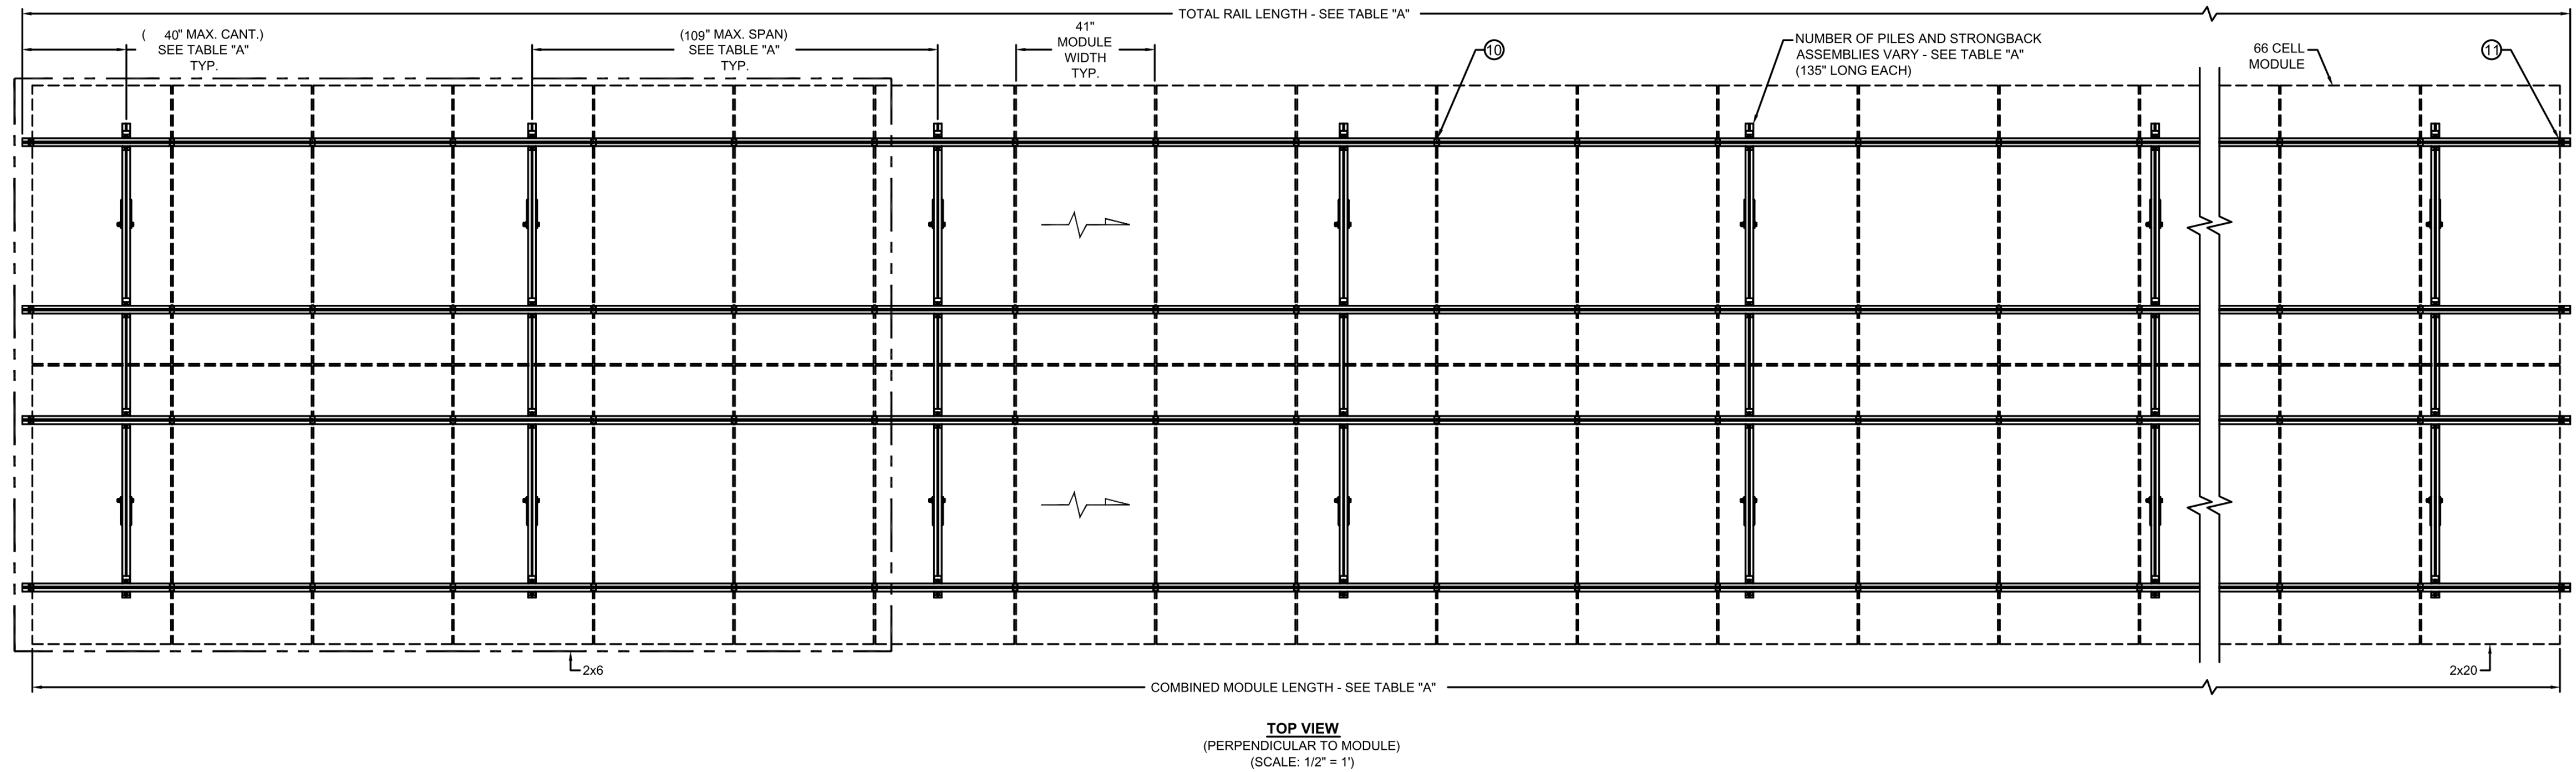


TABLE A - RAIL LENGTHS, MAXIMUM SPAN AND CANTILEVER					DRIVEN PILE	
TABLE	COMBINED MODULE LENGTH	TOTAL RAIL LENGTH	QTY. OF 166" RAIL	QTY. OF 246" RAIL	SPAN	CANTILEVER
2x6	236.5"	242.5"	-	4	72"	13.25"
2x7	276"	282"	8	-	66"	9"
2x8	315.5"	321.5"	8	-	70"	20.75"
2x9	355"	361"	4	4	66"	15.5"
2x10	394.5"	400.5"	4	4	72"	20.25"
2x11	434"	440"	-	8	66"	22"
2x12	473.5"	479.5"	-	8	72"	23.75"
2x13	513"	519"	8	4	70"	14.5"

NOTE: CONTRACTOR SHALL ADJUST DIMENSIONS OF RACKING SYSTEM TO FIT PV SPACING AS INDICATED IN DETAIL 2 ON DRAWING Z1.05 AND EQUIPMENT FOR THE APPROVED PV SYSTEM.

TABLE A - RAIL LENGTHS, MAXIMUM SPAN AND CANTILEVER					DRIVEN PILE	
TABLE	COMBINED MODULE LENGTH	TOTAL RAIL LENGTH	QTY. OF 166" RAIL	QTY. OF 246" RAIL	SPAN	CANTILEVER
2x14	552.5"	558.5"	8	4	72"	27.25"
2x15	592"	598"	4	8	72"	11"
2x16	631.5"	637.5"	4	8	66"	21.75"
2x17	671"	677"	-	12	72"	14.5"
2x18	710.5"	716.5"	12	4	68"	18.25"
2x19	750"	756"	8	8	72"	18"
2x20	789.5"	795.5"	8	8	68"	1.75"



214 EAST FOURTH
WATERLOO, IOWA 319 235 0650 TEL
235 0644 FAX
130 EAST 3RD STREET STE.
DES MOINES, IOWA 515 251 7280 TEL
251 7349 FAX
118 EAST COLLEGE ST. STE.
IOWA CITY, IOWA 319 248 4600 TEL
248 0141 FAX
MODUS-ENG.COM

SHIVEHATTERY
ARCHITECTURE+ENGINEERING

316 Second Street SE Suite 500 | Cedar Rapids, Iowa 52401
319.364.0227 | fax 319.364.4251 | www.shive-hattery.com
Iowa | Illinois | Indiana | Missouri

JOHNSON COUNTY CONSERVATION BOARD

PROJECT NO.: 4217340

ISSUED FOR BID

08/01/2022

SHEET NAME: SEPTIC ELECTRICAL PV DETAILS

SHEET NO.: Z1.06